



January 23, 2025

The Honorable Chair and Members
of the Hawai'i Public Utilities Commission
Kekuanao'a Building, First Floor
465 South King Street
Honolulu, Hawai'i 96813

Dear Commissioners:

Subject: Docket No. 2011-0206
Reliability Standards Working Group
Monthly Report

In accordance with Ordering Paragraph 3 of Order No. 30371, filed May 4, 2012 in the subject proceeding, enclosed as Exhibit A is Hawaiian Electric's¹ monthly report for December 2024 on: (1) system frequency control performance during month; (2) significant system events during month; and (3) curtailment of non-dispatchable renewable resources.

Any party to this proceeding may obtain an electronic copy of this report by emailing Michael Chu at michael.chu@hawaiianelectric.com.

Sincerely,

/s/ Kevin M. Katsura


Kevin M. Katsura
Director, Regulatory Non-Rate Proceedings

Enclosures


c: Service List

¹ Hawaiian Electric Company, Inc., Maui Electric Company, Limited, and Hawai'i Electric Light Company, Inc. are each doing business as "Hawaiian Electric" and have jointly registered "Hawaiian Electric" as a trade name with the State of Hawai'i Department of Commerce and Consumer Affairs, as evidenced by Certificate of Registration No. 4235929, dated December 20, 2019.


Frequency Distribution Plot - Hawaiian Electric December 2024

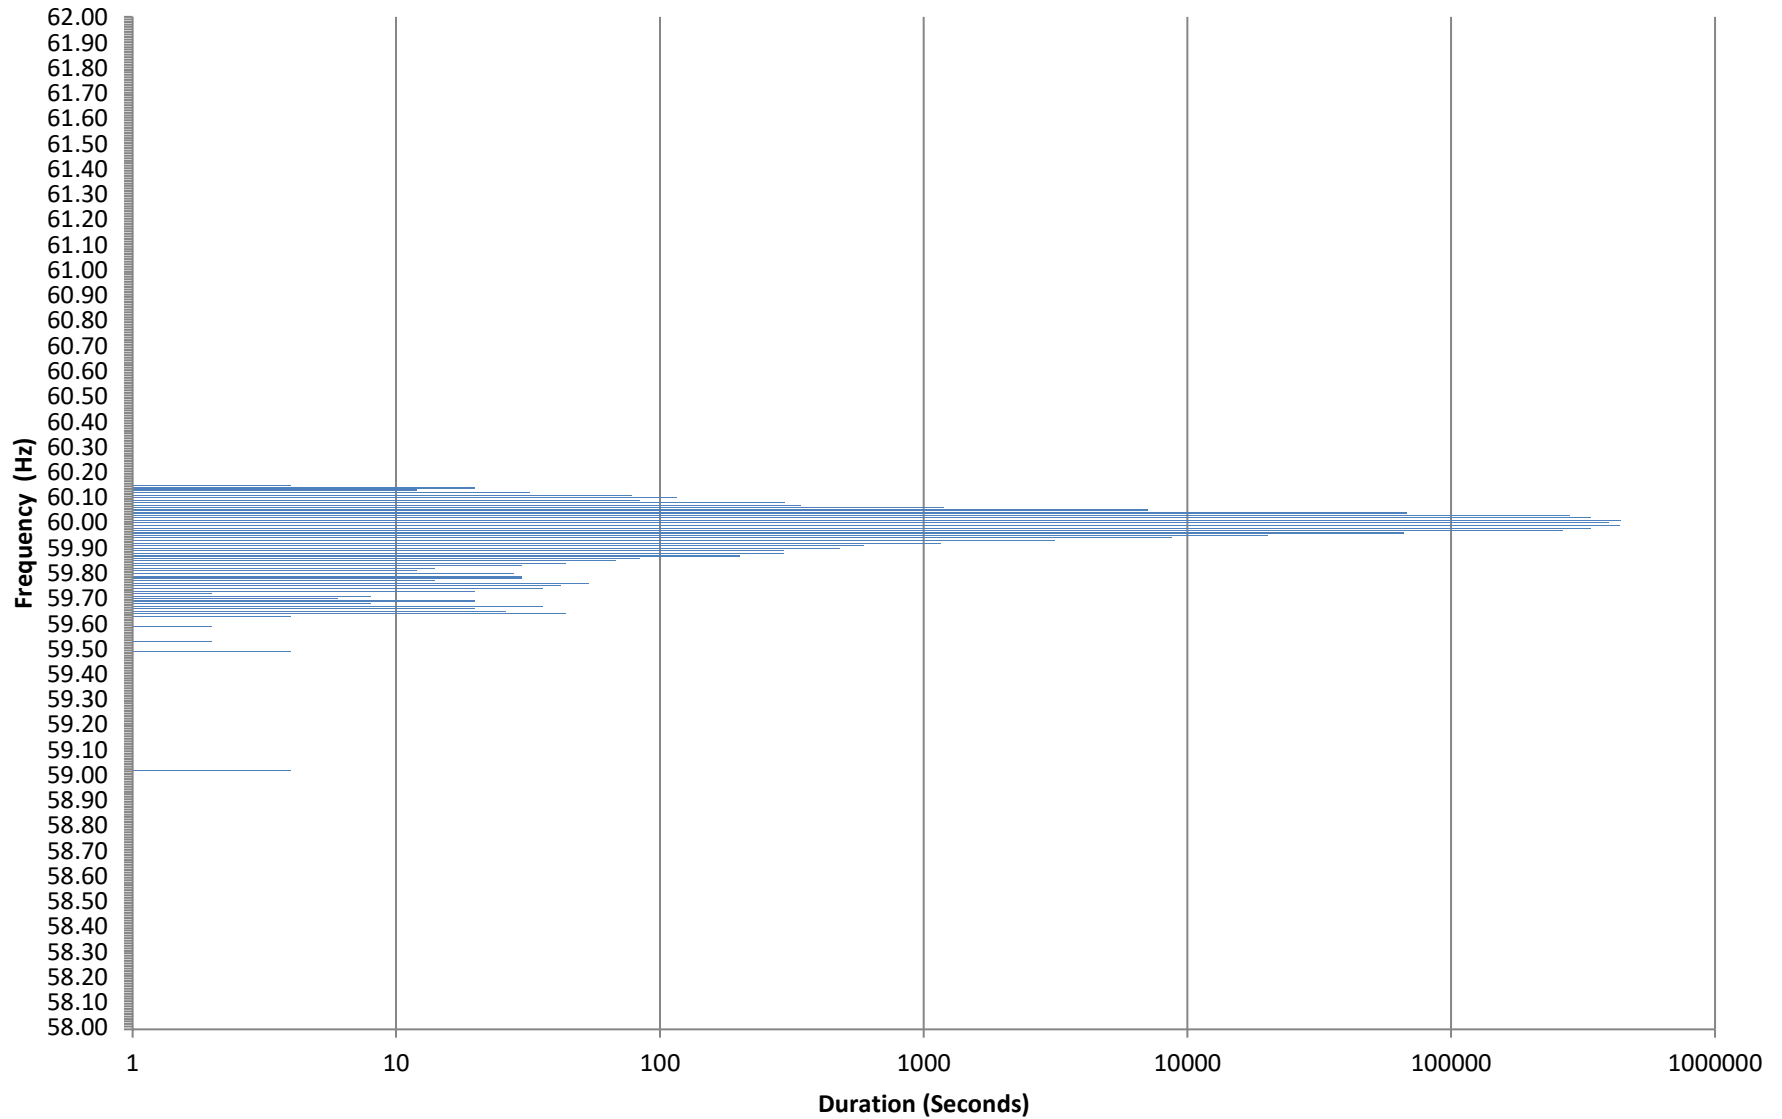

Frequency Distribution Plot - Hawai'i Island December 2024

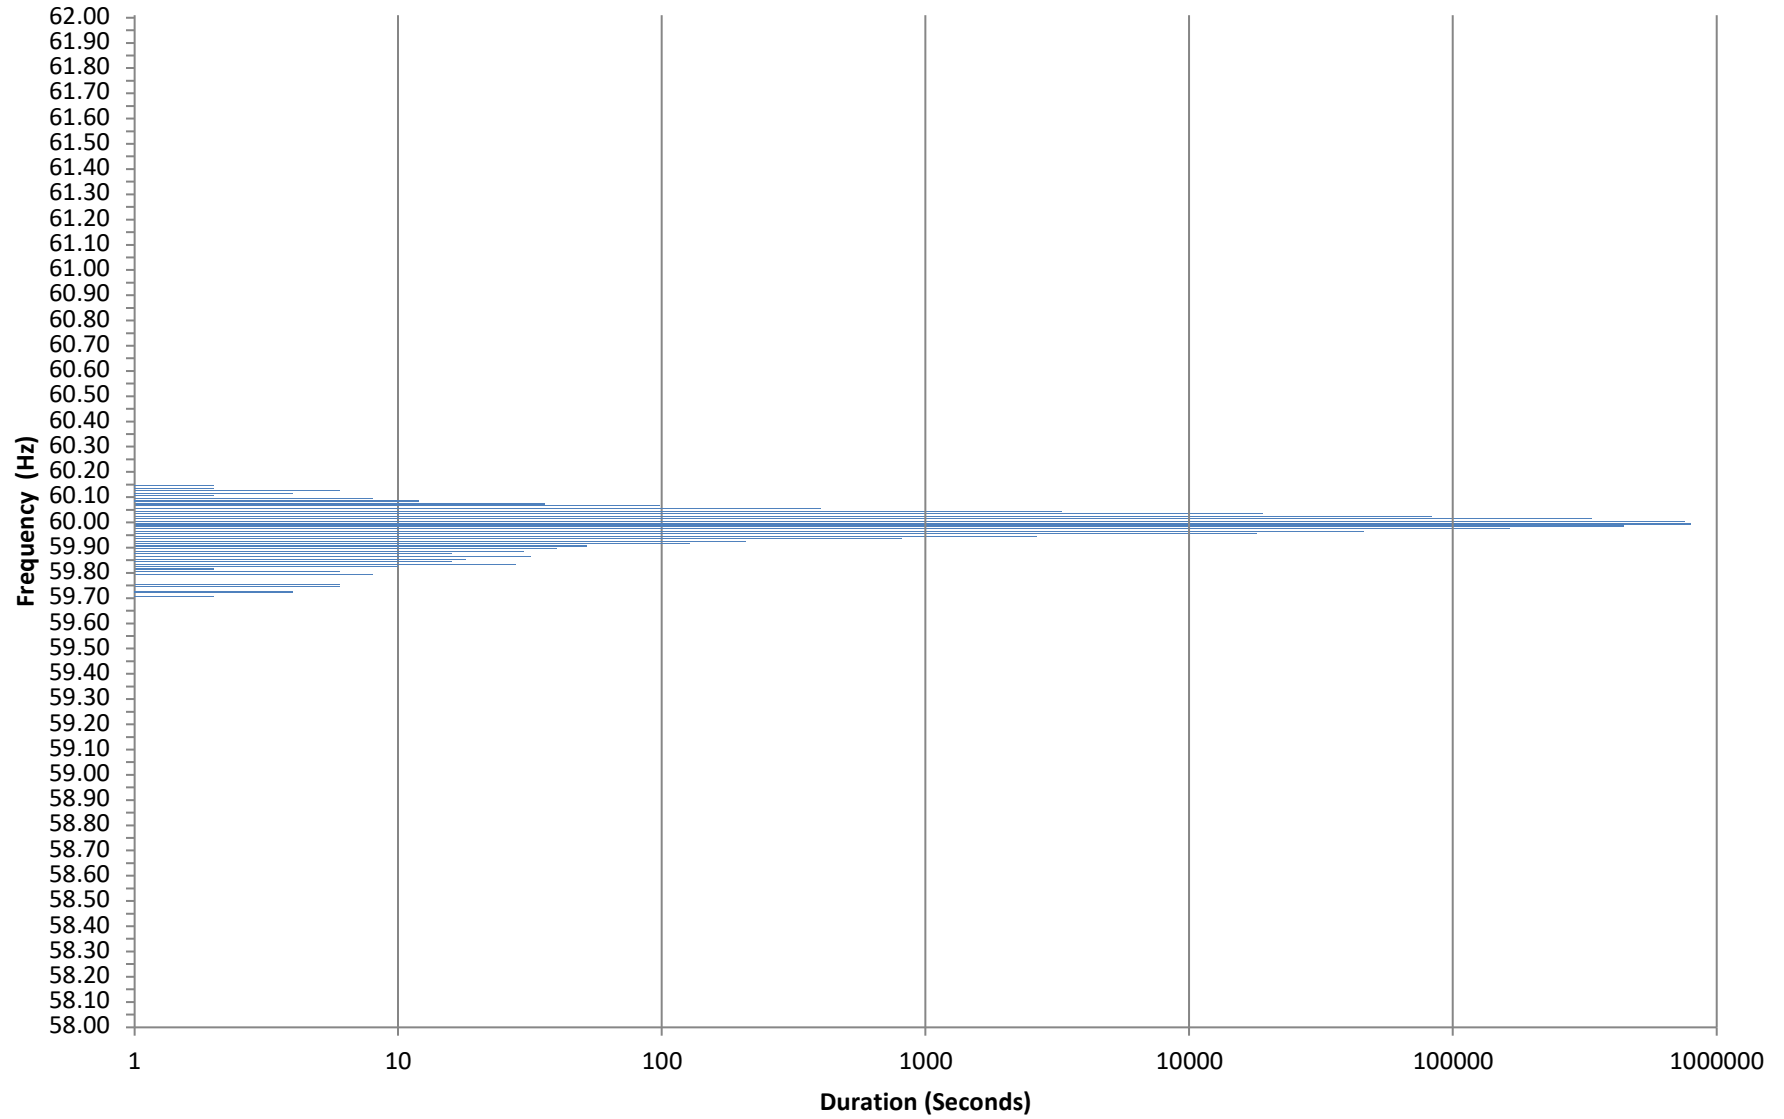

Frequency Distribution Plot - Maui Electric December 2024

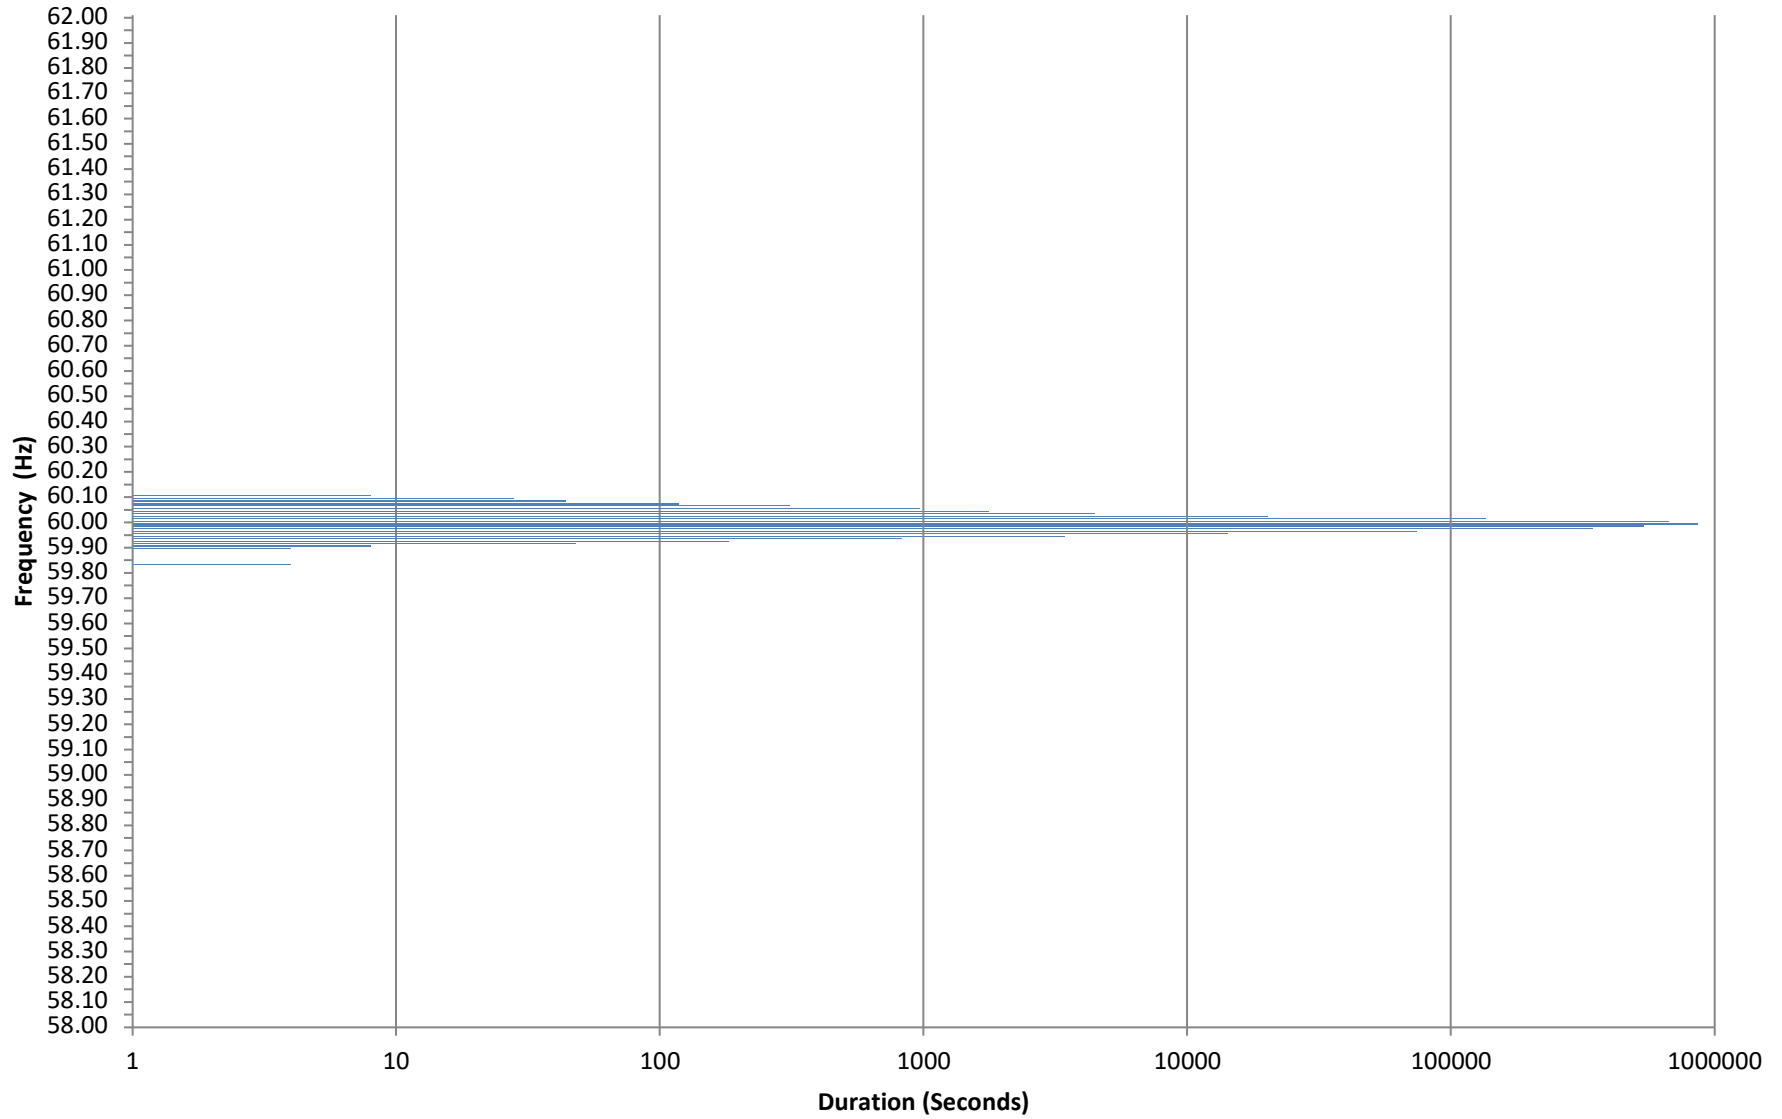

Hawaiian Electric Frequency Excursion Statistics December 2024		
Data Rounded to the nearest	<59.95 Hz	>60.05 Hz
Number of Excursions	1310	369
Maximum Duration (sec)	612	266
Maximum Deviation (Hz)	59.024	60.146
Total Duration of Excursions (sec)	23142	3746

Hawai'i Island Frequency Excursion Statistics December 2024		
	<59.95 Hz	>60.05 Hz
Number of Excursions	2174	75
Maximum Duration (sec)	72	36
Maximum Deviation (Hz)	59.701	60.140
Total Duration of Excursions (sec)	12348	304

Maui Electric Frequency Excursion Statistics December 2024		
	<59.95 Hz	>60.05 Hz
Number of Excursions	3421	52
Maximum Duration (sec)	266	82
Maximum Deviation (Hz)	59.827	60.097
Total Duration of Excursions (sec)	18726	510

HAWAIIAN ELECTRIC COMPANY, INC.
CONTINGENCY RESERVE ACTIVATION EVENTS
December 2024

Event #	Date & Time	Frequency (Hz)			Spinning Reserve Shortfall (MW)	Duration (HH:MM)	Description
		Prior to Event	Nadir	Trigger			
1	12/17/2024 14:15	59.94	59.67	NA	0.00	0:00	K1 tripped offline while generating ~56 MW. SGS called online for spinning reserves.
2	12/18/2024 16:38	59.98	59.45	NA	0.00	0:00	CIP tripped offline while generating ~114 MW. W9 and SGS called online for spinning reserves.
3	12/25/2024 15:14	60.04	59.02	NA	0.00	0:00	K1 tripped offline while generating ~48 MW. W9 called online for spinning reserves.

This page intentionally left blank.

HAWAIIAN ELECTRIC COMPANY, INC.
DEMAND RESPONSE EVENTS
December 2024

Event #	Date & Time	Frequency (Hz)			Load Shed (MW)	Duration (HH:MM)	Description
		Prior to Event	Nadir	Trigger			
1	12/17/2024 14:15	59.94	59.67	59.70	NA	0:03	K1 tripped offline while generating ~56 MW. RDLC activated.
2	12/18/2024 16:38	59.98	59.45	59.70	NA	0:05	CIP tripped offline while generating ~114 MW. RDLC and CIDLC activated.
3	12/25/2024 15:14	60.04	59.02	59.70	NA	0:01	K1 tripped offline while generating ~48 MW. RDLC and CIDLC activated.

Hawaiian Electric Company, Inc. Curtailment Report December 2024

Start Date/Time	Curtailment Set Point	MW output prior to start of curtailment	End Date/Time	MW output after curtailment released	Estimated MWh of curtailed energy during event (1)	IPP/Facility	Reason for Curtailment
12/02/24 06:04	0.0	0.00	12/02/24 09:05	0	*	WAIH N	System Constraints
12/02/24 06:05	0.0	0.00	12/02/24 09:05	0	*	WAIH S	System Constraints
12/02/24 06:43	0.0	0.10	12/02/24 07:48	0	*	NPM	System Constraints
12/02/24 13:57	0.0	7.70	12/02/24 17:45	0	*	KSMauka	System Constraints
12/02/24 13:57	0.0	0.00	12/02/24 17:45	0	*	KWMauka	System Constraints
12/02/24 13:58	0.0	2.50	12/02/24 17:48	0	*	WAIH N	System Constraints
12/02/24 13:59	0.0	1.30	12/02/24 17:49	0	*	WAIH S	System Constraints
12/02/24 14:13	0.0	0.00	12/02/24 15:37	0	*	NPM	System Constraints
12/03/24 05:42	0.0	0.00	12/03/24 07:21	0	*	Aloha1	System Constraints
12/03/24 05:48	0.0	0.00	12/03/24 07:28	0	*	Waianae	System Constraints
12/03/24 07:28	0.0	0.80	12/03/24 07:54	0	*	NPM	System Constraints
12/03/24 13:34	0.0	0.00	12/03/24 15:19	0	*	NPM	System Constraints
12/03/24 13:55	0.0	1.70	12/03/24 14:54	0	*	Aloha1	System Constraints
12/03/24 14:02	0.0	22.82	12/03/24 15:05	0	*	Waianae	System Constraints
12/04/24 06:04	0.0	0.00	12/04/24 06:31	0	*	NPM	System Constraints
12/04/24 13:55	0.0	0.20	12/04/24 14:10	0	*	NPM	System Constraints
12/05/24 05:37	0.0	1.20	12/05/24 16:53	0	*	NPM	System Constraints
12/05/24 06:43	0.0	0.50	12/05/24 07:26	0	*	Kahuku WF	System Constraints
12/05/24 06:44	0.0	0.00	12/05/24 07:30	0	*	KWMakai	System Constraints
12/05/24 06:45	0.0	0.00	12/05/24 07:32	0	*	KSMakai	System Constraints
12/05/24 07:20	0.0	0.10	12/05/24 15:59	0	*	KLS2	System Constraints
12/05/24 07:22	0.0	0.00	12/05/24 19:33	0	*	KREP	System Constraints
12/05/24 07:25	0.0	0.00	12/05/24 16:07	0	*	WestL	System Constraints
12/05/24 18:28	0.0	0.00	12/05/24 19:58	0	*	Kahuku WF	System Constraints
12/05/24 18:28	0.0	0.00	12/05/24 19:59	0	*	KWMakai	System Constraints
12/05/24 18:29	0.0	0.00	12/05/24 19:59	0	*	KSMakai	System Constraints
12/06/24 05:51	0.0	0.20	12/06/24 16:48	0	*	NPM	System Constraints
12/06/24 05:54	0.0	0.00	12/06/24 07:06	0	*	Kahuku WF	System Constraints
12/06/24 05:55	0.0	0.00	12/06/24 07:08	0	*	KWMakai	System Constraints
12/06/24 05:56	0.0	0.00	12/06/24 07:08	0	*	KSMakai	System Constraints
12/06/24 13:49	0.0	0.00	12/06/24 15:16	0	*	Kahuku WF	System Constraints
12/06/24 13:50	0.0	3.00	12/06/24 15:18	0	*	KSMakai	System Constraints
12/06/24 13:50	0.0	1.30	12/06/24 15:17	0	*	KWMakai	System Constraints
12/09/24 05:12	0.0	0.00	12/11/24 19:44	0	*	WestL	System Constraints
12/09/24 05:15	0.0	0.00	12/09/24 15:24	0	*	Aloha2	System Constraints
12/09/24 05:15	0.0	0.00	12/09/24 07:20	0	*	KREP	System Constraints
12/09/24 14:15	0.0	1.30	12/09/24 15:24	0	*	KREP	System Constraints
12/10/24 05:36	0.0	0.00	12/10/24 15:17	0	*	Aloha2	System Constraints
12/10/24 05:36	0.0	0.00	12/10/24 06:39	0	*	KREP	System Constraints
12/10/24 13:42	0.0	1.80	12/10/24 15:16	0	*	KREP	System Constraints
12/11/24 05:34	0.0	0.00	12/11/24 19:43	0	*	Aloha2	System Constraints
12/11/24 05:34	0.0	0.00	12/11/24 06:23	0	*	KREP	System Constraints
12/11/24 14:00	0.0	1.40	12/11/24 19:42	0	*	KREP	System Constraints
12/16/24 05:44	0.0	0.00	12/16/24 11:49	0	*	Kahuku WF	System Constraints
12/16/24 05:45	0.0	0.00	12/16/24 11:46	0	*	KWMakai	System Constraints
12/16/24 05:46	0.0	0.00	12/16/24 11:46	0	*	KSMakai	System Constraints
12/16/24 05:46	0.0	0.00	12/16/24 11:46	0	*	KWMauka	System Constraints
12/16/24 05:47	0.0	0.00	12/16/24 11:47	0	*	KSMauka	System Constraints
12/16/24 11:45	0.0	22.80	12/16/24 22:17	0	*	Waianae	System Constraints
12/16/24 11:38	0.0	3.10	12/16/24 13:18	0	*	Aloha1	System Constraints
12/16/24 19:26	0.0	0.00	12/16/24 22:11	0	*	Aloha1	System Constraints
12/17/24 05:57	0.0	0.00	12/17/24 06:34	0	*	Aloha1	System Constraints
12/17/24 06:04	0.0	0.00	12/17/24 16:35	0	*	Waianae	System Constraints
12/17/24 15:00	0.0	2.00	12/17/24 16:12	0	*	Aloha1	System Constraints
12/19/24 06:49	0.0	0.00	12/19/24 08:20	0	*	Kahuku WF	System Constraints
12/19/24 06:50	0.0	0.00	12/19/24 08:22	0	*	KWMakai	System Constraints
12/19/24 06:51	0.0	0.00	12/19/24 08:24	0	*	KSMakai	System Constraints
12/19/24 06:52	0.0	0.00	12/19/24 08:21	0	*	MFO	System Constraints
12/19/24 13:49	0.0	2.10	12/19/24 14:41	0	*	Kahuku WF	System Constraints
12/19/24 13:50	0.0	8.10	12/19/24 14:42	0	*	KSMakai	System Constraints

Hawaiian Electric Company, Inc. Curtailment Report December 2024

Start Date/Time	Curtailment Set Point	MW output prior to start of curtailment	End Date/Time	MW output after curtailment released	Estimated MWh of curtailed energy during event (1)	IPP/Facility	Reason for Curtailment
12/19/24 13:50	0.0	0.30	12/19/24 14:42	0	*	KWMakai	System Constraints
12/19/24 13:51	0.0	0.00	12/19/24 14:41	0	*	MFO	System Constraints
12/30/24 13:32	0.0	20.20	12/31/24 08:04	0	*	NPM	System Constraints
12/30/24 22:41	0.0	17.00	12/30/24 22:45	0	*	KWMauka	System Constraints
12/30/24 22:47	0.0	4.80	12/30/24 23:05	0	*	KWMakai	System Constraints
12/30/24 22:47	0.0	15.80	12/30/24 23:05	0	*	KWMauka	System Constraints
12/30/24 22:55	0.0	12.50	12/31/24 00:47	0	*	Kahuku WF	System Constraints

Aloha1 = Aloha Solar Energy Fund I
Aloha2 = Aloha Solar Energy Fund II
KLS2 = Kalaeloa Solar Two
KREP = Kalaeloa Renewable Energy Partners
Kahuku WF = Kahuku Wind Power
Lani = Lanikuhana Solar
MFO = Mauka FIT One Solar
NPM = Na Pua Makani Power Partners
KSMakai = Kawaiiloa Solar Makai
KSMauka = Kawaiiloa Solar Mauka
KWMakai = Kawaiiloa Wind Makai
KWMauka = Kawaiiloa Wind Mauka
WAIH N = Waihonu North
WAIH S = Waihonu South
Waianae = EE Waianae Solar Project
Waipio PV = Waipio PV
WestL = West Loch PV

(1) The estimated MWh of energy curtailed during the event is supplied by IPP, and HECO does not make any representations as to its accuracy.

* Data has not been provided by IPP.

9/6 Aloha Solar II curtailment was Facility Initiated and not System Constraints.

Hawai'i Electric Light Company Curtailment Report December 2024

Start Date/Time	MW output prior to start of curtailment	End Date/Time	MW output after curtailment released ¹	IPP	Reason for Curtailment
12/01/24 15:12	0.0 MW	12/02/24 12:43	0.0 MW	TGUHI	Oversupply
12/11/24 10:35	14.3 MW	12/11/24 15:16	0.0 MW	Pakini Nui	Facility Requested
12/14/24 07:33	9.7 MW	12/14/24 08:35	6.7 MW	Pakini Nui	System Constraint
12/14/24 12:33	17.0 MW	12/14/24 13:34	17.1 MW	Pakini Nui	System Constraint
12/15/24 09:45	19.1 MW	12/15/24 15:16	18.2 MW	Pakini Nui	Facility Requested
12/23/24 10:46	17.3 MW	12/23/24 14:38	16.5 MW	Pakini Nui	Facility Requested

¹ The MW output values are taken soon after curtailment is released by Hawai'i Electric Light and may not reflect their full output depending on ramp rate for the facility. The wind farms generally return immediately to full available levels, whereas PGV, Wailuku, and FIT Facilities may take longer to return to scheduled or full available output levels.



Lanai Curtailment Report

December 2024

Start Date and Time	Duration (h:mm)	IPP Curtailed	Estimated MWh Curtailed	Peak MW Curtailed	Reasons for Curtailment
No curtailment for December 2024					
Notes:					
On June 27, 2012, Maui Electric notified Lanai Sustainability Research (LSR) that although LSR has not operated in compliance with the revised ramp rate of 360 kW/minute, Maui Electric would conditionally allow LSR to operate at the allowed capacity of 1.2 MW while the Maui Electric-Lanai Diesel Operator was in the control room.					
LSR possible output data is not available. Therefore, Maui Electric assumes LSR is curtailed if the LSR curtailment set point is less than 1,200 kW and LSR's output is within 70 kW of the curtailment set point.					
The curtailment reasons have been modified to oversupply, system constraints, and facility requested, to provide continuity with HPUC Docket No. 2013-0141 Decoupling for HECO companies' metrics.					
Facility Requested curtailment includes but is not limited to conditions that are attributed to IPPs such as communication problems and curtailment control testing.					



Maui Curtailment Report

December
2024

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/1/2024 0:13	0:02	AWE	0.02628	8.70000	Oversupply
12/1/2024 0:16	0:01	AWE	0.01099	8.70000	Oversupply
12/1/2024 0:20	0:02	AWE	0.01964	10.50000	Oversupply
12/1/2024 0:23	0:01	AWE	0.01768	11.30000	Oversupply
12/1/2024 0:25	0:06	AWE	0.09676	12.30000	Oversupply
12/1/2024 0:33	0:01	AWE	0.00798	11.90000	Oversupply
12/1/2024 0:35	0:01	AWE	0.01088	12.10000	Oversupply
12/1/2024 1:26	0:02	AWE	0.02294	9.70000	Oversupply
12/1/2024 1:30	0:14	AWE	0.20353	10.50000	Oversupply
12/3/2024 14:20	0:01	AWE	0.00333	0.20000	Oversupply
12/4/2024 9:23	0:02	17-2	0.00277	0.08300	Oversupply
12/4/2024 9:28	0:02	17-2	0.00199	0.08300	Oversupply
12/4/2024 9:35	0:02	17-2	0.00277	0.08300	Oversupply
12/4/2024 9:39	0:01	17-2	0.00138	0.08300	Oversupply
12/4/2024 10:44	0:01	17-2	0.00138	0.08300	Oversupply
12/4/2024 10:47	0:02	17-2	0.00277	0.08300	Oversupply
12/4/2024 10:50	0:05	17-2	0.00692	0.08300	Oversupply
12/4/2024 10:56	0:11	17-2	0.01522	0.08300	Oversupply
12/4/2024 11:08	0:02	17-2	0.00277	0.08300	Oversupply
12/4/2024 11:11	0:01	17-2	0.00138	0.08300	Oversupply
12/5/2024 11:15	0:01	17-2	0.00138	0.08300	Oversupply
12/5/2024 11:32	0:02	17-2	0.00277	0.08300	Oversupply
12/5/2024 11:36	0:04	17-2	0.00553	0.08300	Oversupply
12/5/2024 11:41	0:15	17-2	0.02075	0.08300	Oversupply
12/5/2024 11:50	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/6/2024 9:33	0:01	17-2	0.00480	0.61400	Oversupply
12/6/2024 9:47	0:01	17-2	0.01112	0.66700	Oversupply
12/6/2024 9:49	0:08	17-2	0.08893	0.66700	Oversupply
12/6/2024 9:58	0:07	17-2	0.07803	0.70400	Oversupply
12/6/2024 10:26	0:02	17-2	0.01312	0.74400	Oversupply
12/6/2024 10:33	0:02	17-2	0.01839	0.74400	Oversupply
12/6/2024 10:36	0:02	17-2	0.00679	0.74400	Oversupply
12/6/2024 10:41	0:57	17-2	0.70188	0.75000	Oversupply
12/6/2024 10:42	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/6/2024 10:42	0:03	KWPPI	0.03788	2.14261	Oversupply
12/6/2024 10:47	0:24	BS 250	Data is not available	Data is not available	Oversupply
12/6/2024 10:47	0:25	KWPPI	0.31200	1.70251	Oversupply
12/6/2024 10:49	0:02	AWE	0.03520	8.80000	Oversupply
12/6/2024 10:52	0:02	AWE	0.03330	8.90000	Oversupply
12/6/2024 10:56	0:15	AWE	0.61082	8.50000	Oversupply
12/6/2024 11:12	0:04	BS 250	Data is not available	Data is not available	Oversupply
12/6/2024 11:13	0:01	AWE	0.00392	8.30000	Oversupply
12/6/2024 11:13	0:03	KWPPI	0.05767	1.94102	Oversupply
12/6/2024 11:15	0:01	AWE	0.02067	9.50000	Oversupply
12/6/2024 11:20	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/6/2024 11:21	0:01	KWPPI	0.00775	1.60172	Oversupply
12/6/2024 11:25	0:01	KWPPI	0.00026	1.78933	Oversupply
12/6/2024 11:31	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/6/2024 11:32	0:01	KWPPI	0.00794	1.08677	Oversupply
12/6/2024 11:39	0:02	17-2	0.02500	0.75000	Oversupply
12/6/2024 12:12	0:01	KWPPI	0.00130	0.07784	Oversupply
12/6/2024 13:33	0:01	17-2	0.01061	0.75000	Oversupply
12/7/2024 9:38	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/7/2024 9:57	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/7/2024 10:06	0:24	BS 250	Data is not available	Data is not available	Oversupply
12/7/2024 10:07	0:02	AWE	0.02341	15.10000	Oversupply
12/7/2024 10:10	0:20	AWE	0.63091	15.10000	Oversupply
12/7/2024 11:42	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/7/2024 11:43	0:01	AWE	0.00640	13.00000	Oversupply
12/8/2024 1:21	0:02	AWE	0.00333	0.10000	Oversupply
12/8/2024 1:34	0:01	AWE	0.00167	0.10000	Oversupply
12/8/2024 9:48	0:04	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 9:48	0:06	AWE	0.03862	12.80000	Oversupply
12/8/2024 9:53	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 10:45	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:08	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:11	0:05	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:12	0:04	AWE	0.05283	12.10000	Oversupply
12/8/2024 12:15	0:01	KWPPI	0.00364	0.23851	Oversupply
12/8/2024 12:17	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:17	0:01	AWE	0.00605	11.50000	Oversupply
12/8/2024 12:20	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:22	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:25	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:27	0:01	AWE	0.00736	11.70000	Oversupply



Maui Curtailment Report

December
2024

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/8/2024 12:29	0:01	AWE	0.00002	10.70000	Oversupply
12/8/2024 12:30	0:04	BS 250	Data is not available	Data is not available	Oversupply
12/8/2024 12:31	0:01	AWE	0.02091	11.90000	Oversupply
12/8/2024 20:00	0:01	AWE	0.00167	0.10000	Oversupply
12/8/2024 21:33	0:01	KWPPI	0.01117	15.51820	Oversupply
12/8/2024 21:35	0:01	KWPPI	0.00581	15.60403	Oversupply
12/8/2024 22:00	0:01	KWPPI	0.00689	16.54111	Oversupply
12/8/2024 22:09	0:01	KWPPI	0.00012	16.51816	Oversupply
12/8/2024 22:48	0:32	KWPPI	2.64719	16.47325	Oversupply
12/8/2024 23:24	0:02	KWPPI	0.01171	16.24472	Oversupply
12/9/2024 1:47	0:22	KWPPI	0.92354	16.46227	Oversupply
12/9/2024 8:26	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 8:29	2:10	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 8:31	0:01	KWPPI	0.00004	14.97332	Oversupply
12/9/2024 8:33	0:15	KWPPI	0.49208	14.99528	Oversupply
12/9/2024 8:49	1:50	KWPPI	11.30925	14.99029	Oversupply
12/9/2024 10:05	0:03	AWE	0.05667	19.00000	Oversupply
12/9/2024 10:14	0:01	AWE	0.00781	18.40000	Oversupply
12/9/2024 10:40	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 10:40	0:03	KWPPI	0.05898	11.14516	Oversupply
12/9/2024 10:44	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 10:44	0:01	KWPPI	0.00784	11.43956	Oversupply
12/9/2024 10:46	0:03	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 10:46	0:03	KWPPI	0.04175	11.37869	Oversupply
12/9/2024 11:08	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 11:08	0:01	KWPPI	0.01110	8.15629	Oversupply
12/9/2024 11:10	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 11:11	0:01	KWPPI	0.00368	10.31586	Oversupply
12/9/2024 11:20	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 11:20	0:02	KWPPI	0.02631	10.44859	Oversupply
12/9/2024 11:22	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 11:23	0:03	KWPPI	0.04366	11.70402	Oversupply
12/9/2024 11:24	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 11:27	2:52	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 11:28	2:30	KWPPI	21.00333	14.09612	Oversupply
12/9/2024 11:32	0:39	AWE	4.64520	18.30000	Oversupply
12/9/2024 12:03	0:02	5A	Data is not available	Data is not available	Oversupply
12/9/2024 12:05	0:01	KWP	0.00096	9.07039	Oversupply
12/9/2024 13:46	0:03	AWE	0.02156	17.40000	Oversupply
12/9/2024 13:59	0:20	KWPPI	0.77303	12.87961	Oversupply
12/9/2024 14:23	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 14:47	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/9/2024 14:49	0:01	KWPPI	0.00794	13.48637	Oversupply
12/10/2024 0:40	0:01	KWPPI	0.00439	15.00725	Oversupply
12/10/2024 0:43	0:06	KWPPI	0.05889	15.00725	Oversupply
12/10/2024 0:56	0:01	KWPPI	0.00583	14.99927	Oversupply
12/10/2024 1:03	0:01	KWPPI	0.00818	15.00625	Oversupply
12/10/2024 1:07	4:38	KWPPI	41.29204	15.01025	Oversupply
12/10/2024 2:43	0:01	AWE	0.00042	10.90000	Oversupply
12/10/2024 3:04	0:06	AWE	0.13476	13.60000	Oversupply
12/10/2024 5:47	0:05	KWPPI	0.08535	15.00825	Oversupply
12/10/2024 7:18	0:32	BS 250	Data is not available	Data is not available	Oversupply
12/10/2024 7:19	0:32	KWPPI	1.01534	16.54809	Oversupply
12/10/2024 8:47	6:03	BS 250	Data is not available	Data is not available	Oversupply
12/10/2024 8:48	6:02	KWPPI	63.55071	15.01923	Oversupply
12/10/2024 10:28	3:10	AWE	26.39820	20.90000	Oversupply
12/10/2024 10:52	0:01	KWP	0.00060	15.50672	Oversupply
12/10/2024 10:57	0:01	KWP	0.00418	15.38709	Oversupply
12/10/2024 10:58	0:05	5A	Data is not available	Data is not available	Oversupply
12/10/2024 10:59	0:04	KWP	0.04002	14.67003	Oversupply
12/10/2024 11:17	0:04	5A	Data is not available	Data is not available	Oversupply
12/10/2024 11:18	0:02	KWP	0.06802	14.89032	Oversupply
12/10/2024 11:21	0:01	KWP	0.00351	14.00160	Oversupply
12/10/2024 11:24	0:03	5A	Data is not available	Data is not available	Oversupply
12/10/2024 11:25	0:02	KWP	0.06568	14.13860	Oversupply
12/10/2024 11:28	0:01	KWP	0.00994	12.15510	Oversupply
12/10/2024 13:39	0:08	AWE	0.28239	20.80000	Oversupply
12/10/2024 13:49	0:01	AWE	0.01565	20.80000	Oversupply
12/10/2024 23:51	0:03	KWPPI	0.03759	7.34595	Oversupply
12/10/2024 23:55	0:03	KWPPI	0.02759	7.35293	Oversupply
12/10/2024 23:59	0:38	KWPPI	0.87143	7.35892	Oversupply
12/11/2024 0:40	0:03	KWPPI	0.03202	7.35693	Oversupply
12/11/2024 0:53	0:38	KWPPI	0.84756	7.36192	Oversupply
12/11/2024 1:36	0:02	KWPPI	0.01097	7.35792	Oversupply
12/11/2024 1:42	0:03	KWPPI	0.02202	7.36291	Oversupply



Maui Curtailment Report

December
2024

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/11/2024 1:59	0:01	KWPPI	0.00962	7.35493	Oversupply
12/11/2024 2:07	0:11	KWPPI	0.53045	7.35792	Oversupply
12/11/2024 2:34	1:34	KWPPI	3.40339	10.42165	Oversupply
12/11/2024 4:09	0:02	KWPPI	0.01395	10.41466	Oversupply
12/11/2024 4:14	0:15	KWPPI	0.28644	11.94952	Oversupply
12/11/2024 4:41	0:24	KWPPI	1.04417	11.94652	Oversupply
12/11/2024 5:07	0:01	KWPPI	0.00604	11.93355	Oversupply
12/11/2024 5:09	0:02	KWPPI	0.00347	11.94852	Oversupply
12/11/2024 5:14	0:12	KWPPI	0.20597	11.94752	Oversupply
12/11/2024 5:27	0:02	KWPPI	0.02283	11.94652	Oversupply
12/11/2024 5:34	0:01	KWPPI	0.01261	11.94053	Oversupply
12/11/2024 5:36	0:02	KWPPI	0.02053	11.94652	Oversupply
12/11/2024 8:06	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/11/2024 8:08	0:01	KWPPI	0.00316	13.48936	Oversupply
12/11/2024 8:49	6:07	BS 250	Data is not available	Data is not available	Oversupply
12/11/2024 8:49	6:08	KWPPI	67.88291	15.02222	Oversupply
12/11/2024 10:27	0:02	AWE	0.02446	17.50000	Oversupply
12/11/2024 10:33	0:02	AWE	0.03467	17.60000	Oversupply
12/11/2024 10:47	0:01	AWE	0.00379	17.00000	Oversupply
12/11/2024 10:52	0:05	AWE	0.19907	17.80000	Oversupply
12/11/2024 10:58	0:22	AWE	1.22942	17.70000	Oversupply
12/11/2024 11:23	2:22	AWE	12.29242	18.00000	Oversupply
12/11/2024 13:56	0:04	AWE	0.09681	20.70000	Oversupply
12/11/2024 14:02	0:04	AWE	0.07795	20.80000	Oversupply
12/11/2024 14:07	0:01	AWE	0.00890	20.50000	Oversupply
12/11/2024 14:09	0:01	AWE	0.00607	20.20000	Oversupply
12/11/2024 14:13	0:01	AWE	0.00947	20.70000	Oversupply
12/11/2024 14:15	0:01	AWE	0.00787	20.40000	Oversupply
12/11/2024 14:58	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/11/2024 15:03	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/11/2024 15:29	0:33	BS 250	Data is not available	Data is not available	Oversupply
12/11/2024 15:30	0:07	KWPPI	0.22102	15.00925	Oversupply
12/11/2024 15:39	0:23	KWPPI	1.38354	15.01424	Oversupply
12/12/2024 1:05	3:19	KWPPI	20.10389	13.48437	Oversupply
12/12/2024 1:40	0:01	AWE	0.00133	17.50000	Oversupply
12/12/2024 4:30	0:13	KWPPI	0.25217	13.48238	Oversupply
12/12/2024 4:44	0:01	KWPPI	0.00021	13.47838	Oversupply
12/12/2024 8:14	5:02	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 8:18	4:57	KWPPI	50.02226	15.01623	Oversupply
12/12/2024 9:54	0:02	AWE	0.06262	17.80000	Oversupply
12/12/2024 10:02	0:02	AWE	0.02671	17.70000	Oversupply
12/12/2024 10:35	0:13	AWE	0.19895	17.80000	Oversupply
12/12/2024 10:56	0:20	AWE	1.21290	18.00000	Oversupply
12/12/2024 12:03	0:01	AWE	0.01368	17.60000	Oversupply
12/12/2024 12:05	0:02	AWE	0.03418	17.80000	Oversupply
12/12/2024 12:08	0:01	AWE	0.01750	17.60000	Oversupply
12/12/2024 12:12	0:01	AWE	0.00218	17.60000	Oversupply
12/12/2024 12:14	0:03	AWE	0.03953	17.70000	Oversupply
12/12/2024 12:21	0:11	AWE	0.38416	17.80000	Oversupply
12/12/2024 12:44	0:02	AWE	0.02885	17.80000	Oversupply
12/12/2024 12:52	0:01	AWE	0.00992	17.70000	Oversupply
12/12/2024 13:16	0:01	KWPPI	0.00901	14.47534	Oversupply
12/12/2024 13:17	0:17	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 13:19	0:04	KWPPI	0.08250	12.69699	Oversupply
12/12/2024 13:24	0:02	KWPPI	0.06354	14.09911	Oversupply
12/12/2024 13:27	0:03	KWPPI	0.09596	13.90751	Oversupply
12/12/2024 13:31	0:03	KWPPI	0.09951	14.06618	Oversupply
12/12/2024 13:57	0:17	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 13:58	0:12	KWPPI	0.29723	13.13309	Oversupply
12/12/2024 14:11	0:03	KWPPI	0.07175	11.31282	Oversupply
12/12/2024 14:19	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 14:19	0:01	KWPPI	0.00119	10.64020	Oversupply
12/12/2024 14:21	0:04	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 14:23	0:04	KWPPI	0.05614	12.54530	Oversupply
12/12/2024 14:27	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 14:28	0:01	KWPPI	0.00710	9.81988	Oversupply
12/12/2024 14:31	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 18:37	0:04	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 18:38	0:06	KWPPI	0.06483	13.38757	Oversupply
12/12/2024 18:42	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/12/2024 22:51	0:12	KWPPI	0.19136	13.39555	Oversupply
12/12/2024 23:04	0:05	KWPPI	0.14635	13.42849	Oversupply
12/12/2024 23:12	0:05	KWPPI	0.04235	13.46342	Oversupply
12/12/2024 23:47	0:01	KWPPI	0.00794	13.46940	Oversupply
12/12/2024 23:52	0:15	KWPPI	0.37911	13.46641	Oversupply



Maui Curtailment Report

**December
2024**

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/13/2024 0:11	0:04	KWPPI	0.05130	13.46840	Oversupply
12/13/2024 0:22	4:52	KWPPI	47.72373	13.47339	Oversupply
12/13/2024 1:06	0:02	AWE	0.00848	17.60000	Oversupply
12/13/2024 1:10	0:04	AWE	0.02641	17.50000	Oversupply
12/13/2024 1:16	0:06	AWE	0.07138	17.40000	Oversupply
12/13/2024 1:24	0:01	AWE	0.01828	16.60000	Oversupply
12/13/2024 1:26	0:01	AWE	0.00385	17.60000	Oversupply
12/13/2024 1:30	0:01	AWE	0.00891	17.80000	Oversupply
12/13/2024 1:32	0:11	AWE	0.27828	17.40000	Oversupply
12/13/2024 2:16	0:03	AWE	0.03017	15.00000	Oversupply
12/13/2024 2:20	0:16	AWE	0.47035	16.10000	Oversupply
12/13/2024 2:38	0:14	AWE	0.26269	15.50000	Oversupply
12/13/2024 2:53	0:01	AWE	0.00514	13.10000	Oversupply
12/13/2024 3:31	0:02	AWE	0.00793	14.20000	Oversupply
12/13/2024 3:44	0:04	AWE	0.07601	16.20000	Oversupply
12/13/2024 5:22	0:08	KWPPI	0.24489	13.47439	Oversupply
12/13/2024 12:14	0:09	BS 250	Data is not available	Data is not available	Oversupply
12/13/2024 12:17	0:03	KWPPI	0.08532	16.52614	Oversupply
12/13/2024 12:29	0:09	BS 250	Data is not available	Data is not available	Oversupply
12/13/2024 12:29	0:09	KWPPI	0.33911	16.35349	Oversupply
12/13/2024 23:00	0:05	KWPPI	0.08471	14.05021	Oversupply
12/13/2024 23:07	0:01	KWPPI	0.00645	12.54330	Oversupply
12/13/2024 23:14	1:14	KWPPI	9.33108	15.00226	Oversupply
12/14/2024 0:34	0:01	KWPPI	0.01268	14.83959	Oversupply
12/14/2024 0:36	0:14	KWPPI	0.68773	14.93640	Oversupply
12/14/2024 0:52	0:05	KWPPI	0.13123	13.55523	Oversupply
12/14/2024 1:02	0:01	KWPPI	0.00059	11.26093	Oversupply
12/14/2024 1:05	0:03	KWPPI	0.09102	13.45942	Oversupply
12/14/2024 1:09	4:54	KWPPI	51.08948	15.00226	Oversupply
12/14/2024 2:05	0:01	AWE	0.00676	16.40000	Oversupply
12/14/2024 2:07	0:01	AWE	0.00608	16.20000	Oversupply
12/14/2024 2:11	0:03	AWE	0.03382	16.40000	Oversupply
12/14/2024 2:15	0:01	AWE	0.00059	14.40000	Oversupply
12/14/2024 2:41	0:04	AWE	0.03416	14.90000	Oversupply
12/14/2024 2:56	0:01	AWE	0.00896	13.80000	Oversupply
12/14/2024 2:58	0:09	AWE	0.17353	15.80000	Oversupply
12/14/2024 3:08	0:06	AWE	0.19690	15.90000	Oversupply
12/14/2024 3:15	0:08	AWE	0.12564	15.40000	Oversupply
12/14/2024 3:25	0:06	AWE	0.10710	15.50000	Oversupply
12/14/2024 3:32	0:03	AWE	0.03890	14.50000	Oversupply
12/14/2024 3:44	0:19	AWE	0.78267	16.60000	Oversupply
12/14/2024 4:04	0:09	AWE	0.16197	16.40000	Oversupply
12/14/2024 4:14	0:13	AWE	0.29321	17.20000	Oversupply
12/14/2024 6:04	0:37	KWPPI	1.24059	14.99528	Oversupply
12/14/2024 6:25	0:22	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 6:42	0:01	KWPPI	0.00362	14.76175	Oversupply
12/14/2024 6:45	0:03	KWPPI	0.02222	14.75177	Oversupply
12/14/2024 8:00	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 8:03	0:13	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 8:03	0:13	KWPPI	0.34351	13.96040	Oversupply
12/14/2024 8:55	0:12	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 8:56	0:06	KWPPI	0.08394	14.02726	Oversupply
12/14/2024 9:03	0:02	KWPPI	0.01626	12.69100	Oversupply
12/14/2024 9:06	0:01	KWPPI	0.01237	12.48642	Oversupply
12/14/2024 9:08	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 9:08	0:01	KWPPI	0.01204	13.10116	Oversupply
12/14/2024 9:12	0:01	KWPPI	0.00050	13.91948	Oversupply
12/14/2024 9:31	0:07	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 9:32	0:02	KWPPI	0.02160	12.04332	Oversupply
12/14/2024 9:35	0:04	KWPPI	0.10283	12.42754	Oversupply
12/14/2024 9:41	0:02	KWPPI	0.02253	11.83176	Oversupply
12/14/2024 9:42	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 9:48	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 9:48	0:02	KWPPI	0.00904	11.75691	Oversupply
12/14/2024 9:51	5:10	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 9:51	5:10	KWPPI	54.71810	14.90945	Oversupply
12/14/2024 10:04	0:04	AWE	0.05915	17.70000	Oversupply
12/14/2024 10:22	3:15	AWE	24.19199	17.70000	Oversupply
12/14/2024 13:38	0:01	AWE	0.02135	15.80000	Oversupply
12/14/2024 13:42	0:01	AWE	0.00201	17.00000	Oversupply
12/14/2024 14:02	0:01	AWE	0.00261	15.50000	Oversupply
12/14/2024 14:04	0:02	AWE	0.05720	16.20000	Oversupply
12/14/2024 14:07	0:02	AWE	0.02791	16.80000	Oversupply
12/14/2024 14:10	0:01	AWE	0.00759	17.40000	Oversupply
12/14/2024 14:20	0:02	AWE	0.01055	17.20000	Oversupply



Maui Curtailment Report

December
2024

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/14/2024 15:25	0:14	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 15:26	0:13	KWPPII	0.35501	14.12606	Oversupply
12/14/2024 15:48	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 15:48	0:01	KWPPII	0.01416	14.19991	Oversupply
12/14/2024 15:50	0:01	KWPPII	0.00917	13.33268	Oversupply
12/14/2024 15:52	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/14/2024 21:54	0:03	KWPPII	0.02147	15.00027	Oversupply
12/14/2024 23:23	0:06	KWPPII	0.11275	15.00326	Oversupply
12/14/2024 23:34	0:05	KWPPII	0.17358	15.01025	Oversupply
12/15/2024 0:57	0:28	KWPPII	2.42405	15.00825	Oversupply
12/15/2024 1:32	0:44	KWPPII	5.07991	15.01025	Oversupply
12/15/2024 3:05	0:49	KWPPII	4.11175	13.44246	Oversupply
12/15/2024 3:55	0:06	KWPPII	0.12474	13.45843	Oversupply
12/15/2024 4:39	0:14	KWPPII	0.68553	13.46641	Oversupply
12/15/2024 4:56	0:39	KWPPII	3.29301	13.31472	Oversupply
12/15/2024 7:09	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 7:11	0:01	KWPPII	0.01210	8.88979	Oversupply
12/15/2024 7:14	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 7:24	1:23	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 7:25	1:20	KWPPII	7.79204	13.33069	Oversupply
12/15/2024 8:07	0:37	AWE	2.37659	20.80000	Oversupply
12/15/2024 8:48	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 9:21	5:03	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 9:24	5:00	AWE	48.72475	20.80000	Oversupply
12/15/2024 9:32	0:01	KWPPII	0.00146	0.21755	Oversupply
12/15/2024 9:44	0:21	KWPPII	0.11529	1.00095	Oversupply
12/15/2024 10:06	0:01	KWPPII	0.00116	0.17963	Oversupply
12/15/2024 10:08	0:58	KWPPII	1.73391	3.28128	Oversupply
12/15/2024 11:07	0:25	KWPPII	0.56236	2.37813	Oversupply
12/15/2024 11:34	0:01	KWPPII	0.00093	0.20558	Oversupply
12/15/2024 12:18	0:18	KWPPII	0.11088	1.07180	Oversupply
12/15/2024 12:54	0:01	KWPPII	0.00056	0.19360	Oversupply
12/15/2024 13:00	0:17	KWPPII	0.18323	1.65361	Oversupply
12/15/2024 13:34	0:18	KWPPII	0.07362	0.61873	Oversupply
12/15/2024 13:53	0:03	KWPPII	0.00580	0.26645	Oversupply
12/15/2024 13:59	0:01	KWPPII	0.00086	0.12175	Oversupply
12/15/2024 14:04	0:02	KWPPII	0.00267	0.18263	Oversupply
12/15/2024 14:28	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 14:50	0:39	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 14:50	0:39	KWPPII	2.73855	9.43866	Oversupply
12/15/2024 14:58	0:04	AWE	0.04281	19.30000	Oversupply
12/15/2024 15:03	0:01	AWE	0.00567	19.10000	Oversupply
12/15/2024 15:30	0:37	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 15:30	0:30	KWPPII	2.36934	11.21502	Oversupply
12/15/2024 16:01	0:03	KWPPII	0.09401	10.06139	Oversupply
12/15/2024 16:06	0:01	KWPPII	0.01686	9.75501	Oversupply
12/15/2024 16:08	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 16:09	0:03	KWPPII	0.03497	12.05730	Oversupply
12/15/2024 16:10	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 16:14	0:03	BS 250	Data is not available	Data is not available	Oversupply
12/15/2024 16:16	0:01	KWPPII	0.02165	12.53631	Oversupply
12/16/2024 0:47	0:06	AWE	0.08374	17.10000	Oversupply
12/16/2024 2:01	0:01	AWE	0.00814	10.00000	Oversupply
12/16/2024 2:03	0:02	AWE	0.02798	11.10000	Oversupply
12/16/2024 2:28	0:03	AWE	0.04134	11.70000	Oversupply
12/16/2024 3:47	0:10	AWE	0.27662	13.80000	Oversupply
12/16/2024 11:29	0:05	BS 250	Data is not available	Data is not available	Oversupply
12/16/2024 11:30	0:02	AWE	0.02106	9.50000	Oversupply
12/16/2024 11:33	0:01	AWE	0.01515	9.20000	Oversupply
12/16/2024 11:35	0:45	BS 250	Data is not available	Data is not available	Oversupply
12/16/2024 11:36	0:05	AWE	0.10423	8.60000	Oversupply
12/16/2024 11:42	0:32	AWE	1.08320	10.20000	Oversupply
12/16/2024 12:15	0:01	AWE	0.02637	6.10000	Oversupply
12/16/2024 12:21	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/16/2024 12:22	0:01	AWE	0.00145	6.40000	Oversupply
12/18/2024 14:31	0:01	KWPPII	0.00035	0.02096	Oversupply
12/20/2024 13:13	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/20/2024 13:13	0:01	AWE	0.00415	2.80000	Oversupply
12/20/2024 13:16	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/20/2024 13:17	0:01	AWE	0.01638	3.20000	Oversupply
12/20/2024 13:19	0:01	AWE	0.00114	3.40000	Oversupply
12/20/2024 13:22	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/20/2024 13:22	0:03	AWE	0.08510	3.20000	Oversupply
12/20/2024 13:26	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/20/2024 13:30	0:01	BS 250	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

**December
2024**

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/20/2024 13:30	0:02	AWE	0.01673	5.00000	Oversupply
12/20/2024 13:32	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/20/2024 13:36	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/20/2024 13:36	0:01	AWE	0.00933	4.90000	Oversupply
12/21/2024 12:16	0:31	BS 250	Data is not available	Data is not available	Oversupply
12/21/2024 12:16	0:02	KWPPI	0.01112	0.52393	Oversupply
12/21/2024 12:16	0:09	AWE	0.16569	10.10000	Oversupply
12/21/2024 12:21	0:01	KWPPI	0.00147	0.28841	Oversupply
12/21/2024 12:26	0:21	AWE	1.01756	8.90000	Oversupply
12/21/2024 12:49	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/21/2024 12:49	0:02	AWE	0.03349	8.80000	Oversupply
12/22/2024 22:47	0:01	KWPPI	0.00334	16.36247	Oversupply
12/22/2024 22:49	0:01	KWPPI	0.01025	16.36846	Oversupply
12/23/2024 0:08	0:01	KWPPI	0.00184	16.53712	Oversupply
12/23/2024 4:47	1:22	KWPPI	7.44782	16.53911	Oversupply
12/23/2024 8:15	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 8:16	0:01	KWPPI	0.00464	15.00326	Oversupply
12/23/2024 8:34	0:09	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 8:35	0:08	KWPPI	0.21152	14.96733	Oversupply
12/23/2024 8:58	0:03	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 8:59	0:15	KWPPI	0.19792	14.99927	Oversupply
12/23/2024 9:02	0:13	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 9:33	0:02	KWPPI	0.00187	14.99428	Oversupply
12/23/2024 9:34	1:15	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 9:36	1:13	KWPPI	4.45456	15.00027	Oversupply
12/23/2024 10:50	2:48	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 10:51	2:49	KWPPI	15.10355	15.03220	Oversupply
12/23/2024 13:39	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 13:54	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/23/2024 22:57	0:01	KWPPI	0.01033	12.52633	Oversupply
12/23/2024 23:01	0:12	KWPPI	0.34507	15.33059	Oversupply
12/25/2024 0:14	0:11	AWE	0.27440	13.00000	Oversupply
12/25/2024 10:19	0:01	KWPPI	0.00244	7.54454	Oversupply
12/25/2024 10:31	0:01	KWPPI	0.00937	7.29006	Oversupply
12/25/2024 10:59	0:04	BS 250	Data is not available	Data is not available	Oversupply
12/25/2024 10:59	0:01	KWPPI	0.00541	9.16622	Oversupply
12/25/2024 11:02	0:01	KWPPI	0.03806	9.87177	Oversupply
12/25/2024 11:08	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/25/2024 11:08	0:02	KWPPI	0.01872	12.43053	Oversupply
12/26/2024 19:26	0:01	KWPPI	0.00058	0.03493	Oversupply
12/27/2024 9:44	0:01	AWE	0.00167	0.10000	Oversupply
12/27/2024 10:53	0:01	AWE	0.00333	0.20000	Oversupply
12/28/2024 2:56	0:02	KWPPI	0.00406	18.06598	Oversupply
12/28/2024 9:47	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 9:48	0:01	KWPPI	0.00375	11.41960	Oversupply
12/28/2024 9:49	0:07	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 9:50	0:08	KWPPI	0.19120	12.87362	Oversupply
12/28/2024 10:00	0:04	KWPPI	0.07382	13.27181	Oversupply
12/28/2024 10:02	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 10:07	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 10:07	0:02	KWPPI	0.04722	13.20195	Oversupply
12/28/2024 10:12	0:05	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 10:13	0:04	KWPPI	0.14547	12.61216	Oversupply
12/28/2024 10:20	0:42	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 10:20	0:43	KWPPI	4.15222	15.10006	Oversupply
12/28/2024 10:53	0:02	AWE	0.01252	18.30000	Oversupply
12/28/2024 11:04	0:01	KWPPI	0.00163	9.20913	Oversupply
12/28/2024 12:15	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 12:16	0:01	KWPPI	0.00667	11.76789	Oversupply
12/28/2024 12:17	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 12:18	0:02	KWPPI	0.02602	10.34181	Oversupply
12/28/2024 12:25	0:07	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 12:26	0:01	KWPPI	0.04611	11.31681	Oversupply
12/28/2024 12:28	0:04	KWPPI	0.11168	13.06523	Oversupply
12/28/2024 12:50	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 13:16	0:07	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 13:16	0:08	KWPPI	0.21701	15.38348	Oversupply
12/28/2024 13:30	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 13:30	0:02	KWPPI	0.03498	15.34157	Oversupply
12/28/2024 13:33	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 13:33	0:03	KWPPI	0.03530	16.03415	Oversupply
12/28/2024 13:35	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 13:37	0:06	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 13:37	0:07	KWPPI	0.14844	15.96728	Oversupply
12/28/2024 13:50	0:01	BS 250	Data is not available	Data is not available	Oversupply



Maui Curtailment Report

**December
2024**

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/28/2024 13:51	0:03	KWPPI	0.04379	15.87647	Oversupply
12/28/2024 13:52	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 13:56	0:01	KWPPI	0.00408	15.99722	Oversupply
12/28/2024 15:04	0:04	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 15:04	0:01	KWPPI	0.00104	16.09802	Oversupply
12/28/2024 15:06	0:02	KWPPI	0.05525	16.25070	Oversupply
12/28/2024 15:11	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 15:12	0:01	KWPPI	0.00552	15.64794	Oversupply
12/28/2024 15:16	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/28/2024 15:17	0:01	KWPPI	0.00432	15.62299	Oversupply
12/29/2024 6:48	0:01	AWE	0.00167	0.10000	Oversupply
12/29/2024 10:24	0:01	KWPPI	0.00005	15.00226	Oversupply
12/29/2024 10:25	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 10:26	0:01	KWPPI	0.00110	15.00027	Oversupply
12/29/2024 10:27	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 10:28	0:02	KWPPI	0.01098	15.00725	Oversupply
12/29/2024 10:30	1:34	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 10:31	1:32	KWPPI	11.21019	15.00326	Oversupply
12/29/2024 11:21	0:07	AWE	0.34197	19.60000	Oversupply
12/29/2024 11:31	0:05	AWE	0.10444	19.40000	Oversupply
12/29/2024 12:04	0:03	KWPPI	0.02709	13.98634	Oversupply
12/29/2024 12:05	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 12:10	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 12:10	0:01	KWPPI	0.01383	14.41047	Oversupply
12/29/2024 12:13	0:01	AWE	0.03500	14.10000	Oversupply
12/29/2024 12:15	2:34	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 12:17	2:33	KWPPI	20.47973	14.97831	Oversupply
12/29/2024 12:48	0:03	AWE	0.02068	19.90000	Oversupply
12/29/2024 12:53	0:02	AWE	0.03779	18.70000	Oversupply
12/29/2024 12:58	0:01	AWE	0.00295	16.10000	Oversupply
12/29/2024 13:01	0:02	AWE	0.04861	18.50000	Oversupply
12/29/2024 13:04	0:01	AWE	0.01063	16.80000	Oversupply
12/29/2024 13:06	0:51	AWE	2.50483	20.50000	Oversupply
12/29/2024 14:51	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 14:53	0:03	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 14:53	0:03	KWPPI	0.04774	14.95536	Oversupply
12/29/2024 14:57	0:07	BS 250	Data is not available	Data is not available	Oversupply
12/29/2024 14:57	0:08	KWPPI	0.36744	16.06908	Oversupply
12/29/2024 22:58	0:01	KWPPI	0.00410	16.28164	Oversupply
12/29/2024 23:02	0:22	KWPPI	0.66882	16.45528	Oversupply
12/29/2024 23:29	0:02	KWPPI	0.00278	16.16688	Oversupply
12/29/2024 23:33	0:02	KWPPI	0.01552	15.75372	Oversupply
12/30/2024 2:05	0:01	KWPPI	0.00793	13.36961	Oversupply
12/30/2024 2:16	0:01	KWPPI	0.01932	14.51326	Oversupply
12/30/2024 2:24	2:52	KWPPI	13.30988	16.32056	Oversupply
12/30/2024 5:17	0:03	KWPPI	0.03944	16.17885	Oversupply
12/30/2024 5:22	0:01	KWPPI	0.00108	16.32755	Oversupply
12/30/2024 9:06	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/30/2024 9:14	0:03	BS 250	Data is not available	Data is not available	Oversupply
12/30/2024 9:14	0:05	KWPPI	0.04055	18.07097	Oversupply
12/30/2024 9:36	5:56	KWPPI	76.00062	18.07097	Oversupply
12/30/2024 9:37	5:55	BS 250	Data is not available	Data is not available	Oversupply
12/30/2024 11:40	0:06	AWE	0.20081	16.70000	Oversupply
12/30/2024 11:47	0:01	AWE	0.01040	14.50000	Oversupply
12/30/2024 11:57	0:04	AWE	0.07228	16.00000	Oversupply
12/30/2024 12:02	0:02	AWE	0.01282	14.20000	Oversupply
12/30/2024 12:05	0:06	AWE	0.05059	13.90000	Oversupply
12/30/2024 12:12	0:09	AWE	0.12067	14.40000	Oversupply
12/30/2024 12:22	0:02	AWE	0.01479	14.00000	Oversupply
12/30/2024 12:25	1:34	AWE	3.24407	16.60000	Oversupply
12/30/2024 15:35	0:01	BS 250	Data is not available	Data is not available	Oversupply
12/30/2024 23:02	0:06	KWPPI	0.07787	16.54211	Oversupply
12/30/2024 23:09	0:01	KWPPI	0.00121	15.02921	Oversupply
12/30/2024 23:13	0:04	KWPPI	0.07956	16.54011	Oversupply
12/31/2024 0:02	5:58	KWPPI	37.72886	16.54111	Oversupply
12/31/2024 6:02	0:02	KWPPI	0.03556	15.00426	Oversupply
12/31/2024 6:05	0:01	KWPPI	0.00954	15.00226	Oversupply
12/31/2024 6:07	0:01	KWPPI	0.00177	14.98131	Oversupply
12/31/2024 8:13	5:43	BS 250	Data is not available	Data is not available	Oversupply
12/31/2024 8:13	5:41	KWPPI	55.71895	15.04118	Oversupply
12/31/2024 9:19	0:07	AWE	0.17320	16.80000	Oversupply
12/31/2024 9:27	0:01	AWE	0.02101	17.30000	Oversupply
12/31/2024 9:42	0:01	AWE	0.00462	17.30000	Oversupply
12/31/2024 9:48	0:01	AWE	0.00400	17.50000	Oversupply
12/31/2024 9:51	0:01	AWE	0.00486	17.10000	Oversupply



Maui Curtailment Report

**December
2024**

Start Date and Time	Duration (minutes)	IPP Curtailed	Estimated Curtailed MWH	Peak MW Curtailed	Reasons for Curtailment
12/31/2024 9:54	0:06	AWE	0.08680	17.50000	Oversupply
12/31/2024 10:01	0:01	AWE	0.01671	17.00000	Oversupply
12/31/2024 10:03	0:01	AWE	0.01743	17.50000	Oversupply
12/31/2024 11:17	0:02	AWE	0.01474	17.30000	Oversupply
12/31/2024 11:20	0:01	AWE	0.01435	17.00000	Oversupply
12/31/2024 11:25	0:20	AWE	0.68790	17.50000	Oversupply
12/31/2024 11:47	0:01	AWE	0.00551	15.10000	Oversupply
12/31/2024 11:49	0:58	AWE	3.66141	17.40000	Oversupply
12/31/2024 12:49	0:06	AWE	0.16203	17.10000	Oversupply
12/31/2024 12:59	0:01	AWE	0.01568	16.30000	Oversupply
12/31/2024 13:13	0:02	AWE	0.02061	19.40000	Oversupply
12/31/2024 13:19	0:01	AWE	0.00549	18.90000	Oversupply
12/31/2024 13:23	0:01	AWE	0.01165	20.10000	Oversupply
12/31/2024 13:55	0:04	KWP/II	0.07620	13.96139	Oversupply
12/31/2024 13:57	0:02	BS 250	Data is not available	Data is not available	Oversupply
12/31/2024 14:21	1:05	BS 250	Data is not available	Data is not available	Oversupply
12/31/2024 14:22	0:59	KWP/II	5.46215	13.44845	Oversupply
12/31/2024 15:23	0:02	KWP/II	0.02659	13.02232	Oversupply
12/31/2024 21:55	0:25	KWP/II	0.96943	13.47040	Oversupply
12/31/2024 23:56	0:01	KWP/II	0.00476	11.93654	Oversupply
Total Estimated Curtailed MWh			891.781		

Notes:

- Curtailment for Kaheawa Wind Power ("KWP"), AAAAA Rent-A-Space Maui LTD ("5A"), Maui Solar, LLC (MS) fka Strategic Alliance Group ("SAG") fka Bioreal Solar, LLC ("BS"), Auwahi Wind Energy ("AWE"), Kaheawa Wind Power II ("KWP/II") Bioreal Solar 250, LLC ("BS250"), Extra Spaces A ("ESA"), Extra Spaces B ("ESB"), SSA Solar of Hawaii 3 ("SSA3") fka South Maui Renewable Resources ("SMRR"), SSA Solar of HI 2 ("SSA3") fka Ku'ia Solar ("KS"), and Maui 17-2 ("17-2") may now be controlled by Maui Electric's Automatic Generation Control System ("AGC") or a Maui Electric operator-entered curtailment limit. The AGC curtailment control automatically calculates the amount of Maximum Allowable Variable Generation ("MAVG") that Maui Electric can accept into the Maui system, based on the system current available variable generation ("CAVG"), regulating reserve down requirement ("RRDR"), and available regulating reserve down ("ARRD"). Thus, the AGC MAVG - calculated is equal to CAVG less (RRDR less ARRD). Additionally, the AGC curtailment control allows the Maui Electric operator to enter an AGC MAVG value. The AGC curtailment control will employ the lesser of the AGC MAVG - calculated and AGC MAVG - entered values in the control logic.

- Curtailment signals sent to 5A, MS (fka SAG fka BS), BS250, ESA, ESB, SSA3 (fka SMRR), SSA3 (fka KS) and 17-2 during nighttime hours only are not recorded as curtailment events because no energy generation is possible during that time.

- The curtailment reasons have been modified to oversupply, system constraints, and facility requested, to provide continuity with HPUC Docket No. 2013-0141 Decoupling for HECO companies metrics.

- Facility Requested curtailment includes but is not limited to conditions that are attributed to IPPs such as communication problems and curtailment control testing.

- The data to calculate the Estimated Curtailed MWH and Peak MW Curtailed is not provided by 5A, MS, BS 250, ESA, and ESB.

- The Estimated Curtailed MWH and Peak MW Curtailed are calculated with information estimated or provided by AWE, KWP, KWP/II, SSA 2 (fka KS), SSA 3 (fka SMRR) and 17-2. Maui Electric does not make any representation as to its accuracy.

- ESA, and ESB facilities were offline for the month because of Seller equipment problems.

- Kuia Solar was offline for the entire month due to the Lahaina Fire on November 12, 2022. The interconnection Substation was also destroyed in the August 8 2023 Lahaina Wind Storm and Fires. As of June 12, 2024, SMRR was back online but at reduced capacity. The facility went offline again on July 3 and subsequently started a small fire at the facility. Seller is working on a root cause analysis, there is no return to service date available.

- On March 23, 2024 MS (Bioreal 500) FIT project had a fire and lost their interconnection facilities. Owner is working to install new equipment and will coordinate with engineering as needed. Project is offline until repairs are made. Last reported curtailment is March 23, 2024.

-December 6th & 7th Maui 17-2 had communication errors on their side of the comms system, as a result their system data reported 0 (zero) P_Possible, resulting in the site being curtailed until the comms error is fixed. They are waiting on parts. Curtailment data only available up to Dec 6th, 2025. No further data available until the repairs are complete.

SERVICE LIST
(Docket No. 2011-0206)

MICHAEL S. ANGELO
EXECUTIVE DIRECTOR
DEPARTMENT OF COMMERCE AND CONSUMER AFFAIRS
DIVISION OF CONSUMER ADVOCACY
P.O. Box 541
Honolulu, HI 96809

1 Copy
Electronically Transmitted

GREGG J. KINKLEY, ESQ.
DEPARTMENT OF THE ATTORNEY GENERAL
425 Queen Street
Honolulu, Hawaii 96813
Counsel for DBEDT

1 Copy
Electronically Transmitted

DANIEL W.S. LAWRENCE, ESQ.
DEPARTMENT OF THE CORPORATION COUNSEL
CITY AND COUNTY OF HONOLULU
530 S. King Street, Room 110
Honolulu, HI 96813
Counsel for the CITY AND COUNTY OF HONOLULU

1 Copy
Electronically Transmitted

JOSEPH K. KAMELAMELA
ANGELIC M. HO
DEPARTMENT OF THE CORPORATION COUNSEL
COUNTY OF HAWAII
101 Aupuni Street, Suite 325
Hilo, HI 96720
Counsel for the COUNTY OF HAWAII

1 Copy
Electronically Transmitted

HENRY Q CURTIS
VICE PRESIDENT FOR CONSUMER ISSUES
LIFE OF THE LAND
P.O. Box 37158
Honolulu, HI 96837-0158

1 Copy
Electronically Transmitted

MELISSA MIYASHIRO (9360)
CHIEF OF STAFF
BLUE PLANET FOUNDATION
55 Merchant Street, 17th Floor
Honolulu, HI 96813

1 Copy
Electronically Transmitted

SERVICE LIST
(Docket No. 2011-0206)

ISAAC MORIWAKE, ESQ.
DAVID HENKIN, ESQ.
EARTHJUSTICE
850 Richards Street, Suite 400
Honolulu, HI 96813-4501
Counsel for HAWAII SOLAR ENERGY ASSOCIATION

1 Copy
Electronically Transmitted

RICK REED
DIRECTOR
HAWAII SOLAR ENERGY ASSOCIATION
761 Ahua Street
Honolulu, HI 96819

1 Copy
Electronically Transmitted

KENT D. MORIHARA, ESQ.
KRIS N. NAKAGAWA, ESQ.
LAUREN M. IMADA-LEE, ESQ.
TANYA M. FERNANDES, ESQ.
Moriyara Lau & Fong LLP
841 Bishop Street, Suite 400
Honolulu, Hawaii 96813
Counsel for KAUAI ISLAND UTILITY COOPERATIVE

1 Copy
Electronically Transmitted

ERIK W. KVAM
CHIEF EXECUTIVE OFFICER
ZERO EMISSIONS LEASING LLC
4188-4 Keanu Street
Honolulu, HI 96816

1 Copy
Electronically Transmitted

SANDRA-ANN Y.H. WONG, ESQ.
ATTORNEY AT LAW, A LAW CORPORATION
1050 Bishop Street, #514
Honolulu, HI 96813
Counsel for TAWHIRI POWER LLC

1 Copy
Electronically Transmitted

RILEY SAITO
73-1294 Awakea Street
Kailua-Kona, HI 96740
For SOLAR ENERGY INDUSTRIES ASSOCIATION

1 Copy
Electronically Transmitted

DEAN T. YAMAMOTO, ESQ.
YAMAMOTO & SETTLE
1100 Alakea Street, Suite 3100
Honolulu, HI 96813
Counsel for CASTLE & COOKE HOMES HAWAII, INC.,
CASTLE & COOKE RESORTS, LLC and
LANAI SUSTAINABILITY RESEARCH, LLC

1 Copy
Electronically Transmitted

SERVICE LIST
(Docket No. 2011-0206)

MICHAEL J. HOPPER, ESQ. DEPUTY CORPORATION COUNSEL DEPARTMENT OF THE CORPORATION COUNSEL COUNTY OF MAUI 200 S. High Street Wailuku, HI 96793 Counsel for the COUNTY OF MAUI	1 Copy Electronically Transmitted
CURTIS SEYMOUR SENIOR MANAGER, GOVERNMENT AFFAIRS SUN EDISON LLC 600 Clipper Drive Belmont, CA 94002	1 Copy Electronically Transmitted
MONA W. CLARK, ESQ. OFFICE OF THE COUNTY ATTORNEY COUNTY OF KAUAI 4444 Rice Street, Suite 200 Lihue, HI 96766-1300	1 Copy Electronically Transmitted
BRADLEY ALBERT PRESIDENT HAWAII PV COALITION P.O. Box 81501 Haiku, HI 96708	1 Copy Electronically Transmitted
HILTON H. UNEMORI ECM, INC. 130 N. Market Street Wailuku, HI 96793-1716 For SOUTH MAUI RENEWABLE RESOURCES, LLC	1 Copy Electronically Transmitted
SKY STANFIELD SHUTE, MIHALY & WEINBERGER LLP 396 Hayes Street San Francisco, CA 94102 For the INTERSTATE RENEWABLE ENERGY COUNCIL	1 Copy Electronically Transmitted
PETE COOPER SOLARCITY CORPORATION REGIONAL DIRECTOR, HAWAII 599 Kahelu Street Mililani, HI 96789	1 Copy Electronically Transmitted

SERVICE LIST
(Docket No. 2011-0206)

ALISON SILVERSTEIN
19213 Luedtke Lane
Pflugerville, TX 78660

1 Copy
Electronically Transmitted

BRENDAN KIRBY
12011 SW Pineapple Court
Palm City, FL 34990

1 Copy
Electronically Transmitted

Chu, Michael

From: noreply@salesforce.com on behalf of PUC CDMS <hpuc@notify.hawaii.gov>
Sent: Thursday, January 23, 2025 11:21 AM
To: Chu, Michael
Subject: Hawaii PUC CDMS eSERVICES - E-Filing F-318956 FILED Confirmation

[This email is coming from an EXTERNAL source. Please use caution when opening attachments or links in suspicious email.]

E-Filing Filed Confirmation

Aloha Michael Chu,

Your electronic filing to the Hawaii Public Utilities Commission has been **FILED**. You will receive an email when the filing is public.

Please note that filings submitted after 4:30 p.m. Hawaii Standard Time will be deemed "FILED" the next business day. The mere fact of filing shall not waive any failure to comply with Hawaii Administrative Rules Chapter 6-61, Rules of Practice and Procedure Before the Public Utilities Commission, or any other application requirements.

E-Filing Confirmation Number: F-318956
Account: Hawaiian Electric Company, Inc.
Date and Time Submitted: 1/23/2025, 11:20 AM
Case or Docket Reference Number: PC-24334
Case or Docket Number (if applicable): 2011-0206
Filing Category/Type: Miscellaneous Filings / Letters

To view and manage your account, log in to the Hawaii Public Utilities Commission's eServices portal.

This email address is not monitored. Should you have any questions, you may visit our website at <https://puc.hawaii.gov>, email us at puc@hawaii.gov, or call us at 808-586-2020, Monday-Friday 7:45 a.m. - 4:30 p.m.