

BEFORE THE PUBLIC UTILITIES COMMISSION
OF THE STATE OF HAWAII

In The Matter of the Application of)
)
HAWAIIAN ELECTRIC COMPANY, INC.,) DOCKET NO. 2015-0389
HAWAII ELECTRIC LIGHT COMPANY, INC.)
MAUI ELECTRIC COMPANY, LIMITED)
)
For Approval to Establish a Rule to Implement)
a Community-Based Renewable Energy Program,)
and Other Related Matters.)
_____)

THE HAWAIIAN ELECTRIC COMPANIES'
COMMUNITY BASED RENEWABLE ENERGY TARIFF AND
APPENDICES, RFPS AND MODEL CONTRACTS FOR PHASE 2,
TRANCHE 1

Book 8 of 10

Filed December 1, 2020

EXHIBIT 17

Redline of Hawaiian Electric
Rule No. 29 Tariff and Appendices II & V

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

PART I: For Projects Sized Less Than 250kW AC

A. AVAILABILITY

Phase 2 (“Phase 2”) of the Company’s Community-Based Renewable Energy (“CBRE”) program (“Program”) for CBRE Small Projects (as defined below) is available to residential and commercial customers of the Company¹ (“Customers”) as follows:

1. Capacity: Thirty (30) megawatts (MW) of available capacity (“CBRE Small Projects Phase 2 Capacity”) shall be apportioned across the islands of Hawai‘i, Maui and O‘ahu as follows:
 - a. Tranche 1:
 - Hawai‘i: 2.5 MW
 - Maui: 2.5 MW + 0.975 MW transferred from CBRE Phase 1
 - O‘ahu: 15 MW
 - b. Tranche 2:
 - Hawai‘i: 2.5 MW
 - Maui: 2.5 MW
 - O‘ahu: 5 MW
2. Eligibility shall be limited to photovoltaic or wind generation project sizes greater than 4 kW AC and less than 250 kW AC with battery storage strongly recommended. If battery storage is included in the project, the storage capacity and duration of the output shall be at the discretion of the Subscriber Organization but subject always to the limitations, terms and obligations of applicable tariff rules. A CBRE project proceeding under this Tariff Rule No. 29 for Phase 2 shall be referred to as a “CBRE Small Project.”
3. Interconnection of CBRE Small Projects including projects with energy storage shall be subject to the requirements of Rule No. 14H.

¹ The “Company” refers to Hawaiian Electric Company, Inc., Maui Electric Company, Ltd., or Hawaii Electric Light Company, Inc., in their role as “Administrator” of the CBRE Program for the island in which such Company provides electric service to its Customers.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

4. CBRE Small Projects may participate in future grid services programs. Such participation shall be subject to the terms, conditions and eligibility requirements of future rulemaking by the State of Hawai‘i Public Utilities Commission (“Commission”).
5. CBRE Small Projects may participate in future non-wires alternatives opportunities in locations that help defer or obviate investments in transmission and distribution infrastructure, and/or that are located in facilities that provide community resilience benefits. Such participation shall be subject to the terms, conditions and eligibility requirements of future rulemaking by the Commission.

B. CUSTOMER PARTICIPATION AND ELIGIBILITY

A Customer who subscribes to a CBRE Phase 2 facility (“Facility”), defined as and herein referred to as a “Subscriber,” shall meet the following participation and eligibility requirements:

1. Eligible Customers shall be allowed to acquire, lease, or subscribe to, an interest in the energy output (contract capacity) of any eligible CBRE Small Project on the same island as their service address that is allocated CBRE Phase 2 Program capacity to offset their energy consumption.
2. Eligibility:

Customer has a current electricity account with the Company and has (a) received service at the same location for which they are requesting participation for at least 6 months at the time of enrollment and (b) commencing two (2) years after the effective date of this Rule No. 29, has not received any disconnection notifications at the same location within the last 12 months;

Customer is not currently enrolled or participating in Schedule Q, Net Energy Metering, Feed-in Tariff, Standard Interconnection Agreement, Customer Grid Supply, Customer Grid Supply Plus, Smart Export, or Customer Self-Supply tariff program, or similar customer program at the same service location where CBRE participation is requested;

Customer is not currently a Subscriber for another CBRE Phase 1 or Phase 2 Facility; and

For the purpose of satisfying a CBRE Facility’s Residential Customer Requirement per Part I, Section C.11 below, a Subscriber shall be considered a residential customer if the

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Subscriber is served under any of the following Company rate schedules: Schedule R, TOU-R, TOU-RI, TOU EV, or any other residential rate option.

3. Customers shall be required to enter into an appropriate CBRE Subscriber Agreement (“Subscriber Agreement”) with a CBRE subscriber organization (“Subscriber Organization”). The Subscriber Agreement shall contain standard information and provisions that ensure transparency and proper consumer protection. The Subscriber Agreement shall include or be supplemented by, at minimum, the following elements:
 - a. CBRE Phase 2 Facility and Subscriber Organization information
 - i. CBRE Phase 2 Facility name and address;
 - ii. CBRE Subscriber Organization and/or owner name, address, website URL, phone number, and email address;
 - iii. Subscriber name, address, phone number, and email address; and
 - iv. Subscriber’s utility name and account number;
 - b. Financial Information:
 - i. Credit rate (“Credit Rate”) and calculation;
 - ii. Bill credit mechanism and timing;
 - iii. Tax and securities implications;
 - iv. Any fees, charges or payments to be made by the participant to enroll or over the life of the contract;
 - v. Use of escrow account, or other alternative proposed by Subscriber Organization and approved by the Independent Observer to hold or segregate any pre-development enrollment fees or deposits from Subscribers (with appropriate mechanisms to refund such fees/deposits to Subscribers should the Subscriber Organization not complete its Facility), which shall be released to Subscriber Organization upon commercial operation of the Facility; and
 - vi. Transfer, cancellation, termination and/or exit terms and any applicable fees;
 - c. The Subscriber Agency Agreement and Consent Form attached hereto as Appendix I, which each Subscriber Organization shall complete with each Subscriber acquiring, leasing, or subscribing to, an interest in such Subscriber Organization’s CBRE Facility, permitting the sharing of:

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- i. Subscriber's account and energy usage data as required to verify eligibility, determine the appropriate subscription size, and shall not include interval data from advanced metering;
 - ii. Subscription information;
 - iii. Aggregated CBRE Project data and anonymized Subscriber data in response to information requests from the Commission or the State of Hawai'i Department of Commerce and Consumer Affairs, Division of Consumer Advocacy ("CA"); and
 - iv. Subscriber data in response to information requests from the Commission or the CA.
 - d. The standard form disclosure checklist ("Disclosure Checklist") is attached hereto as Appendix II, which each Subscriber Organization shall complete with each Subscriber acquiring an interest in such Subscriber Organization's CBRE Facility.
4. Interested Customers shall (a) obtain confirmation of eligibility and maximum buy-in level and (b) apply to enroll into the CBRE Program through the Company's online portal for the CBRE Program (the "CBRE Portal"). Through the CBRE Portal, Company shall facilitate completion of these tasks, but final approval and enrollment of the Customer into a Subscriber Organization's CBRE Phase 2 Facility shall rest with such Subscriber Organization.
 5. Subscriber's effective kilowatt ("kW") alternating current ("AC") interest in the CBRE Phase 2 Facility shall be calculated based on the Subscriber's portion of the renewable energy output (contract capacity) of the CBRE Phase 2 Facility multiplied by the total contract capacity of the CBRE Phase 2 Facility in kW AC.
 6. Subscribers shall be required to acquire a minimum of 1 kW AC. A lower minimum requirement has been set for Low- and Moderate-Income ("LMI") Subscribers as specified in Part III, Section C.7 herein.
 7. Subscribers shall be permitted to acquire a CBRE Program interest equivalent to an expected production of no more than 100% of their historic energy consumption for the previous 12 months.
 - a. Company shall use the 12 months immediately prior to application submission to determine the Subscriber's previous 12 months of energy consumption.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- b. If Subscriber does not have a 12 month billing history prior to application submission, and there is not 12 months of billing history, including billing history of another customer associated with the Subscriber's premises, the Company shall use the available monthly average consumption multiplied over 12 months in order to generate a proxy average annual consumption.
8. Subscriber shall maintain, for the duration of their participation in the CBRE Program, an electricity account and service address on the same island as the CBRE Phase 2 Facility in which they are participating.
9. Subscriber may change the premises to which the CBRE Phase 2 Facility generation shall be attributed, as long it is on the same island and meets the eligibility requirements set forth herein. No transfer fee shall be applied.
10. For CBRE Phase 2 Projects using a Pay-As-You-Go model for Subscriber interests:
 - a. If a Subscriber wishes to terminate their interest in a CBRE Phase 2 Facility, the Subscriber shall either cancel or terminate their subscription with the Subscriber Organization in accordance with the provisions of the Subscriber Agreement.
 - b. If a Subscriber requests to transfer their interest to another Customer, the Subscriber Organization shall confirm that Customer's eligibility as set forth herein. Any transfer of a Subscriber's Pay-As-You-Go interest in a CBRE Phase 2 Facility must be for 100% of such Subscriber's interest. Any payment for the transfer shall be in accordance with the preset repurchase/resale price schedule outlined in the Subscriber Agreement.
 - i. There shall be no transfer charge/fee if the meter associated with the account remains unchanged.
 - ii. A transfer shall be for no less than all (100%) of the selling Subscriber's interest.
 - iii. Any transfer will not be effective until the Subscriber Organization notifies the Administrator of the transfer. For any notice of transfer on or prior to the twentieth (20th) day of any month, such transfer will be effective as of the first (1st) day of that month. For any notice of transfer after the twentieth (20th) day of a month, the transfer will be effective as of the first (1st) day of the next month.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

A “Pay-As-You-Go” model refers to any lease or subscription interest in a CBRE project or its energy output in which a Subscriber does not make any up-front payment (except for fixed administrative or other costs not based on the level of Subscriber’s interest) to the Subscriber Organization for Subscriber’s interest and instead makes periodic, e.g., monthly, payments to the Subscriber Organization for Subscriber’s interest, with such payment to be commensurate with the extent of the Subscriber’s interest in the CBRE project.

11. For CBRE Phase 2 Projects using a Pay-Up-Front model for Subscriber interests:
- a. If a Subscriber requests to transfer their interest to another Customer, the Subscriber Organization shall confirm that Customer’s eligibility as set forth herein. Any payment for the transfer shall be in accordance with the preset repurchase/resale price schedule outlined in the Subscriber Agreement.
 - i. There shall be no transfer charge/fee if the meter associated with the account remains unchanged.
 - ii. A transfer shall be for no less than all (100%) of the selling Subscriber’s interest.
 - iii. Any transfer will not be effective until the Subscriber Organization notifies the Administrator of the transfer. For any notice of transfer on or prior to the twentieth (20th) day of any month, such transfer will be effective as of the first (1st) day of that month. For any notice of transfer after the twentieth (20th) day of a month, the transfer will be effective as of the first (1st) day of the next month.
 - b. If Subscriber requests to sell all or any portion of their Subscription back to the Subscriber Organization, Subscriber Organization shall buy back the interest in accordance with the preset repurchase/resale price schedule outlined in the Subscriber Agreement.
 - i. Subscriber Organization shall complete the buy-back of the Subscriber’s interest within 30 days of the Subscriber’s request.
 - ii. Upon completion of a subscription buy-back, the Subscriber Organization shall notify the Company by the last day of the month the transaction was completed. The Company shall confirm such buy-back in the Subscriber database and cease CBRE bill credits effective as communicated by the Subscriber Organization on the first day of the month of notification if such transaction was completed on or

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

prior to the twentieth (20th) day of the month. Transactions completed after the twentieth (20th) day of the month will be effective as of the first (1st) day of the next month.

A “Pay-Up-Front” model refers to any asset-type interest in a CBRE project or its energy output where the Subscriber is required to make an up-front payment to the Subscriber Organization for Subscriber’s interest and thereafter is not required to make further periodic payments to the Subscriber Organization for Subscriber’s interest in the CBRE project.

The descriptions for the Pay-As-You-Go and Pay-Up-Front models are limited to payment models for the interest in the CBRE project offered by the Subscriber Organization and do not include other payments that may be necessary from a Subscriber to the Subscriber Organization, such as operations and maintenance, insurance and other cost items that may be specified in the Subscriber Agreement between Subscriber and Subscriber Organization for a particular CBRE project.

12. Subscriber Organization shall determine the eligibility and permitted size of any transferee’s subscription interest by inquiry to the Company electronically through the CBRE Online Portal.
13. Nothing in the Subscriber Agreement shall be deemed to alter or modify any rate schedule, charge, or condition of service established from time to time by the Commission for electric service provided by the Company. All such rates and charges from the Customer’s applicable rate schedule shall apply and remain subject to change in accordance with Commission rules.

C. CREDIT RATE

1. Subscribers to a CBRE Program interest shall continue to receive electric service from the Company and shall be billed in accordance with the Company’s Rule No. 8, the applicable rate schedule and Company rules filed with the Commission. All rates, terms, and conditions from the applicable rate schedules and Company rules shall continue to apply, except for the adjustments described below.
2. Subscribers shall receive CBRE bill credits applied to their electric bill in accordance with the applicable credit rates (“Credit Rates”) for CBRE Phase 2 subscriptions purchased or leased by Subscribers for each rate schedule as follows:

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Energy Credit Rates for Each Applicable Rate Schedule:

Schedule R, TOU-RI, TOU-R, TOU-EV	15.00 cents per kWh daily
Schedule G, TOU-G	15.00 cents per kWh daily
Schedule J, TOU-J, U, SS, EV-F	15.00 cents per kWh daily
Schedule P	15.00 cents per kWh daily
Schedule DS	15.00 cents per kWh daily
Schedule F	15.00 cents per kWh daily

Credit Rates shall be fixed at the above levels for the term of the Subscriber Agreement unless a Competitive Credit Rate Procurement (“CCRP”) is triggered.

The CCRP mechanism will be used when CBRE Phase 2 applications, over a four-month application window, exceed the Tranche 1 capacity or Tranche 2 capacity for each particular island specified in Part I Section A.1 above, in which case, the Tranche 1 credit rate will be dictated by the procurement and the credit rates for Phase 2 Tranche 1 will be capped at Phase 1 credit rates or at the lowest credit rate determined through the CCRP from Tranche 1. Thereafter, the applicable energy credit rates shall be subject to modification by the Commission. The CCRP process is further described in Part I, Section E.5 below.

3. The monthly CBRE bill credit for each Subscriber shall begin to accrue on the first day of the month in which Subscriber completes the purchase or lease of Subscriber’s subscription into a CBRE Phase 2 Facility, provided that Subscriber Organization notifies the Administrator of Subscriber’s subscription no later than the last calendar day of the month in which Subscriber subscribed into the CBRE Phase 2 Facility. Subscriber’s monthly CBRE bill credit shall begin accruing on the first (1st) day of the next month if the purchase or transfer of all or any portion of a Subscriber’s Allocation is made after the twentieth (20th) day of the month. The amount of the Subscriber’s monthly CBRE bill credit shall be equal to the Subscriber’s interest in the energy output of the Facility, multiplied by the Facility’s actual energy output, multiplied by the applicable Credit Rate per kilowatt-hour (“kWh”).
4. A Subscriber’s monthly CBRE bill credit shall be applied to offset eligible charges on the Subscriber’s electric bill no earlier than the 15th day of the following month but no later than two billing cycles. Subscribers will see eligible credits on a future bill depending on the day their meter is read. Eligible charges on the Subscriber’s electric bill shall be all light and power charges.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

5. The Subscriber's electric bill cannot be reduced below the sum of the customer charge, the Green Infrastructure Fee, and any other per-customer charge for the customer's applicable rate schedule or the minimum bill applicable in the underlying tariff, whichever is greater.
6. If the Subscriber's monthly CBRE bill credit exceeds the eligible charges, the value of excess credits shall be carried over to the next billing period(s) within the current 12-month period, as a CBRE bill credit and applied to the Subscriber's electric bill(s) subject to Part I Sections C.4 and C.5 above.
7. Reconciliation will be made at the end of every 12-month period by applying the Subscriber's remaining CBRE bill credit to the Subscriber's remaining eligible charges within the 12-month period. Any CBRE bill credit that remains unused at the end of each 12-month period shall be extinguished.
8. If the Subscriber terminates its CBRE service prior to the end of any 12-month period, the Company shall reconcile the remaining CBRE bill credit to remaining eligible charges at the end of the monthly billing period when service was terminated, similar to the reconciliation that would have been performed at the end of the normal 12-month period. Any CBRE bill credit that remains unused shall be extinguished.
9. Compensation for Unsubscribed Energy:
 - a. "Unsubscribed Energy" is CBRE Phase 2 Facility output that is not associated with any Subscriber subscription and therefore not allocated to a Subscriber. The designated Subscriber Organization under the Standard Form Contract ("SFC") with the Company shall be compensated for Unsubscribed Energy at the same Credit Rate for Subscribers as described in the SFC except as specified in Part I, Section C.9.b below.
 - b. The following shall be effective 6 months from the date of initial commercial operations. Compensation for Unsubscribed Energy shall be as follows:

For any Facility with more than 15% Unsubscribed Energy, the Credit Rate for compensation for the Unsubscribed Energy for that month shall be discounted by the percentage of energy that is unsubscribed.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Unsubscribed capacity shall be calculated at the end of the month and applied retroactively to the CBRE Facility when calculating that month's prior Unsubscribed Energy payment.

Table 1 below illustrates the effect of this Unsubscribed Energy provision as applied to a 100kW CBRE Facility eligible for a 15.00 cents/kWh Credit Rate, assuming varying levels of unsubscribed capacity.

Table 1: Illustrative Treatment of Unsubscribed Energy for CBRE Small Projects

Example CBRE Facility Characteristics			
Credit Rate (cents/kWh)		15.00	
Facility Capacity (kW)		100	
Billing Month	Subscribed Capacity (kW)	Unsubscribed Capacity	Unsubscribed Energy Credit Rate (cents/kWh)
1	25	75%	15.00
2	25	75%	15.00
3	45	55%	15.00
4	65	35%	15.00
5	80	20%	15.00
6	90	10%	15.00
7*	90	10%	15.00
8	90	10%	15.00
9	80	20%	12.00
10	65	35%	9.75
11	75	25%	11.25
12	85	15%	15.00

*Unsubscribed Energy provision becomes applicable

- A Subscriber Organization shall be required to have a minimum of 4 individual Subscribers per CBRE Facility at all times. For a period of 6 months following initial commercial operations, the Subscriber Organization shall incur no payment reduction if it should fall below this minimum number of Subscribers. Effective after 6 months of commercial operations, the following shall be placed into effect for the remainder of the term of the CBRE Facility:

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- a. For any CBRE Facility which does not have the minimum 4 individual Subscribers for any month during the term of its SFC, the unmet percentage of Subscribers to the minimum number of 4 required Subscribers shall reduce the Subscriber Organization's Credit Rate used for compensation for Unsubscribed Energy delivered by such percentage. For example, if a CBRE Small Project has only 3 Subscribers for any given month, the unmet number of Subscribers is 1 and the percentage to the 4 minimum Subscribers required will be 25% and the Subscriber Organization's Credit Rate will be reduced by 25%.
- b. If the Subscriber Organization's Unsubscribed Energy for that CBRE Facility is also greater than 15% in such month, the Credit Rate for compensation for Unsubscribed Energy shall be reduced by the sum of the percentage determined from sub-part a. above plus the percentage of Unsubscribed Energy for that month. If the amount of Unsubscribed Energy is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed Energy was 5% for such month and if the Subscriber Organization's payment for Unsubscribed Energy is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.
- c. If the Subscriber Organization does not have a minimum of 4 individual Subscribers but does not have any Unsubscribed Energy, the Subscriber Organization shall be subject to equivalent liquidated damages as specified below. Continued failure to meet the 4 individual Subscriber threshold under these circumstances by any Subscriber Organization for more than one year shall be construed as an intent to disregard the requirements of this Rule No. 29 and could result in termination and removal from the CBRE Program in accordance with Part I, Section K.3.

Damages for Failure to Maintain Minimum Number of Subscribers: The percentage determined in sub-part a. shall be multiplied by the applicable kWh delivered in such month attributable to 5% Unsubscribed Energy and such amount shall be multiplied by the applicable Credit Rate (the sub-part a. percentage * 15.00 cents/kWh or applicable CCRP rate) to equal a dollar amount liquidated damages for the Subscriber Organization's failure to maintain the requisite number of Subscribers for any given month.

11. Residential Customer Requirement: In Phase 2, 40% of the CBRE Facility's contract capacity shall be reserved for individual subscriptions for residential Customers. For a period of 6 months following initial commercial operations, the Subscriber Organization shall incur no payment reduction if it should fall below this minimum percentage of

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

residential Subscribers. Effective after 6 months of commercial operations, the following shall be placed into effect for the remainder of the term of the CBRE Facility:

- a. For any CBRE Facility which does not have the minimum 40% residential Subscribers for any month during the term of its SFC, the difference in percentage between the project's actual residential Subscriber percentage and the 40% minimum shall reduce the Subscriber Organization's Credit Rate for compensation for Unsubscribed Energy delivered by a factor equal to one-fourth (0.25) of such percentage difference. For example, if a project's residential Subscriber percentage is 30%, the difference, 10%, from the 40% minimum requirement, shall be multiplied by 0.25 ($10\% * 0.25 = 2.5\%$). The 2.5% result shall reduce the Credit Rate for Unsubscribed Energy for that month by such percentage.
- b. If the Subscriber Organization's Unsubscribed Energy for that CBRE Facility is also greater than 15% in such month, the compensation for Unsubscribed Energy delivered in that month shall be reduced by the sum of the percentage payment reduction for the unmet residential Subscriber percentage plus the percentage of Unsubscribed Energy for that month. If the amount of Unsubscribed Energy is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed Energy was 5% for such month and if the Subscriber Organization's payment for Unsubscribed Energy is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.
- c. If the Subscriber Organization does not have the required minimum percentage of Residential Subscribers but does not have any Unsubscribed Energy, the Subscriber Organization shall be subject to equivalent liquidated damages as specified below. Continued failure to meet the Residential Subscriber minimum requirement under these circumstances by any Subscriber Organization for more than one year shall be construed as an intent to disregard the requirements of this Rule No. 29 and could result in termination and removal from the CBRE Program in accordance with Part I, Section K.3.

Damages for Failure to Maintain Minimum Percentage of Residential Subscribers: The percentage determined in sub-part a. shall be multiplied by the applicable kWh delivered in such month attributable to 5% Unsubscribed Energy and such amount shall be multiplied by the applicable Credit Rate (the sub-part a. percentage * 15.00 cents/kWh or applicable CCRP rate) to equal a dollar amount liquidated damages for the Subscriber Organization's failure to maintain the requisite percentage of residential Subscribers for any given month.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

12. Payment reductions from Subscriber Organization's compensation for Unsubscribed Energy under Part I, Sections C.10 and C.11 above shall be cumulative in effect. In any given month after the first 6 months of commercial operations, if the Subscriber Organization fails to meet multiple minimum requirements or exceeds maximum thresholds, the percentage reductions in Subscriber's compensation specified above will be added and the aggregate sum of such percentages shall be used to reduce the Subscriber's compensation for Unsubscribed Energy in any given month.

D. SUBSCRIBER ORGANIZATION ELIGIBILITY

1. Eligibility to be awarded a CBRE Small Project shall be open to all ownership types, including independent power producers, the Companies, and any of their affiliates.
2. For utility self-build projects, the Commission will not require the utility to submit an additional application pursuant to General Order No. 7, but the Commission will hold the bidding utility to the terms of its application, similar to independent power producers.
3. For affiliate and affiliate-related projects, the Commission will not require an additional review pursuant to the Affiliate Transaction Requirements adopted in Docket No. 2018-0065, but the Commission will hold the bidding utility to the terms of their application.

E. SUBSCRIBER ORGANIZATION PARTICIPATION FOR CBRE SMALL PROJECTS

1. A CBRE Small Project may be developed by an approved Subscriber Organization. An applicant seeking to become an approved Subscriber Organization shall be referred to as an "Applicant" until approved.

A CBRE Small Project must be a new facility not otherwise subject to a power purchase agreement with the Company. The CBRE Small Project may participate in such other future grid services and/or non-wires alternative projects as described in Part I, Section A above.

2. Demonstrating transparency and a willingness to engage in early communication with communities is an important part of a Project's viability and success. A community outreach and communications plan ("Community Outreach Plan") is an essential roadmap that guides a Subscriber Organization as they work with various communities

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

and stakeholders to raise awareness and collect input for a project. A Subscriber Organization for a project between 100 kW and 250 kW should have a Community Outreach Plan to provide nearby community members information. The Community Outreach Plan should identify efforts the Subscriber Organization will make to provide the community within a one (1) mile radius of the project boundaries with information regarding the project, including, but not limited to the following information: Project description, Project benefits, government approvals, and development process (including Project schedule). Community outreach requirements for projects that are 250 kW and larger will be detailed in the request for proposals and associated contract documents for such projects.

3. Applications during Tranche 1 of CBRE Phase 2 shall be accepted beginning on the effective date of this Rule No. 29 and continue for 4 months from such date, upon which time the application period shall close.
4. Prior to developing a Facility, an Applicant shall submit a completed application to the Company, which shall provide the following in order to be considered a complete application:
 - a. A one-time, non-refundable application processing fee of \$250 per application;
 - b. Applicant company name, contact information, and address, and indicate their role (e.g., Subscriber Organization, owner, or operator);
 - c. Applicant contact person name, contact information, and address;
 - d. Entity name, contact information, address, and identity role of the Subscriber Organization if approved; if entities other than the Subscriber Organization will act as either owner or operator of the CBRE Facility, name, role identification, contact information, and address shall be provided for those other entities;
 - e. Proposed CBRE Phase 2 Facility name, address, and estimated completion date;
 - f. CBRE Phase 2 Facility system nameplate direct current (DC) capacity, AC output (inverter nameplate), mount location, tracker type, azimuth, and tilt;
 - g. CBRE Phase 2 Facility system description of storage operations, total units, total size per unit (kW), max capacity per unit (kWh), charge/discharge per unit (kW);

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- h. A Certificate of Good Standing for the Applicant obtained from the State of Hawai'i Department of Commerce and Consumer Affairs dated no earlier than 30 days prior to submittal by the Applicant. If the Applicant is a foreign entity, confirmation from the State of Hawai'i Department of Commerce and Consumer Affairs that the Applicant is currently authorized to do business in the State of Hawai'i as of the date of submittal;
- i. Maximum Discounted Credit Bid that the Applicant is willing to accept for its CBRE project for CCRP auction purposes. For example, if an Applicant is willing to accept a maximum discounted Credit Rate of 12 cents/kWh (from the established Credit Rate of 15 cents/kWh), the Applicant shall specify the lowest Discounted Credit Rate for its application at 12 cents/kWh;
- j. Demonstrate project viability by providing site plan with proposed interconnection point, construction plan and commissioning timeline, details of major equipment, and subscriber marketing and outreach timeline and plan, specifically including LMI ratepayers;
- k. Establish a minimum production guarantee (e.g., 85% of projected generation output);
- l. Demonstrate/establish financial creditworthiness through posting of a surety bond, a financial guarantee, a letter of credit, or other sufficient evidence of financial ability to develop the project;
- m. Provide a refundable deposit of \$75/kW AC, through check, wire transfer or credit card, for the installed capacity made available for CBRE. The Independent Observer ("IO") has the authority to lower or waive this deposit requirement for these CBRE Small Projects and/or non-profit subscription organizations. Deposits will be held in an escrow account and refunded within 30 calendar days after the Date of Commercial Operation or upon auction results in which a CBRE Subscriber Organization is not selected. If the CBRE Subscriber Organization informs the Administrator that it will no longer continue to pursue completion of the CBRE Project, or if the Date of Commercial Operation does not occur within the specified timeline (including day-for-day extensions) detailed in the SFC, the Company shall not return to the CBRE Subscriber Organization the deposit paid;
- n. Applicant must also submit with its application all requirements necessary for Company to complete the Rule No. 14H completeness review. See Rule No. 14H at

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Sheets 34D-2 through 34D-3 for these requirements. While applicants shall receive a timestamp for completed applications that comply with this Part I, Section E.4 requirements, such application shall not be deemed complete until Applicant's Rule No. 14H completeness review is deemed complete. Time frames to review and for Applicant to provide requested information shall be as specified in Rule No. 14H;

- o. Demonstrating Site Control for the Site required for the successful implementation of a specific Facility must include all Interconnection Facilities required for the Facility. The need for a firm commitment is necessary to ensure that applications are realistic and shovel-ready so that there is a high likelihood that the proposed project will be developed to completion. In addition, developmental requirements and restrictions such as zoning of the Site and the status of easements must be identified and will be considered in determining whether the application meets the Site Control requirement.

The project "Site" shall be the (1) real property or (2) area upon a structure upon which the CBRE project shall be situated, inclusive of the generating facilities, control facilities and project-owned interconnection facilities for project.

To meet this "Site Control" requirement, Applicant must complete one of the following:

- i. Provide documentation confirming (1) that the Applicant has an existing legally enforceable right to use and control the Site, either in fee simple or under leasehold for a term at least equal to the term of the SFC as specified in the application and (2) the applicable zoning for the Site and that such zoning does not prohibit the development of the Site consistent with the application; or
- ii. Provide documentation confirming, at a minimum, (1) that the Applicant has an executed binding letter of intent, memorandum of understanding, option agreement, or similar document, with the land owner (a "binding commitment") which sets forth the general terms of a transaction that would grant the Applicant the required Site Control, and (2) the applicable zoning for the Site and that such zoning does not prohibit the development of the Site consistent with the application. The binding commitment does not need to be exclusive to the Applicant at the time the application is submitted and may be contingent upon approval of the application and awarding of a project in Phase 2. If multiple applications are provided a binding commitment for the

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

same Site, the documents granting the binding commitments must not prevent the Company from moving forward with the application that otherwise would have been selected.

- iii. Government/Public Lands Only: The above two points may not be feasible where government or publicly owned lands are part of the Site or are required for the successful implementation of the application. In such a case, at a minimum the Applicant must provide a credible and viable plan, including evidence of any steps taken to date, to secure all necessary Site Control for the application, including but not limited to evidence of sufficient progress toward approval by the government agency or other body vested with the authority to grant such approval (as demonstrated by records of the agency). The Applicant will be required, however, to demonstrate Site Control as required in the applicable SFC.
- p. If an Applicant submits an application that does not contain all the required items listed in this Part I, Section E.4 above, the application shall be deemed incomplete and the timestamp for the completed application shall be when the last item(s) is/are received from the Applicant that renders the application complete under Part I, Section E.4 , with the exception of (1) Part I, Section E.4.a, regarding application processing fee payment and (2) Part I, Section E.4.m regarding the refundable deposit. If the (1) application fee and/or (2) refundable deposit are the only missing items and are received within 15 calendar days from the date of submission, the timestamp will be the date the application was submitted electronically. Partially completed applications will be deemed abandoned if all required items are not submitted so as to render the application complete after 60 calendar days.

Applications deemed complete (providing all information required under Part I, Section E.4 above and completing Rule No. 14H completeness review) shall receive a timestamp which shall serve as the date of the Applicant's application for award and queue purposes.

- 5. So long as CBRE Small Project applications do not exceed the CBRE Program capacity available under that classification in Phase 2, CBRE Program capacity shall be awarded to qualified applicants on a first-come, first-served basis and the Credit Rate for all applications awarded capacity shall be as specified in Part I, Section C above.

However, if the CBRE Program capacity requested by Facility applications, at the close of the four-month application window, exceeds the available CBRE Program capacity for CBRE Facilities starting in Phase 2, a CCRP mechanism shall be triggered as a means to

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

award CBRE Program capacity for CBRE Small Projects and to set the applicable Credit Rate for such projects.

Table 2: Awarding CBRE Program Capacity

Awarding CBRE Program Capacity
<ul style="list-style-type: none"> • If applications do not exceed the CBRE Program capacity available under the active Phase, then capacity is awarded on a first-come, first-served basis. • If applications do exceed the available CBRE Program capacity, then a CCRP mechanism will be employed to award capacity. • As part of their application, all Subscriber Organizations must submit the lowest Discounted Credit Rate Bid that they would accept (in increments of 0.1 cents per kW, for example 14.7 cents or 14.6, but not in between). • CCRP ranks bidders by the lowest Discounted Credit Rate Bids and assigns capacity from lowest Discounted Credit Rate to highest until all available capacity is exhausted. • If there is a tie, the project with the earliest timestamp showing either when the application is received (if the application is complete) or when it is deemed complete (if the original submission was incomplete). See Part I, Section E.3.p above. All awarded program capacity will be compensated at the highest accepted Discounted Credit Rate Bid for administrative ease.

Table 3: Example: Competitive Credit Rate Procurement (5 MW of available capacity)

	Discounted Credit Rate Bid (cents/kWh)	Capacity Requested (MW)	Rank	Bid Accepted	Awarded Credit Rate (cents/kWh)	Total Capacity Awarded
Project 1	13.5	3	3	Yes	13.5	5
Project 2	13.3	0.5	2	Yes		
Project 3	12.8	1.5	1	Yes		
Project 4	14	3	4	No		
Project 5	14.2	2	5	No		

6. In the event that the last application to be tentatively accepted to fill the remaining CBRE capacity does not exactly fill the amount of available CBRE Program capacity, the

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Applicant will be provided the opportunity to secure the remaining capacity at the highest accepted credit rate bid but only for the capacity remaining. For example, in Table 3 suppose 6 MW of capacity had been available rather than 5 MW. After Projects 1, 2 and 3 had been awarded capacity based on their winning credit rate bids, 1 MW of capacity would remain available, but the next lowest bidder (Project 4) had proposed a 3 MW project. Under the CBRE Program rules, that bidder would be offered the 1 MW of remainder capacity at its discounted credit rate bid, and, if they refused, then the next lowest bidder would be offered the same and so forth until the capacity was successfully awarded. If the remainder capacity remains unawarded at the end of this described process, the capacity will be allocated to the next active capacity release cycle.

7. Completed Phase 2 applications for CBRE Small Projects that have been allocated Tranche 1 (or Tranche 2, after it is opened) program capacity (“Selected Projects”) shall be accepted into Phase 2 of the CBRE Program. Upon notification by the Administrator, successful Applicants must accept the awarded capacity and the applicable Credit Rate within 10 business days of notification. Selected Projects accepting program capacity shall proceed to Initial Technical Review under Rule No. 14H.
8. Where program capacity was allocated on a first-come, first-serve basis, Selected Projects which drop out or are terminated will not be replaced. Excess capacity not allocated in Tranche 1 will be added to Tranche 2 when it is opened.

If, however, a CCRP mechanism is used to allocate program capacity and there is a queue of applications which were not selected, then a queue process, in effect for 6 months after Selected Projects are notified of their selection, will be in effect to replace allocated capacity should a Selected Project drop out or is terminated after selection. Upon such occurrence during the queue process, the allocation for such Selected Project shall be added back to the capacity allocation for the respective island and the first completed application for a CBRE Small Project in the queue for that island shall be offered the opportunity to become a Selected Project subject to such Applicant agreeing to (1) accept the remaining capacity allocation (up to its original application proposal) and (2) accept the current Credit Rate established from the CCRP mechanism. If the first Applicant in the queue refuses the allocation, the next Applicant will be offered the allocation under the same terms and the process will continue until the program capacity is filled or there are no remaining Applicants in the queue. If unallocated capacity remains unawarded at the end of this described process, the capacity will be allocated to Tranche 2 when it is opened or to the next active capacity release cycle.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

If there is no active queue of available applications, or after the six-month queue process has run, as applicable, any subsequent failure of a CBRE Small Project in Phase 2 shall not be replaced.

9. Phase 2 Tranche 1 will terminate upon the commencement of Phase 2 Tranche 2. Phase 2 Tranche 2 will terminate upon direction by the Commission. If, at the conclusion of Phase 2, there remains excess capacity and no Applicants in the queue desiring to use such capacity, the remaining unused capacity shall be extinguished or added to the next available capacity release, as directed by the Commission.
10. Additional fees and deposit required from Subscriber Organizations in addition to the application processing fee shall include:
 - a. Any applicable interconnection fees, costs and expenses necessary to interconnect the CBRE Phase 2 Facility to the system grid; and
 - b. A \$5/kW AC Program Administration Fee assessed annually commencing on the first day of the month immediately succeeding the date of initial commercial operations for any CBRE Phase 2 Facility. For CBRE Small Projects, this fee will not exceed \$1,000 annually. For CBRE Mid-Tier Projects, this fee will not exceed \$5,000 annually. For CBRE Large Projects, this fee will not exceed \$10,000 annually. For CBRE LMI Projects the Program Administration Fee will be waived.

F. CO-LOCATION LIMITATIONS

If more than one Facility is located on a single parcel of land (i.e., Tax Map Key) and sharing a single point of interconnection is being considered for participation in the CBRE Program, they shall be considered as a single Facility for the purpose of determining whether the cumulative size of the facilities fall within the project size limitations set forth in Part I, Section A. The IO will monitor and review interconnection/program applications to guard against co-location.

G. COMMUNICATIONS AND CONTROLLABILITY

1. The Facility shall include a telemetry and control interface which allows the Company to remotely measure, monitor, evaluate and verify technical compliance, CBRE Facility performance, and power quality and, if necessary, control the CBRE Facility (“Communication and Controls”). The acceptable method(s) of implementing the

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Communication and Controls requirements will be specified by the Company and may be modified after technical review. Such Communication and Controls will be securely achieved through available cellular networks or comparable technology. Monitoring will be performed by system dispatchers or operators at the Company's control center.

2. Current Communication and Controls through cellular or comparable technology shall require a telemetry and control interface capable of monitoring of the following data points. In addition, the cellular or comparable technology control will allow the utility to trip and/or curtail the interrupting device.

Telemetry:

- a) Facility Online/Offline Status
- b) Facility output (kW) that is being exported to the Company System
- c) Facility's confirmation of a Company Control being received and the value of that control as implemented (control echo from Facility controller)
- d) If applicable: Status of Facility's distribution/generation tie breaker CB-A (HECO# XXXX)

Control:

- a) Export limit to the Company System, to be specified as a setpoint and/or discrete on/off control [i.e. may be an active power output control setpoint in a percentage of maximum capacity]
- b) If applicable: Customer's distribution/generation tie breaker CB-A (HECO# XXXX)

The CBRE Facility's Communication and Controls must be capable of supporting, at a future date, the monitoring of additional telemetry data as may be requested by the Company. The Company may request in writing to the Subscriber Organization that the Communications and Control provide some or all of the following data points, as applicable:

- a. Distribution line amps (3 phase), distribution voltage (3 phase L-N), frequency, NET kW, NET kVAR, and NET power factor at point of interconnection. Power factor to be a calculated value;
- b. PV kW and kVAR output;
- c. BESS kW and kVAR output/charge;
- d. Received kWh accumulator, sent kWh accumulator, received kVARh accumulator, Sent kVARh accumulator;

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- e. Plane of Array Solar Irradiance in Watts/m²;
- f. kW output for each inverter;
- g. Status for each inverter;
- h. Facility Net Power Possible (kW);
- i. Volt-Var curve and deadband settings;
- j. Volt-Var Enabled/Disabled Status;
- k. Volt-Watt curve and deadband settings;
- l. Volt-Watt Enabled/Disabled Status;
- m. Frequency-Watt curve and deadband settings;
- n. BESS State of Charge (%);
- o. BESS Energy remaining (kWH);
- p. kW set point for each inverter.

The Subscriber Organization shall make the requested data points available to the Company within 90 days of Company's written request and at no additional cost to the Company. If the data points are not made available to the Company within 90 days, or not to the Company's satisfaction, the Company may take corrective action including reducing the Facility's export or disconnecting the Facility from the system until the points are provided to the Company's satisfaction.

H. INTERCONNECTION

1. All CBRE Phase 2 Facilities shall be designed to interconnect and operate in parallel with the Company's system without adversely affecting the operations of its customers and without presenting safety hazards to the Company's or other customers' personnel. Such Facilities and the interconnection systems shall be in compliance with all applicable safety and performance standards of the National Electric Code (NEC), the Institute of Electrical and Electronics Engineers (IEEE), the Company's interconnection standards and procedures provided in Rule No. 14H, and Rule No. 19, as amended from time to time, and also subject to any other requirements as may be specified in the Interconnection Agreement or the SFC, attached hereto as Appendix IV.
2. CBRE Phase 2 Facilities interconnected at the Distribution Level² that are selected shall follow the applicable Rule No. 14H interconnection process at the time of

² Distribution system (Level) is defined as interconnection to electrical wires, equipment, and other facilities at the distribution voltage levels (such as 25kV (Hawaiian Electric only), 12kV, or 4kV) owned or provided by the Company, through which the utility provides electrical service to its customers.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

interconnection with an added provision of an expedited review. An expedited review of a CBRE Phase 2 Facility shall be applied as follows:

- If an interconnection requirements study (IRS) is required, the IRS shall be completed within 90 calendar days after all information required to commence and complete the IRS is provided by the Subscriber Organization.
- If the Facility is served by a dedicated service transformer and on a circuit with available hosting capacity an IRS shall not be required. Any necessary mitigation required for an applicable facility to interconnect shall be determined within the standard initial technical or supplemental review timeframe.

Exceptions from the expedited review that would still need to be subject to the standard timelines in Rule 14H:

- CBRE systems on 4kV and 2.4 kV circuits
 - CBRE systems on Moloka'i and Lāna'i
3. CBRE Phase 2 Facilities interconnecting at the Sub-Transmission level shall follow the interconnection process applicable to their Facilities at the time of interconnection.
 4. Each CBRE Phase 2 Facility shall have one interconnection point and suitable metering equipment to measure the energy output and data required for calculation of Curtailment (as defined in the SFC) of the Facility.

I. SUBSCRIBER ORGANIZATION AGREEMENTS

1. Successful Subscriber Organizations (completed application process and is offered CBRE Program capacity) shall execute the SFC and Interconnection Agreement for CBRE Small Projects with the Company after successful completion of the Rule No. 14H technical review. Prior to executing the SFC and Interconnection Agreement, but only after the Subscriber Organization has been awarded CBRE Phase 2 program capacity, Subscriber Organizations may announce the availability, market, and solicit Subscribers provided that they disclose the project is not yet final. Subscriber Organizations may also accept deposits for interests in such Subscriber Organization's CBRE Facility provided that the Subscriber Organization has established an IO-approved escrow account. Subscriber Organizations shall not be permitted to formally complete subscriptions with Subscribers until the Subscriber Organization has executed and delivered to the Company the applicable SFC and Interconnection Agreement or PPA and all other required

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

documents and agreements with Company necessary for the Subscriber Organization to commence development and construction of its CBRE Facility.

2. The SFC and Interconnection Agreement shall remain in effect for the Term set forth therein.
3. Subscriber Organizations shall pay fees as described in Part I, Sections E.4 and Part I, Section E.10 above.
4. Subscriber Organizations shall ensure CBRE Facilities are built within the specific number of months as specified in the SFC.
5. Subscriber Organizations are responsible for their own operation and maintenance of their Facility to ensure the Facility meets agreed performance warranties, pursuant to the terms and conditions set forth in the applicable SFC, Interconnection Agreement and/or Rule No. 14H.
6. Electric energy delivered to the Subscriber Organization by the Company shall be billed under the Company's applicable rate schedule. Electric energy delivered to the Subscriber Organization by the Company shall be metered separately from the electric energy delivered by the Subscriber Organization to the Company, either by use of multiple meters or a meter capable of separately recording the inflow and outflow of electricity. Electric energy generated by the CBRE Small Project shall not be used to offset electric energy needs of the Facility itself so as to maximize the output of the Facility and the corresponding bill credits of the Subscribers to such Facility.
7. Subscriber Organization will calculate and will be responsible for the accuracy of the Subscriber's monthly credit. The Subscriber's monthly credit will be provided by the Subscriber Organization to the Company in dollars, per Part I, Section C above and the SFC, no later than ten days after the end of each calendar month.
8. Subscriber Organization's notification of a Subscriber's acquisition of a subscription shall be Subscriber Organization's representation and warranty that the Subscriber Organization has executed a Subscriber Agreement with the Subscriber and provided a completed Disclosure Checklist executed by the Subscriber that is attached to the Subscriber Agreement for such Subscriber. The Administrator, IO for the CBRE Program, or the Commission may request copies of all Subscriber Agreements and/or Disclosure Checklists completed by the Subscriber Organization with its Subscribers at any time during the term of the Subscriber Organization's Facility.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

9. The Company may, but shall not be required to, confirm that the Subscribers submitted by the Subscriber Organization are qualified pursuant to Part I, Section B above for participation in the CBRE Phase 2 Program. If any Subscribers are not qualified or are not purchasing an interest within the allowed limits set out in Part I, Section B above, then the Subscribers shall not be accepted into Phase 2 of the CBRE Program and the Company shall notify the Subscriber Organization of all disqualified Subscribers and remove them from the roster of that Subscriber Organization's list of Subscribers.
10. Generator/Equipment Certification By Subscriber Organization: The Subscriber Organization shall ensure that the CBRE Projects utilize inverter technology compliant with Institute of Electrical and Electronics Engineers IEEE Std 1547-2018, Underwriters Laboratories and the Company's Source Requirement Document Version 2.0 (though not preferred, the Company will accept compliance with the Company's Source Requirement Document Version 1.1 for CBRE Projects with an executed Interconnection Agreement and SFC prior to or on June 30, 2021). The Subscriber Organization shall certify that the installed generating equipment will meet the appropriate preceding requirement(s) and can supply documentation that confirms compliance, including a certification of the same from the Installing Electrical Contractor upon request by the Company.

J. ALLOWED CBRE FACILITY DEVELOPMENT TIMEFRAME

1. Pre-Execution Requirements: Prior to execution of the SFC and Interconnection Agreement, CBRE Facilities must comply with the requirements of this CBRE Rule No. 29 and prove that the CBRE Facility is "shovel-ready" and actively progressing towards completion. Company shall issue a written notice to the Subscriber Organization that will list all documentation that is required from the Subscriber Organization and/or any action that must be taken by the Subscriber Organization in order to comply with the CBRE Rule No. 29. Unless otherwise expressly specified in an existing tariff, the Subscriber Organization shall have 15 calendar days from the date of such notice to submit the required documentation and/or provide evidence that the required action has been completed.
2. Project Development Updates: Once the SFC and Interconnection Agreement are executed the Subscriber Organization agrees to provide the Company informational updates related to the development of the CBRE Facility upon request. Unless otherwise expressly specified in an existing tariff, the Subscriber Organization shall have 15 calendar days from the date of such notice to submit the required documentation and/or

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

provide evidence that the required action has been completed. These updates can include but are not limited to:

- Construction Milestones
- Financing
- Governmental Approvals for Development
- Site Control
- Land Rights for Company-Owned Interconnection Facilities
- Design and Engineering
- Major Procurement
- Construction
- Interconnection
- Startup Testing and Commissioning

3. Commercial Operations Date: CBRE Phase 2 Facilities must be placed into operation within the timeframe specified in the SFC and measured from the Execution Date of the SFC. After completion of required testing by the Company, a Subscriber Organization will be permitted to commence commercial operations as of the first (1st) day of the month immediately following the Company's acceptance of the CBRE Phase 2 Facility.

K. REMOVAL OF CBRE FACILITY FROM CBRE PROGRAM AND TERMINATION:

1. Failure to Meet Pre-Execution Requirements or Post-Execution Requirements: Should a Subscriber Organization fail to comply with pre-execution (before execution of the Interconnection Agreement or SFC) requirements, the Subscriber Organization's Facility shall be subject to removal from the CBRE Program. Should a Subscriber Organization fail to meet post-execution requirements specified in this Rule No.29, the SFC or the Interconnection Agreement, the SFC and the Interconnection Agreement shall be subject to termination in accordance with the terms of the SFC, the Interconnection Agreement (as applicable) and this Rule No. 29. Company, with concurrence of the IO, shall notify the Subscriber Organization when a requirement has been missed or defaulted upon (after any applicable cure period) in accordance with the notice provisions under the SFC or the Interconnection Agreement. The Subscriber Organization shall have 5 business days to provide proof that the Company and IO's determination was in error. If no response is received or if the proof is deemed insufficient by the Company and IO, the Subscriber Organization's Facility in question may be removed from the CBRE Program or the SFC and Interconnection Agreement may be terminated, as may be applicable, with notice to the Subscriber Organization, which termination shall be effective no earlier than 30 days after such notice. Company shall provide a copy of such notice of termination to all Subscribers of such Facility, the IO and the Commission. Concurrence of both the

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Company and the IO shall be required before a CBRE Facility can be removed from the CBRE Program or an SFC and Interconnection Agreement can be terminated. Upon removal of a CBRE Facility from the CBRE Program or termination of an SFC and Interconnection Agreement, any fees and security deposits paid to the Company by the Subscriber Organization for such Facility shall be forfeited.

2. Failure to Meet Commercial Operations Date: Should a Subscriber Organization fail to place a CBRE Phase 2 Facility into operation within the timeframe specified in the SFC, the SFC (and Interconnection Agreement) may be terminated and any fees and security deposits paid to the Company by the Subscriber Organization will be forfeited all as specified in the SFC. If terminated by the Company, Subscriber Organization shall not retain its capacity and/or queue space in the CBRE Program once terminated. If the Subscriber Organization subsequently wishes to complete its CBRE Phase 2 Facility, the Subscriber Organization will be required to re-apply to be a Subscriber Organization under these tariff rules, subject to all requirements herein, including capacity limitations and payment of fees.
3. Failure to Comply with CBRE Program Tariff: Should a Subscriber Organization fail to abide by any of the CBRE Program rules of this Rule No. 29, the Subscriber Organization's CBRE Facility may be subject to termination and removal from the CBRE Program. If the IO is still overseeing the CBRE Program, the Company shall obtain concurrence from the IO before any termination of a CBRE Facility may occur. No termination may occur prior to 30 days after notice of termination is provided by the Company to the Subscriber Organization.
4. IO Oversight: The IO will monitor the CBRE Small Projects to ensure an impartial and fair process. The IO's oversight over CBRE Small Projects shall continue until projects reach commercial operations, subject to direction and oversight by the Commission.

L. EXTENSIONS FOR GOOD CAUSE

When extraordinary circumstances exist that may cause a Subscriber Organization to miss a pre-execution requirement, post-execution milestone or delay the completion of a CBRE Facility within the allowed Facility development timeframe, the Subscriber Organization may request an extension, not to exceed 90 days, of the applicable deadline. All requests for extensions must be made at the time of the event that necessitated the need for an extension. The Company and the IO may each unilaterally approve a request for an extension. A request for an extension may only be rejected by the joint approval of the Company and IO. To the extent that any delays are caused by the Company, a day-for-day extension of time for

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

the period of the delay shall be granted to the affected CBRE Facility to comply with the applicable deadline.

M. COMMISSION OVERSIGHT

The Commission shall have ultimate oversight over the CBRE Program. Material disputes unresolved after consultation with the IO may be presented to the Commission for review and the Commission may issue guidance and/or orders to resolve such disputes consistent with this Rule No. 29. Contractual disputes between Subscribers and Subscriber Organizations and/or between Subscriber Organizations and Company shall be resolved in accordance with the applicable contract between the parties. The IO, pursuant to the Framework, may act as a mediator in any dispute between Subscriber Organizations and the Company.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

PART II: For CBRE Project Sizes 250kW and Above

A. AVAILABILITY AND PROGRAM CHARACTERISTICS

1. Availability and Capacity

- a. Phase 2 of the Company's CBRE Program is available to Customers.
- b. Capacity: Two hundred (200) megawatts (MW) of available capacity shall be apportioned across the islands of Hawai'i, Maui and O'ahu as follows:

Tranche 1:

Hawai'i: 12.5 MW
Maui: 12.5 MW
O'ahu: 75 MW

Tranche 2:

Hawai'i: 12.5 MW
Maui: 12.5 MW
O'ahu: 75 MW

Moloka'i: 2.75 MW (combined for Tranches 1 and 2)
Lāna'i: 3 MW (combined for Tranches 1 and 2)

2. Project Classes: Eligibility shall be limited to photovoltaic or wind generation project sizes greater than or equal to 250kW up to 5 MW (O'ahu) and 2.5 MW (Hawai'i and Maui) ("CBRE Mid-Tier Projects"). All projects proposed with sizes above the CBRE Mid-Tier Projects are referred to hereafter as ("CBRE Large Projects").
3. Project selection for the allocated Capacities specified above shall be accomplished by a request for proposals ("RFP") conducted under the applicable competitive bidding framework rules issued by the Commission.³ All capacity available for Moloka'i and Lāna'i will be available in single procurement in Tranche 1. CBRE project procurement for Lāna'i shall be combined with the Company's Variable Renewable Dispatchable Generation Paired With Energy Storage RFP. Details for all RFPs will be available when such RFPs are issued following Commission direction and order.

³ Currently, the Framework for Competitive Bidding or the "Framework" dated December 8, 2006, adopted by the Commission in Docket No. 03-0372.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- a. Interconnection of CBRE Mid-Tier Projects shall be specified in the Power Purchase Agreement for Renewable Dispatchable Generation for CBRE Mid-Tier Projects (the “Mid-Tier RDG PPA”) and applicable rules and requirements under Rule No. 14H.
- b. Interconnection of CBRE Large Projects shall be specified in the Power Purchase Agreement for Renewable Dispatchable Generation for CBRE Large Projects (the “Large RDG PPA”)
- c. Battery storage requirements shall be specified in the applicable Mid-Tier RDG PPA or Large RDG PPA (references to “RDG PPA” herein shall mean the Mid-Tier RDG PPA or the Large RDG PPA, as applicable).
- d. Independent RFP solicitations will be conducted by the applicable Company for the islands of Hawai‘i, O‘ahu and Maui for CBRE projects dedicated to LMI customers (“CBRE LMI Projects”). There will be no cap on the size of any CBRE LMI Project, and a minimum project size of 250 kW. The form of contract used, either the Mid-Tier RDG PPA or the Large RDG PPA, including provisions regarding interconnection and battery storage, will be predicated on project size and subject to system limitations established by the Company. See Part III below.

B. CUSTOMER PARTICIPATION AND ELIGIBILITY

The Customer participation and eligibility requirements of Part I, Section B of this Rule No. 29 shall apply to Customer participation in CBRE Mid-Tier Projects and CBRE Large Projects.

C. CREDIT RATE

1. Subscribers who subscribe to a CBRE Program interest shall continue to receive electric energy from the Company in accordance with Rule No. 8, the applicable rate schedule and Company rules filed with the Commission. All rates, terms, and conditions from the applicable rule, rate schedules and Company rules shall continue to apply.
2. For CBRE Mid-Tier Projects and CBRE Large Projects the Subscriber’s bill credit will be equal to the Subscriber’s interest in the availability of the CBRE Facility’s energy output, expressed as a percentage of the Facility’s Contract Capacity multiplied by the Lump Sum Payment specified in the applicable RDG PPA, which shall result in a dollar amount CBRE bill credit per month. Applicants responding to any CBRE RFP shall be required to bid a proposed Lump Sum Payment as required under the applicable RFP in

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

order to determine the Lump Sum Payment. A Subscriber's bill credit may be reduced pursuant to the applicable RDG PPA so long as such circumstances are disclosed by the Subscriber Organization in the Disclosure Checklist.

3. The applicable RFP for each island shall determine the CBRE Mid-Tier Project(s) and/or CBRE Large Projects in the Final Award Group. Each Final Award Group Project's bid-specified Lump Sum Payment shall determine the corresponding CBRE bill credit for a Subscriber's interest in such project.
4. The monthly CBRE bill credit will not begin to accrue until commercial operations is achieved. The monthly CBRE bill credit for each Subscriber shall then begin to accrue on the first (1st) day of the month in which Subscriber completes the acquisition of Subscriber's subscription into a CBRE Phase 2 Facility, provided that Subscriber Organization promptly notifies the Administrator of Subscriber's subscription no later than the last calendar day of the month in which Subscriber subscribed into the CBRE Phase 2 Facility. Subscriber's monthly CBRE bill credit shall begin accruing on the first (1st) day of the next month if the purchase or transfer of all or any portion of a Subscriber's Allocation is made after the twentieth (20th) day of the month. The amount of the Subscriber's monthly CBRE bill credit shall be equal to the Subscriber's interest in the Facility's contract capacity (measured as a percentage) multiplied by the Facility's Lump Sum Payment.
5. A Subscriber's monthly CBRE bill credit shall be applied to offset eligible charges on the Subscriber's electric bill no earlier than the 15th day of the following month but no later than two billing cycles. Subscribers will see eligible credits on a future bill depending on the day their meter is read. Eligible charges on the Subscriber's electric bill shall be all light and power charges.
6. The Subscriber's electric bill cannot be reduced below the sum of the customer charge, the Green Infrastructure Fee, and any other per-customer charge for the customer's applicable rate schedule or the minimum bill applicable in the underlying tariff, whichever is greater.
7. If the Subscriber's monthly CBRE bill credit exceeds the eligible charges, the value of excess credits shall be carried over to the next billing period(s) within the current 12-month period, as a CBRE bill credit and applied to the Subscriber's electric bill(s) subject to Part II, Sections C.5 and C.6 above. Reconciliation will be made at the end of every 12-month period by applying the Subscriber's remaining CBRE bill credit to the

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Subscriber's remaining eligible charges within the 12-month period. Any CBRE bill credit that remains unused at the end of each 12-month period shall be extinguished.

8. If the Subscriber terminates its CBRE participation prior to the end of any 12-month period, the Company shall reconcile the remaining CBRE bill credit to remaining eligible charges at the end of the monthly billing period when service was terminated, similar to the reconciliation that would have been performed at the end of the normal 12-month period. Any CBRE bill credit that remains unused shall be extinguished.
9. Compensation for Unsubscribed RDG Availability.

- a. "Unsubscribed RDG" is CBRE Phase 2 Facility Contract Capacity availability that is not associated with any Subscriber subscription and therefore not allocated to a Subscriber. The designated Subscriber Organization under the RDG PPA with the Company shall be compensated for this Unsubscribed RDG as a proportion of the Facility's Lump Sum Payment equal to the percentage of the unallocated portion of the Facility's contract capacity to the total contract capacity multiplied by the Lump Sum Payment, except as specified in sub-part 9.b below.
- b. The following shall be effective 6 months from the date of initial commercial operations. Compensation for Unsubscribed RDG shall be as follows:

For any Facility with more than 15% Unsubscribed RDG, the compensation for the Unsubscribed RDG availability for that month shall be discounted by the percentage of Unsubscribed RDG.

Unsubscribed capacity shall be calculated at the end of the month and applied retroactively to the CBRE Facility when calculating that month's Unsubscribed RDG payment.

Table 4 below illustrates the effect of this Unsubscribed RDG provision as applies to a CBRE Facility with a contract capacity of 1MW (1000kW), assuming varying levels of unsubscribed capacity.

Table 4: Treatment of Unsubscribed RDG for CBRE Mid-Tier and Large Projects

Example CBRE Facility Characteristics	
Lump Sum Payment (\$)	1000.00
Facility Capacity (kW)	1000

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

Billing Month	Subscribed Capacity (kW)	Unsubscribed Capacity (%)	Lump Sum Payment Attributable to SO (\$)	Lump Sum Payment with Unsubscribed RDG % Reduction (\$)
1	250	75%	750	750.00
2	250	75%	750	750.00
3	450	55%	550	550.00
4	650	35%	350	350.00
5	800	20%	200	200.00
6	900	10%	100	100.00
7*	900	10%	100	100.00
8	900	10%	100	100.00
9	800	20%	200	200-20% = 160.00
10	650	35%	350	350-35% = 227.50
11	750	25%	250	250-25% = 187.50
12	850	15%	150	150-0% = 150.00

*Unsubscribed RDG provision becomes applicable

10. A Subscriber Organization shall be required to have a minimum of 4 individual Subscribers per CBRE Facility at all times. For a period of 6 months following initial commercial operations, the Subscriber Organization shall incur no payment reduction if it should fall below this minimum number of Subscribers. Effective after 6 months of commercial operations, the following shall be placed into effect for the remainder of the term of the CBRE Facility:
- a. For any CBRE Facility which does not have the minimum 4 individual Subscribers for any month during the term of its PPA, the unmet percentage of Subscribers to the minimum number of 4 required Subscribers shall reduce the Subscriber Organization's allocation of Unsubscribed RDG delivered in such month by such percentage. For example, if a CBRE Mid-Tier or CBRE Large Project has only 3 Subscribers for any given month, the unmet number of Subscribers is 1 and the percentage to the 4 minimum Subscribers required will be 25%. The Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG will be reduced by 25%.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- b. If the Subscriber Organization's Unsubscribed RDG for that CBRE Facility is also greater than 15% in such month, the Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG delivered in that month shall be reduced by a percentage equal to the sum of (1) the percentage determined in sub-part a. above and (2) the percentage of Unsubscribed RDG for that month. If the amount of Unsubscribed RDG is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed RDG was 5% for such month and if the Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.
- c. If the Subscriber Organization does not have a minimum of 4 individual Subscribers but otherwise has no Unsubscribed RDG, the Subscriber Organization shall be subject to liquidated damages as specified below. Continued failure to meet the 4 individual Subscriber threshold under these circumstances by any Subscriber Organization for more than one year shall be construed as an intent to disregard the requirements of this Rule 29 and could result in termination and removal from the CBRE Program in accordance with Part I, Section K.3.

Damages for Failure to Maintain Minimum Number of Subscribers. The percentage determined in sub-part a. shall be multiplied by the amount equal to 5% of the applicable monthly Lump Sum Payment and the resulting dollar amount shall be the liquidated damages for the Subscriber Organization's failure to maintain the minimum number of Subscribers for any given month.

11. Residential Customer Requirement. In Phase 2, 40% of the Facility's CBRE capacity shall be reserved for individual subscriptions for residential Customers. For a period of 6 months following initial commercial operations, the Subscriber Organization shall incur no payment reduction if it should fall below this minimum percentage of residential Subscribers. Effective after 6 months of commercial operations, the following shall be placed into effect for the remainder of the term of the CBRE Facility:
- a. For any CBRE Facility which does not have the minimum 40% of the Facility's CBRE capacity allocated to residential Subscribers for any month during the term of its PPA, the difference in percentage between the project's actual residential Subscriber percentage and the 40% minimum shall reduce the Subscriber Organization's allocation of the Lump Sum Payment allocated to Unsubscribed RDG. The Subscriber Organization's allocation of the Lump Sum Payment delivered shall be reduced by a factor equal to one-fourth (0.25) of such percentage difference. For

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

example, if a project's residential Subscriber percentage is 30%, the difference, 10%, from the 40% minimum requirement, shall be multiplied by 0.25 ($10\% * 0.25 = 2.5\%$). The 2.5% result shall be used to reduce the Subscriber Organization's allocation of the Lump Sum Payment by such percentage.

- b. For CBRE Mid-Tier Projects and CBRE Large Projects which propose in its bid proposal a higher residential Subscriber goal than the 40% minimum, e.g., 50%, such Subscriber Organization shall be required to meet such goal and will be subject to a reduction in its allocation of the Lump Sum Payment for failing the 40% minimum but at a lower rate. A failure to reach the Subscriber's pledged goal for residential Subscribers above the 40% shall be subject to a reduction in the Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG delivered in the net month by a factor equal to one-tenth (0.10) of the percentage difference between the Subscriber Organization's pledged percentage greater than the 40% minimum percentage and the actual percentage above the 40% minimum. For example, if a Subscriber Organization pledges a 50% minimum residential Subscriber percentage and, for a given month, only has 45% residential Subscribers, the shortfall from its goal and the actual percentage above 40% is 5%. The Subscriber Organization's resulting payment reduction shall be $0.10 * 5\% = 0.5\%$. If the Subscriber Organization instead had only 20% residential Subscribers, the Subscriber Organization would be subject to a reduced allocation of the sum of $(0.25 * 20\%)$ plus $(0.10 * 10\%) = 5\% + 1\% = 6\%$.
- c. If the Subscriber Organization's Unsubscribed RDG for that CBRE Facility is also greater than 15% in such month, the allocation of the Lump Sum Payment for Unsubscribed RDG in that month shall be reduced by the sum of the percentage payment reduction for the unmet residential Subscriber plus the percentage of Unsubscribed RDG for that month. If the amount of Unsubscribed RDG is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed RDG was 5% for such month and if the Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.
- d. If the Subscriber Organization does not have the required minimum percentage of residential Subscribers but does not have any Unsubscribed RDG, the Subscriber Organization shall be subject to equivalent liquidated damages as specified below. Continued failure to meet the Residential Subscriber minimum requirement under these circumstances by any Subscriber Organization for more than one year shall be

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

construed as an intent to disregard the requirements of this Rule No. 29 and could result in termination and removal from the CBRE Program in accordance with Part I, Section K.3.

Damages for Failure to Maintain Minimum Percentage of Residential Subscribers. The percentage determined in sub-part a. shall be multiplied by amount equal to 5% of the applicable monthly Lump Sum Payment and the resulting dollar amount shall be the liquidated damages for the Subscriber Organization's failure to maintain the required percentage of residential Subscribers for any given month.

12. Payment reductions from Subscriber Organization's allocation for Unsubscribed RDG under Part II, Sections C.10 and C.11 above shall be cumulative in effect. In any given month after the first 6 months of commercial operations, if the Subscriber Organization fails to meet multiple minimum requirements or exceeds maximum thresholds, the percentage reductions in Subscriber's allocation specified above will be added and the aggregate sum of such percentages shall be used to reduce the Subscriber's allocation for Unsubscribed RDG in any given month.

D. SELECTION PROCESS TO AWARD CBRE PROGRAM CAPACITY FOR PROJECTS GREATER THAN 250KW

1. A Competitive Bidding (RFP) Process developed by Company with oversight by the IO shall be utilized to select eligible Subscriber Organizations to participate in the CBRE Program other than the allocation for CBRE Small Projects (See Part I of this Rule No. 29). The Company shall adhere to the Framework to administer the RFP Process.
2. Price and Non-Price Criteria as designated in the RFP shall be the primary evaluated criteria reviewed by the Company, which criteria shall be more particularly described in the RFP.
3. IO Oversight. The IO will monitor the RFPs to ensure an impartial and fair process. The IO's oversight shall continue through, (1) selection and execution of the Mid-Tier RDG PPA and (2) selection and negotiation of the Large RDG PPA. IO oversight and involvement shall be specified in the RFP but subject always to direction and oversight by the Commission.

E. SUBSCRIBER ORGANIZATION ELIGIBILITY

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

1. Except where further defined in an individual RFP, eligibility to bid into the RFPs for Phase 2 of the CBRE Program for projects 250kW and greater shall be open to all bidders, including independent power producers, the Companies (except for the CBRE LMI RFPs), and any of their affiliates.
 2. For utility self-build projects with name plate capacities up to 5MW on O‘ahu and up to 2.5MW on Maui and Hawai‘i Island, the Commission will not require the utility to submit an additional application pursuant to General Order No. 7, but the Commission will hold the bidding utility to the terms of its bid, similar to independent power producers.
 3. For affiliate and affiliate-related bids on projects with name plate capacities up to 5MW on O‘ahu and up to 2.5MW on Maui and Hawai‘i Island, the Commission will not require an additional review pursuant to the Affiliate Transaction Requirements adopted in Docket No. 2018-0065, but the Commission will hold these bidders to the terms of their bids.
 4. All independent power producers, including affiliates and affiliate-related entities shall also meet the eligibility requirements specified in the RFP.
- F. APPROVAL PROCESS FOR PROJECTS SELECTED TO THE CBRE PHASE 2 FINAL AWARD GROUP
1. CBRE Mid-Tier Projects
 - a. Shall be permitted to proceed toward development and construction of its project with no further approval required by the Commission.
 - b. After the technical review has been completed the Subscriber Organization shall be required to execute and deliver the pre-approved CBRE Mid-Tier RDG PPA before proceeding to develop its project.
 2. CBRE Large Projects
 - a. Shall negotiate the terms and conditions of the Large RDG PPA that will govern the terms of the project with the Company.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- b. The Large RDG PPA between the Subscriber Organization and the Company for each CBRE Large Project shall be subject to Commission review and approval before proceeding to develop its project.
3. CBRE LMI Projects
 - a. For CBRE LMI Projects that fall within the CBRE Mid-Tier Project size, the provisions of Part II, Section F.1 shall apply.
 - b. For CBRE LMI Projects that fall within the CBRE Large Project size, the provisions of Part II, Section F.2 shall apply.
 4. Development timeframes, milestones, and potential extensions shall be governed by the applicable RDG PPA and/or this Rule No. 29.

G. CO-LOCATION LIMITATIONS

If more than one Facility is located on a single parcel of land (i.e., Tax Map Key) and sharing a single point of interconnection is being considered for participation in the CBRE Program, they shall be considered as a single Facility for the purpose of determining whether the cumulative size of the facilities fall within the project size limitations set forth in Part II, Section A above. The IO will monitor and review interconnection/ program applications to guard against co-location.

H. COMMUNICATIONS AND CONTROLABILITY

The CBRE Mid-Tier Projects and CBRE Large Projects shall require additional communications and control systems to ensure the appropriate level of company dispatch as specified in the applicable RDG PPA.

I. COMMISSION OVERSIGHT

The Commission shall have ultimate oversight over the CBRE Program. Material disputes regarding the CBRE Program unresolved after consultation with the IO may be presented to the Commission for review and the Commission may issue guidance and/or orders to resolve such disputes consistent with this Rule No. 29. Contractual disputes between Subscribers and Subscriber Organizations and/or between Subscriber Organizations and Company shall be resolved in accordance with the applicable contract between the parties. The IO, pursuant

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

to the Framework, may act as a mediator in any dispute between Subscriber Organizations and the Company.

J. SUBSCRIBER ORGANIZATION AGREEMENTS

1. Subscriber Organizations selected in the Final Award Group for any CBRE RFP that have accepted the Company's offer to proceed with its project shall negotiate the appropriate PPA for its project size as specified in Part II, Section F above. Prior to executing the PPA, but only after the Subscriber Organization has been awarded CBRE Phase 2 program capacity, Subscriber Organizations may announce the availability, market, and solicit Subscribers provided that they disclose the project is not yet final. Subscriber Organizations may also accept deposits for interests in such Subscriber Organization's CBRE Facility provided that the Subscriber Organization has established an IO-approved escrow account. Subscriber Organizations shall not be permitted to formally complete subscriptions with Subscribers until the Subscriber Organization (a) has executed and delivered to the Company the applicable PPA, (b) for CBRE Large Projects, has obtained approval from the Commission of the Subscriber Organization's project, and (c) has completed all other required documents and agreements with Company necessary for the Subscriber Organization to commence development and construction of its CBRE Facility.
2. The PPA shall remain in effect for the Term set forth therein.
3. Subscriber Organizations shall pay fees as described in the applicable RFP.
4. Subscriber Organizations shall ensure CBRE Mid-Tier Projects and CBRE Large Projects are built and achieve commercial operations within the specific number of months as specified in the applicable PPA.
5. Subscriber Organizations are responsible for interconnection, operation and maintenance of their Facility to ensure the Facility meets agreed performance warranties, pursuant to the terms and conditions set forth in the applicable PPA and, as applicable for CBRE Mid-Tier Project, Rule No. 14H and Part I, Section H.
6. Electric energy delivered to the Subscriber Organization by the Company shall be billed under the Company's applicable rate schedule. Electric energy delivered to the Subscriber Organization by the Company shall be metered separately from the electric energy delivered by the Subscriber Organization to the Company, either by use of multiple meters or a meter capable of separately recording the inflow and outflow of

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

electricity. Electric energy generated by the CBRE Mid-Tier Project or CBRE Large Project shall not be used to offset electric energy needs of the Facility itself so as to maximize the output of the Facility and the corresponding bill credits of the Subscribers to such Facility.

7. Subscriber Organization will calculate and will be responsible for the accuracy of the Subscriber's monthly credit. The Subscriber's monthly credit will be provided by the Subscriber Organization to the Company in dollars, per the requirements of the PPA, no later than ten days after the end of each calendar month.
8. Subscriber Organization's notification of a Subscriber's acquisition of a subscription shall be Subscriber Organization's representation and warranty that the Subscriber Organization has executed a Subscriber Agreement with the Subscriber and provided a completed Disclosure Checklist executed by the Subscriber that is attached to the Subscriber Agreement for such Subscriber. The Administrator, IO for the CBRE Program, or the Commission may request copies of all Subscriber Agreements and/or Disclosure Checklists completed by the Subscriber Organization with its Subscribers at any time during the term of the Subscriber Organization's Facility.
9. The Company may, but shall not be required to, confirm that the Subscribers submitted by the Subscriber Organization are qualified pursuant to Part I, Section B above for participation in the CBRE Phase 2 Program. If any Subscribers are not qualified or are not purchasing an interest within the allowed limits set out in Part I, Section B above, then the Subscribers shall not be accepted into Phase 2 of the CBRE Program and the Company shall notify the Subscriber Organization of all disqualified Subscribers and remove them from the roster of that Subscriber Organization's list of Subscribers.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

PART III: Specific LMI Provisions

A. AVAILABILITY AND CAPACITY

Bidding will open for a minimum of one dedicated LMI project (“CBRE LMI Project”) on each island of O‘ahu, Hawai‘i Island, and Maui. CBRE LMI Projects shall be limited to LMI Customers and, for CBRE LMI Projects only, governmental agencies serving LMI persons or households and IRC Section 501(c)(3) organizations with an explicit primary mission to serve LMI Customers.

CBRE LMI Project capacity shall not be capped and will not count against the 235MW capacity allocated for CBRE Phase 2. There will be no maximum project size for CBRE LMI Projects, and bidders may propose any project size based on market demand and project cost.

The Commission set a minimum threshold of one project per island but may approve additional projects if there are more bids with compelling customer benefits.

If there are no successful competitive bids for a CBRE LMI Project on one island or more, a utility self-build option may be considered by the Commission for that island. Any utility self-build application shall be consistent with Section VI of the Framework.

B. LMI DEFINITION

A LMI Customer is:

1. A member of a household with a household income equal to or less than the income limit established by the U.S. Department of Housing and Urban Development (“HUD”) for a LMI Household. To qualify, a household’s income must be equal to or less than the income limit established by HUD for the customer’s household size in the appropriate county. Refer to the HUD website to obtain the income limits; or
2. A qualified Low Income Home Energy Assistance Program (LIHEAP) recipient; or
3. A qualified Supplemental Nutrition Assistance Program (SNAP) recipient; or
4. A qualified Housing Choice Voucher Program (Section 8) recipient.

An LMI Subscriber shall be either (1) a LMI Customer, (2) a governmental agency serving LMI persons or households, or (3) an IRC Section 501(c)(3) organization with an explicit, primary mission to serve LMI persons or households. The Subscriber Organization shall demonstrate via affidavit that at the time they enroll such organization that the specific,

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

identifiable, sufficient, and quantifiable benefits of the subscription will be passed through to LMI households. Organizations qualifying as LMI Subscribers in this fashion shall be referred to as “LMI Anchor Tenants.” LMI Anchor tenant participation shall be limited to participation in CBRE LMI Projects.

C. LMI SUBSCRIBER ELIGIBILITY VERIFICATION AND APPLICATION
REQUIREMENTS

1. Subscriber Organizations are required to verify eligibility of the LMI Customers and/or LMI Anchor Tenants at the time the LMI Customer and/or LMI Anchor Tenant applies for CBRE participation by meeting any one of the following, as applicable:
 - a. Utilizing a third-party income verification service to independently verify household income. The Subscriber Organization shall collect a Request for Transcript of Tax Return Form (IRS Form 4506-T) for all household members age 18 and over and send or upload to a third-party income verification service, as identified by the Company. The third-party verification service will return the tax transcript to the Subscriber Organization.
 - b. Verifying income documentation for all household members over the age of 18 by reviewing photocopies of the first two pages of the previous year’s income tax return documents, or IRS confirmation of no prior year’s tax return, or most recent, verified paystubs, in order to confirm that such income meets the HUD LMI qualifications for the appropriate household size.
 - c. Reviewing and verifying participation with any of the following organizations. Acceptable forms of proof include an award letter or current statement of benefit.
 - Low-Income Energy Assistance Program (LIHEAP)
 - Supplemental Nutrition Assistance Program (SNAP)
 - Housing Choice Voucher Program (Section 8)
 - d. For verifying methods b. and c. above, Subscriber Organizations will provide to and obtain from the LMI Customer the applicable executed CBRE Program-approved affidavit (“LMI Subscriber Affidavit”), attached hereto as Appendix VI, certifying that the LMI Customer is eligible to be classified as an LMI Subscriber under the applicable HUD guidelines or LIHEAP, SNAP or Section 8 programs referred to in Part III, Section B above.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

e. For prospective LMI Anchor Tenants, Subscriber Organization shall verify the primary LMI mission of the organization and its eligibility to be an LMI Subscriber. The Subscriber Organization shall also provide to and obtain from the LMI Anchor Tenant the applicable executed CBRE Program-approved affidavit and verification to confirm LMI eligibility (also referred to as “LMI Subscriber Affidavit”) attached hereto as Appendix VII, certifying that the LMI Anchor Tenant is eligible to be classified as an LMI Subscriber and certifying that the benefits of the subscription will flow to LMI households. The Subscriber Organization shall confirm that the proposed organization qualifies as a LMI Anchor Tenant, subject to confirmation by the Company; any disqualification of such organization by the Company shall require the concurrence of the IO.

e.f. If the LMI Anchor Tenant’s primary mission changes such that it no longer primarily serves or benefits LMI persons or households, the LMI Anchor Tenant must notify the Subscriber Organization and Hawaiian Electric within 30 days so that subsequent actions can be explored to maintain the LMI Anchor Tenant’s status. If, however, that no alternative measures are available, the LMI Anchor Tenant may, with the concurrence of the IO, lose its LMI Subscriber status.

2. In addition to the verifications in the LMI Subscriber Affidavit, an individual LMI Subscriber shall:
 - a. Affirm that they have resided at their current residence for a minimum of 6 months;
 - b. Agree to cooperate with the Subscriber Organization and the Company as requested to verify income and/or program participation documents.
3. Subscriber Organization shall acknowledge the LMI Subscriber Affidavit certifying that it has confirmed Subscriber’s LMI status.
4. Subscriber Organization shall collect and store the LMI Subscriber Affidavit for each new LMI Subscriber acquiring a subscription in that Subscriber Organization’s CBRE Project. Subscriber Organization’s enrollment of the LMI Subscriber shall be Subscriber Organization’s representation that it has collected the LMI Subscriber Affidavit from such LMI Subscriber.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

5. Once an individual LMI Subscriber eligibility is verified subsequent income changes will not disqualify the LMI Subscriber's eligibility.
6. As to LMI Anchor Tenants, if the primary mission of the organization changes such that it does not primarily serve or benefit LMI persons or households, the LMI Anchor Tenant may be subject to losing its LMI Subscriber status.
7. LMI Subscribers shall be required to acquire a minimum subscription of 0.5 kW AC.

D. LMI SUBSCRIBER ANNUAL VERIFICATION DURING TERM

1. Annually the Company at its discretion will complete spot checks of up to 10% of Subscribers designated as LMI Subscribers, from primarily, but not limited to, new LMI Subscribers admitted within the last 2 years, to confirm the Subscriber Organization has completed the eligibility verification for such LMI Subscriber.
2. Company will select random LMI Subscribers for verification that the SO completed its LMI verification process as of enrollment. If the Subscriber Organization is unable to provide verification documentation within 30 days, the Subscriber Organization will complete the eligibility verification of such selected LMI Subscribers using any of the verification methods specified in Part C, Section 1 above for such LMI Subscribers that the Subscriber Organization cannot produce verification documentation.
3. If a threshold of 15% or more of the random sample fails verification, the Company at its discretion may perform a second sample test upon Subscriber Organization's request. The Subscriber Organization shall bear all costs of performing any subsequent verification of a second sample of 10% of all LMI subscribers using any of the verification methods specified in Part C, Section 1 above.
4. If the combined sample concludes that 15% or more of the LMI Subscribers which were tested reveals that the Subscriber Organization did not confirm the LMI Subscriber's status under the requirements of Part III, Section C above, Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG will be recalculated by designating the percentage of missing LMI Subscribers verifications from the combined sample shall be added to the percentage of Unsubscribed RDG and will be subject to the payment reductions for Unsubscribed RDG as specified below.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

5. For CBRE LMI Projects, any unqualified LMI Subscribers, identified through the verification process in Part III, Section D, or otherwise identified, shall be removed as LMI Subscribers and prohibited from re-applying for any CBRE Project for 3 years.

E. PAYMENT REDUCTIONS AND LIQUIDATED DAMAGES

A Subscriber Organization that does not meet the 100% LMI requirement for CBRE LMI Projects shall be subject to applicable payment reductions or liquidated damages after 6 months of commercial operations as specified below.

1. Effective after 6 months of commercial operations for a CBRE LMI Project, the following shall be placed into effect for the six-month period (months 7-12) following initial commercial operations:
 - a. A CBRE LMI Project must have at least 60% of the required 100% LMI Subscriber percentage for any month between month 7 and month 12, inclusive, following initial commercial operations (the “Interim LMI Subscriber Percentage”). The difference in percentage between the project’s actual LMI Subscriber percentage and 60% shall be used to potentially reduce the Subscriber Organization’s allocation of the Lump Sum Payment allocated to Unsubscribed RDG for the month of such shortfall. For illustrative purposes, if a CBRE LMI Project only has 50% LMI Subscribers, the Subscriber Organization is 10% short of the 60% minimum required during months 7-12 after initial commercial operations. This percentage shall be used to assess potential payment reduction or liquidated damages pursuant to sub-parts b. and sub-part c. immediately below.
 - b. If the sum of the percentage determined in sub-part a. above plus the percentage deemed to be non-LMI under Part III, Section D.4. (the “Interim LMI Shortfall Percentage”), is greater than 15% for any month between month 7 and month 12, inclusive, after initial commercial operations, then the Subscriber Organization’s allocation of the Lump Sum Payment for Unsubscribed RDG delivered in that month shall be reduced by such Interim LMI Shortfall Percentage. If the amount of Unsubscribed RDG is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed RDG was 5% for such month and if the Subscriber Organization’s allocation of the Lump Sum Payment for Unsubscribed RDG is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- c. If the Interim LMI Shortfall Percentage exceeds 15% for any month between month 7 and month 12, inclusive, after initial commercial operations, but the CBRE LMI Project otherwise has no Unsubscribed RDG, the Subscriber Organization shall be subject to equivalent liquidated damages as specified below.

Damages for Failure to Achieve Interim LMI Subscriber Percentage. The Interim LMI Shortfall Percentage shall be multiplied by the amount equal to 5% of the applicable monthly Lump Sum Payment and the resulting dollar amount shall be the liquidated damages for the Subscriber Organization's failure to maintain the Interim LMI Subscriber Percentage in any month between month 7 and month 12, inclusive, after initial commercial operations of the CBRE LMI Project.

2. Effective after 12 months of commercial operations for a CBRE LMI Project, the following shall be placed into effect for the remainder of the term of the CBRE LMI Project.
 - a. For any CBRE LMI Project which does not have a 100% LMI Subscriber percentage for any month during the term of the LMI RDG PPA, the difference in percentage between the project's actual LMI Subscriber percentage and 100% shall be used to potentially reduce the Subscriber Organization's allocation of the Lump Sum Payment allocated to Unsubscribed RDG for the month of such shortfall. For example, if a CBRE LMI Project only had 90% LMI Subscribers, the Subscriber Organization is 10% short of the 100% minimum required during the term of the LMI RDG PPA. This percentage shall be used to assess potential payment reduction or liquidated damages pursuant to sub-parts b. and sub-part c. immediately below.
 - b. If the sum of the percentage determined in sub-part a. above plus the percentage deemed to be non-LMI under Part III, Section D.4. (the "LMI Shortfall Percentage"), is greater than 15% for any month during the term of the LMI RDG PPA, then the Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG delivered in that month shall be reduced by such LMI Shortfall Percentage. If the amount of Unsubscribed RDG is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed RDG was 5% for such month and if the Subscriber Organization's allocation of the Lump Sum Payment for Unsubscribed RDG is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.
 - c. If the LMI Shortfall Percentage exceeds 15% for any month during the term of the LMI RDG PPA but otherwise has no Unsubscribed RDG, the Subscriber Organization

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

shall be subject to equivalent liquidated damages as specified below. Continued failure to meet the 100% LMI percentage under these circumstances by the Subscriber Organization for more than one year shall be construed as an intent to disregard the requirements of this Rule 29 and could result in termination and removal from the CBRE Program in accordance with Part I, Section K.3.

Damages for Failure to Achieve the 100% LMI Subscriber Percentage. The LMI Shortfall Percentage shall be multiplied by the amount equal to 5% of the applicable monthly Lump Sum Payment and the resulting dollar amount shall be the liquidated damages for the Subscriber Organization's failure to maintain the 100% LMI Subscriber Percentage in any month during the term of the LMI RDG PPA.

3. A Subscriber Organization that does not meet its committed-to LMI percentage specified in its bid proposal ("Committed LMI Percentage") for any CBRE Mid-Tier Project or CBRE Large Project, shall be subject to the following applicable payment reductions or liquidated damages as specified below.
4. For a period of 6 months following initial commercial operations, the Subscriber Organization shall incur no payment reduction if it should fall below its Committed LMI Percentage. Effective after 6 months of commercial operations, the following shall be placed into effect for the six-month period (months 7 -12) following initial commercial operations:
 - a. If a CBRE Mid-Tier or Large Project fails to maintain at least 60% of its Committed LMI Percentage for its project for any month between month 7 and month 12, inclusive, following initial commercial operations (the "Interim Committed LMI Percentage"). The difference in percentage between the project's actual LMI Subscriber percentage and the Interim Committed LMI Percentage, multiplied by a factor of 0.10, shall be used to potentially reduce the Subscriber Organization's allocation of the Lump Sum Payment allocated to Unsubscribed RDG for the month of such shortfall. For illustrative purposes, if a CBRE Mid-Tier or Large Project has a Committed LMI Percentage of 30%, the Interim Committed LMI Percentage is 60% of 30% or 18%. If the project has only 15% LMI Subscribers in any month between months 7-12 after initial commercial operations, the Subscriber Organization is $3\% * 0.10 = 0.3\%$ short of the Interim Committed LMI Percentage for that month. This percentage (0.3%) shall be used to assess potential payment reduction or liquidated damages pursuant to sub-parts b. and sub-part c. immediately below.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- b. If the sum of the percentage determined in sub-part a. above plus the percentage deemed to be non-LMI under Part III, Section D.4. (the “Interim Committed LMI Shortfall Percentage”), is greater than 15% for any month between month 7 and month 12, inclusive, after initial commercial operations, then the Subscriber Organization’s allocation of the Lump Sum Payment for Unsubscribed RDG delivered in that month shall be reduced by such Interim Committed LMI Shortfall Percentage. If the amount of Unsubscribed RDG is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed RDG was 5% for such month and if the Subscriber Organization’s allocation of the Lump Sum Payment for Unsubscribed RDG is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.
- c. If the Interim Committed LMI Shortfall Percentage exceeds 15% for any month between month 7 and month 12, inclusive, after initial commercial operations, but the CBRE LMI Project otherwise has no Unsubscribed RDG, the Subscriber Organization shall be subject to equivalent liquidated damages as specified below.

Damages for Failure to Achieve Interim Committed LMI Percentage. The Interim Committed LMI Shortfall Percentage shall be multiplied by the amount equal to 5% of the applicable monthly Lump Sum Payment and the resulting dollar amount shall be the liquidated damages for the Subscriber Organization’s failure to maintain the Interim Committed LMI Percentage in any month between month 7 and month 12, inclusive, after initial commercial operations of the CBRE Mid-Tier or Large Project.

5. Effective after 12 months of commercial operations for a CBRE Mid-Tier or Large Project with a Committed LMI Percentage, the following shall be placed into effect for the remainder of the term of the project’s applicable RDG PPA.
- a. If a CBRE Mid-Tier or Large Project has not achieved its Committed LMI Percentage for any month during the term of its RDG PPA, the difference in percentage between the project’s actual LMI Subscriber percentage and the Committed LMI Percentage, multiplied by a factor of 0.10, shall be used to potentially reduce the Subscriber Organization’s allocation of the Lump Sum Payment allocated to Unsubscribed RDG for the month of such shortfall. For example, if a CBRE Mid-Tier or Large Project has a Committed LMI Percentage of 50% but only has 40% LMI Subscribers, the Subscriber Organization is $10\% * 0.10 = 1.0\%$ short of its Committed LMI Percentage for that month. This percentage (1.0%) shall be used to assess potential payment reduction or liquidated damages pursuant to sub-parts b. and sub-part c. immediately below.

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

- b. If the sum of the percentage determined in sub-part a. above plus the percentage deemed to be non-LMI under Part III, Section D.4. (the “Committed LMI Shortfall Percentage”), is greater than 15% for any month during the term of the applicable RDG PPA, then the Subscriber Organization’s allocation of the Lump Sum Payment for Unsubscribed RDG delivered in that month shall be reduced by such Committed LMI Shortfall Percentage. If the amount of Unsubscribed RDG is less than 5% in any month, any payment reduction shall be calculated as if such Unsubscribed RDG was 5% for such month and if the Subscriber Organization’s allocation of the Lump Sum Payment for Unsubscribed RDG is insufficient to offset the calculated payment reduction, the Subscriber Organization shall pay the difference upon demand.
- c. If the Committed LMI Shortfall Percentage exceeds 15% for any month during the term of the applicable RDG PPA but otherwise has no Unsubscribed RDG, the Subscriber Organization shall be subject to equivalent liquidated damages as specified below. Continued failure to meet the Committed LMI Percentage under these circumstances by any Subscriber Organization for more than one year shall be construed as an intent to disregard the requirements of this Rule 29 and could result in termination and removal from the CBRE Program in accordance with Part I, Section K.3.

Damages for Failure to Achieve the Committed LMI Percentage. The Committed LMI Shortfall Percentage shall be multiplied by the amount equal to 5% of the applicable monthly Lump Sum Payment and the resulting dollar amount shall be the liquidated damages for the Subscriber Organization’s failure to maintain the Committed LMI Shortfall Percentage in any month during the term of the applicable RDG PPA.

6. Payment reductions from Subscriber Organization’s allocation for Unsubscribed RDG under this Part III, Section E above shall be cumulative in effect. In any given month after the first six months of commercial operations, if the Subscriber Organization fails to meet multiple minimum requirements or exceeds maximum thresholds, the percentage reductions in Subscriber’s allocation specified above will be added and the aggregate sum of such percentages shall be used to reduce the Subscriber’s allocation for Unsubscribed RDG in any given month.
7. Residential LMI Customer Requirement. For CBRE LMI Projects only, Subscriber Organizations shall reserve at least 60% of the total output of a Facility’s CBRE capacity

HAWAIIAN ELECTRIC COMPANY, INC.

Rule No. 29
COMMUNITY-BASED RENEWABLE ENERGY PROGRAM
PHASE 2

to residential LMI Customers and the aggregate percentage of LMI Anchor Tenants to the total output of the Facility shall not exceed 40%.

- a. The CBRE LMI Projects shall remain subject to payment reductions and/or damages specified for CBRE Mid-Tier and CBRE Large Projects under Part II, Sections C.9, C.10 and C.11 and under Part III, Sections E.1 and E.2 above amended only to reflect the revised percentages specified above for CBRE LMI Projects.
- b. If the Subscriber Organization maintains a percentage mix of LMI Subscribers that does not have the required minimum percentage of residential LMI Customers or its LMI Anchor Tenant(s) exceed the aggregate 40% limitation and there is no Unsubscribed RDG for more than one year, such continued failure to meet the residential LMI Customer minimum requirement or exceeding the LMI Anchor Tenant percentage ceiling under these circumstances shall be construed as an intent to disregard the requirements of this Rule No. 29 and could result in termination and removal from the CBRE Program in accordance with Part I, Section K.3.

HAWAIIAN ELECTRIC COMPANY, INC.

Appendix II
Disclosure Checklist

**Community Based Renewable Energy (CBRE) Phase 2 Program
Subscriber Organization Disclosure Checklist**

This disclosure checklist is intended to enable potential Subscribers in the service territories of Hawaiian Electric, Maui Electric, and/or Hawai'i Electric Light to clearly understand where (and whether) a given Subscriber Organization ("SO") discloses the below-listed relevant terms and conditions in its Subscriber Agreement as required by the CBRE Framework.¹

Each SO shall complete this Disclosure Checklist with the page number and/or section reference in its Subscriber Agreement indicating where the stated disclosure or disclaimer is found in the Subscriber Agreement. SO's initial beside each Disclosure described in this Checklist shall serve as the SO's warranty to the Subscriber that the subject of the Disclosure is present in the Subscriber Agreement.

SO Initials	Disclosure Description	Page # in Agreement	Subscriber Confirmed Initials
STATE OF HAWAII CBRE SUBSCRIBERS BILL OF RIGHTS			
	Covenant by SO to Subscriber that it will adhere to the State of Hawaii's Division of Consumer Advocacy "State of Hawaii CBRE Subscribers Bill of Rights" and provide a copy of such to the Subscriber		

FUTURE COSTS AND BENEFITS OF THE SUBSCRIPTION (Section 4.4.1 of the CBRE Framework)			
	Production projections and a description of the methodology used to develop production projections		
	Bill savings and added cost projections and a description of the methodology used to develop bill projections		
	All nonrecurring (i.e., one-time) charges		
	All recurring charges and any escalation rate associated with those charges		
	Terms and conditions of service		
	Whether any charges may increase during the course of service, and if so, how much advance notice is provided to the Subscriber		

¹ On December 22, 2017, the State of Hawaii Public Utilities Commission ("Commission") issued Order No. 35137 in Docket No. 2015-0389 approving a CBRE Framework ("Order 35137"). Order 35137 requires SOs to submit an executed CBRE Disclosure Checklist with the Subscriber Agreement for each subscriber.

SO Initials	Disclosure Description	Page # in Agreement	Subscriber Confirmed Initials
	Whether the Subscriber is required to sign a term contract		
	Terms and conditions for early termination		
	Any penalties that the CBRE SO and/or Owner may charge to the Subscriber		
	Disclose the circumstances in which SO payment reductions or Liquidated Damages would result in reductions to the Subscriber's bill credit.		
	<u>Disclose the circumstances in which SO failure to comply with requirements of the tariff could result in reductions to the Subscriber's bill credits.</u>		
	The process for unsubscribing or transferring subscriptions and any associated costs		
DISCLAIMERS (Section 4.4.2 of the CBRE Framework)			
	Affidavit verifying LMI status		
	Data privacy policies of SO and/or Owner		
	Description of circumstances and method of notice Subscribers will be issued when the CBRE Facility is out of service, including notice of estimated length and loss of production		
	Assurances that all installations, upgrades and repairs will be under direct supervision of a qualified professional and that maintenance will be performed according to industry standards, including the recommendation of the manufacturers of solar panels and other operational components		
	SO statement regarding allocation of unsubscribed production		
	Statement that SO and/or Owner is solely responsible for resolving any disputes with Hawaiian Electric, Maui Electric, or Hawai'i Electric Light (as applicable) or the Subscriber about the accuracy of the CBRE Facility production		
	Statement that Hawaiian Electric, Maui Electric, or Hawai'i Electric Light (as applicable) is solely responsible for resolving any disputes with the Subscriber about the applicable rate used to determine the amount of the bill credit		

SO Initials	Disclosure Description	Page # in Agreement	Subscriber Confirmed Initials
	How to obtain a copy of the solar panel, inverter, and/or any other core component's warranty		
	Definition of underperformance and a description of the compensation to be paid by the Subscriber Organization for any underperformance (i.e., an output guarantee)		
	Disclosure of the type and level of insurance, and what insurance benefits protect Subscribers		
	Proof and description of a long-term maintenance plan including which services the plan includes (module or inverter failures, etc.)		
	SO and/or Owner contact information for questions and complaints and agreement to update and notify the subscriber if ownership changes hands		
SUBSCRIBER AGREEMENT REQUIREMENTS (Section 5.4 of the CBRE Framework)			
	Credit Rate and Calculation		
	Bill Credit mechanism and timing, including (1) calculating credits for delivered energy and confirmation there will be no compensation for curtailed energy events for CBRE Small Projects, or (2) calculating credits for contract capacity availability irrespective of delivered energy for CBRE Mid-Tier Projects, CBRE Large Projects and CBRE LMI Projects		
	Tax and Securities Implications		
	Proof of a SO escrow account established including (1) what fees/payments are deposited into such account, i.e., pre-development fees or deposits, and (2) how the funds may be released to the SO (upon Commercial Operations) or refunded to the Subscriber		
	No transfer fee of subscription interest if a Subscriber moves within the same service territory or transfer involves a change of name without any change in the account or meter		
	No downsizing fees within six months of CBRE program enrollment		
	Transparency of all Costs and Contractual Requirements		
	Subscription limitations (i.e., maximum and minimum kW interest per Subscriber)		
	Proof of Surety bond, financial guarantee, or letter of credit for the benefit of Subscribers and the circumstances under which Subscribers may make claims to such recoupment mechanisms		


SO Initials	Disclosure Description	Page # in Agreement	Subscriber Confirmed Initials
	How to obtain a copy of the SO's Standard Form Contract with Hawaiian Electric, Maui Electric, or Hawai'i Electric Light (as applicable) for the CBRE Phase 2 Program		
	SO notification requirements to Subscribers regarding project changes, development status, and operational updates		
	Statement that the Commission and Hawaiian Electric, Maui Electric, or Hawai'i Electric Light (as applicable) make no warranty or representation concerning potential implications, if any, of federal or state tax, securities, or other laws.		
ADDITIONAL DISCLOSURES (Section 5.5 of the CBRE Framework)			
	Payment schedule (\$/month) with preset repurchase/resale price for the lifetime of the Agreement for a Subscriber		
	Transfer of the selling Subscriber's ownership must be for all of Subscriber's interest.		
	For a Pay-As-You-Go subscription, Subscriber has the right to cancel the Subscriber's subscription at any time.		
	For a Pay-Up-Front interest, SO must buy back all or a portion of the Subscriber's interest upon request in accordance with the preset repurchase/resale price schedule within 30 days		

HAWAIIAN ELECTRIC COMPANY, INC.

Order No. 37070 filed April 9, 2020, Docket 2015-0389
Transmittal Letter dated ~~September 8~~December 20, 2020.

APPENDIX V

Distribution Interconnect Single Line Diagram for CBRE Small Projects

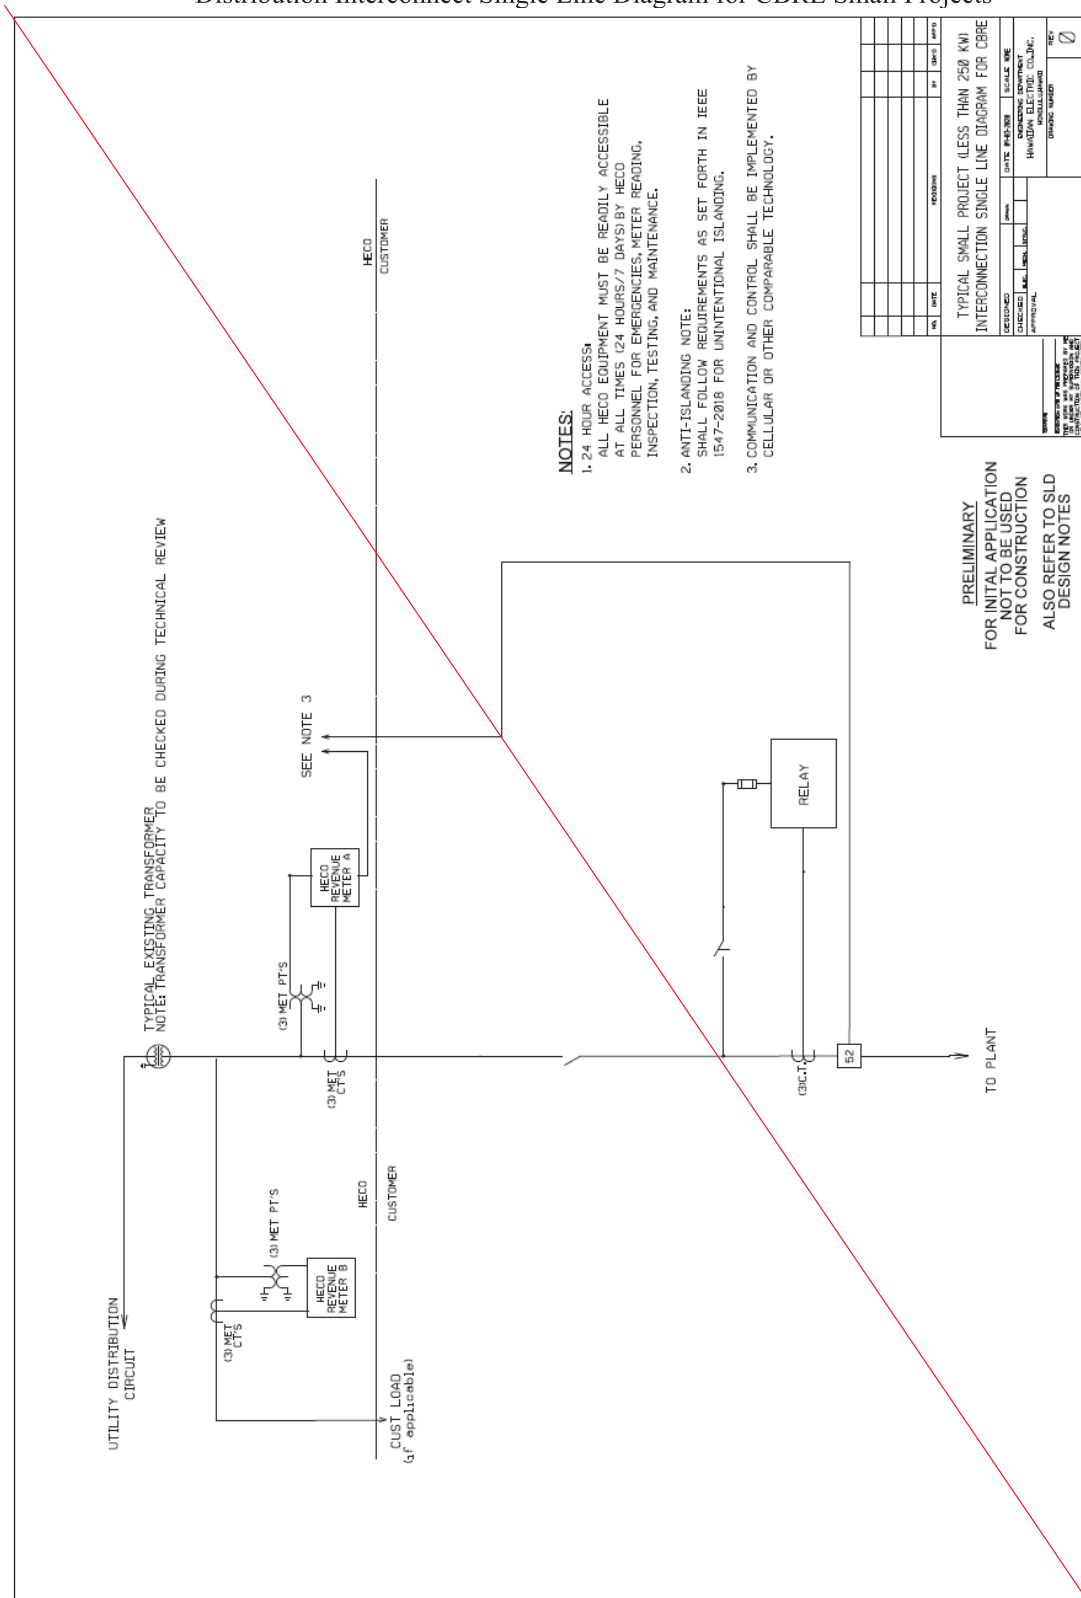

NO.	DATE	DESCRIPTION	BY	CHKD.	DATE

TYPICAL SMALL PROJECT (LESS THAN 250 KW) INTERCONNECTION SINGLE LINE DIAGRAM FOR CBRE

DESIGNED	DATE	SCALE
CHECKED	DATE	SCALE
APPROVAL	DATE	SCALE


ENGINEER'S SIGNATURE: _____
DATE: _____
SCALE: _____

PROJECT NO.: _____
SHEET NO.: _____

HAWAIIAN ELECTRIC COMPANY, INC.

EXHIBIT 18

Redline of Draft CBRE Tranche 1 RFP for Maui

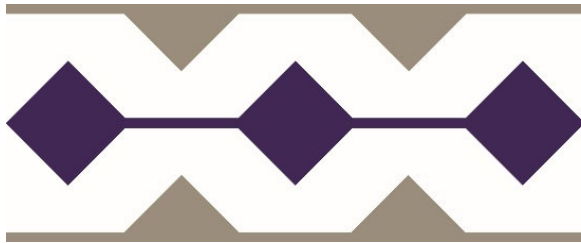

Maui Electric

DRAFT

REQUEST FOR PROPOSALS

FOR

COMMUNITY-BASED RENEWABLE ENERGY TRANCHE 1

ISLAND OF MAUI

~~OCTOBER 9~~DECEMBER 1, 2020

Docket No. 2015-0389

This Request for Proposals (“RFP”) is a DRAFT only. Maui Electric Company, ~~Ltd.~~Limited (“Maui Electric” or “Company”) will employ a competitive bidding process to select renewable energy projects including Community Based Renewable Energy consistent with the State of Hawai‘i Public Utilities Commission’s (“PUC”) Competitive Bidding Framework. Under the Competitive Bidding Framework, Maui Electric ~~will file~~filed the initial draft RFP with the PUC. Then, Maui Electric ~~will~~seeksought input from prospective Proposers and other stakeholders through a Technical Conference as described in the draft RFP and ~~modify~~modified the draft RFP to the extent feasible to address input received in order to foster a robust competitive process. The proposed final RFP ~~will be~~is being submitted to the PUC for approval and is subject to further revision based upon direction received from the PUC. After approval by the PUC, Maui Electric will issue the final RFP.

Table of Contents

Chapter 1: Introduction and General Information	1
1.1 Authority and Purpose of the Request for Proposals	2
1.2 Scope of the RFP	23
1.3 Competitive Bidding Framework	5
1.4 Role of the Independent Observer	5
1.5 Communications Between the Company and Proposers – Code of Conduct Procedures Manual.....	6
1.6 Company Contact for Proposals	67
1.7 Proposal Submittal Requirements.....	67
1.8 Proposal Fee.....	8
1.9 Procedures for the Self-Build or Affiliate Proposals	9
1.10 Dispute Resolution Process.....	11
1.11 No Protest or Appeal.....	12
1.12 Modification or Cancellation of the Solicitation Process	12
Chapter 2: Resource Needs and Requirements.....	12 <u>13</u>
2.1 Performance Standards	12 <u>13</u>
2.2 Distribution Level System Information	13
2.3 Interconnection to the Company System	13 <u>14</u>
Chapter 3: Instructions to Proposers	15
3.1 Schedule for the Proposal Process	15
3.2 Company RFP Website / Electronic Procurement Platform.....	15 <u>16</u>
3.3 Information Exchange.....	16
3.4 Preparation of Proposals	16
3.5 Organization of the Proposal	17
3.6 Proposal Limitations	17
3.7 Proposal Compliance and Bases for Disqualification.....	18
3.8 Power Purchase Agreement	18 <u>19</u>
3.9 Pricing Requirements.....	20
3.10 Project Description.....	21
3.11 Sites Identified by the Company.....	22
3.12 Confidentiality	23

3.13	Credit Requirements	24
Chapter 4: Evaluation Process and Evaluation Criteria.....		25
4.1	Proposal Evaluation and Selection Process	25
4.2	Eligibility Requirements Assessment	27
4.3	Threshold Requirements Assessment	28 <u>27</u>
4.4	Initial Evaluation – Price and Non-Price Analysis	30
4.5	Selection of a Priority List	38
4.6	Best and Final Offer (BAFO)	38 <u>39</u>
4.7	Detailed Evaluation.....	39
4.8	Selection of the Final Award Group	41
Chapter 5: Post Evaluation Process		41 <u>42</u>
5.1	Project Interconnection Process.....	41 <u>42</u>
5.2	Contract Negotiation Process.....	43
5.3	Community Outreach and Engagement.....	43 <u>44</u>
5.4	Greenhouse Gas Emissions Analysis.....	45
5.5	PUC Approval.....	45 <u>46</u>
5.6	Facility In-Service.....	46

List of Appendices

Appendix A	Definitions
Appendix B	Proposer's Response Package / Project Interconnection Data Request
Appendix C	Code of Conduct Procedures Manual
Appendix D	PowerAdvocate User Information
Appendix E	Mutual Confidentiality and Non-Disclosure Agreement
Appendix F	Description of Available Sites
Appendix G	Self-Build Option and Self-Build Option Team Certification Form
Appendix H	Interconnection Facilities and Cost Information
Appendix I	Rule 19 Tariff
Appendix J	Rule 29 Tariff
Appendix K	Model PV Large RDG PPA
Appendix L	Model PV Mid-Tier Standard Form Contract RDG PPA (250 kW to 2.5 MW)
Appendix M	Model Wind Large RDG PPA
Appendix N	Model Wind Mid-Tier Standard Form Contract RDG PPA (250 kW to 2.5 MW)
Appendix O	Grid Needs Assessment
Appendix P	Term Sheet for Large CBRE DC-Coupled Projects (PV + BESS)

Chapter 1: Introduction and General Information

Maui Electric Company, ~~Ltd.~~Limited (“Maui Electric” or the “Company”) seeks proposals for Community-Based Renewable Energy (“CBRE”) projects, also referred to as shared solar,¹ in this Tranche 1-projects for the Maui Electric System on the island of Maui in accordance with this Request for Proposals (“RFP”).

The Company or its Affiliates may submit a Proposal in response to this RFP subject to the requirements of this RFP.

The Company seeks new variable renewable dispatchable generation projects (with or without storage systems) in this RFP. The total amount of CBRE generation sought in this RFP is 12.5 MW. For projects 250 kW or greater in size, up to and including 2.5 MW, a pre-approved standard form contract will be used in the form of Appendix L for photovoltaic (“PV”) generation projects and Appendix N for wind generation projects (“Mid-Tier SFC”). The Mid-Tier SFC treats variable generation facilities as fully dispatchable. For projects greater than 2.5 MW in size, the Company intends to contract for variable renewable dispatchable generation projects through this RFP using its Model Renewable Dispatchable Generation Power Purchase Agreement (“RDG PPA”), which treats variable generation facilities as fully dispatchable. The Company has created a PV version (the “PV RDG PPA”) and a wind version (the “Wind RDG PPA”) of its RDG PPA attached as Appendix K and Appendix M, respectively.

Each successful Proposer will provide variable renewable dispatchable generation and optionally energy storage to the Company pursuant to the terms of an RDG PPA or Mid-Tier SFC. Selected RDG PPAs for selected projects greater than 2.5 MW in size will be subject to ~~PUC~~ review and approval by the State of Hawai‘i Public Utilities Commission (“PUC”), while the Mid-Tier SFCs for projects selected in this RFP that are 250 kW or greater in size, up to and including 2.5 MW will not be subject to further ~~regulatory~~PUC review and approval ~~of the Mid-Tier SFC~~.

The Company’s Model RDG PPA and Mid-Tier SFC employ an innovative contracting mechanism which is very different than traditional PPA structures. Proposers are instructed to thoroughly review the Model RDG PPA attached as Appendix J and L and the Mid-Tier SFC attached as Appendix K and M, based on the size and technology of their project. The structure of the RDG PPA and Mid-Tier SFC intends to provide payments to the Proposer by the Company on a monthly lump sum basis, based upon the energy potential of the facility, regardless of the actual energy dispatched. In exchange, the utility maintains full dispatch

¹ In response to some confusion in the community over the acronym “CBRE” that the Companies have experienced during their latest efforts to publicize the CBRE Program, the Companies are introducing the more descriptive term “shared solar” for the CBRE Program in an effort to alleviate any further confusion in the community. The Companies intent is to use both terms, “CBRE” in regulatory filings and “shared solar” in marketing and other Company literature to refer to the Community-Based Renewable Energy Program first introduced by the CBRE Framework. The term, “shared solar” will be used even though the CBRE Program is not necessarily limited to PV projects only.

control of the Facility as needed.² Under the RDG PPA and Mid-Tier SFC, each Facility must meet certain requirements to receive the full lump sum payment each month. These requirements ensure that each plant is available to the Company for dispatch to meet system needs.

The Company will evaluate Proposals using the evaluation and selection process described in Chapter 4. The Company will evaluate and select Proposals based on both price and non-price factors that impact the Company, its customers, and communities affected by the proposed Projects. The number of Projects that the Company may acquire from this RFP depends on, among other things, the quality and cost-effectiveness of bids received in response to this RFP; economic comparison to other RFP responses; updates to the Company's forecasts; distribution availability; and changes to regulatory or legal requirements. If attractive Proposals are received that will provide energy and energy storage in excess of the targeted amounts, the Company will consider selecting such Proposal(s) if benefits to customers are demonstrated.

All requirements necessary to submit a Proposal(s) are stated in this RFP. A description of the technical requirements for Proposers is included in the body of this RFP, Appendix B, and in the applicable RDG PPA and Mid-Tier SFC attached as Appendix K, L, M, and N.

All capitalized terms used in this RFP shall have the meaning set forth in the glossary of defined terms attached as Appendix A. Capitalized terms that are not included in Appendix A shall have the meaning ascribed in this RFP.

1.1 Authority and Purpose of the Request for Proposals

- 1.1.1 This RFP is issued in response to Order No. 37070 issued on April 20, 2020 and Order No. 37139 issued on May 14, 2020 in Docket No. 2015-0389 as part of a procurement process established by the PUC.
- 1.1.2 This RFP is subject to Decision and Order (“D&O”) No. 23121 in Docket No. 03-0372 (To Investigate Competitive Bidding for New Generating Capacity in Hawai‘i), which sets forth the PUC’s Framework for Competitive Bidding (“Framework” or “Competitive Bidding Framework”).
- 1.1.3 Proposers should review Appendix O, Grid Needs Assessment, to inform Proposers as to the system needs and costs based on inputs and assumptions developed through the Company’s integrated grid planning process, and recent renewable dispatchable generation procurements.³ The Grid Needs Assessment is intended to inform the development of their Proposals that best meets the needs of the system.

² Wind projects ~~only~~ may include a Price for Purchase of Electric/Renewable Energy component in addition to the Lump Sum Payment component. The energy payment would be based on actual production and delivery to the grid. As the RDG PPA and Mid-Tier SFC allow the Company dispatch rights and does not guarantee Seller any amount of energy will be delivered to the Point of Interconnection (POI), in the event that the Company does not accept any energy at the POI, the Company will not pay any Price for Electric/Renewable Energy.

³ See <https://www.hawaiianelectric.com/clean-energy-hawaii/our-clean-energy-portfolio/renewable-project-status-board>

1.2 Scope of the RFP

- 1.2.1 Proposals submitted in response to this RFP shall meet the requirements identified in Part II and III of Tariff Rule No. 29, Community-Based Renewable Energy Program Phase 2, attached as Appendix J.
- 1.2.2 The Company will only accept Proposals that utilize PV or wind generation technologies. Proposals may be submitted as: (1) Generation only Projects; or (2) Generation paired with energy storage Projects (“Paired Projects”).
- 1.2.3 At least 40% of the Project’s capacity must be reserved for residential Subscribers with unsubscribed RDG compensation subject to the requirements in Article 2 of the applicable RDG PPA or Attachment C of the applicable Mid-Tier SFC. The capacity allocations (%) identified in the Proposal submission will be used in the RFP evaluation process and therefore Proposers will be held to their provided value.
- 1.2.4 Preference will be given to Projects whose Subscriber portion reserves an amount greater than 40% of Project capacity for residential customers and/or any additional amount of Project capacity dedicated to Low- and Moderate-Income Customers (“LMI Customers”), as defined in Tariff Rule No. 29 in Appendix J.
- 1.2.5 Each Proposal submitted in response to this RFP must represent a Project that is capable of meeting the requirements of this RFP without having to rely on the completion or implementation of any other Project, or without having to rely on a proposed change in law, rule, or regulation.
- 1.2.6 Proposals that will require system upgrades and the construction of which, in the reasonable judgment of the Company (in consultation with the Independent Observer), creates a significant risk that their Project’s Guaranteed Commercial Operations Date (“GCOD”) will not be met, will not be considered in this RFP.
- 1.2.7 Projects submitted in response to this RFP must be located on the Island of Maui.
- 1.2.8 Proposers will determine their Project Site. Proposers have the option of submitting a Proposal using potential Sites offered and described in Section 3.11. Proposers must locate all Project infrastructure within areas of their Site that are outside the 3.2 feet sea level rise exposure area (SLR-XA) as described in the Hawai‘i Sea Level Rise Vulnerability and Adaptation Report (2017)⁴ and are not located within a Tsunami Evacuation Zone.⁵ All equipment required for a Proposer’s project must be sited within

⁴ Hawai‘i Climate Change Mitigation and Adaptation Commission. 2017. Hawai‘i Sea Level Rise Vulnerability and Adaptation Report. Prepared by Tetra Tech, Inc. and the State of Hawai‘i Department of Land and Natural Resources, Office of Conservation and Coastal Lands, under the State of Hawai‘i Department of Land and Natural Resources Contract No: 64064. This report is available at: https://climateadaptation.hawaii.gov/wp-content/uploads/2017/12/SLR-Report_Dec2017.pdf

⁵ See Hawai‘i Sea Level Rise Viewer at <https://www.pacioos.hawaii.edu/shoreline/slr-hawaii/>, and National Oceanic and Atmospheric Administration (NOAA) interactive map in partnership with the State of Hawai‘i at <https://tsunami.coast.noaa.gov/#/>. Projects infrastructure must be outside the “Tsunami Evacuation Zone” (but not necessary to be outside the “Extreme Tsunami Evacuation Zone”).

the Proposer's project site with no assumptions that any equipment will be sited on Company property unless specified by the Company.

- 1.2.9 Projects must interconnect to the Company's System at the distribution level (12 kV or lower). Projects interconnecting at the distribution level must not exceed 3 MW. Projects interconnecting at the site offered by the Company at Waena must interconnect as described in Appendix H.
- 1.2.10 Projects submitted in response to this RFP must be 250 kW or larger. Proposers for CBRE projects smaller than 250 kW should refer to the Company's CBRE website for instructions on how to submit proposals at www.hawaiianelectric.com/communitysolar.
- 1.2.11 Contracts for Projects selected through this RFP must use the RDG PPA or Mid-Tier SFC, as described in [Section 3.8](#). Under the RDG PPA and Mid-Tier SFC, the Company shall maintain exclusive rights to fully direct dispatch of the Facility, subject to availability of the resource and [Section 1.2.12](#) below. The term of the PPA will be 20 years.
- 1.2.12 The storage component of a Paired Project will be charged during periods when full potential export of the generation component is not being dispatched by the Company, and the storage component can be used to provide energy to the Company during other times that are beneficial to the system. The storage component of a Paired Project must be sized to support the Facility's Allowed Capacity (in MW) for a minimum of four (4) continuous hours throughout the term of the RDG PPA or Mid-Tier SFC.

For example, for a 2 MW facility, the storage component must be able to store and discharge at least 8 MWh of energy at 2 MW in a cycle throughout the term of the RDG PPA or Mid-Tier SFC.
- 1.2.13 ~~All Paired Projects~~[Grid-charging is not required for Paired Projects. However, if grid-charging capability is included, the Paired Project](#) must be able to be charged from the grid at the direction of the Company after the 5-year Investment Tax Credit ("ITC") recapture period has lapsed. Paired Projects [electing to include grid-charging capability](#) that are incapable of claiming the ITC must be capable of being 100% charged from the grid from the GCOD.
- 1.2.14 The amount of energy discharged from any energy storage component in a year will be limited to the energy storage contract capacity (in MWh) multiplied by the number of Days in that year. An energy storage component may be dispatched more than once per Day, subject to such discharge energy limitations.
- 1.2.15 Proposals must specify a GCOD no later than March 31, 2026. Preference will be given to Proposals that specify an earlier GCOD during the non-price evaluation. A Proposer's GCOD set forth in its Proposal will be the GCOD in any resulting RDG PPA or Mid-Tier SFC if such Proposal is selected to the Final Award Group. Proposers will not be able to request a change in the GCOD set forth in their Proposals. Proposals that propose an earlier GCOD will be scored higher during the Initial Evaluation phase ([see Chapter 4](#)).

- 1.2.16 If selected, Proposers will be responsible for all costs throughout the term of the RDG PPA or Mid-Tier SFC, including but not limited to Project development, completion of an Interconnection Requirements Study (“IRS”), the cost of conducting a greenhouse gas analysis, land acquisition, permitting, financing, construction of the Facility and all Interconnection Facilities, and the operation and maintenance (“O&M”) of the Facility.
- 1.2.17 If selected, Proposers will be solely responsible for the decommissioning of the Project and the restoration of the Site upon the expiration of the PPA, as described in Attachment G, Section 7 of the RDG PPA or the Mid-Tier SFC.
- 1.2.18 If selected, Proposers shall pursue all available applicable federal and state tax credits. Proposal pricing must be set to incorporate the benefit of such available federal tax credits. However, to mitigate the risk on Proposers due solely to potential changes to the state’s tax credit law before a selected project reaches commercial operations, Proposal pricing shall be set without including any state tax credits. If a Proposal is selected, the PPA for the project will require the Proposer to pursue the maximum available state tax credit and remit tax credit proceeds to the Company for customers’ benefit as described in Attachment J of the RDG PPA or the Mid-Tier SFC. The PPA will also provide that the Proposer will be responsible for payment of liquidated damages for failure to pursue the state tax credit.

1.3 Competitive Bidding Framework

Consistent with the Framework, this RFP outlines the Company’s requirements in relation to the resources being solicited and the procedures for conducting the RFP process. It also includes information and instructions to prospective Proposers participating in and responding to this RFP.

1.4 Role of the Independent Observer

- 1.4.1 Part III.C.1 of the Framework sets forth the circumstances under which an Independent Observer is required in a competitive bidding process. The Independent Observer will advise and monitor all phases of the RFP process and will coordinate with PUC staff throughout the RFP process to ensure that the RFP is undertaken in a fair and unbiased manner. In particular, the Company will review and discuss with the Independent Observer decisions regarding the evaluation, disqualification, non-selection, and selection of Proposals.
- 1.4.2 The role of the Independent Observer, as described in the Framework, will include but is not limited to:
- Monitor all steps in the competitive bidding process
 - Monitor communications (and communications protocols) with Proposers
 - Monitor adherence to the Company’s Code of Conduct
 - Submit comments and recommendations, if any, to the PUC concerning the RFP
 - Review the Company’s Proposal evaluation methodology, models, criteria, and assumptions
 - Review the Company’s evaluation of Proposals

- Advise the Company on its decision-making
- Participate in dispute resolution as set forth in Section 1.10
- Monitor contract negotiations with Proposers
- Report to the PUC on monitoring results during each stage of the competitive bidding process
- Provide an overall assessment of whether the goals of the RFP were achieved

1.4.3 The Independent Observer for this RFP is: **Arroyo Seco Consulting**.

1.5 Communications Between the Company and Proposers – Code of Conduct Procedures Manual

- 1.5.1 Communications and other procedures under this RFP are governed by the “Code of Conduct Procedures Manual,” (also referred to as the “Procedures Manual”) developed by the Company as required by the Framework, and attached as Appendix C.
- 1.5.2 All pre-Proposal communication with prospective Proposers will be conducted via the Company’s RFP website, Electronic Procurement Platform, and/or electronic mail (“Email”) through the address specified in Section 1.6 (the “RFP Email Address”). Phone communication or face-to-face meetings will not be supported. Frequently asked questions submitted by prospective Proposers and the answers to those questions may be posted on the Company’s RFP website. The Company reserves the right to respond only to comments and questions it deems are appropriate and relevant to the RFP. Proposers shall submit questions no later than fifteen Days before the Proposal Due Date (RFP Schedule in Section 3.1, Items 6 and 7). The Company will endeavor to respond to all questions no later than five Days before the Proposal Due Date.
- 1.5.3 After Proposals have been submitted, the Company may contact individual Proposers for purposes of clarifying their Proposal(s).
- 1.5.4 Any confidential information deemed by the Company, in its sole discretion, to be appropriate to share, will only be transmitted to the requesting party after receipt of a fully executed CBRE Mutual Confidentiality and Non-Disclosure Agreement (“CBRE NDA”). See Appendix E.
- 1.5.5 Except as expressly permitted and in the manner prescribed in the Procedures Manual, any unsolicited contact by a Proposer or prospective Proposer with personnel of the Company pertaining to this RFP is prohibited.

1.6 Company Contact for Proposals

The primary contact for this RFP is:

Isaac Kawahara
Energy Contract Manager
Hawaiian Electric Company, Inc.

RFP Email Address: cbrrerfp@hawaiianelectric.com

1.7 Proposal Submission Requirements

- 1.7.1 All Proposals must be prepared and submitted in accordance with the procedures and format specified in the RFP. Proposers are required to respond to all questions and provide all information requested in the RFP, as applicable, and only via the communication methods specified in the RFP.
- 1.7.2 Detailed requirements regarding the form, submission, organization and information for the Proposal are set forth in Chapter 3 and Appendix B.
- 1.7.3 Proposals must not rely on any information that is not contained within the Proposal itself in demonstrating compliance for any requirement in this RFP.
- 1.7.4 In submitting a Proposal in response to this RFP, each Proposer certifies that the Proposal has been submitted in good faith and without fraud or collusion with any other unaffiliated person or entity. The Proposer shall acknowledge this in the Response Package submitted with its Proposal. Furthermore, in executing the CBRE NDA provided as Appendix E, the Proposer agrees on behalf of its Representatives (as defined in the CBRE NDA) that the Company's negotiating positions will not be shared with other Proposers or their respective Representatives.

In addition, in submitting a Proposal, a Proposer will be required to provide Company with its legal counsel's written certification in the form attached as Appendix B Attachment 1 certifying in relevant part that irrespective of any Proposer's direction, waiver, or request to the contrary, that the attorney will not share a Proposer's confidential information associated with such Proposer with others, including, but not limited to, such information such as a Proposer's or Company's negotiating positions. If legal counsel represents multiple unaffiliated Proposers whose Proposals are selected for the Final Award Group, such counsel will also be required to submit a similar certification at the conclusion of power purchase agreement negotiations that he or she has not shared a Proposer's confidential information or the Company's confidential information associated with such Proposer with others, including but not limited to, such information as a Proposer's or Company's negotiating positions.

- 1.7.5 All Proposals must be submitted via the Electronic Procurement Platform by 2:00 pm Hawai'i Standard Time ("HST") on the Proposal Due Date shown in the RFP Schedule in Section 3.1, Table 1, Item 6 and 7. No hard copies of these Proposals will be accepted by the Company.

It is the Proposer’s sole responsibility to ensure that complete and accurate information has been submitted on time and consistent with the instructions of this RFP. With this assurance, Company shall be entitled to rely upon the completeness and accuracy of every Proposal. Any errors identified by the Proposer or Company after the Proposal Due Date has passed may jeopardize further consideration and success of the Proposal. If an error or errors are later identified, Company, in consultation with the Independent Observer, may permit the error(s) to be corrected without further revision to the Proposal, or may require Proposer to adhere to terms of the Proposal as submitted without correction. Additionally, and in Company’s sole discretion, if such error(s) would materially affect the Priority List or Final Award Group, Company reserves the right, in consultation with the Independent Observer, to remove or disqualify a Proposal upon discovery of the material error(s). The Proposer of such Proposal shall bear the full responsibility for such error(s) and shall have no recourse against Company’s decision to address Proposal error(s), including removal or disqualification. The Energy Contract Manager, in consultation with the Independent Observer, will confirm that the Self-Build Proposals were submitted by the Self-Build Proposal Due Date shown in Section 3.1, Table 1, Item 6. The Electronic Procurement Platform automatically closes to further submissions after the IPP and Affiliate Proposal Due Date shown in Section 3.1, Table 1, Item 7.

1.8 Proposal Fee

1.8.1 IPP and Affiliate proposers are required to tender a non-refundable Proposal Fee, based on the size of the proposed Project, for each Proposal submitted.

Project Size	Proposal Fee
250 kW and larger, up to and including 2.5 MW	\$2,000
Larger than 2.5 MW, up to and including 10 3 MW	\$5,000
Larger than 10 MW	\$10,000

1.8.2 Proposers may submit up to two (2) variations of their Proposal, one of which is the base variation of the Proposal, under a single Proposal Fee.

1.8.3 Variations of pricing terms, Facility size or with/without storage can be offered. Variations which propose a different Site or different generation technology will not be considered and will be deemed a separate Proposal, and a separate Proposal Fee must be paid for each such Proposal. All unique information for each variation of a Proposal, no matter how minor such variation is, must be clearly identified and separated by following the instructions in Appendix B Section 4.

- 1.8.4 The Proposal Fee must be in the form of a cashier’s check or equivalent from a U.S.-chartered bank made payable to “Maui Electric Company, Ltd.” and must be delivered and received by the Company by 2:00 pm (HST) on the Proposal Due Date shown in the RFP Schedule in Section 3.1, Table 1, Item 7. The cashier’s check should include a reference to the Proposal(s) for which the Proposal Fee is being provided. Proposers must identify in the Proposal Response Package (instructions in Appendix B Section 1.3.1) the delivery information for its Proposal Fee. Proposers are strongly encouraged to utilize a delivery service method that provides proof of delivery to validate delivery date and time.

If the Proposal Fee is delivered by U.S. Postal Service (with registered, certified, receipt verification), the Proposer shall address it to:

Isaac Kawahara
Energy Contract Manager
Hawaiian Electric Company, Inc.
Mail Code CP21-IU
PO Box 2750
Honolulu, Hawai‘i 96840

If the Proposal Fee is delivered by other courier services, the Proposer shall address it to:

Hawaiian Electric Company, Inc.
Ward Receiving
Attention: Isaac Kawahara, Energy Contract Manager
Mail Code CP21-IU
799 S. King St.
Honolulu, Hawai‘i 96813

Due to COVID-19 disease prevention measures, Proposal Fees cannot be delivered in person.

1.9 Procedures for the Self-Build or Affiliate Proposals

- 1.9.1 Order No. 37070 states that the CBRE RFPs will be open to all bidders, including the Company. The Competitive Bidding Framework allows the Company the option to offer a Proposal(s) in response to this RFP (“Self-Build Option” or “SBO”). Accordingly, the Company must follow certain requirements and procedures designed to safeguard against and address concerns associated with: (1) preferential treatment of the SBO or members, agents, or consultants of the Company formulating the SBO (the “Self-Build Team”); and (2) preferential access to proprietary information by the Self-Build Team. These requirements are specified in the Code of Conduct (“CBRE Code of Conduct”) required under the Framework and implemented by certain rules and procedures found in the Procedures Manual submitted to the PUC in Docket No. 2015-0389 on October 9, 2020. The CBRE Code of Conduct will apply to all CBRE Phase 2 RFPs, regardless of whether the Company submits an SBO Proposal. A copy of the Procedures Manual is attached as Appendix C.

The Competitive Bidding Framework also allows Affiliates of the Company to submit Proposals⁶ to RFPs issued by the Company. All Self-Build and Affiliate Proposals are subject to the Company's Code of Conduct and the Procedures Manual. Affiliate Proposals are also subject to any applicable Affiliate Transaction Requirements issued by the PUC in Decision and Order No. 35962 on December 19, 2018, and subsequently modified by Order No. 36112, issued on January 24, 2019, in Docket No. 2018-0065. However, for Affiliate Proposals with nameplate capacities that are 250 kW or greater in size, up to and including 2.5 MW, the PUC will not require an additional review pursuant to the Affiliate Transaction Requirements, but will hold Affiliate Proposals to the terms of their Proposals. Affiliate Proposals will be treated identically to IPP Proposals and must be submitted electronically through the Electronic Procurement Platform by IPP and Affiliate Proposal Due Date in RFP Section 3.1, Table 1, Item 7.

- 1.9.2 The Company will require that the Proposal for the SBO(s) and Affiliate Proposals be submitted electronically through the Electronic Procurement Platform. SBO Proposals will be due a minimum of one (1) Day before other Proposals are due. A Proposal for the SBO will be uploaded into the Electronic Procurement Platform in the same manner Proposals from other Proposers are uploaded. The Energy Contract Manager, in consultation with the Independent Observer, will confirm that the Self-Build Proposals are timestamped by the Self-Build Proposal Due Date found in RFP Section 3.1, Table 1, Item 6.
- 1.9.3 Detailed requirements for an SBO Proposal can be found in Appendix G. These requirements are intended to provide a level playing field between SBO Proposals and third-party Proposals. Except where specifically noted, an SBO Proposal must adhere to the same price and non-price Proposal requirements as required of all Proposers, as well as certain RDG PPA or Mid-Tier SFC requirements, such as milestones and liquidated damages, as described in Appendix G. The non-negotiability of the Performance Standards shall apply to any SBO to the same extent it would for any other Proposal. Notwithstanding the fact that it will not be required to enter into an RDG PPA or Mid-Tier SFC with the Company, a Self-Build Proposer will be required to note its exceptions, if any, to the RDG PPA for Projects over 2.5 MW in the same manner required of other Proposers, and will be held to such modified parameters if selected. In addition to its Proposal, the Self-Build Team will be required to submit Appendix G Attachment 1, Self-Build Option Team Certification Form, acknowledging it has followed the rules and requirements of the RFP to the best of its ability and has not engaged in any collusive actions or received any preferential treatment or information providing an impermissible competitive advantage to the Self-Build Team over other Proposers responding to this RFP, as well as adherence to RDG PPA or Mid-Tier SFC terms and milestones required of all Proposers and the SBO's proposed cost protection measures.

The cost recovery methods between a regulated utility SBO Proposal and IPP Proposals are fundamentally different due to the business environments they operate in. As a result,

⁶ A Proposal will also be treated as an Affiliate Proposal if the Affiliate is a partner for the Proposal.

the Company has instituted a process to compare the two types of proposals for the initial evaluation of the price related criteria on a ‘like’ basis through comparative analysis.

At the core of an SBO Proposal are its total project capital cost and any associated annual operations and maintenance (“O&M”) costs. During the RFP’s initial pricing evaluation step, these capital costs⁷ and O&M costs will be used in a revenue requirement calculation to determine the estimated revenues needed from customers which would allow the Company to recover the total cost of the project. The SBO revenue requirements are then used in a levelized benefit calculation to determine a Levelized Benefit (“LB”) (\$/MWh) which will then be used for comparison to IPP and any Affiliate Proposals.

The Company, in conjunction with the Independent Observer, may also conduct a risk assessment of the SBO Proposal to ensure an appropriate level of customer cost protection measures are included in such Proposal.

If the SBO is not included in any shared savings mechanism for this RFP pre-approved by the Commission, the SBO will be permitted to submit a shared savings mechanism with its Proposal to share in any cost savings between the amount of cost bid in the SBO Proposal and the actual cost to construct the Project. If the SBO Proposal is selected to the Final Award Group, the proposed shared savings mechanism will need to be approved by the PUC. Submission of a shared savings mechanism is not required and will not be considered in the evaluation of the SBO Proposal.

1.10 Dispute Resolution Process

- 1.10.1 If disputes arise under the RFP, the provisions of Section 1.10 and the dispute resolution process established in the Framework will control. See Part V of the Framework.
- 1.10.2 Proposers who challenge or contest any aspect of the RFP process must first attempt to resolve their concerns with the Company and the Independent Observer (“Initial Meeting”). The Independent Observer will seek to work cooperatively with the parties to resolve any disputes or pending issues and may offer to mediate the Initial Meeting to resolve disputes prior to such issues being presented to the PUC.
- 1.10.3 Any and all disputes arising out of or relating to the RFP which remain unresolved for a period of twenty (20) Days after the Initial Meeting takes place may, upon the agreement of the Proposer and the Company, be submitted to confidential Mediation in Honolulu, Hawai‘i, pursuant to and in accordance with the Mediation Rules, Procedures, and Protocols of Dispute Prevention Resolution, Inc. (“DPR”) (or its successor) or, in its absence, the American Arbitration Association then in effect (“Mediation”). The Mediation will be administered by DPR. If the parties agree to submit the dispute to Mediation, the Proposer and the Company shall each pay fifty percent (50%) of the cost

⁷ SBO Proposals will be required to provide a table identifying project costs by year. These capital costs should be all inclusive, including but not limited to costs associated with equipment, Engineering, Procurement, and Construction (“EPC”), interconnection, overhead, and Allowance for Funds Used During Construction (“AFUDC”).

of the Mediation (i.e., the fees and expenses charged by the mediator and DPR) and shall otherwise each bear their own Mediation costs and attorney's fees.

- 1.10.4 If settlement of the dispute is not reached within sixty (60) Days after commencement of the Mediation, or if after the Initial Meeting, the parties do not agree to submit any unresolved disputes to Mediation, then as provided in the Framework, the Proposer may submit the dispute to the PUC in accordance with the Framework.
- 1.10.5 In accordance with the Framework, the PUC will serve as the arbiter of last resort for any disputes relating to this RFP involving Proposers. The PUC will use an informal expedited dispute resolution process to resolve the dispute within thirty (30) Days, as described in Parts III.B.8 and V of the Framework.⁸ There will be no right to hearing or appeal from this informal expedited dispute resolution process.
- 1.10.6 If any Proposer initiates a dispute resolution process for any dispute or claim arising under or relating to this RFP, other than that permitted by the Framework and Section 1.10 (e.g., a court proceeding), then such Proposer shall be responsible for any and all attorneys' fees and costs that may be incurred by the Company or the PUC in order to resolve such claim.

1.11 No Protest or Appeal

Subject to Section 1.10, no Proposer or other person will have the right to protest or appeal any award or disqualification of a Project made by the Company.

By submitting a Proposal in response to the RFP, the Proposer expressly agrees to the terms and conditions set forth in this RFP.

1.12 Modification or Cancellation of the Solicitation Process

- 1.12.1 Unless otherwise expressly prohibited, the Company may, at any time up to the final execution of an RDG PPA or Mid-Tier SFC, as may be applicable, in consultation with the Independent Observer, postpone, withdraw, and/or cancel any requirement, term, or condition of this RFP, including deferral of the award or negotiation of any contract, and/or cancellation of the award all together, all of which will be without any liability to the Company.
- 1.12.2 The Company may modify this RFP subject to requirements of the Framework, whereby the modified RFP will be reviewed by the Independent Observer and submitted to the PUC thirty (30) Days prior to its issuance, unless the PUC directs otherwise. See Framework Part IV.B.10. The Company will follow the same procedure with regard to

⁸ The informal expedited dispute resolution process does not apply to PUC review of contracts that result from the RFP. See Decision and Order No. 23121 at 34-35. Further, the informal expedited dispute resolution process does not apply to the Framework's process relating to issuance of a draft and final RFP, and/or to the PUC approval of the RFP because: (1) the Framework (and the RFP) set forth specific processes whereby interested parties may provide input through the submission of comments; and (2) the Framework's dispute resolution process applies to "Bidders" and there are no "Bidders" at this stage in the RFP process.

any potential postponement, withdrawal, or cancellation of the RFP or any portion thereof.

Chapter 2: Resource Needs and Requirements

2.1 Performance Standards

Proposals must meet the attributes set forth in this RFP, the technical requirements identified in Appendix I of Rule 14H, and either the requirements of the applicable RDG PPA for proposals greater than 2.5 MW or Mid-Tier SFC for proposals 250 kW or greater, up to and including 2.5 MW. This RFP, Rule 14H, and either the applicable RDG PPA or the Mid-Tier SFC set forth the minimum requirements that all Proposals must satisfy to be eligible for consideration in this RFP. If there is a conflict between the Performance Standards in Rule 14H and the applicable RDG PPA or Mid-Tier SFC, the contract terms will control. Additional Performance Standards may be required based on the results of the IRS.

- 2.1.1 For Paired Projects, the functionality and characteristics of the storage must be maintained throughout the term of the RDG PPA or Mid-Tier SFC. To be clear, Proposers may not propose any degradation for either capacity or efficiency in their Proposals.
- 2.1.2 Grid forming and black start capability⁹ are preferred but not required.

2.2 Distribution-Level System Information

Proposers are encouraged to use the Locational Value Maps located at <https://www.hawaiianelectric.com/clean-energy-hawaii/integration-tools-and-resources/locational-value-maps> to determine circuit capacity. However, while the Locational Value Map provides information regarding an initial assessment of the potential MW hosting capacity for distribution level circuits, these numbers should only be used as a screening tool to select a circuit that will provide a higher likelihood of interconnection. This is because the methodology used to develop these hosting capacity numbers is geared towards smaller distributed energy resources (“DER”) and does not include the scenario of a larger DER interconnecting at one point. As a result, load flow analyses are required to confirm the impact to line capacities and voltage limits. Detailed load flow analyses will be performed as part of the project selection process. Prior to submitting a proposal, Proposers are encouraged to inquire about the viability of interconnecting a proposed Project at a specific location. Please direct questions to the RFP Email Address in Section 1.6.

⁹ The ability to start itself and provide power to the Company's grid without relying on any services or energy from the Company's grid in order to assist the grid in recovering from a total or partial shutdown. During such a total or partial shutdown of the grid, the Project may experience step changes in load and other transient and dynamic conditions as it picks up load without support from other resources on the grid during start-up (if the Project remains connected) or while connecting to the loads the Project is picking up (not the start-up and connecting of the Facility itself).

2.2.1 A detailed IRS, when performed, may reveal other adverse system impacts that may further limit a Project's ability to interconnect and/or further limit the net output of the Facility without upgrades.

2.3 Interconnection to the Company System

2.3.1 The Proposer must provide all information pertaining to the design, development, and construction of the Interconnection Facilities as specified in Appendix B. Interconnection Facilities includes both: (1) Seller-Owned Interconnection Facilities; and (2) Company-Owned Interconnection Facilities.

2.3.2 All Proposals must include a description and conceptual or schematic diagrams of the Proposer's plan to transmit power from the Facility to the Company System. The proposed Interconnection Facilities must be compatible with the Company System. In the design, Projects must adequately consider Company requirements to address impacts on the performance and reliability of the Company System.

2.3.2.1 In addition to the Performance Standards and findings of the IRS, the design of the Interconnection Facilities, including power rating, Point(s) of Interconnection with the Company System, and scheme of interconnection, must meet Company standards. The Company will provide its construction standards and procedures to the Proposer (Engineer, Procure, Construct Specifications for Hawaiian Electric Power Lines and Substations) if requested via the communication methods identified in Section 1.5 and upon the execution of a CBRE NDA as specified in Section 3.12.1. These specifications are intended to illustrate the scope of work typically required to administer and perform the design and construction of a Maui Electric substation and power line.

2.3.2.2 Interconnection Facilities must be designed such that it meets or exceeds the applicable single line diagram in Appendix H, Attachment 1 or Attachment 2.

2.3.3 Tariff Rule No. 19, a copy of which is attached as Appendix I, establishes provisions for Interconnection and Transmission Upgrades. The tariff provisions are intended to simplify the rules regarding who pays for, installs, owns, and operates interconnection facilities in the context of competitive bidding.

2.3.4 The Proposer shall be responsible for all costs required to interconnect a Project to the Company System, including all Seller-Owned Interconnection Facilities and Company-Owned Interconnection Facilities.

2.3.5 Proposers are required to include in their pricing proposal all costs for interconnection and equipment expected to be required between their Facility and their proposed Point of Interconnection. Appendix H includes information related to Company-Owned Interconnection Facilities and costs that may be helpful to Proposers. Selected Proposers shall be responsible for the actual final costs of all Seller-Owned Interconnection Facilities and Company-Owned Interconnection Facilities (see Appendix H, Attachment 1 or Attachment 2), whether or not such costs exceed the costs set forth in a Proposer's Proposal. No adjustments will be allowed to the proposed price in a Proposal if actual costs for Interconnection Facilities exceed the amounts proposed.

- 2.3.6 Proposers are required to include in their pricing proposal all costs for distribution-level service interconnection for station power.
- 2.3.7 All Projects will be screened for general readiness to comply with the requirements for interconnection. Proposals selected to the Final Award Group will be subject to Section 5.1.1. Proposals selected to the Final Award Group may be subject to further study in the form of an IRS. The IRS process is further described in Section 5.1.2. The results of the completed IRS or as identified through the Detailed Evaluation process, as well as any mitigation measures identified, will be incorporated into the terms and conditions of a final executed RDG PPA or Mid-Tier SFC.

Chapter 3: Instructions to Proposers

3.1 Schedule for the Proposal Process

Table 1 sets forth the proposed schedule for the proposal process (the “RFP Schedule”). The RFP Schedule is subject to PUC approval. The Company reserves the right to revise the RFP Schedule as necessary. Changes to the RFP Schedule prior to the RFP Proposal Due Date will be posted to the RFP website. Changes to the RFP Schedule after the Proposal Due Date will be communicated via Email to the Proposers and posted on the RFP Website.

**Table 1
Proposed RFP Schedule**

Milestone	Schedule Dates
(1) Draft RFP filed	October 9, 2020
(2) Technical Status Conference	October 28, 2020
(3) Parties and Participants file Comments by	November 13, 2020
(4) Proposed Final RFP filed	December 1, 2020
(5) Final RFP is Issued	January 8, 2021 ¹⁰
(6) Self-Build Proposal Due Date	March 9, 2021 at 2:00 pm HST
(7) IPP and Affiliate Proposal Due Date	March 10, 2021 at 2:00 pm HST
(8) Selection of Priority List	May 21, 2021
(9) BAFOs Due	May 28, 2021
(10) Selection of Final Award Group	September 10, 2021
(11) Contract Negotiations Start	September 20, 2021

¹⁰ Per Section IV.B.6.e.ii of the Competitive Bidding Framework “[t]he utility shall have the right to issue the RFP if the Commission does not direct the utility to do otherwise within thirty (30) days after the Commission receives the proposed RFP and the Independent Observer's comments and recommendations.” January 8, 2021 is an offered issue date that provides the Commission at least thirty (30) days to review the Proposed Final RFP drafts but shifts the Proposal development period to begin after the holiday season. However, this date and all subsequent dates in the proposed schedule are dependent on any further guidance provided by the PUC.

3.2 Company RFP Website/Electronic Procurement Platform

- 3.2.1 The Company has established a website for general information to share with potential Proposers. The RFP website is located at the following link:

www.hawaiianelectric.com/competitivebidding

The Company will provide general notices, updates, schedules and other information on the RFP website throughout the process. Proposers should check the website frequently to stay abreast of any new developments. This website will also contain the link to the Electronic Procurement Platform employed by the Company for the receipt of Proposals.

“Sourcing Intelligence” developed by Power Advocate is the Electronic Procurement Platform that the Company has licensed and will utilize for the receipt of Proposals in this RFP. Proposers who do not already have an existing account with PowerAdvocate and who intend to submit a Proposal for this RFP will need to register as a “Supplier” with PowerAdvocate.

- 3.2.2 There are no license fees, costs, or usage fees to Proposers for the use of the Electronic Procurement Platform.

See Appendix D for user information on and screenshots of PowerAdvocate’s Sourcing Intelligence procurement platform.

3.3 Information Exchange

The PUC ~~will conduct~~conducted a Technical Status Conference on October 28, 2020 to discuss the draft RFP. Parties and Participants ~~will have had~~ the opportunity to submit comments on the draft RFP. The Company ~~will then~~ ~~reviser~~revised the RFP after considering the comments received and ~~filed~~ a final RFP for PUC review and approval.

Additionally, the Company will hold a prerecorded webinar for CBRE Tranche 1 in accordance with the Competitive Bidding Framework for prospective Proposers to learn about the provisions and requirements of this RFP. This prerecorded webinar will be posted to the Company’s website within one week of the issuance of the final RFP.

Prospective Proposers may also submit written questions regarding the RFP to the RFP Email Address set forth in Section 1.6. The Company will endeavor to address all questions that will be helpful to prospective Proposers via a Q&A section on the RFP website.

Prospective Proposers should review the RFP Website’s Q&A section prior to submission of their Proposal. Duplicate questions will not be answered.

3.4 Preparation of Proposals

- 3.4.1 Each Proposer shall be solely responsible for reviewing the RFP (including all attachments and links) and for thoroughly investigating and informing itself with respect to all matters pertinent to this RFP, the Proposer's Proposal, and the Proposer's anticipated performance under the applicable RDG PPA or Mid-Tier SFC. It is the Proposer's responsibility to ensure it understands all requirements of the RFP, to seek clarification if the RFP's requirements or Company's request is not clear, and to ask for any confirmation of receipt of submission of information. Under Section 1.7.5, the Proposer is solely responsible for all errors in its Proposal(s). The Company will not accept any explanation by a Proposer that it was incumbent on the Company to catch any error.
- 3.4.2 Proposers shall rely only on official information provided by the Company in this RFP when preparing their Proposal. The Company will rely only on the information included in the Proposals, and additional information solicited by the Company to Proposers in the format requested, to evaluate the Proposals received. Evaluation will be based on the stated information in this RFP and on information submitted by Proposers in response to this RFP. Proposals must clearly state all capabilities, functionality and characteristics of the Project; must clearly detail plans to be performed; must explain applicability of information; and must provide all referenced material if it is to be considered during the Proposal evaluation. Referencing previous RFP submissions or projects for support will not be considered. Proposers should not assume that any previous RFP decisions or preferences will also apply to this RFP.
- 3.4.3 Each Proposer shall be solely responsible for, and shall bear all of its costs incurred in the preparation of its Proposal and/or its participation in this RFP, including, but not limited to, all costs incurred with respect to the following: (1) review of the RFP documents; (2) status conference participation; (3) site visits; (4) third-party consultant consultation; and (5) investigation and research relating to its Proposal and this RFP. The Company will not reimburse any Proposer for any such costs, including the selected Proposer(s).
- 3.4.4 Each Proposal must contain the full name and business address of the Proposer and must be signed by an authorized officer or agent¹¹ of the Proposer.

3.5 Organization of the Proposal

The Proposal must be organized as specified in Appendix B. It is the Proposer's responsibility to ensure the information requested in this RFP is submitted and contained within the defined proposal sections as specified in Appendix B.

¹¹ Proposer's officer or agent must be authorized to sign the Proposal. Such authorization must be in writing and may be granted via Proposer's organizational documents (i.e., Articles of Incorporation, Articles of Organization, By-laws, etc.), resolution, or similar documentation.

3.6 Proposal Limitations

Proposers expressly acknowledge that Proposals are submitted subject to the following limitations:

The RFP does not commit or require the Company to award a contract, pay any costs incurred by a Proposer in the preparation of a Proposal, or procure or contract for products or services of any kind whatsoever. The Company reserves the right, in consultation with the Independent Observer, to accept or reject, in whole or in part, any or all Proposals submitted in response to this RFP, to negotiate with any or all Proposers eligible to be selected for award, or to withdraw or modify this RFP in whole or in part at any time.

- The Company reserves the right, in consultation with the Independent Observer, to request additional information from any or all Proposers relating to their Proposals or to request that Proposers clarify the contents of their Proposals. Proposers who are not responsive to such information requests may be eliminated from further consideration upon consultation with the Independent Observer.
- The Company reserves the right, in consultation with the Independent Observer, to solicit additional Proposals from Proposers after reviewing the initial Proposals. Other than as provided in this RFP, no Proposer will be allowed to alter its Proposal or add new information to a Proposal after the Proposal Due Date.
- All material submitted in response to this RFP will become the sole property of the Company, subject to the terms of the CBRE NDA.

3.7 Proposal Compliance and Bases for Disqualification

Proposers may be deemed non-responsive and/or Proposals may not be considered for reasons including, but not limited to, the following:

- Any unsolicited contact by a Proposer or prospective Proposer with personnel of the Company pertaining to this RFP as described in Section 1.5.5.
- Any illegal or undue attempts by or on behalf of the Proposer or others to influence the Proposal Review process.
- The Proposal does not meet one or more of the Eligibility Requirements specified in Section 4.2.
- The Proposal does not meet one or more of the Threshold Requirements specified in Section 4.3.
- The Proposal is deemed to be unacceptable through a fatal flaws analysis as described in Section 4.4.2.

- The Proposer does not respond to a Company request for additional information to clarify the contents of its Proposal within the timelines specified by the Company.
- The Proposal contains misrepresentations or errors.

3.8 Power Purchase Agreement

- 3.8.1 The Power Purchase Agreement for proposals selected under this RFP that are greater than 2.5 MW in size will be in the form of the RDG PPA, attached as Appendix K and Appendix M.
- 3.8.2 The Power Purchase Agreement for proposals selected under this RFP that are 250 kW or larger, up to and including 2.5 MW in size, will be in the form of a pre-approved Mid-Tier SFC, attached as Appendix L and Appendix N. The Mid-Tier SFC will be reviewed and pre-approved by the PUC and as a result, will not be negotiable.
- 3.8.3 If selected, any Affiliate Proposers will be required to enter into the applicable RDG PPA or Mid-Tier SFC with the Company.
- 3.8.4 If selected, a Self-Build Proposer will not be required to enter into a RDG PPA or Mid-Tier SFC with the Company. However, the Self-Build Proposer will be held to the proposed modifications to the RDG PPA, if any, it submits as part of the SBO in accordance with Section 3.8.6. Moreover, the SBO will be held to the same performance metrics and milestones set forth in the applicable RDG PPA or Mid-Tier SFC to the same extent as all Proposers, as attested to in the SBO's Appendix G Attachment 1, Self-Build Option Certification submittal. If liquidated damages are assessed, they will be paid from shareholder funds and returned to customers through the Purchased Power Adjustment Clause ("PPAC") or other appropriate rate adjustment mechanisms.

To retain the benefits of operational flexibility for a Company-owned facility, the SBO Proposal will be permitted to adjust operational requirements and performance metrics with the approval of the PUC. The process for adjustment would be similar to a negotiated amendment to a PPA with PUC approval.

- 3.8.5 In general, under the RDG PPA and Mid-Tier SFC, payment to the Seller consists of a Lump Sum Payment component to cover the costs of the Project. For wind projects only, the Company will allow developers to also include an additional Price for Purchase of Electric/Renewable Energy component (\$/MWh component) to cover variable operations and maintenance costs that cannot be captured within the Lump Sum Payment component. In return for the Lump Sum Payment component, the Seller shall guarantee minimum performance and availability metrics to ensure that the Facility is maintained and available for energy storage (if applicable) and dispatch, as well as provide an indication of the available energy in near real-time for the Company's dispatch. Company shall not be obligated to accept, nor shall it be required to pay for, test energy generated by the Facility during acceptance testing or other test conditions.

- 3.8.6 The Performance Standards identified in Section 2.1 establish the minimum requirements a Proposal must satisfy to be eligible for consideration in this RFP. A proposed Facility's ability to meet these Performance Standards is both a Threshold Requirement and a Non-Price Related Criteria under Sections 4.3 and 4.4.2, respectively. As such, these Performance Standards are non-negotiable by a Self-Build Proposer or any other Proposer. Proposers may propose modifications to other sections of the RDG PPA but are encouraged to accept such terms as written in order to expedite the overall RFP process and potential contract negotiations. As a component of their respective Proposals, a Self-Build Proposer or any other Proposer who elects to propose modifications shall provide a Microsoft Word red-line version of the relevant document identifying specific proposed modifications to the model language that the Proposer is agreeable to, as well as a detailed explanation and supporting rationale for each modification.
- 3.8.6.1 General comments, drafting notes and footnotes such as "parties to discuss," and reservation of rights to propose modifications at a later time, are unacceptable and will be considered non-responsive. Proposed modifications to the RDG PPA will be evaluated as a non-price evaluation criterion as further described in Section 4.4.2. In order to facilitate this process, the Company will make available electronic versions of the model agreements on the RFP website and through the Electronic Procurement Platform for the RFP. Any proposed modifications to the RDG PPA will be subject to negotiation between the Company and the Final Award Group and should not be assumed to have been accepted either as a result of being selected to the Final Award Group or based on any previously executed PPA. As stated above, since general comments, drafting notes, and footnotes without accompanying specific proposed language modifications are unacceptable and non-responsive, the Company will not negotiate provisions simply marked by such general comments, drafting notes, and footnotes.
- 3.8.6.2 The Company has an interest in maintaining consistency for certain provisions of the RDG PPAs, such as the calculation of availability and payment terms. Therefore, for such provisions, the Company will endeavor to negotiate similar and consistent language across PPAs for the Final Award Group.
- 3.8.7 Proposals that do not include specific proposed modifications to the attached RDG PPAs will be deemed to have accepted the RDG PPA in its entirety.

3.9 Pricing Requirements

- 3.9.1 Proposers must submit pricing for each of their variations associated with each Proposal (if variations as described in Section 1.8.2 and 1.8.3 are submitted). Proposers are responsible for understanding the terms of the applicable RDG PPA or Mid-Tier SFC. Pricing cannot be specified as contingent upon other factors (e.g., changes to federal tax policy or receiving all Investment Tax Credits assumed).
- 3.9.2 Escalation in pricing over the term of the RDG PPA or the term of the Mid-Tier SFC is prohibited.

- 3.9.3 Pricing information must only be identified within specified sections of the Proposal as instructed by this RFP's Appendix B Proposer's Response Package (i.e., Proposal pricing information must be contained within defined Proposal sections of the Proposal submission). Pricing information contained anywhere else in a Proposal will not be considered during the evaluation process.
- 3.9.4 The Proposer's Response Package must include the following prices for each Proposal (and variation):

For IPP or Affiliate proposals:

- **Lump Sum Payment (\$/year):** Payment amount for full dispatchability of the Facility. Payment will be made in monthly increments.
- **(Optional, For Wind Projects Only) Price for Purchase of Electric/Renewable Energy (\$/MWh):** Payment for delivery of net energy sourced from the variable generation resource, if desired. No Energy Payment will be provided for any energy delivery that is sourced originally from the grid (Company's System).

For Self-Build Proposals:

- **Total Project Capital Costs (\$/year):** Total capital costs for the project (identified by year).
- **Annual O&M Costs (\$/year):** Initial year operations and maintenance costs, annual escalation rate.
- **Annual Revenue Requirement (\$/year):** Annual revenue requirements (ARR) calculated for each year.

See Appendix G for descriptions and detail on the Total Project Capital Costs, Annual O&M Costs, and Annual Revenue Requirement for the Self-Build Proposals.

- 3.9.5 As identified in the Schedule of Defined Terms in the PPA under "BESS Allocated Portion of the Lump Sum Payment", the allocated portion of the Lump Sum Payment specified for energy storage for the Facility for determining liquidated damages is 50% and shall be a non-negotiable percentage in the PPA.

3.10 Project Description

- 3.10.1 Proposals are required to provide a NEP RFP Projection for the Project. The NEP RFP Projection associated with the proposed Project represents the estimated annual net energy (in MWh) that could be produced by the Facility and delivered to the Point of Interconnection over a ten-year period with a probability of exceedance of 95%. For Paired Projects, the energy generated by the Facility in excess of Company dispatch but below the Facility's Allowed Capacity that is stored in the Facility's energy storage component and can later be discharged to the POI considering the BESS Contract

Capacity and Maximum Rated Output should be included in the NEP RFP Projection. Any energy in excess of what is allowed to be delivered to the POI and would exceed the BESS Contract Capacity shall be excluded from the Net Energy Potential. To achieve this objective, the BESS Contract Capacity (MWh) must be at least four times the MW Capacity of the installed PV or wind Capacity. Any energy generated outside of the proposed Facility that is used to charge the energy storage component should not be factored into the NEP RFP Projection. Any losses that may be incurred from energy being stored and then discharged from the energy storage (round trip efficiency losses) should be excluded from the NEP RFP Projection, but the NEP should consider auxiliary loads in developing the value relative to the POI. The NEP RFP Projection will be used in the RFP evaluation process and therefore Proposers will be held to their provided value.¹²

- 3.10.2 Paired Project Proposals are required to provide a single value Round Trip Efficiency (“RTE”), measured at the Point of Interconnection, that the Facility’s BESS component is required to maintain throughout the term of the RDG PPA or Mid-Tier SFC. This RTE value will be used in the RFP evaluation process and therefore Proposers will be held to this provided value as it will become the RTE Performance Metric in Section 2.10 of the RDG PPA or Mid-Tier SFC. Please review the model PPA for potential liquidated damages assessed against Seller if the BESS does not maintain the required RTE. The RTE is further specified in Appendix B Section 2.
- 3.10.3 Each Proposer must also agree to provide Project financial information, including proposed Project finance structure information specified in Appendix B. Such information will be used to evaluate Threshold Requirements and non-price criteria (e.g., Financial Viability of Proposer, Financial Strength and Financing Plan, State of Project Development and Schedule) set forth in Sections 4.3 and 4.4.2. Upon selection, the Final Award Group may be requested to provide further detailed cost information if requested by the PUC or the Consumer Advocate as part of the PPA approval process. If requested, such information would be provided to the PUC, Consumer Advocate, and Company pursuant to a protective order in the docket.
- 3.10.4 The Proposer agrees that no material changes or additions to the Facility from what is submitted in its Proposal will be made without the Proposer first having obtained prior written consent from the Company. Evaluation of all Proposals in this RFP is based on the information submitted in each Proposal at the Proposal Due Date. If any Proposer requests any Proposal information to be changed after that date, the Company, in

¹² If a Proposal is selected to the Final Award Group and a RDG PPA or Mid-Tier SFC is executed between the Company and the Proposer, the NEP RFP Projection will be further evaluated at several steps throughout the process as set forth in the RDG PPA or Mid-Tier SFC, and adjustments to the Lump Sum Payment will be made accordingly. Additionally, because the Company will rely on an accurate representation of the NEP RFP Projection in the RFP evaluation, a one-time liquidated damage as described in the RDG PPA or Mid-Tier SFC will be assessed if the First NEP benchmark is less than the Proposer’s NEP RFP Projection. After the Facility has achieved commercial operations, the performance of the Facility will be assessed on a continuing basis against key metrics identified in the RDG PPA or Mid-Tier SFC. See Article 2 and Attachment U of the RDG PPA or the Mid-Tier SFC.

consultation with the Independent Observer, and in consideration of whether the evaluation is affected, will determine whether the change is permitted.

3.11 Sites Identified by the Company

- 3.11.1 As an alternative to a Site identified by the Proposer, the Company has identified potential Sites where landowners have expressed a willingness to negotiate a lease or purchase of the land to support a renewable energy project. These Sites were identified through a Land RFI. Proposers will be responsible for working directly with the landowner and must secure Site Control with such landowner prior to submitting a Proposal. Land RFI information is available to interested parties who sign the CBRE NDA. The Land RFI is further described in Appendix F.

Proposers are not required to select a Site identified in the Land RFI and as noted above may propose any Site for a Project.

- 3.11.2 Additionally, a Company-owned Site is being offered to Proposers for their consideration. An approximately 8.65 acre area within the Company's Waena property in central Maui, referred to as the Waena Site, is further described in Appendix F to site a potential 2 MW PV project. Additional details regarding the specific interconnection requirements for a project sited at the Waena Site are described in Appendix H. Viability of this project option depends on the approvals of the proposed Waena BESS and Switchyard applications that are currently with the PUC.

Proposers proposing to use the Waena Site shall be required to agree to specific terms and conditions for such use as provided for in Attachment K of the Mid-Tier SFC. Provisions providing for access to the site during construction and thereafter, during commercial operations, will be subject to current Company security policies and procedures, including any additional restrictions due to COVID 19. Physical, communication, and internet security will be required consistent with Company policy. Additional measures may be required to limit or eliminate interference between Seller and Company facilities and infrastructure. Such policies, procedures, and requirements may change as necessary during the term of the PPA to reflect changes in Company policies or to remain in compliance with current applicable laws, rules, or regulations.

Due to COVID-19 travel restrictions, a site visit will not be available at this time. The Company will endeavor to provide as much information as possible to interested potential Proposers. Additional site information, beyond the details included in Appendix F, may be provided by the Company. Information on how to request such additional information, if available, will be posted on the Company's website.

3.12 Confidentiality

- 3.12.1 Each prospective Proposer must submit an executed CBRE NDA in the form attached as Appendix E by the Proposal Due Date specified in the RFP Schedule in Section 3.1, Table 1, Item 7. The form of the CBRE NDA is not negotiable. Information designated as confidential by the Company will be provided on a limited basis, and only those prospective Proposers who have submitted an executed CBRE NDA will be considered.

NDA's that were fully executed for prior non-CBRE RFPs will not be accepted. Proposers must clearly identify all confidential information in their Proposals. However, Proposers should designate as confidential only those portions of their Proposals that genuinely warrant confidential treatment. The Company discourages the practice of marking every page of a Proposal as confidential. The Company will make reasonable efforts to protect any such information that is clearly marked as confidential. Consistent with the terms of the CBRE NDA, the Company reserves the right to share any information, even if marked confidential, to its agents, contractors, or the Independent Observer for the purpose of evaluating the Proposal and facilitating potential contract negotiations.

- 3.12.2 Proposers, in submitting any Proposal(s) to Company in response to this RFP, certify that such Proposer has not shared its Proposal(s), or any part thereof, with any other Proposer of a Proposal(s) responsive to this RFP.
- 3.12.3 The Company will request that the PUC issue a Protective Order to protect confidential information provided by Proposers to the Company and to be filed in a proceeding before the PUC. A copy of the Protective Order, once issued by the PUC, will be provided to Proposers. Proposers should be aware that the Company may be required to share certain confidential information contained in Proposals with the PUC, the State of Hawai'i Department of Commerce and Consumer Affairs, Division of Consumer Advocacy, and the parties to any docket instituted by the PUC, provided that recipients of confidential information have first agreed in writing to abide by the terms of the Protective Order. Notwithstanding the foregoing, no Proposer will be provided with Proposals from any other Proposer, nor will Proposers be provided with any other information contained in such Proposals or provided by or with respect to any other Proposer.

3.13 Credit Requirements

- 3.13.1 Proposers with whom the Company enters into an RDG PPA or Mid-Tier SFC must post Development Period Security and Operating Period Security in the form of an irrevocable standby letter of credit from a bank chartered in the United States as required and set forth in Article 14 of the RDG PPA or the Mid-Tier SFC. Cash, a parent guaranty, or other forms of security will not be accepted in lieu of the irrevocable standby letter of credit.
- 3.13.2 The Development Period Security and Operating Period Security identified in the RDG PPA or the Mid-Tier SFC are minimum requirements. Proposers shall not propose an amount lower than that set forth in the RDG PPA or the Mid-Tier SFC.
- 3.13.3 Each Proposer shall be required to provide a satisfactory irrevocable standby letter of credit in favor of the Company from a bank chartered in the United States to guarantee Proposer's payment of interconnection costs for all Company-Owned Interconnection Facilities in excess of the Total Estimated Interconnection Costs and/or all relocations costs in excess of Total Estimated Relocation Costs that are payable to Company as required and set forth in Attachment G to the RDG PPA or the Mid-Tier SFC.

- 3.13.4 Proposers may be required to provide an irrevocable standby letter of credit in favor of the Company from a bank chartered in the United States in lieu of the required Source Code Escrow in an amount and as required and set forth in Attachment B to the RDG PPA or Mid-Tier SFC.

Chapter 4: Evaluation Process and Evaluation Criteria

4.1 Proposal Evaluation and Selection Process


The Company will employ a multi-step evaluation process. Once the Proposals are received, the Proposals will be subject to a consistent and defined review, evaluation, and selection process. This Chapter provides a description of each step of the process, along with the requirements of Proposers at each step. Figure 1 sets forth the flowchart for the proposal evaluation and selection process.

Upon receipt of the Proposals, the Company will review each Proposal submission to determine if it meets the Eligibility Requirements and the Threshold Requirements. The Company, in coordination with the Independent Observer will determine if a Proposer is allowed to cure any aspect of its Proposal or whether the Proposal would be eliminated based on failure to meet either Eligibility or Threshold Requirements.¹³ If a Proposer is provided the opportunity to cure any aspect of its Proposal, the Proposer shall be given three (3) business days to cure from the date of notification to cure.¹⁴ Proposals that have successfully met the Eligibility and Threshold Requirements will then enter a two-phase process for Proposal evaluation, which includes the Initial Evaluation resulting in the development of a Priority List, followed by the opportunity for Priority List Proposals to provide Best and Final Offers, and then a Detailed Evaluation process to arrive at a Final Award Group.

¹³ As a general rule, if a Proposer does not include a requested document, inadvertently excludes minor information or provides inconsistencies in its information, it may be given a chance to cure such deficiency. If a Proposer fails to provide material required information in its Proposal and providing the Proposer an opportunity to cure is deemed by the Company, in consultation with the Independent Observer, as an unfair advantage to such Proposer, the Proposal could be classified as non-conforming and eliminated for failure to meet the Eligibility Requirements.

¹⁴ The initial request will be offered **three (3)** business days to cure. Succeeding inquiries on the deficiencies will be offered cure periods deemed sufficient by the Company and Independent Observer.

Figure 1 – Evaluation Workflow

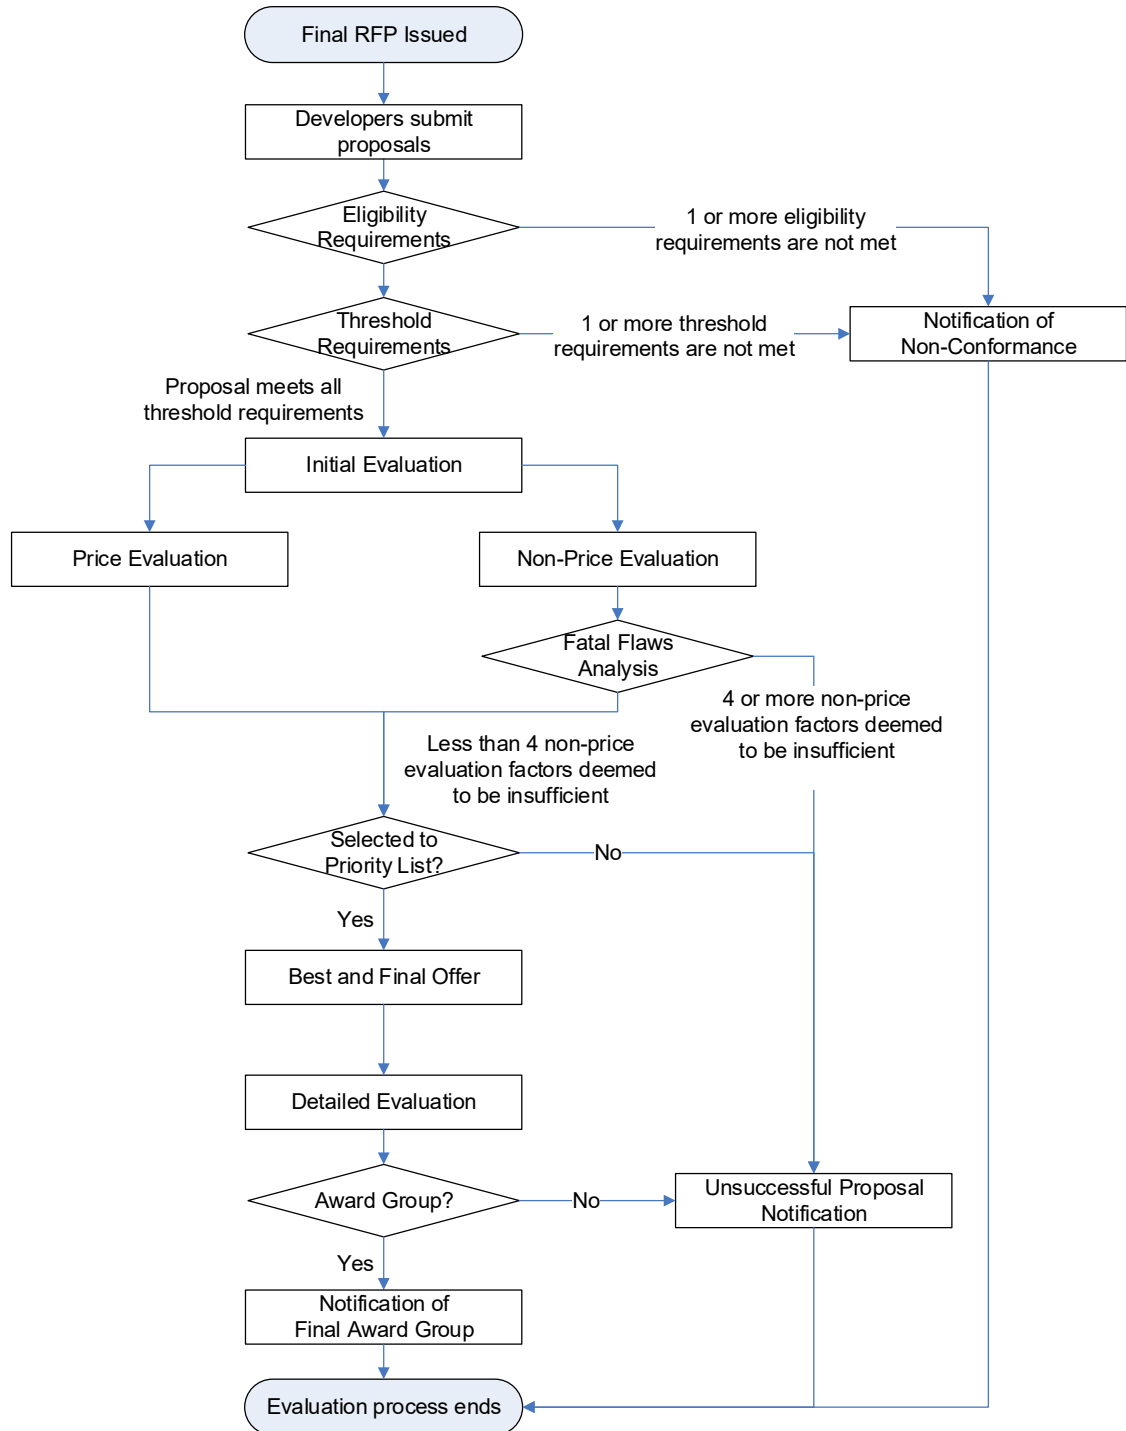

4.2 Eligibility Requirements Assessment

Upon receipt of the Proposals, each Proposal will be reviewed to ensure that it meets the following Eligibility Requirements.

- The Proposer is not eligible to participate in this RFP if the Proposer, its parent company, or an affiliate of the Proposer has:
 - defaulted on a current contract with the Company, or
 - had a contract terminated by the Company, or
 - any pending litigation with the Company.
- The Proposal including required uploaded files must be received on time via the Electronic Procurement Platform.
- The Proposal Fee must be received on or before the Proposal Due Date.¹⁵
- The Proposal must not contain material omissions.
- The Proposal must be signed and certified by an officer or other authorized person of the Proposer.
- The Proposer must fully execute the CBRE NDA and any other document required pursuant to this RFP.
- The Proposer must provide a Certificate of Vendor Compliance from the Hawai'i Compliance Express dated and issued within 60 days of the date of Proposal submission (a certificate of good standing from the State of Hawai'i Department of Commerce and Consumer Affairs and also federal and Hawai'i state tax clearance certificates for the Proposer may be substituted for the Certificate of Vendor Compliance).
- The Proposal must not be contingent upon changes to existing county, state, or federal laws or regulations.
- The proposed Project must be located on the island of Maui.
- The proposed project must be 250 kW or larger.
- Projects interconnecting to a distribution circuit (12 kV or lower) must not exceed 3 MW.
- A minimum of 40% of the Subscriber portion of the Project must be dedicated to residential Subscribers as described in Section 1.2.3.
- Project infrastructure and point of interconnection must be located outside the 3.2 feet sea level rise exposure area (SLR-XA) as described in the Hawai'i Sea Level Rise Vulnerability and Adaptation Report (2017), and not located within a Tsunami Evacuation Zone.
- ~~The Proposal must meet the grid-charging requirements of Section 1.2.13.~~
- The Proposal must specify a GCOD no later than March 31, 2026.
- Proposers shall agree to post Development Period Security and Operating Period Security as described in Section 3.13.

¹⁵ Proposal Fees will not be required for SBO Proposals.

4.3 Threshold Requirement Assessment

Proposals that meet all the Eligibility Requirements will then be evaluated to determine compliance with the Threshold Requirements, which have been designed to screen out Proposals that are insufficiently developed, lack demonstrated technology, or will impose unacceptable execution risk for the Company.

Proposals must provide explanations and contain supporting information demonstrating how and why the Project proposed meets each of the Threshold Requirements. Proposals that fail to provide this information or meet a Threshold Requirement will be eliminated from further consideration upon concurrence with the Independent Observer.

The Threshold Requirements for this RFP are the following:

1. **Site Control:** The Proposal must demonstrate that the Proposer has Site Control for all real property required for the successful implementation of a specific Proposal at a Site not controlled by the Company, including any Interconnection Facilities, with the exception of right-of-way or easements for the interconnection route, for which the Proposer is responsible. The need for a firm commitment is necessary to ensure that Proposals are indeed realistic and can be relied upon as the Company moves through the remainder of the RFP process. As noted in Attachment B, Section 2.5.4, while land rights are not required with the Proposal for the interconnection route, the Proposal should thoroughly describe the interconnection route and as set forth in Attachment B, Section 2.5.5, the Proposal should identify any rights-of-way or easements that are required for access to the Site or for the interconnection route and describe the plan for obtaining such rights-of-way or easement, including the proposed timeline. In addition, developmental requirements and restrictions such as zoning of the Site and the status of easements must be identified and will be considered in determining whether the Proposal meets the Site Control threshold.

To meet this Site Control requirement, Proposers must do one of the following:

- Provide documentation confirming (1) that the Proposer has an existing legally enforceable right to use and control the Site, either in fee simple or under leasehold for a term at least equal to the term of the RDG PPA or Mid-Tier SFC (“Site Control”) as specified in the Proposer’s Proposal (taking into account the timelines set forth in this RFP for selection, negotiation, and execution of a RDG PPA or Mid-Tier SFC and PUC approval as applicable), and (2) the applicable zoning for the Site and that such zoning does not prohibit the development of the Site consistent with the Proposal; or
- Provide documentation confirming, at a minimum, (1) that the Proposer has an executed binding letter of intent, memorandum of understanding, option agreement, or similar document with the land owner (a “binding commitment”) which sets forth the general terms of a transaction that would grant the Proposer the required Site Control, and (2) the applicable zoning for the Site and that such zoning does not prohibit the development of the Site consistent with the Proposal. The binding commitment does not need to be

exclusive to the Proposer at the time the Proposal is submitted and may be contingent upon selection of the Proposal to the Final Award Group. If multiple Projects are provided a binding commitment for the same Site, the documents granting the binding commitments must not prevent the Company from choosing the Proposal that otherwise would have been selected.

- **Government/Public Lands Only:** The above two bullet points may not be feasible where government or publicly-owned lands are part of the Site or are required for the successful implementation of the Proposal. In such a case, at a minimum the Proposer must provide a credible and viable plan, including evidence of any steps taken to date, to secure all necessary Site Control for the Proposal, including but not limited to evidence of sufficient progress toward approval by the government agency or other body vested with the authority to grant such approval (as demonstrated by records of the agency). The Proposer will still be required, however, to demonstrate Site Control as required in the applicable RDG PPA or Mid-Tier SFC should the Proposal be selected to the Final Award Group.
2. **Performance Standards:** The proposed Facility must be able to meet the performance attributes identified in this RFP and the Performance Standards identified in Section 2.1 of this RFP. Proposals should include sufficient documentation to support the stated claim that the Facility will be able to meet the Performance Standards. The Proposal should include information required to make such a determination in an organized manner to ensure this evaluation can be completed within the evaluation review period.
 3. **Proven Technology:** This criterion is intended as a check to ensure that the technology proposed is viable and can reasonably be relied upon to meet the objectives of this RFP. The Company will only consider Proposals utilizing technologies that have successfully reached commercial operations in commercial applications (i.e., a PPA) at the scale being proposed. Proposals should include any supporting information for the Company to assess the commercial and financial maturity of the technology being proposed.
 4. **Experience of the Proposer:** The Proposer, its affiliated companies, partners, and/or contractors and consultants on the Proposer's Project team must have experience in financing, designing, constructing, interconnecting, owning, operating, and maintaining at least one (1) electricity generation project, including all components of the project (i.e., storage or other attributes), similar in size, scope, technology, and structure to the Project being proposed by Proposer. The Company will consider a Proposer to have reasonably met this Threshold Requirement if the Proposer can provide sufficient information in its Proposal's RFP Appendix B Section 2.13 tables demonstrating that at least one member of the Proposer's team (identified in the Proposal) has specific experience in each of the following categories: financing, designing, constructing, interconnecting, owning, operating, and maintaining projects similar to the Project being proposed.

5. **Financial Compliance:** The proposed Project must not cause the Company to be subject to consolidation, as set forth in Financial Accounting Standards Board (“FASB”) Accounting Standards Codification Topic 810, Consolidation (“ASC 810”), as issued and amended from time to time by FASB. Proposers are required to state to the best of their knowledge, with supporting information to allow the Company to verify such conclusion, that the Proposal will not result in the Seller under the PPA being a Variable Interest Entity (“VIE”) and result in the Company being the primary beneficiary of the Seller that would trigger consolidation of the Seller’s finances on to the Company’s financial statements under FASB ASC 810. The Company will perform a preliminary consolidation assessment based on the Proposals received. The Company reserves the right to allow a Proposal to proceed through the evaluation process through selection of the Priority List and work with the Proposer on this issue prior to or during PPA negotiations. The Company has determined that for purposes of FASB ASC 842, a generation plus storage facility will be treated as two separate measurements of account. For accounting purposes, the energy storage portion (if applicable) will be treated as a lease, while the generation facility will not. As a result, no lease evaluation will be completed as part of the Proposal evaluation.
6. **Community Outreach:** Gaining community support is an important part of a Project’s viability and success. A comprehensive community outreach and communications plan (“Community Outreach Plan”) is an essential roadmap that guides a developer as they work with various communities and stakeholders to gain their support for a Project. Proposers must include a Community Outreach Plan that describes the Proposer’s commitment to work with the neighboring community and stakeholders and to provide them timely Project information during all phases of the Project. The Community Outreach Plan shall include, but not be limited to, the following information: Project description, community scoping (including stakeholders and community concerns), Project benefits, government approvals, development process (including Project schedule), and a comprehensive communications plan.
7. **Cultural Resource Impacts:** Proposers need to be mindful of the Project’s potential impacts to historical and cultural resources. Proposers must identify: (1) valued cultural, historical, or natural resources in the area in question, including the extent to which traditional and customary native Hawaiian rights are exercised in the area; (2) the extent to which those resources – including traditional and customary native Hawaiian rights – will be affected or impaired by the proposed action; and (3) the feasible action, if any, to be taken to reasonably protect any identified cultural, historical, or natural resources in the area in question, and the reasonable protection of traditional and customary native Hawaiian rights in the affected area. Also, Proposers must have already contracted with a consultant with expertise in this field to begin a cultural impact assessment for the Project.

4.4 Initial Evaluation – Price and Non-Price Analysis

Proposals that meet both the Eligibility and Threshold Requirements are Eligible Proposals which will then be subject to a price and non-price assessment. Two teams have been established to undertake the Proposal evaluation process: a Price Evaluation Team and Non-Price Evaluation Team. The results of the price and non-price analysis will be a relative ranking and scoring of all Eligible Proposals. Price-related criteria will account for fifty-one percent (51%) of the total score and non-price-related criteria will account for forty-nine percent (49%) of the total score. The non-price criteria and methodology for applying the criteria are explained in Section 4.4.2.

The Company will employ a closed-bidding process for this solicitation in accordance with Part IV.H.3 of the Framework where the price and non-price evaluation models to be used will not be provided to Proposers. However, the Company will provide the Independent Observer with all necessary information to allow the Independent Observer to understand the evaluation models and to enable the Independent Observer to observe the entire analysis to ensure a fair process.

4.4.1 Initial Evaluation of the Price Related Criteria

For the initial price analysis, an avoided cost screening approach will be used to rank proposals. Using the forecast and planning assumptions developed for the Company's Integrated Grid Planning process and evaluation methodology proposed in the Solution Evaluation & Optimization Working Group, a resource portfolio will be developed using a capacity expansion model to identify proxy resources that serve the grid needs and inform their marginal avoided costs. For each Proposal, the avoided cost of each grid service would be multiplied by the expected ability of the Proposal to provide that service or others, and summed across the services to determine the potential benefit of the Proposal. The benefit would then be reduced by the Proposal cost and normalized by the Net Energy Potential ("NEP") provided in the Proposal to calculate a Levelized Benefit ("LB") (\$/MWh).

The Company will conduct the comparative evaluation and award evaluation points to Proposals in accordance with the relative ranking based on LB. The Eligible Proposal with the highest LB will receive 510 points. All other Eligible Proposals will receive points based on a proportionate reduction using the percentage by which the Eligible Proposal's LB is lower than the highest LB. For example, if a Proposal's LB is ten percent (10%) lower than the highest LB, the Proposal will be awarded 459 points (that is, 510 points less 10%). The result of this assessment will be a ranking and scoring of the Proposals.

4.4.2 Initial Evaluation of the Non-Price Related Criteria

For the non-price analysis, each Proposal will be evaluated on each of the twelve (12) non-price criteria categories set forth below:

1. Community Outreach
2. State of Project Development and Schedule

3. Performance Standards
4. Locational Value: Non-Wires Alternative (NWA) and Community Resilience
5. Commitment to Residential Subscriber Participation
6. CBRE Program
7. Environmental Compliance and Permitting Plan
8. Experience and Qualifications
9. Financial Strength and Financing Plan
10. RDG PPA Contract Proposed Modifications
11. Guaranteed Commercial Operations Date
12. Cultural Resource Impacts

Each of the first six criteria – Community Outreach, State of Project Development and Schedule, Performance Standards, Locational Value: NWA and Community Resilience, Commitment to Residential Subscriber Participation, and CBRE Program – will be weighted twice as heavily as the others to reflect the impact these categories have to achieve a successful and timely procurement. The non-price criteria are generally scored on a scale of 1 (poor) to 5 (highly preferable). A score of 3 means that a Proposal meets the minimum standard for that criteria.

The total non-price score will be the sum of the scores for each of the individual non-price criteria. The Company will then award non-price evaluation points in accordance with the relative ranking of scores. The Proposal with the highest total non-price score will receive 490 points, and all other Proposals will receive points equal to the Proposal's score divided by the top score, multiplied by 490.

During the non-price criteria evaluation, a fatal flaws analysis will also be conducted such that any Proposal that is deemed not to meet the minimum standards level for four (4) or more non-price criteria will be disqualified given that the Proposal has failed to meet the required number of non-price factors that are indicative as to the general feasibility and operational viability of a proposed Project. Non-price criteria number 4, 5 and 11 above will be excluded from the fatal flaws analysis.

The Company's evaluation of the non-price criteria will be based on the materials provided by a Proposer in its Proposal. Acceptance of any Proposal into the Final Award Group shall not be assumed or construed to be an endorsement or approval that the materials provided by Proposer are complete, accurate or in compliance with applicable law. The Company assumes no obligation to correct, confirm, or further research any of the materials submitted by Proposers. Proposers retain sole responsibility to ensure their Proposals are accurate and in compliance with all laws.

The non-price criteria are:

1. **Community Outreach** – Gaining community support is an important part of a Project's viability and success. An effective Community Outreach Plan will call for early meaningful communications with stakeholders and will reflect a deep understanding and respect for the community's desire for information to enable them to make informed decisions about future projects in their communities.

Therefore, Proposals will be evaluated on the quality of the Community Outreach Plan to inform the Project's impacted communities.

Proposals should include a Community Outreach Plan that describes the Proposer's commitment to work with the neighboring community and stakeholders and to provide timely Project information during Project development, construction and operation. The Community Outreach Plan shall include, but not be limited to the following:

- 1) Project description. A thorough description including a map of the location of the Project. This information will help the community understand the impact that the Project may have on the community.
- 2) Community scoping. Identify stakeholders (individuals, community leaders, organizations), community issues and concerns, and community sentiment.
- 3) Project benefits. An explanation of the need for the Project. This will help the community to understand how the Project might benefit their community.
- 4) Government approvals. Required government permits and approvals, public hearings and other opportunities for public comment. This information will help the community to understand the level of public scrutiny and participation that might occur for the Project and the opportunities to provide public comments.
- 5) Development process. A Project schedule that identifies key milestones will facilitate the community's understanding of the development process.
- 6) Communications Plan. A communications plan including a detailed community outreach schedule that will keep the affected communities and stakeholders informed about the Project's outreach efforts during early Project development period through construction and operations.

Preference will be given to Proposers who have already identified established contacts to work with the local community, have used community input to incorporate changes to the final design of the Project and mitigate community concerns, have proposed a community benefits package (including details of the community recipients and benefits package), or have community consultants as part of the Project team doing business in Hawai'i that have successfully worked with communities in Hawai'i on the development of two or more energy projects or projects with similar community issues. These criteria are aligned with the Company's community engagement expectation whereby all developers will be required to engage in community outreach prior to signing a PPA with the Company. This process is also outlined in RFP Section 5.3. Further information and instructions regarding expectations for the Community Outreach Plan are included as Attachment 4 and 5 to Appendix B.

2. **State of Project Development and Schedule** – Projects that are further along in development generally have lower project execution risk and a greater probability of being able to be successfully placed into service prior to the GCOD

(specifically identified in each Proposal). At a minimum, Projects should demonstrate how they plan to capture any ITC safe harbor and reach their GCOD specified, including identification of risks and schedule assumptions. (Schedules must identify the IRS completion date and PUC approval dates assumed.) Proposals should also demonstrate, via a detailed critical path schedule, that there is a high likelihood that the Project will be able to reach commercial operations as specified. Proposals shall include a Gantt chart that clearly illustrates the overall schedule and demonstrates achievement of any ITC safe harbor, if applicable, and commercial operations by their specified GCOD. The Gantt chart shall include task durations and dependencies, identify tasks that will be fast tracked, and identifies slack time and contingencies. This criterion will also look at the high-level Project costs set forth in the Proposal including: costs for equipment, construction, engineering, Seller-Owned Interconnection Facilities, Company-Owned Interconnection Facilities, land, annual O&M, the reasonableness of such costs and the assumptions used for such costs. Project costs that do not appear reasonable for a project of the size proposed may result in a lower ranking for this criterion if the Company reasonably determines that the cost information is unrealistic based on prior experience in the market which may result in a risk that the Project can be built on time and for the price proposed by the Proposer. The Company reserves the right to discuss any cost and financial information with a Proposer to ensure the information provided is accurate and correct.

3. **Performance Standards** – The proposed Facility must be able to meet the performance attributes identified in this RFP and the Performance Standards identified in the applicable RDG PPA or Mid-Tier SFC. The Company will review the Proposal information received, including design documents and operating procedures materials provided in the Proposal, and evaluate whether the Project as designed is able to meet the Performance Standards identified in the applicable RDG PPA or Mid-Tier SFC and in this RFP. At a minimum, in addition to meeting the Performance Standards, the Proposal should include sufficient documentation, provided in an organized manner, to support the stated claim that the Facility will be able to meet the Performance Standards. The Proposal should include information required to make such a determination in an organized manner to ensure this evaluation can be completed on a timely basis. Preference will be given to Proposals that provide detailed technical and design information showing how each standard can be met by the proposed Facility. Preference will also be provided on facilities that offer additional capabilities.
4. **Locational Value: Non-Wires Alternative and Community Resilience** – The Company has identified areas on the grid where the siting of a CBRE Project would support grid needs, non-wire alternatives and/or community resilience. Non-wires alternatives have been identified for areas with grid needs. For Projects that support non-wires alternatives, the capability to grid charge is needed to reliably meet distribution capacity needs. For Projects to support community resilience, storage with grid-forming and black start capability is needed: for the purposes of being able to energize any proposed community or “island” as a

microgrid from a de-energized state. The black start capability is not needed to energize the entire grid. Proposals should provide a description of the critical infrastructure or community resilience hubs in proximate location to the proposed Project site that could benefit from the islanding capabilities of the proposed Project. Proposers are encouraged to and will be scored more favorably for locating projects in the following:

- Areas where the grid needs that are identified in Appendix O have a higher certainty rating. Distribution Grid Needs can also be found on the Company's Locational Value Map: [https://www.hawaiianelectric.com/clean-energy-hawaii/integration-tools-and-resources/locational-value-maps/maui-county-locational-value-map-\(lvm\)](https://www.hawaiianelectric.com/clean-energy-hawaii/integration-tools-and-resources/locational-value-maps/maui-county-locational-value-map-(lvm))
 - Areas with identified community resilience that are more vulnerable to extended outages are:
 - Maui County: Hana
5. **Commitment to Residential Subscriber Participation** – Proposals will be evaluated on the stated commitments of the Project's Subscriber Organization to residential Subscribers. At a minimum, Subscriber Organizations will be required to set aside 40% of the Project's capacity for residential Subscribers. Proposers that commit to reserving a portion larger than 40% of their Project capacity for residential Subscribers will be given more favorable scoring. In addition, Proposals will also be evaluated on the stated commitments of the Project's Subscriber Organization to LMI Customers. Proposers that commit to reserving a portion of the Project's capacity for LMI Customers will be given more favorable scoring.
6. **CBRE Program** – Proposals will be evaluated on several facets of the CBRE program being proposed.
- 1) **Program Offering:** Proposals will be evaluated to give preference to program offerings that provide the most benefits to residential and LMI Customers, as applicable. Financing options, upfront fees, payment over time, public funding options, and other creative approaches will be preferred along with programs that offer higher expected customer level savings, favorable payback periods and mechanisms, and other customer benefits. In addition, Proposals shall describe the extent to which residential Subscribers will be financially responsible for the Facility's underperformance.
 - 2) **Marketing and Outreach Plans:** Proposals will be evaluated on the proposed strategies and methods to educate, inform, and stimulate the market in order to achieve their target levels of participation.

- 3) **Program Experience:** Proposals will also be evaluated on Proposers documented success in reaching and retaining participation of residential and LMI Customers, as applicable, in other community-based renewable energy programs.
7. **Environmental Compliance and Permitting Plan** – This criterion relates to the potential (short- and long-term) environmental impacts associated with each project, the quality of the plan offered by the Proposer to mitigate and manage any environmental impacts (including any pre-existing environmental conditions), and the plan of Proposers to remain in environmental compliance over the term of the contract. These impacts are reflected on a technology-specific basis. Completing any necessary environmental review and obtaining the required permitting in a timely manner is also important and Proposals will be evaluated on their plan to identify, apply for, and secure the required permits for the Project, any permitting activity that has been completed to date, including having initial discussions with the applicable regulating agencies such as U.S. Fish and Wildlife and the State of Hawai‘i Department of Land and Natural Resources’ Division of Forestry and Wildlife, prior to submitting a Proposal, and the degree of certainty offered by the Proposer in securing the necessary permits.

At a minimum, proposed Projects should be expected to have minimal environmental impact for most areas and Proposals should provide a comprehensive plan to mitigate the identified potential or actual significant environmental impacts to remain in environmental compliance. The proposed mitigation plans should be included in the Project timeline. Preference will be given to Proposals that provide a more detailed plan as well as those that have proactively taken steps to mitigate potential environmental impacts.

Also, this criterion requires that, at a minimum, Proposers should have identified, and disclosed in their Proposal(s) all major permits, approvals, appurtenances and entitlements (including applicable access, rights of way and/or easements) (collectively, the “permits”) required and have a preliminary plan for securing such permits. Preference will be given to Proposals that are able to provide a greater degree of certainty that its plan to secure the required permits is realistic and achievable, or have already received all or a majority of the required permits. The Proposer should disclose all identified (a) discretionary permits required, i.e., those requiring public or contested case hearings and/or review and discretionary approval by an appropriate government agency and (b) ministerial conditions without discretionary approval conditions. In all cases, the Proposer must provide a credible and viable plan to secure all necessary and appropriate permits necessary for the project. For example, if the project is located within an agricultural district, the Proposer shall provide evidence of Proposer’s verification with the appropriate government agency that the project complies with HRS Section 205-2 and Section 205-4.5, relating to solar energy facilities placed on agricultural land, provided, however that where a special use permit (under Section 205-6), exemption (under Section 205-6), or amendment to land use

district boundary lines (under Section 205-4) is required to secure such compliance, Proposer shall identify the need for such permit, exemption or amendment and provide a list of required prerequisites and/or conditions and a realistic timeline necessary to obtain such permit, exemption or amendment satisfactory for Proposer to still meet its designated Guaranteed Commercial Operations Date.

8. **Experience and Qualifications** – Proposals will be evaluated based on the experience of the Proposer in financing, designing, constructing, interconnecting, owning, operating, and maintaining projects (including all components of the project) of similar size, scope and technology. At a minimum, Proposals must show via the table format specified in RFP Appendix B Section 2.13 that at least one (1) member must have specific experience in each of the following categories: financing, designing, constructing, interconnecting, owning, operating, and maintaining at least one electricity generation project including all components of the project similar to the Project being proposed. Preference will be given to Proposers with experience in successfully developing multiple projects that are similar to the one being proposed and/or that have prior experience successfully developing and interconnecting a utility scale project to the Company's System.
9. **Financial Strength and Financing Plan** – This criterion addresses the comprehensiveness and reasonableness of the financial plan for the Project as well as assesses the financial strength and capability of the Proposer to develop the Project. A complete financial plan addresses the following issues: Project ownership, capital cost and capital structure, sources of debt and equity, and evidence that credit-worthy entities are interested in financing the Project. The financial strength of Proposers or their credit support providers will be considered, including their credit ratings. The financing participants are expected to be reasonably strong financially. Developers and their sources of capital that have investment grade credit ratings from a reputable credit rating agency (S&P, Moody's, Fitch) will also be given preference, with those that have higher credit ratings ranked higher.
10. **RDG PPA Contract Proposed Modifications** – Proposers are encouraged to accept the contract terms identified in the model RDG PPA in its entirety in order to expedite the overall RFP process and potential contract negotiations. Proposers who accept the model RDG PPA without edits or utilize the Mid-Tier SFC, which is non-negotiable and cannot be marked up as part of their Proposal, will receive a higher score and will be the only proposals that can achieve the highest scoring for this non-price evaluation criterion. Technology-specific or operating characteristic-required modifications, with adequate explanation as to the necessity of such modifications, will not jeopardize a project's ability to achieve the highest score. Proposers who elect to propose modifications to the model agreements shall provide a Microsoft Word red-line version of the applicable document identifying specific proposed modifications to the model agreement

language, as well as a detailed explanation and supporting rationale for each modification. General comments without proposed alternate language, drafting notes without explanation or alternate language, footnotes such as “parties to discuss,” or a reservation of rights to make additional modifications to the model agreements at a later time are unacceptable, will be considered unresponsive, and will result in a lower score. See also Section 3.8. The Company and Independent Observer will evaluate the impact that the proposed modifications will have on the overall risk assessment associated with the evaluation of each Proposal.

11. **Guaranteed Commercial Operations Date** – Proposers that are able to design for and commit to an earlier GCOD will be given more favorable scoring. Proposers will be held to the GCOD identified in their Proposal. The GCOD will be a Guaranteed Milestone and will be inserted without amendment into the RDG PPA or Mid-Tier SFC, as applicable.
12. **Cultural Resource Impacts** – Proposers need to be mindful of the Project’s potential impacts to historical and cultural resources. Proposers should have identified (1) valued cultural, historical, or natural resources in the area in question, including the extent to which traditional and customary native Hawaiian rights are exercised in the area; (2) the extent to which those resources – including traditional and customary native Hawaiian rights – will be affected or impaired by the proposed action; and (3) the feasible action, if any, to be taken to reasonably protect any identified cultural, historical, or natural resources in the area in question, and the reasonable protection of traditional and customary native Hawaiian rights in the affected area.

Also, Proposers should have already contracted with a consultant with expertise in this field to begin a cultural impact assessment for the Project. Proposals will be evaluated on the Proposer’s plan and commitment to addressing cultural resource impacts on their Project, if any. Therefore, in order to be evaluated for this criterion, Proposers should, at least, provide the following documentation, as applicable: (1) Proposer’s or its consultant’s experience with cultural resource impacts on past projects; (2) the status of their cultural impact assessment plan. Proposals will be evaluated on the extent to which their cultural impact assessment plan has been developed, and preference will be given to Proposals that are further along in the assessment process, including but not limited to, whether a mitigation/action plan has been provided that addresses any identified cultural resource issues, or a date for when such a plan will be available has been identified, or any portions of such plan have been completed.

4.5 Selection of a Priority List

At the conclusion of both the price and non-price analysis, a total score will be calculated for each Proposal using the 51% price-related criteria / 49% non-price-related criteria weighting outlined above. The price and non-price analysis, and the summation of both price and non-price scores described above, will result in a ranking of Proposals.

The Company will determine a Priority List from the highest scoring Proposals. The Company will develop the Priority Lists in consultation with the Independent Observer. The Company reserves the right, in consultation with the Independent Observer, to limit the projects allowed for further consideration in the initial evaluation to projects that fall within 15% of the highest Levelized Benefit. Selection to the Priority List does not assure an eligible Project's inclusion in the selection of the Final Award Group.

4.6 Best and Final Offer (BAFO)

4.6.1 The Company will solicit a Best and Final Offer from Proposers selected to the Priority List. If the SBO is selected to the Priority List, the SBO will not be eligible to provide a Best and Final Offer and the original pricing submitted in its Self-Build Proposal will be used in the Detailed Evaluation. All other Proposers selected to the Priority List will have the opportunity to update (downward only)¹⁶ the pricing elements in their Proposal in order to improve the competitiveness of their Proposal prior to being further assessed in the Detailed Evaluation phase. At this point in the process, updates may only be made to the following pricing elements:

- Lump Sum Payment (\$/year) amount
- (For Wind Projects Only) Price for Purchase of Electric/Renewable Energy (\$/MWh) amount. Payment for delivery of net energy sourced from the variable generation resource. No Energy Payment will be provided for any energy delivery that is sourced originally from the grid (Company's System).

Proposers will not be allowed to increase their price¹⁷ but may elect to maintain the same pricing submitted in their original Proposal. Proposers will not be allowed to make any other changes to their Proposal during the Best and Final Offer.

4.6.2 If a Proposer does not propose improvements to their pricing elements during the Best and Final Offer solicitation, the original Proposal pricing elements will be deemed its Best and Final Offer.¹⁸

4.7 Detailed Evaluation

The Best and Final Offers of the Priority List Proposals as well as any original Self-Build Proposals, if advanced to the Priority List, will be further assessed in the Detailed Evaluation to identify the Proposals selected to the Final Award Group.

¹⁶ Proposers will only be allowed to adjust pricing elements downward. No upward adjustment to the pricing elements will be permitted or considered. All other characteristics of the Proposal and Facility capabilities must remain valid and unchanged (e.g., NEP, GCOD, etc.)

¹⁷ Proposers will not be allowed to increase the pricing in their Proposals to address interconnection and/or system upgrade costs or for any other reason.

¹⁸ The Company reserves the right, in consultation with the Independent Observer, to adjust the parameters of the BAFO, in the unlikely event that system needs have evolved in a way that the Proposals received do not fully address.

The detailed evaluation process will consist of assessment of combinations of Proposals from the Priority List. A capacity expansion model will use the same assumptions as in the Initial Evaluation but replace the generic resource costs and performance characteristics with the specific costs and performance characteristics of the Projects. Due to computational limitations, all Proposals from the Priority List may not be evaluated simultaneously. The ranking developed in the Initial Evaluation can be used to screen the Proposals in the Detailed Evaluation to those that provide the highest potential benefit to the system. A production simulation model will then be used to provide a feasibility check on the final resource portfolio of Projects.

The evaluation will evaluate the benefits and costs of integrating the Project or combination of Projects onto the Company's System which includes:

1. The cost to dispatch the Project or combination of Projects and the energy and storage purchased;
2. The fuel cost savings (benefits) and any other direct savings (IPP savings from dispatchable fossil fuel savings, where applicable) resulting from the displacement of generation by the Priority List Proposals, including consideration of round-trip efficiencies for facilities with storage;
3. The estimated increase (or decrease) in operating cost, if any, incurred by the Company to maintain system reliability; and
4. The cost of imputed debt, if applicable.

As noted, the Company will take into account the cost of rebalancing its capital structure resulting from any debt or imputed debt impacts associated with each Proposal (including any costs to be incurred by the Company, as described above, that are necessary in implementing the Proposal). The Company proposes to use the imputed debt methodology published by S&P that is applicable to the Proposal being evaluated. S&P views long-term PPAs as creating fixed, debt-like financial obligations that represent substitutes for debt-financed capital investments in generation capacity. By adjusting financial measures to incorporate PPA-fixed obligations, greater comparability of utilities that finance and build generation capacity and those that purchase capacity to satisfy new load are achieved.

During the Detailed Evaluation and before the Proposals advance to the Final Award Group, the Company will perform load flow analyses to determine if certain Projects or combinations of Projects introduce circuit constraints that will factor into the selection process. This is to address the possibility that even though sufficient line capacity was identified for an individual Project, Projects that are in close proximity with each other could introduce additional circuit constraints. The Projects selected must not have any additional constraints imposed based on the Load Flow Analysis to advance to the Final Award Group. However, the Company reserves the right, in consultation with the Independent Observer, to allow minor modifications (i.e., downsize project) to a Proposal to avoid such additional constraints. If such modification resulted in a reduced size of the

Facility, the pricing proposed would also need to be revised. Under no circumstances would a Proposer be allowed to increase their price as a result of such minor modification.

Also in the Detailed Evaluation, other factors will be validated to ensure that the final combination of Projects provides the contemplated benefits that the Company seeks. The Company will evaluate the collateral consequences of the implementation of a combination of Projects, including consideration of the geographic diversity, resource diversity, interconnection complexity, and flexibility and latitude of operation control of the Projects.

The Company may assess additional combinations of Projects if requested by the Independent Observer and if the time and capability exist to perform such analyses.

Projects interconnecting to distribution circuits may be subject to the Technical Review process of Rule 14H. The Company may consider a Project's performance through this process in the Detailed Evaluation.

4.8 Selection of the Final Award Group

Based on the results of the Detailed Evaluation and review of the results with the Independent Observer, the Company will select a Final Award Group. Projects selected to the Final Award Group that are 250 kW or greater, up to and including 2.5 MW in size will execute a Mid-Tier SFC with the Company in the form of Appendix L or Appendix N. Projects larger than 2.5 MW will enter into RDG PPA (in the form of Appendix K or Appendix M) negotiations. All Proposers will be notified at this stage of the evaluation process whether their Proposal is included in the Final Award Group.

Selection to the Final Award Group and/or entering into contract negotiations does not guarantee execution of an RDG PPA or Mid-Tier SFC.

Further, if at any time during the evaluation process it is discovered that a Proposer's Proposal contains incorrect or misrepresented information that has a material effect on any of the evaluation processes, including selection of the Priority List or the Final Award Group, the Company reserves the right, at any time prior to submission of the PPA Application with the PUC, in consultation with the Independent Observer, to disqualify the Proposer from the RFP. If discovery of the incorrect or misrepresented information is made after the Company has filed its PUC application for approval of the PPA with the Proposer, the Company will disclose the incorrect or misrepresented information to the PUC for evaluation and decision as to whether such Proposer should be disqualified and the Company's application dismissed.

Following any removal of a proposal from the Final Award Group, either by disqualification noted immediately above, or via any other removal or withdrawal of a proposal, including failure to reach agreement to the PPA, the Company, taking into consideration the timing of such removal and the current status of the Company's needs under the RFP, in consultation with and concurrence from the Independent Observer, will

review the Priority List to determine (1) if another proposal should be added to the Final Award Group; or (2) if the remaining proposals in the Final Award Group should remain unchanged.

Chapter 5: Post Evaluation Process

5.1 Project Interconnection Process

5.1.1 Interconnection Modeling Process

For all projects greater than or equal to 1 MW in size (regardless of whether an IRS is required), a complete package of Project Interconnection Data Request worksheets, Project single line diagram(s), models for equipment and controls, list(s) to clearly identify the components and respective files (for inverters and power plant controller), three line diagram(s) which show the Point of Interconnection, potential transformer (PT) and current transformer (CT) ratios, and details of the generating facility configuration, including relays, meters, and test switches, and complete documentation with instructions shall be submitted with each Proposal within 30 days after selection to the Final Award Group (see Section 2.11.1 of Appendix B). PSSE Generic models, PSSE User models, and ASPEN models shall be configured to represent all of the functional equipment with settings in place to comply with the Company's performance requirements. These must be checked for functionality by the Proposer or its vendors and consultants prior to submission to the Company. Similar and fully accurate PSCAD models shall be submitted in a condition that complies with the PSCAD modeling guidelines provided by the Company. Overlaid validation plots of PSSE Generic models, PSSE User models, and PSCAD models shall be submitted as described in the Project Interconnection Data Request worksheets to ensure compatible responses from each model.

If the Company determines that an IRS is not required, the Company will provide an Interconnection Modeling Letter Agreement for each selected Project greater than or equal to 1 MW in size, with a statement of required deposit for individual work for: (a) a technical model checkout for each project, and (b) any considerations that are specific to a particular project and location. After proposals and models are submitted, the Company will inspect the data packages for general completeness. For any incomplete submissions, a list of missing or non-functional items will be provided. Proposers will be given 15 Days to resolve data and modeling deficiencies. The Company, in consultation with the Independent Observer, may remove Proposals if their submission requirements are deemed incomplete for the lack of requested models and validation plots.

The technical model checkouts will be conducted first. Upon identification of any functional problems or deficiencies, corrective action shall be taken immediately and on an interactive basis so that the problems or deficiencies can be resolved within 15 Days, including re-submission of data and updated models, or the Project shall be deemed withdrawn. At the discretion of the Company and provided that there is a demonstration of good faith action to minimize delay that would affect the schedule, a second round of model checkout and problem solving may proceed. Thereafter, any notice that a Project is deemed withdrawn for lack of completeness shall be final. Subject to consultation with

the Independent Observer, failure to provide all requested material within the time(s) specified, or changes to the data provided after the due date(s), shall result in elimination from consideration.

5.1.2 Interconnection Requirements Study Process

The Detailed Evaluation process or Appendix III of Rule 14H shall determine the need for an IRS. Upon notification of selection to the Final Award Group, and subject to Rule 14H, the Company will provide an IRS Letter Agreement (in lieu of an Interconnection Modeling Letter Agreement) for each selected project that will require an IRS, with a statement of required deposit for individual and prorated work as part of an IRS Scope for: (1) a System Impact Study that will involve (a) technical model checkout for each project, (b) any considerations that are specific to a particular project and location, and (c) system impact analyses of the projects as a group; and (2) a Facilities Study that includes the Interconnection cost and schedule, including cost of any required system upgrades. After proposals and models are submitted within 30 days after selection to the Final Award Group, the Company will inspect the data packages for general completeness. For any incomplete submissions, a list of missing or non-functional items will be provided. Proposers will be given 15 Days to resolve data and modeling deficiencies. The Company, in consultation with the Independent Observer, may remove Proposals if their submission requirements are deemed incomplete for the lack of requested models and validation plots.

The technical model checkouts will be conducted first. Upon identification of any functional problems or deficiencies, corrective action shall be taken immediately and on an interactive basis so that the problems or deficiencies can be resolved within 15 Days, including re-submission of data and updated models, or the Project shall be deemed withdrawn. At the discretion of the Company and provided that there is a demonstration of good faith action to minimize delay that would affect the schedule, a second round of model checkout and problem solving may proceed. Thereafter, any notice that a Project is deemed withdrawn for lack of completeness shall be final. Subject to consultation with the Independent Observer, failure to provide all requested material within the time(s) specified, or changes to the data provided after the due date(s), shall result in elimination from consideration.

Proposers shall be responsible for the cost of the IRS, under separate agreements for the System Impact Study and the Facilities Study. The overall IRS will provide information including, but not limited to, an estimated cost and schedule for the required Interconnection Facilities for a particular Project and any required mitigation measures. Proposers will be responsible for the actual final costs of all Seller-Owned Interconnection Facilities and Company-Owned Interconnection Facilities. Upon reviewing the results of the IRS, Detailed Evaluation or Technical Review process, if required, pursuant to Rule 14H, Appendix III, Proposers will have the opportunity to declare the RDG PPA (see Section 12.4) or Mid-Tier SFC null and void in the event that the estimated interconnection costs and schedule for the Project are higher than what was estimated in the Project Proposal.

5.2 Contract Negotiation Process

Within five (5) business days of being notified by the Company of its intent to enter into RDG PPA contract negotiations or execute a Mid-Tier SFC, Proposers selected for the Final Award Group will be required to indicate, in writing to the Company's primary contact for this RFP, whether they intend to proceed with their Proposals. Proposers who elect to remain in the Final Award Group will be required to keep their Proposal valid through the award period. RDG PPA contract negotiations will take place in parallel with the IRS process.

The Company intends to execute and file the PPA with the PUC for approval and later amend the PPA to include the results of the IRS.

5.3 Community Outreach and Engagement

The public meeting and comment solicitation process described in this section and Section 29.21 of the RDG PPA (Community Outreach Plan) and Section 28 of the Mid-Tier SFC (Community Outreach) do not represent the only community outreach and engagement activities that can or should be performed by a Proposer.

The Company will publicly announce the Final Award Group no more than five (5) business days after the notification is given to Proposers who are selected to the Final Award Group. Selected Proposers shall not disclose their selection to the public before the Company publicly announces the Final Award Group selection.

On the next business day after the Company notifies a Proposer they were selected, each Proposer shall provide the Company with links to their Project website, which the Company will post on the Company's website. Each Proposer will launch a Project website that will go-live on the day the Company publicly announces the Final Award Group selection. Information on what should be included on the Project website is identified in Appendix B.

Within five (5) business days of notification of selection to the Final Award Group, Proposers must provide the Company with an updated comprehensive Community Outreach Plan to work with and inform neighboring communities and stakeholders and to provide them timely information during all phases of the Project. The Community Outreach Plan shall include but not be limited to the following information: Project description, Project stakeholders, community concerns and Proposer's efforts to address such concerns, Project benefits, government approvals, Project schedule, and a comprehensive communications plan. The Proposer's Community Outreach Plan shall be a public document identified on the Proposer's Project website and made available to the public upon request. As an option, Proposers may provide their updated Community Outreach Plan and website information to the Company for review and feedback. If provided at least 30 days prior to the dates required, the Company will endeavor to review such information and provide feedback on the information before it is made available to the public. Details on the Community Outreach Plan can be found in Appendix B, Attachments 4 and 5.

Prior to the execution date of the PPA, Proposers shall also host a public meeting in the community where the proposed Project is to be located for community and neighborhood groups in and around the vicinity of the Project Site that provided the neighboring community, stakeholders and the general public with: (i) a reasonable opportunity to learn about the proposed Project; (ii) an opportunity to engage in a dialogue about concerns, mitigation measures, and potential community benefits of the proposed Project; and (iii) information concerning the process and/or intent for the public's input and engagement, including advising attendees for projects greater than 2.5 MW in size that they will have thirty (30) calendar days from the date of said public meeting to submit written comments to Company and/or Proposer for inclusion in the Company's submission to the PUC of its application for a satisfactory PUC Approval Order for Projects greater than 2.5 MW and for inclusion on the Proposer's website for Projects up to and including 2.5 MW. The Proposer shall collect all public comments, and then provide the Company copies of all comments received in their original, unedited form. The Proposer will post all comments with personal information redacted on its website for public review. Comments should remain on the Proposer's website for at least two years after the Commercial Operations date. If ~~aan~~ RDG PPA is executed by the Proposer and the Company, the Company may submit any and all public comments (presented in its original, unedited form) as part of its PUC application for this Project. Proposers shall notify the public at least three weeks in advance of the meeting. The Company shall be informed of the meeting. The Company has provided Proposers with detailed instructions regarding the community meeting requirement after the selection of the Final Award Group (Attachment 4 to Appendix B). (For example, notice will be published in county or regional newspapers/media, as well as media with statewide distribution. The Proposer will be directed to notify certain individuals and organizations. The Proposer will be provided templates to use for the public meeting notices, agenda, and presentation.) Proposers must also comply with any other requirement set forth in the RDG PPA or Mid-Tier SFC relating to Community Outreach.

Following the submission of the PUC application for the Project, and prior to the date when the Parties' statements of position are to be filed in the docketed PUC proceeding for the Project, the Proposer shall provide another opportunity for the public to comment on the proposed Project. The Proposer's statement of position filed in the docket associated with the Project will contain an attachment including those comments.

The Proposer shall be responsible for community outreach and engagement for the Project, and that the public meeting and comment solicitation process described in this section do not represent the only community outreach and engagement activities that can or should be performed.

5.4 Greenhouse Gas Emissions Analysis

Proposers whose Proposal(s) are selected for the Final Award Group and are greater than 2.5 MW in size shall cooperate with and promptly provide to the Company and/or Company's consultant(s) upon request all information necessary, in the Company's sole and exclusive discretion, for such consultant to prepare a greenhouse gas ("GHG") emissions analysis and report in support of a PUC application for approval of the RDG

PPA for the Project (the “GHG Review”). Proposers shall be responsible for the full cost of the GHG Review associated with their Project under a Greenhouse Gas Analysis Letter Agreement between the Proposer and the Company. The GHG Review is anticipated to address whether the GHG emissions that would result from approval of the RDG PPA and subsequent to addition of the Project to the Company’s system are greater than the GHG emissions that would result from the operations of the Company’s System without the addition of the Project, whether the cost for renewable, dispatchable generation, and/or energy storage services as applicable under the RDG PPA is reasonable in light of the potential for GHG emissions, and whether the terms of the RDG PPA are prudent and in the public interest in light of its potential hidden and long-term consequences.

5.5 PUC Approval

Any signed RDG PPA resulting from this RFP, greater than 2.5 MW in size, is subject to PUC approval as described in the RDG PPA, including Article 12 and Section 29.20 thereof. Selected projects that are 250 kW or greater, up to and including 2.5 MW will execute a Mid-Tier SFC with the Company which will not be subject to further regulatory review and approval. Selected SBO proposals, greater than 2.5 MW in size are required to file application pursuant to General Order No. 7 if the requirements for such filing are met. However, SBO proposals that are 250 kW or greater, up to and including 2.5 MW will also not be required to submit an additional application pursuant to General Order No. 7, but the Commission will hold the bidding utility to the terms of its bid, similar to an independent power producer.

5.6 Facility In-Service

In order to facilitate the timely commissioning of the projects selected through this RFP, the Company requires the following be included with the 60% design drawings: relay settings and protection coordination study, including fuse selection and ac/dc schematic trip scheme.

For the Company to test the Facility, coordination between the Company and Project is required. Drawings must be approved by the Company prior to testing. The entire Facility must be ready for testing to commence. Piecemeal testing will not be allowed. Communication infrastructure and equipment must be tested by the IPP and ready for operation prior to Company testing.


If approved drawings are not available, or if the Facility is otherwise not test ready as scheduled, the Project may lose its place in the queue, with the Company retaining the flexibility to adjust scheduling as it sees fit. If tests are not completed within the allotted scheduled testing time, the Project will be moved to the end of the Company’s testing queue. The IPP will be allowed to cure if successful testing is completed within the allotted scheduled time. No adjustments will be made to RDG PPA or Mid-Tier SFC milestones if tests are not completed within the original allotted time. Liquidated damages for missed milestones will be assessed pursuant to the RDG PPA or Mid-Tier SFC.

DRAFT
REQUEST FOR PROPOSALS
FOR
COMMUNITY-BASED RENEWABLE ENERGY TRANCHE 1
ISLAND OF MAUI

~~OCTOBER 9~~DECEMBER 1, 2020

Docket No. 2015-0389

*Appendix B – Proposer’s Response Package /
Project Interconnection Data Request*

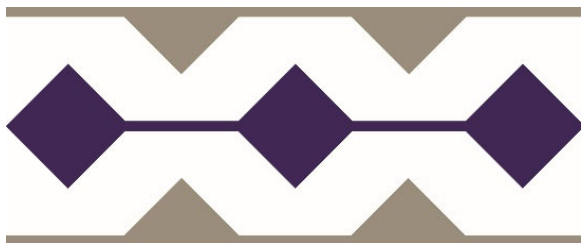

**Maui
Electric**

1.0 GENERAL INSTRUCTIONS TO PROPOSERS

The Company has elected to use the services of PowerAdvocate®, a third-party electronic platform provider. Sourcing Intelligence®, developed by PowerAdvocate®, is the Electronic Procurement Platform that the Company has licensed and will utilize for the RFP process. All Proposals and all relevant information must be submitted via the Electronic Procurement Platform, in the manner described in this RFP.

Proposers must adhere to the response structure and file naming conventions identified in this Appendix for the Proposer's response package. Information submitted in the wrong location/section or submitted through communication means not specifically identified by the Company will not be considered by the Company.

Proposers must provide a response for every item. If input/submission items in the RFP are not applicable to a specific Proposer or Proposal variation, Proposers must clearly mark such items as "N/A" (Not Applicable) and provide a brief explanation.

Proposers must clearly identify all confidential information in their Proposals, as described in more detail in Section 3.12 Confidentiality of the RFP.

All information (including attachments) must be provided in English. All financial information must be provided in U.S. Dollars and using U.S. credit ratings.

It is the Proposer's sole responsibility to notify the Company of any conflicting requirements, ambiguities, omission of information, or the need for clarification prior to submitting a Proposal.

The RFP will be conducted as a "Sealed Bid" event within Sourcing Intelligence, meaning the Company will not be able to see or access any of the Proposer's submitted information until after the event closes.

1.1 ELECTRONIC PROCUREMENT PLATFORM

To access the RFP event, the Proposer must register as a "Supplier"¹ on Sourcing Intelligence (Electronic Procurement Platform). One Proposal may be submitted with each Supplier registration. Minor variations, as defined in Section 1.8.2 and 1.8.3 of this RFP may be submitted along with the Proposal under the same registration.

If a Proposer is already registered on Sourcing Intelligence, the Proposer may use their current login information to submit their Proposal. Two variations of a Proposal, one variation of which is the base variation of the Proposal, may be submitted together as a Proposal by following the instructions outlined in this Appendix (see Section 4 below). If the Proposer chooses to submit more than one Proposal, the Proposer must register as a new "Supplier" on Sourcing Intelligence for each additional Proposal.

Each registration will require a unique username, unique Email address, and unique Company name. Proposers that require multiple registrations to submit multiple Proposals should use the Company name field to represent

¹ The language in Appendix B sometimes refers to "Energy Contract Managers" as "Bid Event Coordinator" and to "Proposers" as "Suppliers" (Bid Event Coordinator and Supplier are terms used by PowerAdvocate).

the Company name and Proposal number (ex: CompanyNameP1). Proposers may use shorthand or clear abbreviations. The unique Email address used to create the PowerAdvocate account does not necessarily have to match the Email address specified in Section 2.2.1 below. For example, if the Proposer is submitting multiple Proposals, all of the Proposer's Proposals could specify the same primary point of contact Email address if that is what the Proposer requests contact through for all their proposals.

Proposers can register for an account on Sourcing Intelligence by clicking on the "Registration" button (located in the top right corner of the webpage) on the PowerAdvocate website at the following address:

www.poweradvocate.com

The Proposer's use of the Electronic Procurement Platform is governed by PowerAdvocate's Terms of Use. By registering as a "Supplier" on the Electronic Procurement Platform, the Proposer acknowledges that the Proposer has read these Terms of Use and accepts and agrees that, each time the Proposer uses the Electronic Procurement Platform, the Proposer will be bound by the Terms of Use then accessible through the link(s) on the PowerAdvocate login page.

Once a Proposer has successfully registered as a "Supplier" with PowerAdvocate, the Proposer shall request access to the subject RFP event from the Company Contact via Email through the RFP Email Address set forth in Section 1.6 of the RFP. The Email request must list the Company Name field and username under which the Proposer has registered with PowerAdvocate. If the Proposer plans to submit multiple Proposals and has registered multiple accounts in accordance with the instructions above, the Email request must contain the Company Name field and username for each account that will be used to submit the Proposals. After being added to the event, the Proposer will see the bid event on their dashboard upon logging into Sourcing Intelligence. Once the RFP event opens, the Proposer may begin submitting their Proposal(s).

After registering and prior to the opening of the RFP, Proposers are encouraged to familiarize themselves with the Electronic Procurement Platform, including tabs, the dashboard, PowerAdvocate Users Guide (RFP Appendix D), etc. Proposers should note that they will not be able to access any bid documents until the event officially opens.

Proposers may contact PowerAdvocate Support for help with registration or modification of registration if desired. Support is available from 8 AM to 8 PM Eastern Time (2 AM to 2 PM Hawai'i Standard Time when daylight savings is in effect) Monday to Friday, except for Holidays posted on the PowerAdvocate website, both by phone (857-453-5800) and by Email (support@poweradvocate.com).

Contact information for PowerAdvocate Support can also be found on the bottom border of the PowerAdvocate website: www.poweradvocate.com

Once the RFP event is opened, registered Proposers will have online access to general notices and RFP-related documents via the Electronic Procurement Platform. Proposers should also monitor the RFP Website throughout the RFP event.

1.2 PROPOSAL SUBMISSION PROCEDURES

An Email notification will be sent to all registered Proposers when the event has been opened to receive Proposals.

After logging onto the Electronic Procurement Platform, the RFP will be visible on the Proposer's dashboard with several tabs, including the following:

- **"1. Download Documents:"** Documents stored under this tab are provided for the Proposer's use and information. All documents can be downloaded and/or printed, as required.
- **"2. Upload Documents:"** Proposal submission documents requested in Appendix B must be uploaded using this tab.
- Note that "3. Commercial Data:", "4. Technical Data:", and "5. Pricing Data:" tabs are NOT USED for this event.

Step-by-step instructions for submitting a complete Proposal are provided below:

1. Proposers must upload their Proposal files, including all required forms and files, to submit a complete Proposal. All files must be uploaded before the respective Proposal Due Date (RFP Section 3.1 Item 6 or Item 7).
2. Submit (upload) one consolidated PDF representing your Proposal via the "2. Upload Documents" tab. That Proposal PDF must abide by the format specified in this Appendix B. A MSWord.docx template that outlines the format of this document is available under the "1. Download Documents" tab for the Proposer's use. **Response information must be provided in the order, format, and manner specified in this Appendix B and must clearly identify and reference the Appendix B section number that the information relates to.**
 - a. Proposers shall use a filename denoting: CompanyName_Proposal#.pdf.
(example: AceEnergy_P1.pdf)
3. Proposal information that cannot be easily consolidated into the PDF file described in Step 2 (such as large-scale drawing files) or files that must remain in native file format (such as computer models and spreadsheets) shall be **uploaded separately but must be referenced from within the main Proposal PDF file** (e.g., "See AceEnergyP1V2_2.5_SiteControlMap.kmz"). Such additional files must follow the naming convention below:
 - a. File names must include, in order, Company Name, Proposal number (if more than one Proposal being submitted per Proposer), Variation (if any variations are being submitted), Appendix B section number, and a file descriptor, as shown in the example file name below:
AceEnergyP1V2_2.5_SiteControlMap.kmz
Proposers may use abbreviations if they are clear and easy to follow.
4. Upload files using the **"2. Upload Documents"** tab on the Electronic Procurement Platform.
 - a. For all documents identify the "Document Type" as "Technical Information." (Do not identify any documents as "Commercial and Administrative" or "Pricing.")
 - b. "Reference ID" may be left blank.
 - c. Select "Choose File..." Navigate to and choose the corresponding file from your computer. Select "Open" and then "Submit Document."

There is no limit to the number or size of files that can be uploaded. Multiple files may be grouped into a .zip archive for upload. (Any zipped files must still adhere to the naming directions in #3 above.) When


successfully uploaded, documents will appear under the "Bid Submissions" section on the bottom of the tab's page, organized within the "Technical Information" Document Type. Repeat steps a, b, and c, as required for each file upload.

If a file with the same name is uploaded twice, the Platform will automatically append a unique numerical extension to the Document Name. To delete a file that has been previously uploaded, click on the "X" button in the "Actions" column for the file to be deleted. Do not upload any files prior to the issuance of the Final RFP.

5. The Company will not be responsible for technical problems that interfere with the upload or download of Proposal information. Support is available to answer technical questions about PowerAdvocate's Sourcing Intelligence from 8 AM to 8 PM Eastern Time (2 AM to 2 PM Hawai'i Standard Time when daylight savings is in effect) Monday to Friday, except for Holidays posted on the PowerAdvocate website, both by phone (857-453-5800) and by Email (support@poweradvocate.com).
6. Proposers are strongly encouraged to start early and avoid waiting until the last minute to submit the required information. Proposers are allowed to add, modify, and/or delete documents that have been previously submitted any time prior to the event close deadline. For clarity, it is the Proposer's responsibility to ensure a complete Proposal is uploaded into PowerAdvocate before the Proposal Due Date.
7. Any questions or concerns regarding the RFP, may be submitted to the Company Contact via the RFP Email address provided in Section 1.6 of the RFP. Per RFP Section 1.4.2, the Independent Observer will monitor messages within the bid event. Proposers are responsible for following instructions and uploading documents in their appropriate locations. Documents uploaded in the wrong tab will not be considered by the Company.

1.3 PROPOSAL COMPLETION AND CONFIRMATION PROCEDURES

To confirm the submission of all proposal files, in the "Status" tab on the Electronic Procurement Platform, confirm that the "Total Uploaded Files" is the number of expected files to be included in the submission by checking it against your list of submitted files. Example "Status" tab view:

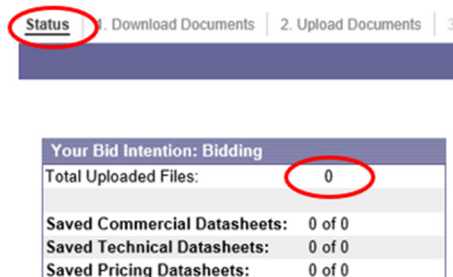

As stated above in Section 1.2, nothing should be uploaded to the Commercial, Technical or Pricing Datasheet tabs. Documents uploaded there will not be included in your Proposal submission.

1.3.1 **Proposal Fee Delivery Information.** Provide the Proposal Fee submission information for this Proposal. Include:

- The Date the Proposal Fee was sent.
- The delivery service used and the tracking number for the parcel.
- The U.S.-chartered bank name that issued the cashier’s check and the check number.

2.0 PROPOSAL (BASE VARIATION) SUMMARY TABLE

Base variation Proposal Summary. If proposal variations are submitted, any changes to the summary information for such variations must be specifically identified in a similar table placed in Sections 4.2, 4.3, 4.4, etc. of this Appendix, as applicable.

To be filled out in its entirety by IPP or Affiliate Proposers:

1	Proposer Name (Company Name)	
2	Parent Company/Owner/Sponsor/Business Affiliation/etc.	
3	Project Name	
4	Net AC Capacity of the Facility (MW)	
5	Proposed Facility Location, Street Address if available, or what City/Area on the island is it near	
6	TMK(s) of Facility Location (use 9-digit TMK format)²	
7	Point of Interconnection’s Circuit Name	
8	Coordinates for Point of Interconnection (use decimal degrees)³	
9	Project Generation Technology	
10	Net Energy Potential (NEP) Projection for the Facility (MWh)	
11	Lump Sum Payment (\$/Year)	
12	Price for Purchase of Electric/Renewable Energy (\$/MWh) (optional and only for wind projects)	
13	Does Project include an Energy Storage Component? (Yes/No)	
If the Project includes an Energy Storage Component:		
14	Project Energy Storage Technology	
15	Energy Storage Capability for the Facility (MW and MWh)	
16	Is the Project capable of being 100% charged from the grid after the 5 year ITC recapture period? (Yes/No)	
17	Is the Project grid-forming and black start capable? (Yes/No)	
18	Proposal Guaranteed Commercial Operations Date (MM/DD/YYYY)	
19	The Proposer hereby certifies that the Project meets all performance attributes identified in Section 2.1 of the RFP? (Yes/No)	

² 9-digit Tax Map Key format: Island Number (1 digit); Zone Number (1 digit); Section Number (1 digit); Plat Number (3 digits, add leading zeros if less than 3 digits); Parcel Number (3 digits, add leading zeros if less than 3 digits).

³ Decimal degrees (YY.YYYYYY, -XXX.XXXXXX) latitude and longitude coordinates of the Point of Interconnection for the project. If there is more than one interconnection point, specify each.

20	The Proposer hereby certifies that the Proposal (including its pricing elements) is not contingent upon changes to existing County, State or Federal laws or regulations. (Yes/No)	
21	The Proposer hereby agrees to provide Development Period Security and Operating Period Security as set forth in the applicable Model RDG PPA or Model Mid-Tier SFC. (Yes/No)	
22	The Proposer hereby certifies under penalties of perjury that this Proposal has been made in good faith and without collusion or fraud with any other person. As used in this certification, the word “person” shall mean any natural person, business partnership, corporation, union, committee, club, or organization, entity, or group of individuals. (Yes/No)	
23	The Proposer hereby certifies that the Proposer, its parent company, or any affiliate of the Proposer has not either defaulted on a current contract with the Company, had a contract terminated by the Company, or has any pending litigation with the Company (Yes/No)	
24	The Proposer hereby certifies that the Project is dedicated to LMI Subscribers with a minimum 60% dedicated to LMI Customers as described in Section 1.2.3 of the RFP? (Yes/No)	

To be filled out in its entirety by Self-Build Proposers:

1	Proposer Name (Company Name)	
2	Parent Company/Owner/Sponsor/Business Affiliation/etc.	
3	Project Name	
4	Net AC Capacity of the Facility (MW)	
5	Proposed Facility Location, Street Address if available, or what City/Area on the island is it near	
6	TMK(s) of Facility Location (use 9-digit TMK format)⁴	
7	Point of Interconnection’s Circuit Name	
8	Coordinates for Point of Interconnection (use decimal degrees)⁵	
9	Project Generation Technology	
10	Net Energy Potential (NEP) Projection for the Facility (MWh)	
11	Does Project include an Energy Storage Component? (Yes/No)	
If the Project includes an Energy Storage Component:		
12	Project Energy Storage Technology	
13	Energy Storage Capability for the Facility (MW and MWh)	
14	Is the Project capable of being 100% charged from the grid after the 5 year ITC recapture period? (Yes/No)	
15	Is the Project grid-forming and black start capable? (Yes/No)	
16	Proposal Guaranteed Commercial Operations Date (MM/DD/YYYY)	
17	The Proposer hereby certifies that the Project meets all performance attributes identified in Section 2.1 of the RFP? (Yes/No)	
18	The Proposer hereby certifies that the Proposal (including its pricing elements) is not contingent upon changes to existing County, State or Federal laws or regulations. (Yes/No)	
19	The Proposer hereby agrees to provide Development Period Security and Operating Period Security as set forth in the applicable Model RDG PPA or Model Mid-Tier SFC. (Yes/No)	

⁴ 9-digit Tax Map Key format: Island Number (1 digit); Zone Number (1 digit); Section Number (1 digit); Plat Number (3 digits, add leading zeros if less than 3 digits); Parcel Number (3 digits, add leading zeros if less than 3 digits).

⁵ Decimal degrees (YY.YYYYYY, -XXX.XXXXXX) latitude and longitude coordinates of the Point of Interconnection for the project. If there is more than one interconnection point, specify each.

20	The Proposer hereby certifies under penalties of perjury that this Proposal has been made in good faith and without collusion or fraud with any other person. As used in this certification, the word “person” shall mean any natural person, business partnership, corporation, union, committee, club, or organization, entity, or group of individuals. (Yes/No)		
21	The Proposer hereby certifies that the Project is dedicated to LMI Subscribers with a minimum 60% dedicated to LMI Customers as described in Section 1.2.3 of the RFP? (Yes/No)		
22	Year (YYYY)	Project Capital Cost (\$)	
23	Year (YYYY)	O&M Cost (\$)	
24	Year (YYYY)	Annual Revenue Requirement (\$)	

2.1 REQUIRED FORMS ACCOMPANYING PROPOSAL PDF

The following forms must accompany each proposal, must be attached to the Proposal PDF, and uploaded via the “2. Upload Documents” tab:

- Document signed by an officer or other Proposer representative **authorizing the submission** of the Proposal
- Fully executed **CBRE Mutual Confidentiality and Non-Disclosure Agreement** (Appendix E to the RFP, may be downloaded from the “1. Download Documents” tab in the Electronic Procurement Platform)
- **Certificate of Vendor Compliance** for the Proposer
 - **Certificate of Good Standing** for the Proposer and **Federal and State tax clearance certificates** for the Proposer may be provided in lieu of the Certificate of Vendor Compliance
- **Certification of Counsel for Proposer**, if applicable. (See Appendix B Attachment 1.)
- Completed applicable **Project Interconnection Data Request worksheet** for the proposed technology and **project diagram(s)**. **Models for equipment and controls, list(s)** identifying components and **respective files** (for inverters and power plant controller), and **complete documentation with**

instructions as specified in the Data Request worksheet shall be submitted within the respective timeframes specified in Section 5.1 of the RFP.⁶ (See Section 2.11.1 below)

- [For Self-Build Only] **Self-Build Option Team Certification Form**. See Appendix G Attachment 1.
- [For Self-Build Only] **Revenue Requirements Worksheets** that support the annual revenue requirements estimates shall be submitted. A starter revenue requirements template file can be requested by the Self-Build Team via email to the RFP Email Address once the RFP event opens. The revenue requirements worksheets submitted will be modified to reflect the details of the Project's Proposal. All assumptions used will be reflected in an assumptions input tab.

2.2 PROPOSAL SUMMARY/CONTACT INFORMATION

2.2.1 Provide a **primary point of contact** for the Proposal being submitted:

- Name
- Title
- Mailing Address
- Phone Number
- Email Address – this will be the official communication address used during the RFP process

2.2.2 **Executive Summary of Proposal.** The executive summary must include an approach and description of the important elements of the Proposal, including a description if a minor variation to the base variation is being submitted. Refer to Section 1.8.2 and 1.8.3 of the RFP for an explanation of minor variations that are allowed. If a minor variation to the base variation is proposed, a **table summarizing the differences of the minor variation in Section 4 shall be included.**

2.2.3 **Pricing information.** Pricing information must be filled out in the Section 2.0 Proposal Summary Table above. If a minor variation to the base variation is proposed, the minor variation's pricing summary must be identified in a similar pricing table in Sections 4.2.0 below. Proposers must provide pricing information only in those table sections – do not embed pricing information in any other portion of the Proposal PDF.

2.2.4 Provide a **high-level overview of the proposed Facility**, including at a minimum the following information:

- Facility Generation Size (MW_{AC} and MW_{DC})
- Net Maximum Output Capacity of the Facility at the Point(s) of Interconnection (MW_{AC})
- Identified Available Hosting Capacity of the Distribution-level (12 kV or less) Circuit Facility Interconnecting to (MW_{AC}), if available. If a Hosting Capacity value is provided, please describe the source of the value (i.e. LVM, Company response to Proposer's inquiry, etc.).
- Technology Type
- Number of Generators
- Rated Output of each Generator

⁶ If the Models, lists, respective files and complete documentation are not submitted with the Proposal upload, they shall be submitted via PowerAdvocate's Messaging as attachments within the respective timeframes specified in Section 5.1 of the RFP.

- Generator Facility Design Characteristics

For projects that include a storage component:

- Technology Type (i.e. lithium ion battery)
- Maximum Rated Output, as defined in the applicable contract (MW)
- Discharge Duration at Maximum Rated Output (hours)
- Storage Energy Capacity (MWh) available at the point of interconnection (i.e. BESS Contract Capacity as defined in the applicable contract)
- Operational Limitations, such as but not limited to: grid charging limits (with respect to ITC), energy throughput limits (daily, monthly, annually), State of Charge restrictions (min/max SOC while at rest (not charging/discharging)), etc. Proposed Operational Limits cannot be in conflict with the energy discharge requirement in Sections 1.2.12 and 1.2.13 of the RFP. If such a conflict is identified, the Proposal may be disqualified.
- Round Trip Efficiency (“RTE”). Specify a single value (percentage) that the Facility is required to maintain throughout the term of the applicable contract. The RTE must consider and reflect:
 - the technical requirements of the Facility (as further set forth in the applicable contract);
 - that the measurement location of charging and discharged energy is at the point of interconnection;
 - electrical losses associated with the point of interconnection measurement location;
 - any auxiliary and station loads that need to be served by BESS energy during charge and discharge that may not be done at Maximum Rated Output or over a fixed duration; and
 - that the data used to validate the RTE will be captured during a full charge cycle (0%-100% SOC) directly followed by a full discharge cycle (100%-0% SOC).
- Describe any augmentation plans for the storage component to maintain the functionality and characteristics of the storage during the term of the applicable contract. Include any expected interval of augmentation (months/years).
- Estimated useful life of the storage component (including augmentation if used) (years)

2.2.5 If the Project requires a RDG PPA as specified in RFP Section 3.8, **state whether the Proposer accepts the contract terms** identified in the model RDG PPA in its entirety or if modifications to the model agreements are proposed. Specify the name of the Microsoft Word red-line file that identifies the proposed modifications to the model language that the Proposer is agreeable to.

2.3 FINANCIAL

Provide the following financial information identified below. As specified in the General Instructions in Section 1.0 above, all information (including attachments) must be provided in English, be provided in U.S. Dollars and use U. S. credit ratings.

2.3.1 Identification of Equity Participants

2.3.1.1 Who are the **equity participants** in the Project (or the equity partners’ other partners)?

2.3.1.2 Provide an **organizational structure** for the Proposer including any general and limited partners and providers of capital that identifies:

- Associated responsibilities from a financial and legal perspective
- Percentage interest of each party

2.3.2 Project Financing

2.3.2.1 **How will the Project be financed** (including construction and term financing)? Address at a minimum:

- The Project's projected financial structure
- Expected source of debt and equity financing

2.3.2.2 [For IPP and Affiliate Proposals] Identify all **estimated development and capital costs** for, at a minimum:

- Equipment
 - Identify the manufacturer and model number for all major equipment
- Construction
- Engineering
- Seller-Owned Interconnection Facilities
- Land
- Annual O&M
- (For Projects that include a storage component) Specify a percentage of the total project cost that is estimated to be attributed to the storage functionality of the Facility. As the storage functionality is treated as a lease, the Company will use the percentage for its preliminary calculation of the lease liability only. This percentage requested for the Company's accounting purposes does not affect nor alter the liquidated damage provisions of the PPA, as those provisions reflect the benefit the Company seeks from the Project's storage functionality.

[For Self-Build Only] Identify all **estimated development and capital costs** for, at a minimum:

- Facility (including any generation and storage components)
- Outside Services
- Interconnection
- Overhead Costs
- Allowance for Funds Used During Construction
- Annual O&M
- Specify the percentage of the total cost associated with the storage component of the Facility
- (For Projects that include a storage component) Specify a percentage of the total project cost that is estimated to be attributed to the storage functionality of the Facility. As the storage functionality is treated as a lease, the Company will use the percentage for its preliminary calculation of the lease liability only. This percentage requested for the Company's accounting purposes does not affect nor alter the liquidated damage provisions of the PPA, as those provisions reflect the benefit the Company seeks from the Project's storage functionality.

2.3.2.3 Discuss and/or provide **supporting information on any project financing guarantees**.

2.3.2.4 Describe any **written commitments obtained from the equity participants**.

2.3.2.5 Describe any **conditions precedent to project financing**, and the Proposer's plan to address them, other than execution of the Power Purchase Agreement or any other applicable project agreements and

State of Hawai'i Public Utilities Commission approval of the Power Purchase Agreement and other agreements.

2.3.2.6 Provide any **additional evidence to demonstrate that the Project is financeable**.

2.3.3 Project Financing Experience of the Proposer

Describe **the project financing experience of the Proposer** in securing financing for projects of a similar size (i.e., no less than two-thirds the size) and technology as the one being proposed including the following information for any referenced projects:

- Project Name
- Project Technology
- Project Size
- Location
- Date of Construction and Permanent Financing
- Commercial Operations Date
- Proposer's Role in Financing of the Project
- Off-taker
- Term of the Interconnection Agreement
- Financing Structure
- Major Pricing Terms
- Name(s) of Finance Team Member(s); Time (i.e., years, months) worked on the project and Role/Responsibilities

2.3.4 Evidence of the Proposer's Financial Strength

2.3.4.1 Provide **copies of the Proposer's audited financial statements** (balance sheet, income statement, and statement of cash flows):

- Legal Entity
 - Three (3) most recent fiscal years
 - Quarterly report for the most recent quarter ended
- Parent Company
 - Three (3) most recent fiscal years
 - Quarterly report for the most recent quarter ended

2.3.4.2 Provide the **current credit ratings** for the Proposer (or Parent Company, if not available for Proposer), affiliates, partners, and credit support provider:

- Standard & Poor's
- Moody's
- Fitch

2.3.4.3 Describe any **current credit issues** regarding the Proposer or affiliate entities raised by rating agencies, banks, or accounting firms.

2.3.4.4 Provide any **additional evidence that the Proposer has the financial resources and financial strength** to complete and operate the Project as proposed.

2.3.5 Provide **evidence** that the Proposer can provide **the required securities**.

2.3.5.1 Describe the Proposer's **ability (and/or the ability of its credit support provider) and proposed plans to provide the required securities** including:

- Irrevocable standby letter of credit
- Sources of security
- Description of its credit support provider

2.3.6 Disclosure of Litigation and Disputes

Disclose any **litigation, disputes, and the status of any lawsuits or dispute resolution** related to projects owned or managed by the Proposer or any of its affiliates

2.4 CONTRACT EXCEPTIONS AND FINANCIAL COMPLIANCE

2.4.1 If Proposers elect to propose modifications to the Model RDG PPA, **provide a Microsoft Word red-line version of the Model RDG PPA** identifying specific proposed modifications to the model language that the Proposer is agreeable to and a detailed explanation and supporting rationale for each modification. General comments, drafting notes and footnotes such as “parties to discuss” are unacceptable and will be considered non-responsive.

Proposers that do not upload redlines of the applicable RDG PPA with their Proposal submission will be deemed to have accepted the Model RDG PPA in its entirety. If no modifications are proposed, please state in this section “no modifications to the Model RDG PPA”.

As set forth in RFP Section 3.8.5.1, proposed modifications to the RDG PPA will be subject to negotiation between the Company and the Final Award Group and should not be assumed to have been accepted either as a result of being selected to the Final Award Group or based on any previously executed PPA.

The Mid-Tier SFC for projects 250 kW or greater, up to and including 2.5 MW will be preapproved by the Commission and as a result, modifications may not be proposed to it.

2.4.2 State to the best of the Proposer's knowledge: Will the Project result in **consolidation** of the Developer entity's finances onto the Company's financial statements under FASB 810. **Provide supporting information** to allow the Company to verify such conclusion.

2.5 SITE CONTROL

2.5.1 The Proposal must demonstrate that the Proposer has Site Control for all real property required for the successful implementation of a specific Proposal at a Site not controlled by the Company, including any Interconnection Facilities for which the Proposer is responsible. In addition, developmental requirements and restrictions such as zoning of the Site and the status of easements must be identified. **Proposers must provide documentation set forth in RFP Section 4.3 to prove Site Control.**

2.5.2 Provide a **map of the Project site** that clearly identifies:

- Location of the parcel on which the site is located

- Tax map key number (9-digit format: Island Number (1 digit), Zone Number (1 digit), Section Number (1 digit), Plat Number (3 digits, add leading zeros if less than 3 digits), Parcel Number (3 digits, add leading zeros if less than 3 digits)
- Site boundaries (if the site does not cover the entire parcel)
- Total acreage of the site
- Point(s) of Interconnection
- Relationship of the site to other local infrastructure

2.5.3 Provide a **site layout plan** which illustrates:

- Proposed location of all equipment
- Proposed location of all facilities on the site, including any proposed line extensions

2.5.4 Describe the **interconnection route** and include:

- Site sketches of how the facility will be interconnected to the Company's System (above-ground and/or underground)
- Identify the approximate latitude and longitude of the proposed Point of Interconnection, in decimal degrees format, to six (6) decimal places.
- Description of the rationale for the interconnection route

2.5.5 Identify **any rights-of-way or easements** that are required for access to the site or for interconnection route:

- Describe the status of rights-of-way or easement acquisition
- Describe the plan for securing the necessary rights-of-way or easement, including the proposed timeline

2.5.6 Provide a **description of any critical infrastructure or community resilience hubs** in proximate location to the proposed Project site that could benefit from an islanding capability of the proposed Project and could enhance resilience in the community.

2.5.7 Indicate whether the Proposal is intended to partially or fully satisfy a Company identified Non-Wire Alternative as stated in Appendix O or the Company's Locational Value Map, and which locational need it intends to satisfy.

2.6 ENVIRONMENTAL COMPLIANCE AND PERMITTING PLAN

Scoring of proposals for the non-price evaluation criteria of this section will be based on the completeness and thoroughness of responses to each of the criteria listed below. The Company recommends that each Proposal incorporate the list below as an outline together with complete and thorough responses to each item in the list. Proposals that closely follow this recommendation will typically be awarded higher scores than proposals that do not.

2.6.1 Describe your **overall land use and environmental permits and approvals strategy** and approach to obtaining successful, positive results from the agencies and authorities having jurisdiction, including:

- Explanation of the conceptual plans for siting
- Studies/assessments
- Permits and approvals
- Gantt format schedule which identifies the sequencing of permit application and approval activities and critical path. (Schedule must be in MM/DD/YY format.)

2.6.2 Discuss the **city zoning and state land use classification**:

- Identify present and required zoning and the ability to site the proposed Project within those zoning allowances.
- Identify present and required land use classifications and the ability to site the proposed Project within those classifications.
- Provide evidence of proper zoning and land use classifications for selected site and interconnection route.
- If changes in the above are required for the proposed Project, provide a plan and timeline to secure the necessary approvals.

2.6.3 Identify all required discretionary and non-discretionary **land use, environmental and construction permits, and approvals** required for development, financing, construction, and operation of the proposed Project, including but not limited to zoning changes, Environmental Assessments, and/or Environmental Impacts Statements.

Provide a **listing of such permits and approvals** indicating:

- Permit Name
- Federal, State, or Local agencies and authorities having jurisdiction over the issuance
- Status of approval and anticipated timeline for seeking and receiving the required permit and/or license
- Explanation of your basis for the assumed timeline
- Explain any situation where a permit or license for one aspect of the Project may influence the timing or permit of another aspect (e.g. a case where one permit is contingent upon completion of another permit or license), if applicable.
- Explain your plans to secure all permits and approvals required for the Project.

2.6.4 Provide a **preliminary environmental assessment of the site** (including any pre-existing environmental conditions) and potential short- and long-term **impacts** associated with, or resulting from, the proposed Project – including direct, indirect, and cumulative impacts associated with development, construction, operation, and maintenance of the proposed Project in every area identified below. Discuss if alternatives have been or will be considered. The assessment shall also include Proposer's short- and long-term plans to mitigate such impacts and explanation of the mitigation strategies for, but not limited to, each of the major environmental areas as presented below:

- Natural Environment
 - Air quality
 - Biology (Natural habitats and ecosystems, flora/fauna/vegetation, and animals, especially if threatened or endangered)
 - Climate
 - Soils
 - Topography and geology

- Land Regulation
 - Land Uses, including any land use restrictions and/or pre-existing environmental conditions/contamination
 - Flood and tsunami hazards
 - Noise
 - Roadways and Traffic
 - Utilities
- Socio-Economic Characteristics
- Aesthetic/Visual Resources
- Solid Waste
- Hazardous Materials
- Water Quality
- Public Safety Services (Police, Fire, Emergency Medical Services)
- Recreation
- Potential Cumulative and Secondary Impacts

2.6.5 Provide a **decommissioning plan**, including:

- Developing and implementing program for recycling to the fullest extent possible, or otherwise properly disposing of installed infrastructure, if any, and
- Demonstrating how restoration of the Site to its original ecological condition is guaranteed in the event of default by the Proposer in the applicable Site Control documentation.

2.7 CULTURAL RESOURCE IMPACTS

2.7.1 Provide a **plan to address the below requirements** as they pertain to the Project Site and interconnection route including the status of any consultant/s with expertise in this field that have been identified and/or contracted with, and documentation of any assessments or work that has been planned or performed to date. Identify any cultural, historical or natural resources in the area in question. For any impacts identified to the categories listed below, provide a mitigation strategy and the expected impact on the Project schedule. Detail the potential impacts of the Proposal on cultural resources in the short- and long-term and the Proposer's plan to mitigate such impacts. Proposers must provide as much information as possible to allow the Company to understand the considerations.

- Archaeological Resources
- Cultural Practices and Resources

2.8 COMMUNITY OUTREACH

Gaining community support is an important part of a Project's viability and success. An effective Community Outreach Plan will call for early meaningful communications with stakeholders and will reflect a deep understanding and respect for the community's desire for information. The public meeting and comment solicitation process described in Section 5.3 of the RFP is intended to support that premise and the Commission's desire to increase bid transparency within the RFP process. When developers neglect to demonstrate transparency and a willingness to engage in early and frequent communication with Hawaii's communities, costly and timely challenges to their projects have resulted. In some instances, projects have failed. Incorporating transparency during the competitive bidding phase may seem unconventional, but it has become an essential community expectation. Developers must share information and work with communities

to address concerns through careful listening, thoughtful responsiveness, and a commitment to respect the environmental and cultural values of Hawai‘i.

2.8.1 Provide a **detailed Community Outreach Plan** to work with and inform neighboring communities and stakeholders and to provide them timely information during all phases of the Project. The plan shall address, but not be limited to, the following items:

- Project description
- Community scoping
- Project benefits
- Government approvals
- Development process
 - Identification of communities and other stakeholders that may be affected by the proposed Project:
 - How will they be affected?
 - What mitigation strategies will the Proposer implement?
- Comprehensive communication strategy with affected communities and the general public regarding the proposed Project:
 - Describe frequency of communication
 - Provide source of information
 - Identify communication outlets
 - Describe opportunities, if any for affected communities and general public to provide the developer with feedback and comments on the proposed Project

Proposers are reminded of RFP Section 3.4.2 including the provision of Proposals must provide all referenced material if it is to be considered during the Proposal evaluation.

2.8.2 Provide any **documentation of local community support or opposition** including any letters from local organizations, newspaper articles, or communications from local officials.

2.8.3 Provide a **description of community outreach efforts** already taken or currently underway, including the names of organizations and stakeholders contacted about the proposed Project.

2.8.4 Describe any anticipated or negotiated investment in the community and other **community benefits** that the Proposer proposes to provide in connection with the Project, along with an estimated value of the community benefits in dollars (including the cost to Proposers providing the benefits and supporting details on how those costs and benefits were derived).

2.8.5 All Proposers selected to the Final Award Group must display the below table of information on their website as described in Section 5.3 of the RFP to provide communities Project information that is of interest to them in a standard format. All information in this table must be included in all community presentations in addition to the Proposer’s project website.

PROJECT SUMMARY AND COMMUNITY OUTREACH PLAN

*	Proposer Name (Company name)	
*	Parent Company/Owner/Sponsor/Business Affiliation/etc.	
*	Project Name	

*	Net AC Capacity of the Facility (MW) (must match Proposal information)	
*	Proposed Facility Location, Street Address if available, or what City/Area on the island it is near	
*	TMK(s) of Facility Location (must match Proposal information)	
*	Point of Interconnection's Circuit (must match Proposal information)	
*	Project Description (in 200 words or less)	<i>(A description that includes information about the project that will enable the community to understand the impact that the Project might have on the community.)</i>
*	Project site map	<i>(provide a map similar to what was provided in Section 2.5.2)</i>
*	Site layout plan	<i>(provide a layout similar to what was provided in Section 2.5.3)</i>
*	Interconnection route	<i>(provide a map of the route similar to what was provided in Section 2.5.4)</i>
Environmental Compliance and Permitting Plan		
*	Overall land use and environmental permits and approvals strategy	<i>(provide information in level of detail as provided in Section 2.6.1)</i>
*	Gantt format schedule which identifies the sequencing of permit applications and approval activities and critical path. Schedule must be in MM/DD/YY format)	<i>(provide information in level of detail as provided in Section 2.6.1)</i>
*	City Zoning and Land Use Classification	<i>(provide information in level of detail as provided in Section 2.6.2)</i>
*	Discretionary and non-discretionary Land use, environmental and construction permits and approvals	<i>(provide information in level of detail as provided in Section 2.6.3)</i>
*	Listing of Permits and approvals	<i>(provide information in level of detail as provided in Section 2.6.3)</i>
*	Preliminary environmental assessment of the Site (including any pre-existing environmental conditions)	<i>(provide information in level of detail as provided in Section 2.6.4)</i>
Cultural Resource Impacts		
*	Proposer's updated Community Outreach Plan must include a plan that (1) identifies any cultural, historic or natural resources that will be impacted by the Project (2) describes	<i>(provide information in level of detail as provided in Section 2.7)</i>

	the potential impacts on these resources and (3) identifies measures to mitigate such impacts.	
Community Outreach		
*	Detailed Community Outreach Plan	<i>(provide key information from Community Outreach Plan as specified in Section 2.8.1 or provide a link to updated comprehensive Community Outreach Plan)</i>
*	Local community support or opposition	<i>(provide latest comprehensive information)</i>
*	Community outreach efforts	<i>(provide latest comprehensive information)</i>
*	Community benefits	<i>(provide latest comprehensive information)</i>

2.9 OPERATIONS AND MAINTENANCE (O&M)

2.9.1 To demonstrate the long-term operational viability of the proposed Project, describe the **planned operations and maintenance**, including:

- Operations and maintenance funding levels, annually, throughout the term of the contract.
- Description of the operational requirements by frequency (daily, weekly, monthly, yearly, as-necessary, run hour interval) and maintenance requirements by frequency (daily, weekly, monthly, yearly, as-necessary, run hour interval).
- A discussion of the staffing levels proposed for the Project and location of such staff. If such staff is offsite, describe response time and ability to control the Project remotely.
- Technology specific maintenance experience records.
- Identification of any O&M providers.
- The expected role of the Proposer (Owner) or outside contractor.
- Scheduling of major maintenance activity.
- Plan for testing equipment.
- Estimated life of Generation and/or Storage Facilities and associated Interconnection Facilities.
- Safety plan, including historical safety records with environmental history records, violations, and compliance plans.
- Security plan.
- Site maintenance plan.
- Substation equipment maintenance plan.

2.9.2 State whether the Proposer would **consider 24-hour staffing**. Explain how this would be done.

2.9.3 Describe the **Proposer's contingency plan**, including the Proposer's mitigation plans to address failures. Such information should be described in the Proposal to demonstrate the Project's reliability with regard to potential operational issues.

2.9.4 Describe if the Proposer will **coordinate their maintenance schedule** for the Project with the Company's annual planned generation maintenance. See Article 5 of the model RDG PPA.

2.9.5 Describe the **status of any O&M agreements or contracts** that the Proposer is required to secure. Include a discussion of the Proposer's plan for securing a long-term O&M contract.

2.9.6 Provide **examples of the Proposer's experience with O&M services** for other similar projects.

2.10 PERFORMANCE STANDARDS

2.10.1 Design and operating information. Provide a **description of the project design**. Description shall include:

- Configuration description, including conceptual or schematic diagrams Overview of the Facility Control Systems – central control and inverter- or resource-level control
- Diagrams approved by a Professional Electrical Engineer registered in the State of Hawai'i, indicated by the presence of the Engineer's Professional seal on all drawings and documents. Including but not limited to:
 - A single-line diagram, relay list, trip scheme and settings of the generating facility, which identifies the Point of Interconnection, circuit breakers, relays, switches, synchronizing equipment, monitoring equipment, and control and protective devices and schemes.
 - A three-line diagram which shows the Point of Interconnection, potential transformer (PT) and current transformer (CT) ratios, and details of the generating facility configuration, including relays, meters and test switches.

2.10.1.1 Provide the projected **hourly annual energy potential production profile of the Facility⁷ (24 hours x 365 days, 8760 generation profile)** for the provided NEP RFP Projection.

2.10.1.2 Provide the **sample rate of critical telemetry** (i.e. frequency and voltage) based on inputs to the facility control systems.

2.10.1.3 Provide a description of the Facility's **capability to be grid-forming and have black start capability**.

2.10.1.4 Provide the explanation of the methodology and underlying **information used to derive the Project's NEP RFP Projection**, including the preliminary design of the Facility and the typical meteorological year file used to estimate the Renewable Resource Baseline, as required in Article 6.6 of the applicable Model PV Large RDG PPA and Mid-Tier SFC. The explanation of the methodology should include, but not be limited to, the long-term resource data used, the gross and net generation MWh, and assumptions (loss factors, uncertainty values, any grid or project constraints).

2.10.2 Capability of **Meeting Performance Standards**. The proposed Facility must meet the performance attributes identified in Section 2.1 of the RFP. Provide **confirmation that the proposed Facility will meet the requirements identified** or provide clarification or comments about the Facility's ability to meet the performance standards. Proposals should include sufficient documentation to support the stated claim that the Facility will be able to meet the Performance Standards. The Proposal should include

⁷ For Paired Projects, the projected hourly annual energy production profile is the projected output from the generating facility without curtailment and before any energy is directed to an energy storage component.

information required to make such a determination in an organized manner to ensure this evaluation can be completed within the evaluation review period.

2.10.3 **Reactive Power Control:** Provide the facility's **ability to meet the Reactive Power Control capabilities**, including Voltage Regulation at the point of interconnection, required in the Performance Standards, including contribution from the inverters of generation and/or storage and means of coordinating the response. Provide the inverter capability curve(s). Confirm ability to provide reactive power at zero active power.

2.10.4 **Ramp Rate** for Generation Facilities: Confirm the ability to meet the ramp rate requirement specified in the Model RDG PPA or Mid-Tier SFC.

2.10.5 **Undervoltage ride-through:** Provide the facility's terminal voltage level(s) and elapsed time at which the facility will disconnect from the utility system during the disturbance, if any. Confirm the ability to meet ride-through requirements and include supporting documentation regarding inverter design, control parameters, etc.

2.10.6 **Overvoltage ride-through:** Provide the facility's terminal voltage level(s) and elapsed time at which the facility will disconnect from the utility system during the disturbance, if any. Confirm the ability to meet ride-through requirements and include supporting documentation regarding inverter design, control parameters, etc.

2.10.7 **Transient stability ride-through:** Provide the facility's ability to stay online during Company System: (1) three-phase fault located anywhere on the Company System and lasting up to __ cycles; and (2) a single line to ground fault located anywhere on the Company System and lasting up to __ cycles. Provide the Facility's ability to withstand subsequent events.

2.10.8 **Underfrequency ride-through:** Provide the facility's terminal frequency level(s) and elapsed time at which the facility will disconnect from the utility system during the disturbance, if any. Confirm the ability to meet ride-through requirements and include supporting documentation regarding inverter design, control parameters, etc.

2.10.9 **Overfrequency ride-through:** Provide the facility's terminal frequency level(s) and elapsed time at which the facility will disconnect from the utility system during the disturbance, if any. Confirm the ability to meet ride-through requirements and include supporting documentation regarding inverter design, control parameters, etc.

2.10.10 **Frequency Response:** Provide the facility's frequency response characteristics as required by the Model RDG PPA or Mid-Tier SFC, including time of response, tunable parameters, alternate frequency response modes and means of implementing such features.

2.10.11 **Auxiliary Power Information:** Proposer must provide the maximum auxiliary power requirements for:

- Start-up
- Normal Operations (from generator)
- Normal Operating Shutdown
- Forced Emergency Shutdown

- Maintenance Outage

2.10.12 **Coordination of Operations:** Provide a description of the control facilities required to coordinate generator operation with and between the Company's System Operator and the Company's System.

- Include a description of the equipment and technology used to facilitate dispatch to the Company and communicate with the Company.
- Include a description of the control and protection requirements of the generator and the Company's System.

2.10.13 **Cycling Capability:** Describe the Facility's ability to cycle on/off and provide limitations.

2.10.14 **Active Power Control Interface:** Describe the means of implementing active power control and the Power Possible, including the contribution to the dispatch signal from paired storage, if any. Provide the Proposer's experience dealing with active power control, dispatch, frequency response, and ride-through.

2.10.15 Provide the details of the **major equipment** (i.e. batteries, inverters, battery management system), including, but not limited to, name of manufacturer, models, key metrics, characteristics of the equipment, and performance specifications.

2.10.16 **Energy Storage performance standards:** For projects that include a storage component, provide additional performance standard descriptions as follows:

- MWh storage output for a full year
- Ramp Rate: Provide the Facility's ramp rate, which should be no more than 2 MW/minute for all conditions other than those under control of the Company System Operator and/or those due to desired frequency response.
- System Response Time – Idle to Design Maximum (minutes)
- Discharge Start-up time (minutes from notification)
- Charge Start-up time (minutes from notification)
- Start and run-time limitations, if any
- Ancillary Services provided, if any (i.e. Spinning Reserves, Non-Spinning Reserves, Regulation Up, Regulation Down, Black Start capability, other)

2.10.17 Provide the description and details of the **grid-charging capabilities of the Facility**. Include a description on the ability to control the charging source.

2.11 INTERCONNECTION SUBMITTAL REQUIREMENTS

2.11.1 For projects greater than or equal to 1 MW in size, provide the appropriate completed **Project Interconnection Requirement Study Data Request worksheets** for the proposed technology with the Proposal submission. The worksheets can be found in the "1. Download Documents" tab as Appx B Att 2a or 2b with the respective file names of Project Interconnection Data Request Worksheets (PV Generation) and Project Interconnection Data Request Worksheet (Wind Generation) MSEXcel files. Also provide all **project diagram(s)** with the Proposal submission. **Models for equipment and controls, list(s)** identifying components and **respective files** (for inverters and power plant controller), and **complete documentation with instructions** shall be submitted within the timeframes specified in Section 5.1 of the RFP.⁶³ Proposers

may also download the Facility Technical Model Requirements and Review Process documentation labelled as Appx B Att 3 from the “1. Download Documents” tab also.

2.12 PROVEN TECHNOLOGY

2.12.1 Provide all supporting information for the Company to assess the **commercial and financial maturity of the technology** being proposed. Provide any supporting documentation that shows examples of projects that:

- Use the technology at the scale being proposed
- Have successfully reached commercial operations (for example, by submitting a PPA)
- Demonstrate experience in providing Active Power dispatch

2.13 EXPERIENCE AND QUALIFICATIONS

Proposers, its affiliated companies, partners, and/or contractors and consultants are required to demonstrate project experience and management capability to successfully develop and operate the proposed Project.

2.13.1 Provide an **organizational chart** for the Project that lists the project participants and identifies the management structure and responsibilities. In addition to the organizational chart, Proposers must provide a completed table:

- For each of the project participants (including the Proposer, partners, and proposed contractors), **fill out the table below** and provide statements that list the specific experience of the firm in: financing, designing, constructing, interconnecting, owning, operating, and maintaining renewable energy generating or storage facilities, or other projects of similar size and technology, and
- Provide any evidence that the project participants have worked jointly on other projects.

EXPERIENCE:							
In the applicable columns below, include project details (i.e., project name, location, technology, size) and relevant job duties (role/responsibilities) and time (in years/months) spent on the project. List multiple projects if applicable.							
Participant Name:	Financing	Designing	Constructing	Interconnecting	Owning	Operating	Maintaining
1.							
2.							
3.							
...							

2.13.2 Identify those **member(s) of the team** the Proposer is submitting to meet the experience Threshold Requirement and demonstrate the member(s) firm commitment to provide services to the Proposer.

2.13.3 Identify those **members of the team with experience and qualifications**, including affiliates, and their principal personnel who will be involved in the project contracting to sell and deliver energy. If the Proposer consists of multiple parties, such as joint ventures or partnerships, provide this information for each

party, clearly indicating the proposed role of each party, including an ownership chart indicating direct and indirect ownership, and percentage interests in the partnership or joint venture.

2.13.4 Provide a **management chart** which lists the key personnel dedicated to this Project and provide **biographies / resumes** of the key personnel, including position, years of relevant experience, and similar project experience. Provide specifics as they relate to financing of renewable energy projects. Identify architects and engineers or provision to provide same that are licensed to practice in the State of Hawai‘i.

2.13.5 Provide a **listing in the table format below, of all renewable energy generation or energy storage projects** the Proposer has successfully developed or that are currently under construction. Describe the Proposer’s role and responsibilities associated with these projects (lead developer, owner, investor, etc.). Provide the following information as part of the response:

Project Name	Location (City, State)	Technology (wind, PV, hydro, plus storage, etc.)	Size (MW/ MWh)	Commercial Operation Date	Offtaker (if applicable)	Role & Responsibilities
1.						
2.						
3.						
...						

2.14 STATE OF PROJECT DEVELOPMENT AND SCHEDULE

2.14.1 Provide a **project schedule in GANTT chart format** with complete **critical path activities** identified for the Proposal from the Notice of Selection of the Proposal to the start of Commercial Operations.

- The **schedule** must include:
 - Interconnection Requirement Study (IRS) assumptions
 - Anticipated contract negotiation period assumptions
 - Regulatory assumptions
 - Anticipated submittal and approval dates for permitting (including but not limited to environmental and archaeological compliance)
 - Siting and land acquisition
 - Cultural Resource implications and mitigation activities
 - Community outreach and engagement activities
 - Energy resource assessment
 - Financing
 - Engineering
 - Procurement
 - Facility construction including construction management events
 - Applicable reporting milestone events specified in the Model RDG PPA or Mid-Tier SFC
 - Testing
 - Interconnection (including engineering, procurement, and construction)
 - Commercial Operations Date
 - All other important elements outside of the direct construction of the Project

- For each project element, list the start and end date (must be in MM/DD/YY format), and include predecessors to clearly illustrate schedule dependencies and durations.
- Proposers must also list and describe critical path activities and milestone events, particularly as they relate to the integration and coordination of the project components and the Company's Electric System. Proposers must ensure that the schedule provided in this section is consistent with the milestone events contained in the RDG PPA or Mid-Tier SFC and/or other agreements.

2.14.2 Describe the **construction execution strategy** including:

- Identification of contracting/subcontracting plans
- Modular construction
- Safety plans⁸
- Quality control and assurance plan
- Labor availability
- Likely manufacturing sites and procurement plans
- Similar projects where these construction methods have been used by the Proposer.

2.14.3 Provide a description of any **project activities that have been performed to date**.

2.14.4 Explain how you plan to reach **safe harbor milestones** (if applicable) and **guaranteed commercial operations**, including durations and dependencies which support this achievement.

3.0 PROPOSED CBRE PROGRAM

Provide a detailed description of the CBRE program that will be offered to eligible subscribers, including at a minimum, but not limited to, a discussion of the following. Please refer to the CBRE program non-price criteria in the RFP for elements of the proposed CBRE program that Proposals will be evaluated on.

- Financing Options
 - LMI Subscriber fees and payments
 - Upfront payments
 - Ongoing payments
 - Public funding options
 - Extent to which subscribers will be financially responsible for any facility underperformance
- Percentage of the project's capacity that will be available to subscribers vs. unsubscribed capacity
 - Capacity allocation (%) and other commitments to residential subscribers
 - Capacity allocation (%) and other commitments to low to moderate income ("LMI") subscribers
- Marketing or outreach plans to advertise the proposed project/program to LMI eligible customers
- Strategies for LMI customer retention and maintaining LMI customer participation levels
- Customer protection provisions
- Estimated benefits to LMI customer participants
 - Expected savings
 - Payback periods
 - Payback mechanisms

⁸ A document that describes the various safety procedures and practices that will be implemented on the Project and how applicable safety regulations, standards, and work practices will be enforced on the Project.

- Other benefits
- Prior experience, specifically relating to community-based renewable energy projects
- Plans for CBRE program administration
 - Strategies for subscriber retention
 - How turnover and churn of subscribers will be handled

4.0 MINOR PROPOSAL VARIATION

Proposers submitting a minor variation to their base variation (as allowed in RFP Section 1.8.2 and 1.8.3) **must** provide the **details of the variation in the below section**. In this proposal variation Section 4.0 below, Proposers **must** (1) complete a Proposal Summary identical to Section 2.0 of this Appendix B. The information in this table must reflect the information for the variation being proposed. As specified in Section 2.2.2 above, Proposers submitting a variation must also (2) include a table summarizing the differences between the base variation and the minor variation. Additionally, Proposers must (3) identify all changes to any information provided in response to Sections 2.1 through 3.0 of this Appendix B for the proposal variation. If differences from any section in Sections 2.1 through 3.0 are not identified, the Company will assume that the information contained in the base Proposal (Sections 2.1 through 3.0) also applies to this proposal variation.

4.1 RESERVED

4.2.0 PROPOSAL VARIATION SUMMARY TABLE

Replicate the entire Summary Table here. The responses to all line items must reflect the variation being proposed.

4.2.1 through 4.3.0 RESPECTIVE SECTIONS AS NECESSARY

Identify differences to any Appendix B Section 2.1 through 3.0 here.


Note: Section 2.2.2 above requires a table summarizing the differences between the variations, if variations are proposed. For convenience, please duplicate the table summarizing the differences here.

DRAFT
REQUEST FOR PROPOSALS
FOR
COMMUNITY-BASED RENEWABLE ENERGY
TRANCHE 1
ISLAND OF MAUI

~~OCTOBER 9~~DECEMBER 1, 2020

Docket No. 2015-0389

*Appendix H – Interconnection Facilities and
Cost Information*

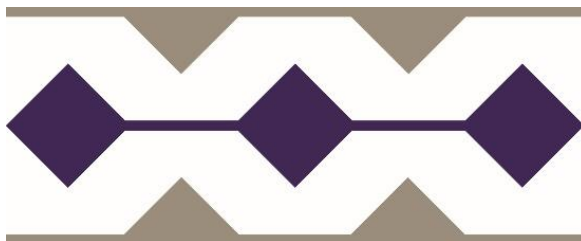

**Maui
Electric**

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

Tariff Rule No. 19, approved by the PUC, establishes provisions for Interconnection and Transmission Upgrades (see Appendix I). The tariff provisions are intended to simplify the rules regarding who pays for, installs, owns, and operates interconnection facilities in the context of competitive bidding. Tariff Rule No. 19 will be utilized as the basis for addressing interconnection and transmission upgrades for any projects developed through this RFP. BiddersProposers will comply with the terms and conditions as specified therein.

To assist BiddersProposers in assessing the impacts of location on potential projects, the per unit cost figures provided in the tables below are to be used to provide an approximate estimated cost for interconnecting, including substation, ~~communicationstelecommunications~~, security, and transmission or distribution line cost to the existing Maui Electric System. The per-unit cost figures below should not be used to create a detailed project estimate. A detailed project estimate typically requires a certain level of engineering to assess project site conditions and to factor in other parameters specific to the project.

The BidderProposer should identify the components assumed for their project and the quantity assumed for each. Each table below provides notes on the assumptions for each of the unit cost estimates. If a Bidder'sProposer's project requirements are different than what is assumed in the notes, the BidderProposer should identify each difference and provide an estimated additional cost or savings resulting from those different requirements.

2.1 Transmission & Distribution Line Interconnection Costs

Component	Description	Cost per Mile
1	New 12kV Overhead line (accessible 250' spans)	\$1,020,000
2	12 kV underbuild on existing line (accessible 250' spans)	\$735,000
3	12 kV underbuild on existing line (inaccessible 250' spans)	\$1,292,000
4	New 12kV Underground line	\$1,369,000
5	Padmount service 500 kVA transformer (for station service)	\$89,000
6	PME9 and PME3 switches for 1-ph and 3-ph transformers	\$307,000

Notes:

1. Please refer to Attachment 1 (for Projects greater than 250 kW and less than 1 MW) or Attachment 2 (for Projects 1 MW or greater) of this Appendix H for a single line diagram depicting the required interconnection to the Company's system. Conceptual Designdesign is not intended to cover all interconnection requirements. Final interconnection design will be subject to the results of a technical review. The costs below are high level per unit costs for

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

Company T&D work in support of the Project. Please see Attachment 4 for examples of how to apply these per unit costs.

<u>Component</u>	<u>Description</u>	<u>Cost</u>
<u>1</u>	<u>New 12kV Overhead line (accessible 250' spans)</u>	<u>\$1,020,000 / mile</u>
<u>2</u>	<u>12 kV underbuild on existing line (accessible 250' spans)</u>	<u>\$735,000 / mile</u>
<u>3</u>	<u>12 kV underbuild on existing line (inaccessible 250' spans)</u>	<u>\$1,292,000 / mile</u>
<u>4</u>	<u>New 12kV Underground line</u>	<u>\$2,407,000 / mile</u>
<u>5</u>	<u>12 kV double riser</u>	<u>\$48,000 each</u>
<u>6</u>	<u>12kV padmount 3ph transformer</u>	<u>\$97,000 each</u>
<u>7</u>	<u>12kV switchgear</u>	<u>\$229,000 each</u>

Notes:

- 2.1. Component 1 assumes wood pole construction.
- 3.2. Components 2 and 3 assume no poles need to be replaced.
- 3. -Component 34 assumes ~~one set~~two (2) sets of 1000 KCM AL 15kV (600A) cable but does NOT feeder cables.
- 4. Component 5 assumes a new wood pole is needed.
- 5. Components 6 and 7 include ~~duet bank and MH~~Company labor and materials to install Company-owned electrical facilities.
- 4.6. EXCLUSIONS to costs provided include, but are not limited to, civil infrastructure design/construction- (ductlines, MHs, equipment pads, etc.), permitting, regulatory approvals, environmental/archeological studies, survey, easements/land costs, vegetation trimming, and clearing/grading. Proposers should conduct their own due diligence for these costs.
- 5. Exclusions to these rough costs are as follows but not limited to the following. Proposers should conduct their own due diligence for these costs:
 - a. Development of the PUC application/proceedings timeline
 - b. State or County right of way permitting and SMA
 - c. Environmental studies cost
 - d. Survey proposed line extension route
 - e. Easement/Land Issues if discovered in the course of final design
 - f. Archaeological survey and monitoring cost/duration (if needed)
 - g. Clearing/grading along power line corridor and access road
 - h. Final design adjustments required to negotiate terrain, physical landmarks, existing utilities and access
 - i. Construction of permanent roadways/truck access
 - j. Helicopter services

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

- ~~k. Traffic Control~~
- ~~l. Removals (MECO & HTCOM as applicable)~~
- ~~m. Salvage and depreciation credits~~
- ~~n. Street lights~~
- ~~o. Delays due to weather and material acquisitions~~
- ~~p. Civil infrastructure (duct bank, MH, equipment pads, etc.) construction~~
- 7. Company may share joint occupancy of poles in the project scope. As a result, there may be facilities on the poles, which are neither owned nor controlled by Company. Please contact the appropriate companies and agencies for any work and costs associated with their respective facilities.
- ~~6.8. All estimates are provided in 2022 dollars.~~
 - ~~The customer shall be responsible to confirm if independent station power is required. Meter requirements should be discussed with Maui Electric during the customer's design stage. Station power shall emanate from an existing 12kV distribution line to the customer's point of connection, either by overhead utility poles or underground line extension. For underground line extensions, the customer shall be responsible for installing and maintaining the infrastructure consisting of, but not limited to, concrete encased ducts, manholes/handholes, transformer and switchgear pads, and meter equipment.~~

2.2 Typical CBRE SLD Interconnection Costs (Projects 250 kW and larger, and less than 1 MW)

Please refer to Attachment 1 of this Appendix H (for Projects greater than 250 kW and less than 1 MW). Conceptual Design is not intended to cover all interconnection requirements. Final interconnection design will be subject to the results of the Detailed Evaluation, Technical Review, or an IRS.

Component	Description	Cost
1	All other components in <u>Attachment 1</u> except for the line extension from the project to the utility distribution circuit (<u>See Section 2.1 above</u>)	\$ 313442 ,000

Notes:

1. Costs ~~includes~~include components on the Company side of the demarcation shown in Attachment 1.
2. Costs for line extension from the project to tap the distribution circuit should be estimated using Section 2.1, above.

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

- ~~3. Company shall own a high-speed power quality device (i.e., Tesla Lite Model) near the point of interconnection, which shall be in continuous service and on a rolling window basis monitoring sub-cycle voltages, currents and harmonics, as well as disturbance events and capable of remote interrogation following an event. Company requires 24-hour access to this equipment. Customer to provide the following hard-wired inputs to Company's power quality device:

 - ~~a. Status of Customer's main AC breaker CB-A (MECO# XXXX);~~
 - ~~b. Line amps (3 phase); and~~
 - ~~c. Line to line voltage (3 phase)~~~~
- ~~4. Secure and reliable communication is required for the following:

 - ~~a. Revenue metering for power export and consumption readings;~~
 - ~~b. Power quality and fault recording and retrieval; and~~
 - ~~c. Phone circuits as required.~~~~
- ~~5. Customer to design revenue metering facilities in accordance with the requirements in Chapter 4 of the HECO Electric Service Installation Manual.~~
- ~~6. PTs and CTs for high-speed digital fault recorder should be the same quality as the PTs and CTs for the protective relaying.~~
- 7.3. Estimate does not contain any of the following costs. Proposers should conduct their own due diligence for these costs:
 - a. Telecommunication infrastructure
 - b. Relay Coordination Study
 - c. Land Cost
 - d. Environmental Assessment/Environmental Impact Statement
 - e. Project Management
- 8.4. Substation relay protection requirements have not been identified, so costs are based upon typical line protection relaying requirements.

5. All estimates are provided in 2022 dollars.

2.3 Typical CBRE SLD Interconnection Costs (Projects 1 MW or greater)

Please refer to Attachment 2 of this Appendix H (for Projects 1 MW or greater). Conceptual ~~Design~~design is not intended to cover all interconnection requirements. Final interconnection design will be subject to the results of the Detailed Evaluation, Technical Review, or an IRS.

Component	Description	Cost
1	All other components in <u>Attachment 2</u> at Developer site except for the line extension from the project to the utility distribution circuit (See <u>see Section 2.1</u> above).	\$480,000

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

2	Components at Company Substation including DTT and relaying requirements	\$356,000 / site

Notes:

1. Costs includes Costs include components on the Company side of the demarcation shown in Attachment 2.
2. Costs for line extension from the project to tap the distribution circuit should be estimated using Section 2.1, above.
3. Component 2 assumes Company Substation is already SCADA enabled.
4. Estimate does not contain any of the following costs. Proposers should conduct their own due diligence for these costs:
 - a. Telecommunication infrastructure
 - b. Relay Coordination Study
 - c. Land Cost
 - d. Environmental Assessment/Environmental Impact Statement
 - e. Project Management
5. Substation relay protection requirements have not been identified, so costs are based upon typical line protection relaying requirements.
6. All estimates are provided in 2022 dollars.

2.4 Typical CBRE SLD Interconnection Costs (Waena Site)

Please refer to Attachment 3 of this Appendix H (for Projects at Waena). Conceptual design is not intended to cover all interconnection requirements. Final interconnection design will be subject to the results of the Detailed Evaluation, Technical Review, or an IRS.

<u>Component</u>	<u>Description</u>	<u>Cost</u>
1	<u>All components in Attachment 2 at Developer site except for the line extension from the project to the utility distribution circuit (See 2.1)</u>	<u>\$480,000</u>
2	<u>Components as shown in Attachment 3 at future Company Waena BESS 34.5kV switchgear.</u>	<u>\$500,000 / interconnecting line</u>

Notes:

Maui Electric Company
APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

1. Costs include components on the Company side of the demarcation shown in Attachment 2.
2. Costs for line extension from the project to tap the distribution circuit should be estimated using 2.1, above.
- ~~3. Company shall own a high-speed power quality device (i.e., Tesla Model No. 4000) near the point of interconnection, which shall be in continuous service and on a rolling window basis monitoring sub-cycle voltages, currents and harmonics, as well as disturbance events and capable of remote interrogation following an event. Company requires 24-hour access to this equipment. Customer to provide the following hard-wired inputs to Company's power quality device:
 - a. Status of Customer's main AC breaker CB-A (MECO# XXXX);
 - b. Status of remotely-resettable lockouts;
 - c. Line amps (3 phase); and
 - d. line to line voltage (3 phase)~~
- ~~4. Secure and reliable communication is required for the following:
 - a. Direct transfer trip from _____ (HECO 12kV circuit) 12kV CB _____ (HECO breaker number);
 - b. SCADA to/ from Customer's facility;
 - c. Revenue metering for power export and consumption readings;
 - d. Power quality and fault recording and retrieval; and
 - e. Phone circuits as required.~~
- ~~5. Customer to provide a reliable DC Source for 12-hour backup period; specific voltage to be determined by Company at a later date.~~
- ~~6. Upon receipt of direct transfer trip signal from _____ (MECO substation name) Substation opening of breaker _____ (MECO breaker number), trip and block close Customer's 12-kV breaker CB-A (MECO# XXXX) via Company-owned SCADA resettable lockout relay.~~
- ~~7. Upon DTT communication channel failure longer than 6 seconds:
 - a. Company to provide signal to Customer to initiate Customer-performed ramp down and tripping of Customer's 12-kV breaker CB-A (MECO# XXXX).
 - b. Company to initiate trip and block close of Customer's 12-kV breaker CB-A (MECO# XXXX) via Company-owned SCADA resettable lockout relay after _____ (Project size MW/2 MW per minute ramp down) minutes.~~
- ~~8. Customer to design revenue metering facilities in accordance with the requirements in Chapter 4 of the HECO Electric Service Installation Manual.~~
- ~~9. PTs and CTs for high-speed digital fault recorder should be the same quality as the PTs and CTs for the protective relaying.~~
- ~~10.3. _____ Component 2 assumes Company Substation is already SCADA enabled.~~
- ~~11.4. _____ Estimate does not contain any of the following costs. Proposers should conduct their own due diligence for these costs:
 - a. Telecommunication infrastructure
 - b. Relay Coordination Study
 - c. Land Cost~~

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

- d. Environmental Assessment/Environmental Impact Statement
 - e. Project Management
- 12.5. Substation relay protection requirements have not been identified, so costs are based upon typical line protection relaying requirements.
6. All estimates are provided in 2022 dollars.

~~**2.4 Typical CBRE SLD Interconnection Costs (Waena Site)**~~

~~[NOTE: Specific requirements for projects proposed at the Waena Site are under review and will be included in the final RFP. Please refer to Attachment 3 of this Appendix H for a conceptual draft interconnection for projects proposed at the Waena Site. Additional interconnection information will be made available upon request to Proposers who have executed the CBRE NDA, included as Appendix E to the RFP.]~~

2.5 Telecommunications

Please refer to Attachment 1 (for Projects greater than 250 kW and less than 1 MW) or Attachment 2 (for Projects 1 MW or greater), of this Appendix H for a single line diagram depicting the required interconnection to the Company’s system. Conceptual design is not intended to cover all interconnection requirements. Final interconnection design will be subject to the results of a technical review.

The communications equipment will require a communications channel(s). Some of the communications channel options include cellular, lease line, licensed radio, fiber, or microwave. The number of communication circuits (primary/backup) and type of communication circuits required will vary depending on the type/size of the project.

The costs below are high level per unit costs for communications requirements in support of the Project. Sections 2.6 and 2.7 provide scenarios of when these options may be utilized. Attachment 4 also provides examples of how to apply these per unit costs.

2.5.1 Cellular or Lease Line Options

<u>Component</u>	<u>Description</u>	<u>Cost</u>
<u>1</u>	<u>Cellular or Lease line one-time and recurring costs</u>	<u>will vary based on 3rd party provider</u>
<u>2</u>	<u>Communications Cabinet* with SCADA</u>	<u>\$127,000 / site</u>
<u>3</u>	<u>Communications Cabinet* with SCADA and Relay Protection</u>	<u>\$171,000 / site</u>
<u>4</u>	<u>Communications Enclosure with SCADA (proj. less than 1MW)</u>	<u>\$46,000 / site</u>

* All projects that require ~~telecommunications~~communications will require facilities to store the communications equipment. An example for a communications cabinet is provided but other alternatives can be available upon request. ~~The communications equipment will require a~~

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

~~communications channel. Some of the communication channel options include microwave, fiber, lease line, or licensed radio. The number of communication circuits (primary/backup) and type of communication circuits required will vary depending on the type/size of the project.~~

Notes:

1. Cellular or Lease Line:

- a. Check with Company to understand the current cellular or lease line requirements.
- b. Communication circuit requirements will be based on applications needed for the project.
- c. Company can provide communication circuit interconnection requirements and assist with review of circuit order from the 3rd party provider as needed.
- d. Customer to work directly with 3rd party provider if a cellular or lease line circuit is needed.
- e. Cost will be the responsibility of the developer and to be negotiated with the 3rd party provider.

2. Communications Cabinet or Enclosure:

- a. Cabinet used to support company equipment and capable of providing communications circuit for SCADA
- b. Communications cabinet cost does not include fiber, microwave, or radio equipment or lease circuits.
- c. Customer will provide all conduits, foundations, handholes, AC Power, grounding as required per company standards.
- d. Cost estimates are in 2022 dollars.

2.5.2 Licensed 900 MHz Radio Option

<u>Component</u>	<u>Description</u>	<u>Cost</u>
<u>1</u>	<u>Licensed 900 MHz Radio equipment</u>	<u>\$144,000 / link</u>
<u>2</u>	<u>Communications Cabinet with SCADA</u>	<u>\$127,000 / site</u>
<u>3</u>	<u>Communications Cabinet with SCADA and Relay Protection</u>	<u>\$171,000 / site</u>

Notes:

1. Licensed 900 MHz Radio:

- a. This cost will be in addition to the Communication Cabinet cost. The radio equipment will be installed within the Communication Cabinet.
- b. There is radio line-of-sight clearance between the communication endpoints.

~~1. Microwave Equipment~~

~~a. 1. Point To Point Microwave: \$684,117 with the following assumptions:~~

- ~~i.a. There is radio line of sight clearance between the communication endpoints.~~
- c. FCC licensed 900Mhz frequencies are available.

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

- d. There is an existing structure/building with space available on the Company side to mount the antenna equipment and house the radio equipment.
- e. The customer will install a structure to mount the antenna equipment on the customers side.
 - i. Customer will provide any conduit required between the Communications Cabinet and antenna mount structure.
- f. The cost includes 2 each antenna equipment to create a radio link.
- g. Cost estimates are in 2022 dollars.
- 2. Communications Cabinet:
 - a. See notes above under 2.5.1 (Cellular or Lease Line Options).

2.5.3 Fiber Cable Option

<u>Component</u>	<u>Description</u>	<u>Cost</u>
<u>1</u>	<u>Fiber with overbuild and new construction</u>	<u>\$456,000 / mile</u>
<u>2</u>	<u>Communications Cabinet with SCADA</u>	<u>\$127,000 / site</u>
<u>3</u>	<u>Communications Cabinet with SCADA and Relay Protection</u>	<u>\$171,000 / site</u>

Notes:

- 1. Fiber Cable:
 - a. Accessible 250' average spans.
 - b. The poles are in good condition and do not need replacing.
 - c. The poles are not overloaded.
 - d. The poles and the attachments are in accordance with NESC 2002 and no work is required to upgrade the poles to current standards.
 - e. Cost estimates are in 2022 dollars.
- 2. Communications Cabinet:
 - a. See notes above under 2.5.1 (Cellular or Lease Line Options).

2.5.4 Microwave Option

<u>Component</u>	<u>Description</u>	<u>Cost</u>
<u>1</u>	<u>Point-To-Point Microwave Link</u>	<u>\$684,000 / link</u>
<u>2</u>	<u>50 Foot Microwave Tower</u>	<u>\$591,000 / tower</u>
<u>3</u>	<u>100 Foot Microwave Tower</u>	<u>\$859,000 / tower</u>
<u>4</u>	<u>Communications Cabinet with SCADA</u>	<u>\$127,000 / site</u>
<u>5</u>	<u>Communications Cabinet with SCADA and Relay Protection</u>	<u>\$171,000 / site</u>

Notes:

- 1. Microwave Link:

Maui Electric Company
APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

- a. There is radio line-of-sight clearance between the communication endpoints.
- ~~ii.b.~~ Frequencies~~FCC licensed microwave frequencies~~ are available.
- ~~iii.c.~~ There are existing structures/buildings with space available on both ends to house the radio equipment.
- ~~iv.d.~~ Telecommunications grounding standards are up-to-date at both sites.
- ~~v.e.~~ 48 V DC power with 12-hour battery backup is available.
- ~~vi.f.~~ This estimate does not include any special site-specific permit/approval activities that may be required including, but not limited to, Neighborhood Board (s), Conservation District Use Application, Environmental Assessment, Shoreline Management Area approval, biological (endangered species or habitat) surveys, and/or cultural (archeological) surveys or the cost of any migration required for approvals to be granted. Proposers should conduct their own due diligence for these costs.
- ~~vii.g.~~ Space is available at both ends to construct antenna towers or structures that are rated to survive a Saffir-Simpson category 4 hurricane.
- ~~viii.h.~~ Cost to interconnect to Hawaiian Electric's Company's existing communications network is not included.
- ~~ix.i.~~ Costs~~Cost estimates~~ are in 2022 dollars.
- ~~b.~~ 2.50 Foot Microwave Tower: \$591,021 with the following assumptions:
- ~~i.~~ Telecommunications grounding standards are up to date.
- ~~ii.~~ This estimate does not include any special site specific permit/approval activities that may be required including, but not limited to, Neighborhood Board (s), Conservation District Use Application, Environmental Assessment, Shoreline Management Area approval, biological (endangered species or habitat) surveys, and/or cultural (archeological) surveys or the cost of any migration required for approvals to be granted. Proposers should conduct their own due diligence for these costs.
- ~~iii.~~ Costs are in 2022 dollars.
- ~~e.~~ 100 Foot Microwave Tower: \$858,563 with the following assumptions:
- ~~a.~~ Example costs are provided for two tower options (50 ft or 100ft); other options may be available.
- ~~i.b.~~ Telecommunications grounding standards are up-to-date.
- ~~ii.c.~~ This estimate does not include any special site-specific permit/approval activities that may be required including, but not limited to, Neighborhood Board (s), Conservation District Use Application, Environmental Assessment, Shoreline Management Area approval, biological (endangered species or habitat) surveys, and/or cultural (archeological) surveys or the cost of any migration required for approvals to be granted. Proposers should conduct their own due diligence for these costs.
- ~~iii.d.~~ Costs~~Cost estimates~~ are in 2022 dollars.

Maui Electric Company
APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

- ~~2. Fiber with overbuild and new construction: \$456,000 per mile with the following assumptions:~~
- ~~a. Accessible 250' average spans.~~
 - ~~b. a. The poles are in good condition and do not need replacing.~~
 - ~~c. a. The poles are not overloaded.~~
 - ~~d. a. The poles and the attachments are in accordance with NESC 2002 and no work is required to upgrade the poles to current standards.~~
- ~~3. Leased Line: Cost will be the responsibility of the developer and to be negotiated with the lease provider.~~
- ~~a. Communication circuit requirements will be based on applications needed for the project.~~
 - ~~b. Company can provide communication circuit interconnection requirements and assist with order review as needed.~~
- ~~4. Communications Cabinet: \$207,365 with the following assumptions:~~
- ~~a. Cabinet used to support company equipment and capable of providing communications circuit for SCADA.~~
 - ~~b. Communications cabinet costs do not include fiber, microwave, or lease circuits costs. Proposers should refer to estimates provided above and perform their own due diligence.~~

Customer to work directly with

2.6 Typical Telecommunications Interconnection Requirements (Projects 250 kW and larger, and less than 1 MW)

Please refer to Attachment 1 of this Appendix H (for Projects greater than 250 kW and less than 1 MW). Conceptual design is not intended to cover all interconnection requirements. Final interconnection design will be subject to the results of the Detailed Evaluation, Technical Review, or an IRS.

Examples of minimum communications requirements for interconnection projects in this category, which are subject to change based on project specific evaluations, technical reviews, or IRS, are:

1. Primary communications links can consist of cellular, lease line, licensed radio, fiber or microwave.
2. Back-up communications links not required.
3. Additional analog leased telephone lines are required to support revenue meters (cost for this not included in above tables).

Maui Electric Company
APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

2.7 Typical Telecommunications Interconnection Requirements (Projects 1 MW or greater)

Please refer to Attachment 2 of this Appendix H (for Projects 1 MW or greater). Conceptual design is not intended to cover all interconnection requirements. Final interconnection design will be subject to the results of the Detailed Evaluation, Technical Review, or an IRS.

Examples of minimum communications requirements for interconnection projects in this category, which are subject to change based on project specific evaluations, technical reviews, or IRS, are:

1. Primary communications links can consist of lease line, licensed radio, fiber or microwave.
2. Back-up communications links can consist of lease provider line, licensed radio, fiber or microwave.
3. Licensed radio is permitted for projects 3MW or smaller in size only.
- i.4. Back-up communications links are generally optional for projects less than 10 MW. Back-up communications links may be required if the project includes a lease line circuit is needed battery system.
 - ii. Check with company to understand the current lease requirements.
 - e. Customer will provide all conduits, PAD, handholes, AC Power, grounding as required per company standards.
 - d. Cost are in 2022 dollars.
5. Licensed 900 MHz Radio: \$143,626 with the following assumptions:
 - a. This cost will be in addition to the Communication Cabinet cost. The radio equipment will be installed within the Communication Cabinet.
 - b.a. There is radio line of sight clearance between the communication endpoints.
 - e. FCC licensed 900Mhz Frequencies is available.
 - d.a. There is an existing structure/building with space available on the company side to mount the antenna equipment and house the radio equipment.
 - e.a. The customer will install a structure to mount the antenna equipment on the customers side.
 - i. Customer will provide any conduit required between the Communications Cabinet and antenna mount structure.
 - f.a. The cost includes 2 each antenna equipment to create a radio link.
 - g. Cost are in 2022 dollars.
5. ~~2.6~~ Back-up communications links are required for projects greater than or equal to 10 MW.

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

- 6. Back-up communications links must be transport diverse until the “last mile” for projects greater than 10 MW.
- 7. Additional analog leased telephone lines are required to support revenue meters (cost for this not included in above tables).

2.8 Security System Interconnection Costs

The ~~developer~~Developer shall be responsible to incorporate security components and systems for **their facilities** that consider the Security Guidelines for the Electricity Sector (CIP-014-2): Physical Security, as published by the North American Electric Reliability Corporation (NERC) and that at a minimum adhere to Company’s performance requirements outlined in Company’s Physical Security Strategy for the following four security concepts.

- **Deter:** Deploy visible physical security measures to encourage individuals to seek other, less secure targets.
- **Detect:** Utilize state of the art physical security technologies to detect unauthorized intrusion and provide real-time alerts to monitoring personnel. Detection to include 24/7 monitoring personnel.
- **Delay:** Deploy multiple physical security countermeasures to delay an intruder’s access to assets and provide time for incident assessment and appropriate response.
- **Respond:** Take immediate measures to assess, interrupt, and/or respond to the incident, including notification to Company and the use of contracted patrol personnel and/or the involvement of law enforcement assets to apprehend an intruder.

The Company’s Physical Security Strategy is available upon request after execution of an NDA with the Company.

Facilities will need to meet Tier Three security requirements. These requirements will be subject to final review during the design and engineering phase. Additional information is available upon request after execution of an NDA with the Company.

Type of Facility	Tier One High Criticality	Tier Two Medium Criticality	Tier Three Lower Criticality
------------------	------------------------------	--------------------------------	---------------------------------

Maui Electric Company
 APPENDIX H - INTERCONNECTION FACILITIES AND COST INFORMATION

<p>Substation</p>	<ul style="list-style-type: none"> • FLIR or Similar camera perimeter monitoring. • Secondary perimeter intrusion detection system. • Interior Video monitoring system with motion detection. • Gunfire detection/IP intercom public address system. • Electronic card access system for control & microwave houses. • Standard 8' high security fence with 3-strand barbed wire V-top. • Interior mounted 4' high cattle fencing. • LED perimeter lighting. • All gates will be secured using a proprietary padlock system. 	<ul style="list-style-type: none"> • Video monitoring system with motion detection. • Card access on control and microwave houses. • Standard 8' high security fence with 3-strand barbed wire V-top. • Interior mounted 4' high cattle fencing. • All gates will be secured using a proprietary padlock system. 	<ul style="list-style-type: none"> • Standard 8' high security fence with 3-strand barbed wire V-top. • Interior mounted 4' high cattle fencing. • All gates will be secured using a proprietary padlock system.
--------------------------	---	---	---


2.9 Project Management Costs

The costs below indicate additional Project Management expenses:

<u>Component</u>	<u>Description</u>	<u>Cost</u>
<u>1</u>	<u>Projects 1 MW or greater</u>	<u>\$281,000</u>

EXHIBIT 19

Redline of Draft Mid-Tier SFC for RDG (PV+BESS)
for Maui and Hawaii Island

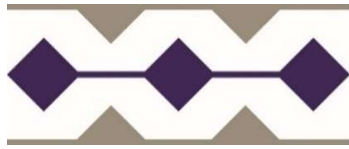

**Maui
Electric**



MID-TIER STANDARD FORM CONTRACT
for
Renewable Dispatchable Generation
(PV + BESS)
~~October 9~~December 1, 2020 Version

(Maui and Hawaii Islands)

This contract document assumes that the proposed generation facility will be paired with a battery energy storage system ("BESS"), and therefore contains terms and conditions with respect to the BESS. If a generation only proposal is selected for the CBRE Mid-Tier Project RFP's final award group, the BESS specific provisions will be removed from this Contract for such project proposal.

Attachment A	Schedule Of Defined Terms
Attachment B	Company Payments for Energy, Dispatchability and Availability of BESS
Attachment C	Required Performance Metrics; Liquidated Damages
Attachment D	Calculation and Adjustment of Net Energy Potential
Attachment E	Monthly Reporting and Dispute Resolution by Independent AF Evaluator
Attachment F	Facility Owned by Subscriber Organization
Exhibit F-1	Description of Generation and Battery Storage Facilities
Exhibit F-2	Consultants List
Exhibit F-3	Modeling Requirements
Exhibit F-4	Generator and Energy Storage Capability Curve(S)
Exhibit F-5	Single-Line Drawing and Interface Block Diagram
Exhibit F-6	Relay List and Trip Scheme
Exhibit F-7	Control System Acceptance Test Criteria
Exhibit F-8	Acceptance Test General Criteria
Attachment G	Company-Owned Interconnection Facilities
Exhibit G-1	Form of Letter of Credit
Attachment H	BESS Requirements
Section 1	BESS Test
Section 2	BESS Annual Equivalent Availability Factor
Section 3	BESS Annual Equivalent Forced Outage Factor
Attachment I	Facility's CBRE Program
Attachment J	[Reserved]
Attachment K	Company Owned Site
Exhibit K-1	Site Plan
Contract Rider	DC-Coupled Term Sheet <u>Term Sheet for Mid-Tier Standard Form Contract for DC-Coupled Storage (PV+BESS)</u>

NOTE: THIS CONTRACT IS FOR PROJECTS THAT ARE AC-COUPLED. THE CHANGES SHOWN IN THE CONTRACT RIDER ATTACHED HERETO TITLED "TERM SHEET FOR MID-TIER STANDARD FORM CONTRACT FOR DC-COUPLED STORAGE (PV+BESS)" SHALL BE APPLIED TO THIS CONTRACT FOR DC COUPLED PROJECTS.

**MID-TIER STANDARD FORM CONTRACT
FOR
RENEWABLE DISPATCHABLE GENERATION**

THIS MID-TIER STANDARD FORM CONTRACT FOR RENEWABLE DISPATCHABLE GENERATION (“Contract”) is entered into as of _____, 20__ (the “Effective Date”), by [Maui Electric Company, Ltd., Hawai‘i Electric Light Company, Inc.], a Hawai‘i corporation (“Company”) and _____ (“Subscriber Organization”). Together, the Company and Subscriber Organization are the “Parties” and may singularly each be referred to as a “Party.”

RECITALS

WHEREAS, Company is an operating electric public utility engaged in the generation, transmission, distribution, storage, regulation, or physical control of electricity (“Company System”) on the Island of [Hawai‘i, Maui], subject to the Hawai‘i Public Utilities Law (Hawai‘i Revised Statutes, Chapter 269) and the rules and regulations of the Hawai‘i Public Utilities Commission (“PUC” or the “Commission”); and

WHEREAS, the Company System is operated as an independent power grid and must both maximize system reliability for its customers by ensuring that sufficient generation is available that meets the Company’s requirements for voltage stability, frequency stability, and reliability standards; and

WHEREAS, Company desires to minimize fluctuations in its purchased energy costs by acquiring renewable dispatchable generation at a fixed Unit Price; and

WHEREAS, Subscriber Organization understands the need to use all commercially reasonable efforts to maximize the overall reliability of the Company System; and

WHEREAS, Subscriber Organization is an “approved Subscriber Organization” for Phase 2 of the State of Hawai‘i Community-Based Renewable Energy (“CBRE”) Program, and desires to construct and operate a dispatchable generation renewable energy system (“CBRE Facility” or “Facility”) that is classified as an eligible resource under Hawai‘i’s Renewable Portfolio Standards Statute (codified as Hawai‘i Revised Statutes ~~(“HRS”)~~ 269-91 through 269-95) and qualifies for the CBRE Program together with a safe, reliable and operationally flexible battery energy storage system (“BESS”) so as to provide the Company System with those benefits and services associated with renewable energy generation and energy storage services, as defined herein; and

WHEREAS, this Contract applies to CBRE Facilities which provide at least 250 kW ~~but less than~~ up to and including 2.5 MW of renewable dispatchable generation and is entered into in accordance with the terms and conditions contained herein, the CBRE Tariff and Tariff Rule 14, Paragraph H (Interconnection of Distributed Generating Facilities Operating in Parallel With The Company’s Electric System) (“Rule 14H”); and

WHEREAS, the Parties agree to allow Subscriber Organization to interconnect and operate the CBRE Facility in parallel with the Company System so long as all applicable requirements and conditions of this Contract, the CBRE Tariff and Rule 14H have been satisfied; and

WHEREAS, the PV System to be developed by the Subscriber Organization will be a planned electrical energy generation system with a nameplate capacity of _____ kilowatts of alternating current (AC) (“PV System”); and

WHEREAS, the BESS to be installed by the Subscriber Organization will be an electrical energy battery storage system with a nameplate capacity in kilowatts of _____ and in kilowatt-hours [kWh] of _____; and

WHEREAS, the CBRE Facility will be installed and operated on property located at _____, Island of _____, State of Hawai'i and more fully described in Attachment F (Facility Owned by Subscriber Organization), Exhibit F-1 (Description of Generation and Battery Storage Facilities) to the Contract; and

WHEREAS, Subscriber Organization desires to sell to Company, and Company agrees to purchase, subject to the terms and conditions set forth herein, (i) the Actual Output produced by the Facility and delivered to the Point of Interconnection; (ii) the availability of the BESS; and (iii) the availability of the Facility's Net Energy Potential for Company Dispatch in accordance with this Contract;

NOW, THEREFORE, in consideration of the premises and the respective promises herein, Company and Subscriber Organization hereby agree as follows:

AGREEMENT

1. **DEFINITIONS**. Capitalized terms in this Contract shall have the meanings set forth in the Schedule of Defined Terms in Attachment A hereto.
2. **PARALLEL OPERATION**. Company agrees to allow Subscriber Organization to interconnect and operate the Facility to provide renewable dispatchable generation and energy in parallel with the Company System; provided, however, that such interconnection and operation shall not:— (i) adversely affect Company's property or the operations of its customers and customers' property; (ii) present safety hazards to the Company System, Company's property or employees or Company's customers or the customers' property or employees; or (iii) otherwise fail to comply with this Contract. Such parallel operation shall be contingent upon the satisfactory completion, as determined solely by Company, of the Acceptance Test and, to the extent applicable, the Control System Acceptance Test, in accordance with Good Engineering and Operating Practices.
3. **TERM**.
 - A. The Term of this Contract shall begin when signed by the Parties and end twenty (20) years after the Commercial Operations Date unless otherwise provided for in this Contract.
 - B. This Contract shall continue in full force and effect as set forth above, until the earliest date that one of the following events occurs:
 1. The Parties agree in writing to terminate the Contract; or
 2. The Contract is declared null and void pursuant to the terms of Section 3.E (Contract Null and Void). Upon receipt of such notice, the Parties shall take reasonable steps to minimize additional costs to the other Party, where reasonably possible; or
 3. The Contract is terminated under Section 10.I.4 (Project Completion) if Subscriber Organization fails to interconnect and operate the CBRE Facility pursuant to the terms of this Contract or;
 4. The Contract is terminated pursuant to an Event of Default under the Contract.
 - C. **Interconnection Requirements Study**. If this Contract is executed prior to completion of the Interconnection Requirements Study, then following the completion of the IRS:
 1. The Parties shall, no later than the IRS Amendment Deadline, execute a formal amendment to this Contract substituting new versions of appropriate attachments to this Contract, including but not limited to, Attachment F (Facility Owned by Subscriber Organization) and Exhibits attached thereto, Attachment G (Company-Owned Interconnection Facilities) (the "IRS Amendment") solely to reflect the results of the IRS. If the IRS Amendment is not executed by the IRS Amendment Deadline, either Party may, by written notice delivered to the other Party, declare this Contract null and void.
 2. If Subscriber Organization is dissatisfied with the results of the IRS, Subscriber Organization shall have the option, by written notice delivered to Company no later than the IRS Termination Deadline, to declare the Contract null and void.

- D. Prior to IRS Amendment Deadline. Company may, by written notice delivered prior to the IRS Amendment Deadline, declare the Contract null and void if any one or more of the following conditions applies:
1. Subscriber Organization implements a material change to the Facility without following the requirements of Section 5(g) of ~~Exhibit F~~Exhibit F-1 (Description of Generation and Battery Storage Facilities).
 2. Subscriber Organization, subsequent to making any payment to Company required under Attachment G (Company-Owned Interconnection Facilities), or subsequent to making the payment to Company to pay for the IRS under the IRS Amendment(s), requests in writing that Company stop or otherwise delay the performance of the work for which Company received such payment.
 3. The IRS Letter Agreement(s) is/are terminated pursuant to the terms thereof prior to the completion of the IRS.
- E. Contract Null and Void. If the Contract is declared null and void pursuant to Section 3.C (Interconnection Requirements Study), Section 3.D (Prior to IRS Amendment Deadline), or Section 1(d) (NEP IE Estimate, Liquidated Damages and Subscriber Organization's Null and Void Right) of said Attachment D (Calculation and Adjustment of Net Energy Potential) (the "Null and Void Rights"), the Parties hereto shall thereafter be free of all obligations hereunder except as set forth in this Section 3.E (Contract Null and Void) and Section 11.F.2 (Return of Development Period Security), and shall pursue no further remedies against one another. A declaration that this Contract is null and void pursuant to the Null and Void Rights, shall not affect the following provisions, which shall remain in full force and effect: this Section 3.E (Contract Null and Void), Section 8.F.2 (Confidentiality), Section 17 (Dispute Resolution), Section 26.A (Disconnection and Survival of Obligations), Section 26.L (Survival), and such provisions of Section 26 (Miscellaneous) which, by their terms, should survive termination of this Contract, and Section 7 (Land Restoration) of Attachment G (Company-Owned Interconnection Facilities).
- F. Termination Rights. Notwithstanding any of the foregoing, the right of Company to terminate the Contract at any time upon the occurrence of any Event of Default described in Section 13 (Events of Default) shall remain in full force and effect.

4. **BILLING AND PAYMENT PROVISIONS.**

- A. Purchase and Sale of Renewable Energy, Dispatchability of CBRE Facility and Availability of the BESS. Subject to the other provisions of this Contract, Company shall, though a combination of Bill Credits allocated among CBRE Facility Subscribers and payments to Subscriber Organization, pay for: (i) the Actual Output produced by the CBRE Facility and delivered to the Point of Interconnection in response to Company Dispatch of the CBRE Facility; (ii) the availability of the CBRE Facility's Net Energy Potential for Company Dispatch in accordance with this Contract; and (iii) the availability of the BESS. Included in such purchase are all of the Environmental Credits associated with the renewable energy. Company will not reimburse Subscriber Organization for any taxes or fees imposed on Subscriber Organization including, but not limited to, State of Hawai'i general excise tax.
- B. Lump Sum Payment. Commencing on the Commercial Operations Date, Company shall pay a monthly lump sum payment ("Lump Sum Payment"), to be apportioned between Subscribed and Unsubscribed RDG, as provided in Section 2. (Lump Sum Payment for Purchase of Dispatchability) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. As more fully set forth in Section 3. (Calculation of Lump Sum Payment) of Attachment B, the monthly Lump Sum Payment shall be calculated and adjusted to reflect changes in the estimate of the CBRE Facility's Net Energy Potential as such estimate is revised from time to time as more fully set forth in Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract. For purposes of calculating the monthly Lump Sum Payment, the monthly Lump Sum Payment shall be adjusted downward to account for the time the PV System(s) are Facility or any portion of the Facility is not available for Company Dispatch because of a Force Majeure condition (i) at the CBRE Facility, whether the PV System, the BESS or both, or (ii) that otherwise delays or prevents the Subscriber Organization from making the PV System(s) Facility or any portion of the Facility in question available for Company Dispatch, as more fully set forth in Section 3.D (Lump Sum Payment Pro-Rata Adjustments) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.

- C. Assurance of Capability of CBRE Facility to Deliver Net Energy Potential and Availability of BESS. In order to provide Company with reasonable assurance that, subject to the Renewable Resource Variability, the CBRE Facility's Net Energy Potential will be available for Company Dispatch: (i) the PV System Equivalent Availability Factor Performance Metric shall be used to evaluate the availability of the PV System for dispatch by Company; (ii) the Guaranteed Performance Ratio ("GPR") Performance Metric shall be used to evaluate the efficiency of the PV System; (iii) the BESS Capacity Performance Metric shall be used to confirm the capability of the BESS to discharge continuously for ~~six (6)~~four (4) hours at Maximum Rated Output or to discharge continuously for a total energy (MWh) equal to the BESS Contract Capacity if the test is conducted at less than Maximum Rated Output; (iv) the BESS EAF Performance Metric shall be used to determine whether the BESS is meeting its expected availability; (v) the BESS EFOF Performance Metric shall be used to evaluate whether the BESS is experiencing excessive unplanned outages; and (vi) the RTE Performance Metric shall be used to evaluate the storage efficiency of the BESS. Whenever the PV System potential output is in excess of the Company Dispatch, the excess energy from the PV System shall be used to maximize the BESS State of Charge so long as this does not conflict with the operating parameters of the BESS set forth in Section 9.(d) (Battery Energy Storage System) of Attachment F (Facility Owned by Subscriber Organization) to this Contract. Subscriber Organization shall design, operate and maintain the CBRE Facility in a manner consistent with the standard of care reasonably expected of an experienced owner/operator with the desire and financial resources necessary to design, operate and maintain the CBRE Facility to achieve the Performance Metrics. The foregoing is without limitation to Subscriber Organization's other obligations under this Contract, including the obligation to operate the CBRE Facility in accordance with Good Engineering and Operating Practices. The Performance Metrics are set forth in Attachment C (Required Performance Metrics; Liquidated Damages) of this Contract and shall be interpreted consistent with the North American Electric Reliability Corporation Generating Availability Data System ("NERC GADS") Data Reporting Instructions. In the event of a conflict between NERC GADS and the terms of this Contract, the terms of this Contract will control.
- D. No Payments Prior to Commercial Operations Date. CBRE Facilities shall be subject to an Acceptance Test and a Control System Acceptance Test prior to initial parallel operation. Company may accept test energy delivered by Subscriber Organization as provided in Section 6. (Test Energy) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. The procedures for such tests will be provided to Subscriber Organization by the Company prior to executing this Contract. Company shall not compensate Subscriber Organization for such test energy.
- E. Sale of Energy to Third Parties. Subscriber Organization shall not sell the renewable energy produced, stored or associated with the CBRE Facility, to any person or entity other than the Company during the Term of this Contract.
- F. Subscriber Organization's Preparation of the Monthly Invoice. By the tenth (10th) Business Day of each calendar month, Subscriber Organization shall submit to Company an invoice that separately states the following for the preceding calendar month: (i) the Actual Output during the preceding calendar month; (ii) the monthly Lump Sum Payment for the preceding calendar month; (iii) a computation, based on the updated Monthly Subscriber Information for such preceding calendar month as provided pursuant to Section 4. (Updating Monthly Subscriber Information Used to Calculate Bill Credits and Other Matters) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract, of each Subscriber's Subscriber Allocation for the preceding month stated as a percentage of Contract Capacity; (iv) the Unsubscribed RDG for the preceding calendar month stated as a percentage of Contract Capacity; (v) a computation, based on each Subscriber's Subscriber Allocation, of the dollar amount of the Bill Credit to which each Subscriber is entitled for the monthly Lump Sum Payment for the preceding calendar month; (vi) the dollar amount owing to Subscriber Organization for its share of the monthly Lump Sum Payment for the preceding calendar month; and (vii) as a credit against the amount owing to the Subscriber Organization, the amounts payable by Subscriber Organization under Section 8.D (Subscriber Organization Fees) of this Contract. The dollar amount payable to the Subscriber Organization shall be subject to adjustment as provided in Section 5: (Payment to Subscriber Organization; Payment Reductions-Liquidated Damages for Failure to

Achieve CBRE Subscriber Thresholds) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.

G. Payment Procedures.

1. Payments to Subscriber Organization. By the twentieth (20th) Business Day of each calendar month following the month during which the invoice was submitted (i.e., by the twentieth (20th) Business Day of the second calendar month following the calendar month covered by the invoice in question), and not later than the last Business Day of that month if there are less than twenty (20) Business Days in that month, Company shall, make payment to Subscriber Organization of the amount payable for the Unsubscribed RDG shown on such invoice, or provide to Subscriber Organization an itemized statement of its objections to all or any portion of such invoice and pay Subscriber Organization its share of any undisputed amount. Any such payment to the Subscriber Organization shall be subject to Company's right to set-off payment reductions-liquidated damages and/or to draw liquidated damages from Operating Period Security as provided in Section 5 (Payment To Subscriber Organization; Payment Reductions-Liquidated Damages for Failure to Achieve CBRE Subscriber Thresholds) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. The foregoing is without limitation to Company's rights under Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract.
2. Time Extensions. Notwithstanding the foregoing, the Day by which the Company shall make payment to Subscriber Organization hereunder shall be increased by one (1) Day for each Day that Subscriber Organization is delinquent in providing to the Company either: (i) the Monthly Report for the calendar month in question pursuant to Section 1. (Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract; or (ii) the information required under Section 4.F (Subscriber Organization's Preparation of the Monthly Invoice) of this Contract.

H. Bill Credits.

1. The sole means of payment for each Subscriber Allocation for the calendar month covered by the invoice shall be by a Bill Credit on such Subscriber's retail electric bill. The Bill Credit shall be calculated on the undisputed amount of Subscriber Organization's invoice as set forth in Section 4.F. (Subscriber Organization's Preparation of the Monthly Invoice) of this Contract. Because not all of Company's customers have the same billing cycle, the timing of the appearance of the Bill Credit will vary with the Subscriber's billing cycle, but Company shall cause the Bill Credit to appear on each Subscriber's retail electric bill no later than the next billing cycle for such Subscriber following the due date for Company's payment to Subscriber Organization for the Unsubscribed RDG on the corresponding invoice. The calendar month upon which the Bill Credit is based shall not necessarily match the billing period for the retail electric service bill in which the Bill Credit is applied.
2. For purposes of applying the Bill Credit to each Subscriber's retail electric bill, the Company shall be entitled to rely exclusively on the Monthly Subscription Information as timely entered by the Subscriber Organization via the CBRE Online Portal as set forth in Section 4. (Updating Monthly Subscriber Information Used to Calculate Bill Credits and Other Matters) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.
3. If there is a breach, error or changed circumstances resulting in some portion of the monthly Lump Sum Payment being assigned to a Subscriber in excess of such Subscriber's allowable Subscriber Allocation under the CBRE Tariff, then the Company may treat this excess as an "overpayment" of the Subscriber Allocation and reduce the Bill Credit(s) to such Subscriber for the following calendar month for overpayment in proportion to the excess allocation received in error. Payment to the Subscriber Organization for such Unsubscribed RDG shall only occur if no corresponding Bill Credit is made to a Subscriber, or if already allocated, if such allocation is corrected and withdrawn from such Subscriber. The intent of the Parties is to ensure that no production from the CBRE Facility is double-counted to any Subscriber and/or Subscriber Organization.

- I. Late Payments. Notwithstanding all or any portion of such invoice in dispute, and subject to the provisions of Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on

Liquidated Damage) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract (to the extent applicable), interest shall accrue on any invoiced amount that remains unpaid following the twentieth (20th) Business Day of each calendar month (or the last Business Day of that month if there are less than twenty Business Days in that month), or following the due date for such payment if extended pursuant to Section 4.G.2. (Time Extensions) to this Contract, at the average daily Prime Rate for the period commencing on the Day following the Day such payment is due until the invoiced amounts (or amounts due to Subscriber Organization if determined to be less than the invoiced amounts) are paid in full. Partial payments shall be applied first to outstanding interest and then to outstanding invoice amounts.

- J. Adjustments to Invoices aAfter Payment. In the event adjustments are required to correct inaccuracies in an invoice after payment, the Party requesting adjustment shall recompute and include in the Party's request the principal amounts due during the period of the inaccuracy together with the amount of interest from the date that such invoice was payable until the date that such recomputed amount is paid at the average daily Prime Rate for the period. The difference between the amount paid and that recomputed for the invoice, along with the allowable amount of interest, shall either be (i) paid to Subscriber Organization or set-off by Company, as appropriate, in the next invoice payment to Subscriber Organization, or (ii) objected to by the Party responsible for such payment within thirty (30) Days following its receipt of such request. If the Party responsible for such payment objects to the request, then the Parties shall work together in good faith to resolve the objection. If the Parties are unable to resolve the objection, the matter shall be resolved pursuant to Section 17. (Dispute Resolution) of the Contract. All claims for adjustments shall be waived for any amounts that were paid or should have been payable more than thirty-six (36) months preceding the date of receipt of any such request.
- K. Limitations Period. All Subscriber Organization claims for adjustments shall be submitted to the Company within three years of the end of the calendar month covered by the invoice on which the adjustment amount in question was invoiced or should have been invoiced. Claims not submitted to the Company by the end of such three-year period shall be deemed to have been waived.
- L. Company's Billing Records. Subscriber Organization, after giving reasonable advance written notice to Company, shall have the right during Company's normal working hours on Business Days to review all billing, metering and related records necessary to verify the accuracy of the data provided by Company regarding payments and credits.
- M. Subscriber Organization Responsibility for Billing Inaccuracies. The correction of any allocation of previously-applied Bill Credits among Subscribers or payments to the Subscriber Organization for Unsubscribed RDG, pertaining to a particular month due to any inaccuracy reflected in such Monthly Subscription Information with regard to a Subscriber's subscription in the CBRE Facility and the beneficial share of (RDG / NEP) exported by the CBRE Facility, or the share of Unsubscribed RDG, shall be the full responsibility of the Subscriber Organization, unless such inaccuracies are shown to have been caused by the Company.

5. COMPANY DISPATCH.

- A. General. Company shall have the right to dispatch all available real and reactive power delivered from the CBRE Facility to the Company System and to start up and shut down Subscriber Organization's Facility, in whole or in part, as it deems appropriate in its reasonable discretion, subject only to Company Dispatch and Subscriber Organization's operations and maintenance schedule determined in accordance with Section 4. (Maintenance of Subscriber Organization-Owned Interconnection Facilities) ~~and Section 10. (Operations Committee and Operating Procedures) to Attachment F (Facility Owned by Subscriber Organization) to this Contract.~~ Because the CBRE Facility must be available to respond to Company Dispatch, the Facility may not consume any energy generated by the Facility. Company shall not pay for reactive power.
- B. Company Dispatch. Dispatch will either be by Subscriber Organization's manual control under the direction of the Company System Operator or by remote computerized control by the EMS provided in Section 1.(g) (Active Power Control Interface) of Attachment F (Facility Owned by Subscriber Organization) to this Contract, in each case at Company's reasonable discretion.

- C. Company Rights of Dispatch. Company may require deration or outage in response to the CBRE Facility's failure to comply with Company Dispatch or to any conditions of Subscriber Organization-Attributable Non-Generation. A deration or outage required by Company pursuant to the preceding sentence shall be considered a Planned Deration and shall "count against" Subscriber Organization for the purpose of calculating the PV System Equivalent Availability Factor until the conditions that led to the deration or outage are resolved by Subscriber Organization and Subscriber Organization notifies Company of same. If, after such communication, Company attempts to dispatch the CBRE Facility and determines that such conditions that led to the deration or outage are not resolved, all time from the notice of resolution to actual resolution shall be revised as continuance of the deration or outage. If Subscriber Organization requests confirmation from Company that Subscriber Organization's actions to resolve such conditions that led to the deration or outage were successfully completed, then Company shall use reasonable efforts to respond to such request within three (3) Business Days in writing (with email being acceptable) to allow Subscriber Organization the opportunity to take further appropriate corrective actions if needed. An outage or deration required by Company pursuant to the first sentence of this sub-section shall not be considered a "restriction or limitation that would lower maximum output" of the CBRE Facility for purposes of filtering the 15-minute intervals used to calculate the MPR under Section 2.A. (Calculation of Measured Performance Ratio) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract and shall, therefore, potentially "count against" Subscriber Organization for purposes of calculating MPR until the conditions that led to such outage or deration are resolved by Subscriber Organization to Company's reasonable satisfaction. Nothing in this sub-section shall relieve Subscriber Organization of its obligation under the terms of this Contract to make available the full capability of the CBRE Facility for Company Dispatch.
- D. Monthly Report. Commencing with the month during which the Commercial Operations Date is achieved, and for each calendar month thereafter during the Term, Subscriber Organization shall prepare and provide to Company a Monthly Report by the tenth (10th) Business Day of the following month in accordance with Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract. Beginning with the Monthly Report for the last calendar month of the initial Contract Year, Subscriber Organization shall include calculations of, as applicable, (a) the PV System Equivalent Availability Factor for the LD Period, (b) the Measured Performance Ratio for the MPR Assessment Period, (c) any of the BESS Capacity Ratio, the BESS Annual Equivalent Availability Factor, the BESS Equivalent Forced Outage Factor or the RTE Performance Metric for the BESS Measurement Period (if any), as well as (d) any liquidated damages to be assessed, as set forth in the form of Monthly Report included in Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator). All rights and obligations of the Parties with respect to each Monthly Report and any disagreements arising out of any Monthly Report are fully set forth in Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.
6. **HOUSE POWER**. The Company will sell House Power to the CBRE Facility under the rate schedule in force for the class of customer to which the Subscriber Organization belongs. A separate meter to record energy delivered to the CBRE Facility may be installed by the Company. The Subscriber Organization shall be solely responsible for arranging retail electric service exclusively from the Company in accordance with the Company's Electric Rate Book. The Subscriber Organization shall obtain House Power solely through separately metered retail service and shall not obtain House Power through any other means and waives any regulatory or other legal claim or right to the contrary. Because the Subscriber Organization must make all energy produced by the CBRE Facility available to the Company, the CBRE Facility may not use the energy it generates to be consumed by it. It may not net-out or use energy it generates for House Power. The Parties acknowledge and agree that the performance of their respective obligations with respect to House Power shall be separate from this Contract and shall be interpreted independently of the Parties' respective obligations under this Contract. Notwithstanding any other provision in this Contract, nothing with respect to the arrangements for House Power shall alter or modify the Subscriber Organization's or the Company's rights, duties and obligations under this Contract. This Contract shall not be construed to create any rights between the Subscriber Organization and the Company with respect to the arrangements for House Power.

7. **METERING REQUIREMENTS, CHARGES AND TESTING.**

- A. Company shall install, operate and maintain for the benefit of the CBRE Facility, one or more revenue metering package(s) suitable for measuring the export of renewable energy (AC) produced by the CBRE Facility in kilowatts and kilowatt-hours on a time-of-day basis and reactive power flow in kilovars and true root mean square kilovar-hours (the "Revenue Meter"). The metering point for the Revenue Meter shall be as close as possible to the Point of Interconnection as allowed by Company.
- B. Subscriber Organization, subject to Company review and approval, shall purchase, install, and maintain the infrastructure and other related equipment ("Meter Infrastructure") including meter housing, socket replacement and rewiring as required to install the Revenue Meter and any additional service meter(s), including, but not limited to, such meters for measuring House Power. Subscriber Organization shall install the Meter Infrastructure in adherence with requirements set forth in the latest edition of the Company's Electric Service Installation Manual (ESIM). Company shall test the Production Meter prior to installation and at the request and expense of the Subscriber Organization.
- C. Subscriber Organization shall reimburse Company for the costs reasonably incurred for the purchase and installation of the Revenue Meter. Subscriber Organization shall be responsible for the ongoing costs incurred by Company to operate, maintain (including maintenance replacements) and test the Revenue Meter during the Term.
- D. Metering Charge per Month: \$25.00. Subscriber Organization shall be charged each month during the Term an administrative metering fee of a \$25.00 for the Revenue Meter. The administrative metering fee is addition to the costs associated with the purchase, installation, maintenance and testing of the Revenue Meter and Meter Infrastructure.
- E. Meter Testing. Company shall provide at least forty-eight (48) hours' notice to Subscriber Organization prior to any test it may perform on the Revenue Meter or metering equipment. Subscriber Organization may request tests in addition to the every fifth-year test and Subscriber Organization shall pay the cost of such tests. Company may perform tests in addition to the fifth-year test. If any of the revenue meters or metering equipment is found to be inaccurate at any time, as determined by testing in accordance with this section, Company shall promptly cause such equipment to be made accurate, and the period of inaccuracy, as well as an estimate for correct meter readings, shall be determined as provided in Company's Tariff Rule No.11 (Billing Error, Meter Tests and Adjustment for Meter Errors).

8. **CBRE TARIFF REQUIREMENTS.**

- A. CBRE Framework and CBRE Tariff. The Subscriber Organization shall comply with and assure that the requirements of the CBRE Framework and CBRE Tariff applicable to the CBRE Facility are met.
- B. Subscriber Agreement. Subscriber Organization shall require all prospective Subscribers to execute a Subscriber Agreement as a precondition to enrollment as a Subscriber in the CBRE Facility. The Subscriber Agreement must satisfy the requirements of the CBRE Tariff, the CBRE Framework, this Contract and any additional guidance from the PUC. Without limitation to the generality of the preceding sentence, the Subscriber Agreement must include the right for the Subscriber to sell the subscription, either a portion or the entirety thereof, back to Subscriber Organization. The Subscriber Agreement shall require that the Subscriber Organization must buy back the interest in accordance with the preset repurchase/resale price schedule outlined in the Subscriber Agreement within thirty (30) Days of the Subscriber's request. Prior to executing the Subscriber Agreement, the Subscriber Organization shall make to the Subscriber the disclosures required under the Disclosure Checklist (attached as an Appendix to the CBRE Tariff). A copy of the Disclosure Checklist signed by both the Subscriber Organization and the Subscriber shall be attached to the executed Subscriber Agreement. The Subscriber Organization shall also disclose to the Subscriber that a failure to pay such Subscriber's monthly retail electric bill that results in Company issuance of a disconnection notice will result in forfeiture of Bill Credits for the duration of such disconnection. For each Subscriber, there must be a completed and fully executed Subscriber Agency Agreement and Consent Form (attached as an Appendix to the CBRE Tariff), which is delivered to the Company prior to the Commercial Operations Date, or prior to

adding each Subscriber. The Subscriber Organization shall provide to each Subscriber a copy of the Subscriber's Bill of Rights (attached as an Appendix to the CBRE Tariff).

- C. Funds Received From Subscribers Prior to the Commercial Operations Date. Any payments made to Subscriber Organization by Subscribers prior to the Commercial Operations Date shall be deposited into an escrow account or other alternative proposed by Subscriber Organization and approved by the Company or CBRE IO ("Pre-COD Escrow"), to hold or segregate any pre-development enrollment fees or deposits from Subscribers (with appropriate mechanisms to refund such fees/deposits to Subscribers should the Subscriber Organization not complete its Facility), which shall be released to Subscriber Organization upon commercial operation of the Facility. These funds may not be withdrawn from the Pre-COD Escrow by the Subscriber Organization until the Commercial Operations Date. The Pre-COD Escrow must conform to the CBRE Tariff, the CBRE Framework, applicable Laws, and any additional guidance from the PUC or the CBRE IO.
- D. Subscriber Organization Fees.
- Subscriber Organization shall pay to Company the ~~following Subscriber Organization fees; required under the CBRE Tariff.~~
 - ~~• \$250 Application Fee (once);~~
 - ~~• All applicable late fees for failure to meet Commercial Operations Date;~~
 - ~~• \$5/kW AC Program Administration Fee (annually), from the Commercial Operations Date;~~
 - ~~• \$25.00 (monthly) Revenue Meter Administration Fee;~~
 - ~~• Such other fees as the PUC may establish for the CBRE Program.~~
 - ~~If Company~~ If Company has not received prior payment of such fees, Company may set off the unpaid amounts against Company payments to Subscriber Organization for Unsubscribed RDG, draw from the Security Funds, or, in its sole discretion, Company shall invoice Subscriber Organization for payment to Company of the foregoing fees. Subscriber Organization shall make payment to Company within 15 Days of Subscriber Organization's receipt of such invoice.
 - ~~2.3.~~ does not set off the amount of these fees against Company payments to Subscriber Organization for Unsubscribed Energy, Company may, in its sole discretion, obtain payment from Security Funds, or invoice Subscriber Organization for payment to Company of the foregoing fees. Subscriber Organization shall make payment to Company within fifteen (15) Days of Subscriber Organization's receipt of such invoice.
- E. Facility Compliance.
- The Subscriber Organization shall be responsible for ensuring that the equipment installed at the CBRE Facility meets all applicable codes, standards, and regulatory requirements at the time of installation and throughout its operation.
 - Subscriber Organization shall comply with all of the rules stated in the Company's applicable electric tariff rules related to the CBRE Program, as the same may be revised from time to time, and this Contract, as may be amended from time to time, as allowed by an amendment to this Contract approved, or deemed approved, by the PUC. In the event of any conflict between the terms of this Contract and Company's electric tariff rules related to the CBRE Program, the provisions of the tariff shall control.
- F. Financial Compliance.
- If Company reasonably believes the provisions of this Section 8.F apply to the CBRE Facility, Company shall notify Subscriber Organization in writing and Subscriber Organization shall provide or cause to be provided to Company on a timely basis, all information, including but not limited to information that may be obtained in any audit referred to below (the "Financial Compliance Information"), reasonably requested by Company for purposes of permitting Company and its parent company, Hawaiian Electric Industries, Inc. ("HEI") to comply with the requirements (initial and on-going) of (i) the accounting principles of Financial Accounting Standards Board ("FASB") Accounting Standards Codification 810, Consolidation ("FASB ASC 810"), (ii) FASB ASV 842 Leases ("FASB ASC 842"), (iii) Section 404 of the Sarbanes-Oxley Act of 2002 ("SOX 404") and (iv) all clarifications, interpretations and revisions of and regulations implementing FASB ASC 810, FASB ASC 842, and SOX 404 issued by the FASB, Securities and Exchange Commission, the Public Company Accounting Oversight Board, Emerging

Issues Task Force or other Governmental Authorities. In addition, if required by Company in order to meet its compliance obligations, Subscriber Organization shall allow Company or its independent auditor to audit, to the extent reasonably required, Subscriber Organization's financial records, including its system of internal controls over financial reporting; provided, however, that Company shall be responsible for all costs associated with the foregoing, including but not limited to Subscriber Organization's reasonable internal costs. Company shall limit access to such Financial Compliance Information to Company and HEI personnel involved with such compliance matters and restrict any Company or HEI personnel involved in Company's monitoring, dispatch or scheduling of the Subscriber Organization and/or the CBRE Facility, the administration of this Contract, or in developing potential CBRE projects, from having access to such Financial Compliance Information (unless approved in writing in advance by Subscriber Organization).

2. Confidentiality. As a condition to obtaining the Financial Compliance Information, Company shall, and shall cause HEI to, maintain the confidentiality of said Financial Compliance Information pursuant to a mutually agreed to confidentiality and non-disclosure agreement to be executed among Company, HEI and Subscriber Organization.
 3. Consolidation. Company does not want to be subject to consolidation as set forth in FASB ASC 810, as issued and amended from time to time by FASB. Company represents that, as of the Effective Date, it is not required to consolidate Subscriber Organization into its financial statements in accordance with FASB ASC 810. If for any reason, at any time during the Term, Company determines, in its sole but good faith discretion, that it is required to consolidate Subscriber Organization into its financial statements in accordance with FASB ASC 810, then Subscriber Organization shall immediately provide audited financial statements (including footnotes) in accordance with U.S. generally accepted accounting principles (and as of the reporting periods Company is required to report thereafter) in order for Company to consolidate and file its financial statements within the reporting deadlines of the Securities and Exchange Commission. Notwithstanding the foregoing requirement that Subscriber Organization provide audited financial statements to Company, the Parties will take all commercially reasonable steps, which may include modification of this Contract to eliminate the consolidation treatment, while preserving the economic "benefit of the bargain" to both Parties.
- G. Audits. The Company reserves the right to inspect the CBRE Facility as necessary to assure the safety and reliability of the system at any time during the Term, and for an additional period of one (1) year thereafter.

9. **REQUIREMENTS APPLICABLE TO SUBSCRIBER ORGANIZATION'S RELATIONSHIP WITH ITS SUBSCRIBERS.** The Subscriber Organization must comply with all of the following:

- A. Subscriber Information. The Subscriber Organization shall issue subscriptions in the CBRE Facility only to eligible retail electric service customers of the Company and provide to the Company the name, account number and service address attributable to each subscription and the Subscriber Allocation for each Subscriber's subscription. The Subscriber Organization shall take care to preserve the privacy expectations of the Subscribers, such as not publicly providing a Subscriber's Confidential Account Information, Subscriber Energy Usage Data, or Bill Credits. The Subscriber Organization will not disclose or share such information except as permitted by the Subscriber Agency Agreement and Consent Form executed by Subscriber in connection with Subscriber's acquisition of its subscription in the CBRE Facility or otherwise unless the Subscriber has provided explicit informed consent or if such disclosure is compelled by Law.
- B. Subscriber Exit or Transfer of Interest in CBRE Facility. The transfer, cancellation, termination and/or exit of a Subscriber's interest in the CBRE Facility shall be completed in full accordance with applicable CBRE Framework or CBRE Tariff rules, in addition to any other terms, conditions or requirements imposed by the Subscriber Organization in the Subscriber Agreement, which Subscriber Organization shall ensure is also consistent with and in compliance with applicable CBRE Framework or CBRE Tariff rules. The CBRE Framework and/or CBRE Tariff requirements shall take precedence over any inconsistent or conflicting provisions found in the Subscriber Agreement.
- C. Updating Subscriber Information. The Subscriber Organization shall provide to the Company the Monthly Subscriber Information together with any and all updates to the Monthly Subscription Information as provided

in Section 4. (Updating Monthly Subscriber Information Used to Calculate Bill Credits and Other Matters) to Attachment B (Company Payments for Energy, Dispatchability and Availability of Bess) to this Contract.

- D. Responsibility for Verification.
1. Subscriber Verification. If not already qualified by the CBRE Online Portal, the Subscriber Organization shall verify that each Subscriber is eligible to be a Subscriber in the CBRE Facility and that the CBRE Tariff requirements are met.
 2. LMI Subscriber Verification. For CBRE LMI Projects (as defined in the CBRE Tariff) or for CBRE Mid-Tier Projects or CBRE Large Projects (as defined in the CBRE Tariff) which commit to a certain percentage of LMI Subscribers, in addition to the requirements of Section 9.D.1., Subscriber Organization must comply with CBRE Tariff provisions to verify the LMI status of each LMI Subscriber.
- E. Disclosure of Production Information. The Subscriber Organization acknowledges and agrees that, in order for the Company to carry out its responsibilities in applying Bill Credits to each Subscriber's retail electric bills, the Company may be required and shall be permitted to provide access or otherwise disclose and release to any Subscriber any and all production data related to the PV System and BESS in its possession and information regarding the total Bill Credits applied by the Company with respect to the CBRE Facility and any information pertaining to a Subscriber's subscription. Any additional detailed information requested by a Subscriber shall be provided only upon the Subscriber Organization's consent in writing or email to the Company, or unless the Commission or the CBRE IO requests that the Company provide such information to the Subscriber, or as otherwise required by law.
- F. Disclosure of CBRE Facility Information. The Subscriber Organization acknowledges and agrees that the Company may publicly disclose the CBRE Facility location, Subscriber Organization, nameplate capacity and production data of the CBRE Facility. Additionally, the Company will periodically provide a bill message to Subscribers clarifying that questions or concerns related to their subscription should be directed to the Subscriber Organization, including a statement that the Subscriber Organization is solely responsible for resolving any disputes with the Company or the Subscriber about the accuracy of the CBRE Facility data and that the Company is solely responsible for resolving any disputes with the Subscriber about the applicable rate used to determine the amount of the Bill Credit.
- G. Certain Tax and Securities Law Issues. The Company makes no warranty or representation concerning the taxable consequences, if any, to Subscriber Organization or its Subscribers with respect to its Bill Credits to the Subscribers for participation in the CBRE ~~Facility~~Facility's CBRE Program. Additionally, the Company makes no warranty or representation concerning the implication of any federal or state securities laws on how subscriptions to the CBRE ~~Facility~~Program are handled.
- H. Full Cooperation with the PUC. The Parties agree to fully cooperate with any request for information from the PUC or the CBRE IO pertaining in any way to the CBRE Facility and will provide such information upon request in a timely manner. To the extent to which any request calls for producing a specific Subscriber's Confidential Account Information, Subscriber Energy Usage Data or Bill Credits, such information shall be provided and marked as Confidential Information.
- I. New Energy Generating Systems. The PV System must not be built or previously interconnected at the time of application to the CBRE Program.
- J. Fair Disclosure; Disclosure Checklist. Prior to the time when any person or entity becomes a Subscriber, the Subscriber Organization will fairly disclose the future costs and benefits of the subscription and all other matters specified in the Disclosure Checklist and provide to the potential Subscriber a copy of this Contract. The Subscriber Organization shall comply with all other requirements of the PUC and applicable Laws with respect to communications with Subscribers.

10. GENERAL PROVISIONS FOR CBRE FACILITY DESIGN, CONSTRUCTION AND OPERATION.

- A. The following provisions generally set forth the minimum requirements of Subscriber Organization in designing, constructing and operating the CBRE Facility and are more fully described in Attachment F (Facility Owned by Subscriber Organization) and including without limitation the exhibits to Attachment F, Exhibits F-1 through F-6. In the event of any inconsistency or conflict between the terms and provisions of this Section 10, the terms and provisions of Attachment F and Exhibits F1-F6 shall control.

- B. Permits and Licenses. Subscriber Organization shall be responsible for the design, installation, operation, and maintenance of the CBRE Facility and shall obtain at its expense and maintain any required governmental authorizations and/or permits for the construction and operation of the CBRE Facility.
- C. Control and Protection of Equipment. Design, installation, operation and maintenance of the CBRE Facility shall include control and protection equipment as specified by the Company, including but not limited to the Telemetry and Control interface identified in Section 10.H (Telemetry and Control) below, and an automatic load-break device such as a circuit breaker or inverter and a manual disconnect that has a visible break or breaker with rack-out capability to isolate the CBRE Facility from the Company System. The manual disconnect device must be accessible by the Company and be capable of being locked by the Company in the open position, to establish working clearance for maintenance and repair work in accordance with the Company's safety rules and practices. The disconnect devices shall be furnished and installed by the Subscriber Organization and are to be connected between the CBRE Facility and the Company system. The disconnect devices shall be located in the immediate vicinity of the electric meter serving the Subscriber Organization. The manual disconnect device shall be, at a minimum, clearly labeled "Subscriber Organization System Disconnect." With permission of the Company, the disconnect devices may be located at an alternate location which is readily and safely accessible to the Company on a 24-hour basis. Such alternate location shall be clearly identified with signage placed in the immediate vicinity of the electric meter serving the Subscriber Organization.
- D. Access. The Subscriber Organization grants access to the Company to utilize the disconnect device, if needed. Subscriber Organization shall obtain the authorization from the owner and/or occupants of the premises where the CBRE Facility is located that allows the Company to access the CBRE Facility for the purpose specified in this Contract. Company may enter premises where the CBRE Facility is located, as permitted by law or tariff, for the following purposes: (1) to inspect CBRE Facility's protective devices and read or test meter(s); and (2) to disconnect the CBRE Facility and/or service to Subscriber Organization, whenever in Company's sole opinion, a hazardous condition exists and such immediate action is necessary to protect persons, Company's facilities, or property of others from damage or interference caused by the CBRE Facility, or the absence or failure of properly operating protective device.
- E. Prior Written Approval. Under no circumstances shall a Subscriber Organization interconnect and operate the CBRE Facility in parallel with the Company's electric system without prior written approval by the Company.
- F. Equipment Modifications. Once the CBRE Facility is interconnected to the Company's system, the Company reserves the right to require the installation of, or modifications to, equipment determined by the utility to be necessary to facilitate the delivery of reliable electric service to its customers, subject to the requirement that such installation or modification be consistent with the terms of this Contract and applicable interconnection standards (e.g., Rule 14H). If interconnection standards outside of this Contract conflict with the terms of this Contract, the provisions in this Contract shall apply. The Company shall provide a written explanation of the need for such installation or modification. Any disputes related to this provision shall be resolved according to the dispute resolution process set forth in Section 17. (Dispute Resolution) of this Contract.
- G. [~~RESERVED~~Reserved]
- H. Telemetry and Control Interface. The CBRE Facility must comply with the communications and controllability requirements set forth in Section 1.(b) (Certain Specifications for the Facility), Sub-section (iii).e. of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
- I. Project Completion.
1. The Subscriber Organization shall achieve the Commercial Operations Date for the CBRE Facility within eighteen (18) months from the execution date of this Contract, as the same may be extended as provided herein or in the CBRE Tariff (the "Commercial Operations Date Deadline"). The Commercial Operations Date Deadline shall be extended day-for-day for a CBRE Facility that, in the Company's determination, has suffered a Force Majeure event as set forth in Section 27. (Force Majeure) of this Contract prior to the Commercial Operations Date, or for any delay caused by Company.
 2. Notwithstanding the foregoing, a local-government moratorium to issuing a permit may extend the 18-month Project Completion period for no more than an additional six (6) months. Failure to seek a permit,

- delay in seeking a permit, or permit-processing time not subject to a moratorium is not included in this 6-month extension.
3. If Substantial Progress, as defined herein, has been achieved, but the Commercial Operations Date has not been achieved by the Commercial Operations Date Deadline, and Subscriber Organization still intends to complete its CBRE Facility, then the Subscriber Organization shall pay a “late fee” to Company of \$200/day/MW nameplate capacity of the PV System until the CBRE Facility achieves the Commercial Operations Date. For example, if the CBRE Facility has a nameplate capacity of 500 kW, and it achieves the Commercial Operations Date thirty (30) Days late, the “late fee” would be \$3,000. The “late fee” shall be paid to Company before the Commercial Operations Date. However, if Company fails to collect in full such amount by this date, such unpaid amount may be set off against any refund that may be due to Subscriber Organization for Total Estimated Interconnection Costs paid by Subscriber Organization that exceeds the Actual Interconnection Costs. All “late fee” payments received by Company will be credited back through the appropriate regulatory mechanism to offset the costs to Company ratepayers for the CBRE Program. A prerequisite to showing that Substantial Progress has been achieved in a timely manner is that before the Commercial Operations Date Deadline the Subscriber Organization must submit a signed letter to Company attesting to the fact that Substantial Progress as defined in this Contract has been made, and attach photographs to that letter demonstrating this.
 4. If: (i) Substantial Progress has not been achieved by the Commercial Operations Date Deadline, or (ii) Subscriber Organization does not wish to complete its CBRE Facility upon the Commercial Operations Date Deadline, or (iii) the Commercial Operations Date that is extended due to a permit issuance moratorium is not achieved within six (6) months from the originally required Commercial Operations Date Deadline, then the application for the CBRE Facility and this Contract will be terminated by Company without further notice. No additional concurrence from the CBRE IO shall be necessary for such termination. The Application Fee and any other deposits paid by the Subscriber Organization shall be forfeited.
 5. After termination, the Subscriber Organization, if it still intends to proceed with the CBRE Facility, must submit a new application and pay any applicable deposit and/or fees which will be subject to the then current CBRE Tariff, Bill Credit Rate and other applicable CBRE requirements for new projects, including CBRE Program capacity availability.

11. INTERCONNECTION REQUIREMENTS.

- A. Rule 14H Compliance. The Subscriber Organization must comply with all of the terms, conditions and requirements of Rule 14H (Interconnection of Distributed Generating Facilities Operating in Parallel With The Company’s Electric System), including without limitation Appendix I (Distributed Generation Facility Interconnection Standards Technical Requirements). In the event of any inconsistency or conflict between the terms and provisions of this Contract and Rule 14H, the terms and ~~provisions of Rule 14H~~provisions of this Contract shall control.
- B. Distribution Interconnection. ~~If Subject to Section 11.A (Rule 14H Compliance) above, if~~ the CBRE Facility is a facility interconnecting at the Distribution level, the CBRE Facility shall follow the applicable Rule No. 14H interconnection process at the time of interconnection. If the CBRE Facility is a facility interconnecting at the Sub-Transmission and Transmission levels, the CBRE Facility shall follow the interconnection process applicable to such CBRE Facility at the time of interconnection.
- C. Subscriber Organization-Owned Interconnection Facilities.
 1. The Subscriber Organization shall furnish, install, operate and maintain, at its cost, the interconnection facilities (such as circuit breakers, relays, switches, synchronizing equipment, monitoring equipment, and control and protective devices and schemes identified in Exhibit F-1 (Description of Generation and Battery Storage Facilities) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 2. The point of interconnection is shown on the single-line diagram and three-line diagram (provided by the Subscriber Organization and reviewed by the Company) which are appended to Attachment F, herein. Pursuant to Rule 14H, Appendix I (Distributed Generation Facility Interconnection Standards Technical Requirements), Section 6.c (Review of Design Drawings), the Company must review and approve

- Subscriber Organization's single-line and three-line diagrams prior to Subscriber Organization constructing of the CBRE Facility interconnection.
3. The Subscriber Organization shall not operate equipment that superimposes a voltage or current upon the Company's system that interferes with the Company's operations, service to the Company's customers, or the Company's communication facilities. Such interference shall include, but not be limited to, overcurrent, voltage imbalance, and abnormal waveforms. If such interference occurs, the Subscriber Organization must diligently pursue and take corrective action at its own expense after being given notice and reasonable time to do so by the Company. If the Subscriber Organization does not take timely corrective action or continues to operate the equipment causing interference without restriction or limit, the Company may, without liability, disconnect the Subscriber Organization's equipment from the Company's system. ~~Pursuant to Rule 14H, Appendix I (Distributed Generation Facility Interconnection Standards Technical Requirements), Section 6.c (Review of Design Drawings), the Company must review and approve Subscriber Organization's single line and three line diagrams prior to Subscriber Organization constructing of the CBRE Facility interconnection.~~
 4. The Subscriber Organization agrees to test the CBRE Facility, to maintain operating records, and to follow such operating procedures, as may be specified by the Company to protect the Company's system from damages resulting from the parallel operation of the CBRE Facility, including such testing, records and operating procedures as more fully described Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 5. The Company may inspect the CBRE Facility and Subscriber Organization's interconnection facilities.
- D. System Capacity. The CBRE Facility must have a nameplate capacity, in the aggregate, of no more than _____ (_____) kW/MW to assure that the CBRE Facility has a nameplate capacity of less no more than 2.5MW.
- E. Company-Owned Interconnection Facilities.
1. The Company agrees to furnish, install, operate and maintain such interconnection facilities on its side of the point of interconnection with the CBRE Facility as required for the parallel operation with the CBRE Facility and more fully described in Attachment G (Company- Owned Interconnection Facilities) to this Contract.
 2. All Company-Owned Interconnection Facilities shall be the property of the Company. Where portions of the Company-Owned Interconnection Facilities are located on the Subscriber Organization's premises, the Subscriber Organization shall provide, at no expense to the Company, a suitable location for and access to all such equipment. If a 120/240 Volt power source or sources are required, the Subscriber Organization shall provide these at no expense to the Company.
 3. Subscriber Organization agrees to pay to the Company a non-refundable initial payment as contribution for the Company's investment in development of the Company-Owned Interconnection Facilities and to pay for all other interconnection costs (the "Total Estimated Interconnection Costs"), as more fully described in Attachment G (Company-Owned Interconnection Facilities). The Total Estimated Interconnection Costs shall not include the cost of an initial technical screening (under Rule 14H) of the impact of the CBRE Facility on the Company's system.
 4. Governmental Approvals for Company-Owned Interconnection Facilities. Subscriber Organization shall obtain at its sole cost and expense all Governmental Approvals necessary to the construction, ownership, operation and maintenance of the Company-Owned Interconnection Facilities. Subscriber Organization shall provide all Governmental Approvals necessary for the construction of such Company-Owned Interconnection Facilities prior to the commencement of construction by Company.
- F. Credit Assurance and Security. Subscriber Organization is required to post and maintain Development Security and Operating Security based on the requirements of this Section 11.F (Credit Assurance and Security).
1. Development Security. To guarantee undertaking the performance of Subscriber Organization's obligations under the Contract for the period prior to the Commercial Operations Date (including but not limited to Subscriber Organization's obligation to meet the Commercial Operations Date Deadline), Subscriber Organization shall post and maintain development period security ("Development Security")

- in an amount not less than twenty-five percent (25%) of the Total Estimated Interconnection Costs for the Company-Owned Interconnection Facilities within thirty (30) Days of Execution Date of the Contract.
2. Return of Development Security. The Development Security shall be returned to Subscriber Organization, subject to Company's right to draw from the Development Security as set forth in Section 11.F.6 (Company's Right to Draw from Security Funds), in the following circumstances: (i) this Contract is declared null and void under Section 3.E (Contract Null and Void) or this Contract is terminated prior to the Commercial Operations Date but, in each case, only after all amounts which may be due and owing to Company upon such termination are paid in full by Subscriber Organization, including by draw upon such Development Security or (ii) following Company's receipt of Operating Security pursuant to Section F.3 (Operating Security).
 3. Operating Security. To guarantee the performance of Subscriber Organization's obligations under this Contract for the period starting from the Commercial Operations Date to the expiration or termination of this Contract, Subscriber Organization shall provide satisfactory operating period security to Company in the amount of \$75/kW based on the Contract Capacity (the "Operating Security"). Subscriber Organization shall provide such Operating Security to Company within five (5) Business Days after the Commercial Operations Date, provided that, at all times, some form of Security Funds shall be in place and available to Company, whether Development Security or Operating Security.
 4. Form of Security. Subscriber Organization shall supply the Development Security and Operating Security required in the form of an irrevocable standby letter of credit with no documentation requirement substantially in the form attached to this Contract as Attachment G-1 (Form of Letter of Credit) from a bank chartered in the United States with a credit rating (as measured by Standard & Poor's) of "A-" or better. If the rating of the bank issuing the standby letter of credit falls below A-, Company may require Subscriber Organization to replace, within thirty (30) Days' notice by Company, the standby letter of credit with a standby letter of credit from another bank chartered in the United States with a credit rating of "A-" or better. Such letter of credit shall be issued for a minimum term of one (1) year and shall be automatically renewed for at least an additional one (1) year term so that at the time of such renewal, the remaining term of any such security shall not be less than one (1) year. The reasonable costs and expenses of establishing, renewing, substituting, canceling, increasing, reducing, or otherwise administering the letter of credit shall be borne by Subscriber Organization.
 5. Security Funds. The Development Security and Operating Security, including L/C Proceeds therefrom (collectively referred to as the "Security Funds") established, funded, and maintained by Subscriber Organization pursuant to the provisions of this Section 11.F (Credit Assurance and Security) shall provide security for the performance of Subscriber Organization's obligations under this Contract and shall be available to be drawn on by Company as provided in Section 11.F.6 (Company's Right to Draw from Security Funds). Subscriber Organization shall maintain the Security Funds at the contractually-required level throughout the Term of this Contract. Subscriber Organization shall replenish the Security Funds to such required level within fifteen (15) Business Days after any draw on the Security Funds by Company or any reduction in the value of Security Funds below the required level for any other reason. Notwithstanding the foregoing, Subscriber Organization's obligation to replenish the Development Security shall not exceed in total four (4) times the original amount of the Development Security required under Section 11.F.1 (Development Period Security) of this Contract.
 6. Company's Right to Draw from Security Funds. In addition to any other remedy available to it, Company may, before or after termination of this Contract, draw from the Security Funds such amounts as are necessary to recover amounts Company is owed pursuant to this Contract, any accompanying letter agreements associated with the Contract for other work, such as the IRS, to be paid by Subscriber Organization, including, without limitation, any damages due Company, any interconnection costs owed pursuant to Attachment G (Company-Owned Interconnection Facilities) and any amounts for which Company is entitled to indemnification under this Contract. Company may, in its sole discretion, draw all or any part of such amounts due Company from any of the Security Funds to the extent available pursuant to this Section 11.F (Credit Assurance and Security), and from all such forms, and in any sequence Company may select. Any failure to draw upon the Security Funds or other security for any damages or

other amounts due Company shall not prejudice Company's rights to recover such damages or amounts in any other manner.

7. Failure to Renew or Extend Letter of Credit. If the letter of credit is not renewed or extended at least thirty (30) Days prior to its expiration or earlier termination, Company shall have the right to draw immediately upon the full amount of the letter of credit and, at Company's sole option, to place the proceeds of such draw (the "L/C Proceeds"), at Subscriber Organization's cost, in an escrow account until and unless Subscriber Organization provides a substitute letter of credit meeting the requirements of this Section 11.F (Credit Assurance and Security). If Company elects, the L/C Proceeds shall be deposited with a reputable escrow agent acceptable to Company ("Escrow Agent"). Without limitation to the generality of the foregoing, a federally-insured bank shall be deemed to be a "reputable escrow agent." Company shall have the right to apply the L/C Proceeds as necessary to recover amounts Company is owed as specified in Section 11.F.6 (Company's Right to Draw from Security Funds). The documentation governing such escrow account shall be in form and content satisfactory to Company and shall give Company the sole authority to draw from the escrow account. Subscriber Organization shall not be a party to such documentation and shall have no rights to the L/C Proceeds. If an adequate substitute letter of credit is obtained and provided to Company, the net L/C Proceeds remaining as of the date that such substitute letter of credit is provided, shall be returned to Subscriber Organization, or as Subscriber Organization directs in writing.
8. Release of Security Funds. Upon the end of the Term and the complete performance of all of Subscriber Organization's obligations under this Contract, including but not limited to the obligation to pay any and all amounts owed by Subscriber Organization to Company under this Contract, Company shall release the Security Funds to Subscriber Organization.

12. PERSONNEL AND SYSTEM SAFETY. Notwithstanding any other provisions of this Contract, if at any time Company determines that the Facility may endanger Company's personnel, and/or the continued operation of the Facility may endanger the integrity of the Company System or have an adverse effect on Company's other customers' electric service, Company shall have the right to disconnect the Facility from the Company System, as determined in the sole discretion of the Company System Operator. The Facility shall immediately comply with the dispatch instruction, which may be initiated through remote control, and shall remain disconnected (and in Subscriber Organization-Attributable Non-Generation status if so determined), until such time as Company is satisfied that the condition(s) referred to above have been corrected. If Company disconnects the Facility from the Company System for personnel or system safety reasons, it shall as soon as practicable notify Subscriber Organization by telephone, and thereafter make reasonable efforts to confirm, in writing (with email being acceptable), within three (3) Days of the disconnection, the reasons for the disconnection. If the reason for the disconnection constitutes Subscriber Organization-Attributable Non-Generation, Company will notify Subscriber Organization (i) whether the conditions resulting in such disconnection have been resolved (in which case no additional time after such confirmation shall count as Subscriber Organization-Attributable Non-Generation); or (ii) that conditions resulting in such disconnection have not been resolved so that Subscriber Organization can take such appropriate corrective actions. Subscriber Organization shall notify Company in writing when such corrective action has been completed; provided, however, that Subscriber Organization shall remain in Subscriber Organization-Attributable Non-Generation until Company is satisfied that the condition resulting in the disconnection has been corrected. Company shall use reasonable efforts to inspect such corrective measures (if necessary) and confirm the resolution of such condition within three (3) Business Days after Subscriber Organization's notification.

13. EVENTS OF DEFAULT BY SUBSCRIBER ORGANIZATION.

- A. The occurrence of any of the following shall constitute an "Event of Default" by Subscriber Organization:
 1. If at any time during the Term, Subscriber Organization delivers or attempts to deliver to the Point of Interconnection for sale under this Contract renewable energy that was not produced by the CBRE Facility and Subscriber Organization fails to cease such delivery or attempt to deliver such renewable energy within ten (10) Days after Company's written notice of such delivery or attempt.

2. If at any time subsequent to the Commercial Operations Date, the PV System Equivalent Availability Factor is less than **84%** for each of three consecutive Contract Years.
3. If at any time subsequent to the Commercial Operations Date, the Measured Performance Ratio for each of three consecutive Contract Years falls below the Tier 2 Bandwidth for such Contract Year.
4. If at any time subsequent to the Commercial Operations Date, the Subscriber Organization fails to demonstrate satisfaction of the BESS Capacity Performance Metric prior to the expiration of the BESS Capacity Cure Period.
5. If at any time subsequent to the Commercial Operations Date, the Subscriber Organization fails to achieve a BESS Annual Equivalent Availability Factor of not less than **75%** for each of six (6) consecutive BESS Measurement Periods as provided in Section 4.B (BESS Annual Equivalent Availability Factor; Liquidated Damages; Termination Rights) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract.
6. If at any time subsequent to the Commercial Operations Date, Subscriber Organization fails to demonstrate satisfaction of the RTE Performance Metric prior to the expiration of the RTE Cure Period.
7. If at any time subsequent to the Commercial Operations Date, the Facility is unavailable to provide electric energy in response to dispatch by Company for a period of three hundred sixty-five (365) or more consecutive Days.
8. If at any time during the Term, Subscriber Organization fails to satisfy the requirements of Section 11.F (Credit Assurance and Security) of this Contract.
9. If at any time subsequent to the Commercial Operations Date, Subscriber Organization fails to take all corrective actions specified by the Company's written notice that the CBRE Facility is out of compliance with the terms of this Contract, within the timeframe set forth in such notice.
10. If at any time subsequent to the Commercial Operations Date, Subscriber Organization fails to install, operate, maintain, or repair the Facility in accordance with Good Engineering and Operating Practices if such failure is not cured within thirty (30) Days after written notice of such failure from Company unless such failure cannot be cured within said thirty (30) Day period and Subscriber Organization is making commercially reasonable efforts to cure such failure, in which case Subscriber Organization shall have a cure period of three hundred sixty-five (365) Days after Company's written notice of such failure.
11. The failure to make any payment required pursuant to this Contract when due if such failure is not cured within ten (10) Business Days after written notice is received by Subscriber Agreement.
12. If any representation or warranty made to Company by Subscriber Organization herein is false and misleading in any material respect when made.
13. Subscriber Organization becomes insolvent, or makes an assignment for the benefit of creditors; or shall have an order for relief in an involuntary case under the bankruptcy Laws as now or hereafter constituted entered against it, or shall commence a voluntary case under the bankruptcy Laws as now or hereafter constituted, or shall file any petition or answer seeking for itself any arrangement, composition, adjustment, liquidation, dissolution or similar relief to which it may be entitled under any present or future Law; or seeks or consents to or acquiesces in the appointment of or taking possession by, any custodian, trustee, receiver or liquidator of it or of all or a substantial part of its properties or assets; or takes action looking to its dissolution or liquidation, and Subscriber Organization is unable to remedy such actions within one hundred eighty (180) Days of the occurrence of such breach or default.
14. Subscriber Organization fails to comply with the applicable term, conditions and minimum requirements specified in the CBRE Tariff governing Subscriber Organization's CBRE Facility, if such failure is not cured within thirty (30) Days after written notice of such failure from Company.
15. Subscriber Organization fails to comply with a decision under Section 17 (Dispute Resolution) within thirty (30) Days after such decision or, if such decision cannot be complied with within thirty (30) Days, Subscriber Organization fails to have commenced commercially reasonable efforts designed to achieve compliance within such thirty (30) Days and diligently continue such commercially reasonable efforts until compliance is attained, but no longer than one hundred twenty (120) Days;
16. Other than the events of default specified in this Section 13.A.1 through Section 13.A.15, should Subscriber Organization, by act or omission, materially breach or default on any other material covenant,

condition or other provision of this Contract, and if such breach or default is not cured within thirty (30) Days after written notice of such breach or default from Company, such failure to cure shall constitute an Event of Default; provided, however, that if it is objectively impossible to cure such breach or default within said thirty (30) Day period, then, for so long as Subscriber Organization is making the same effort to cure such breach or default as would be expected of an experienced independent power producer willing and able to exert commercially reasonable efforts to achieve such cure, Subscriber Organization shall have a cure period equal to three hundred sixty-five (365) Days beginning on the date of Company's written notice of such breach or default; provided, further, that if the material breach in question involves Subscriber Organization's failure to meet the operational and performance standards set forth in Attachment F (Facility Owned by Subscriber Organization), the provisions of Section 1(j) (Demonstration of Facility) of Attachment F (Facility Owned by Subscriber Organization) for consultant's study and Subscriber Organization implementation of such study's recommendation shall apply in lieu of the extended cure period provided under the preceding proviso.

14. TERMINATION FOR CAUSE.

A. Upon an Event of Default by the Subscriber Organization:

1. Company shall provide written notice to the Subscriber Organization to remedy the Event of Default within the applicable cure period specified for such Event of Default, if any.
2. If after the cure period, if any, provided for in the Company's notice, Subscriber Organization is still not in compliance with this Contract, then the Company shall have the right to terminate the Contract, as follows:
 - a. Company shall issue a written a Notice of Intent to Terminate the Contact for just cause;
 - b. Subscriber Organization shall have five (5) Business Days in which to provide evidentiary documentation reasonably establishing that Company's decision to terminate the Contract is in error.
 - c. If the Subscriber Organization fails to provide such proof or if the Company reasonably determines that such proof is insufficient to reverse the Company's decision to terminate, Company may proceed to terminate the Contract by providing a written Notice of Termination to Subscriber Organization. A copy of such notice shall be provided to all Subscribers of the CBRE Facility, the PUC, and the CBRE IO, if applicable.
3. The termination date in the notice of termination shall not be earlier than thirty (30) Days from the date of such notice.
4. Subscriber Organization acknowledges that Company is a public utility and is relying upon Subscriber Organization's performance of its obligations under this Contract, and that Company and/or its customers may suffer irreparable injury as a result of the failure of Subscriber Organization to perform any of such obligations, whether or not such failure constitutes an Event of Default or otherwise gives rise to a termination for cause of this Contract. Accordingly, Company shall have right to seek specific performance injunctions or other available equitable remedies for Subscriber Organization's failure to perform any of its obligations under this Contract, irrespective of whether such failure constitutes an Event of Default.
5. In the event of any breach of this Contract by Company, the Subscriber Organization shall provide Company with a written notice of the breach. Company shall have up to thirty (30) Days to cure the breach. If the breach is not cured within the thirty (30) Days, the Subscriber Organization may utilize the procedures set forth in Section 17. (Dispute Resolution) of this Contract. If the breach results in Bill Credits not being issued to one or more individual Subscribers, in the absence of a cure by Company within the allowed time following the notice, the Subscriber Organization may also seek a remedy on behalf of the affected Subscribers for any past due Bill Credits pursuant to the process set forth in Section 17. (Dispute Resolution) of this Contract.

- B. Following Termination, applicable provisions shall continue in effect after termination to the extent necessary to enforce and complete the duties, obligations or responsibilities of the Parties arising prior to termination and, as applicable, to provide for final billings and adjustments related to the period prior to termination, repayment of any money due and owing to either Party pursuant to this Contract.

15. DAMAGES IN THE EVENT OF TERMINATION BY COMPANY.

- A. Termination Due to an Event of Default. If the Contract is terminated by Company in accordance with this Contract due to an Event of Default, Company shall be entitled to Termination Damages calculated by multiplying the Contract Capacity by [\$75/kW].
- B. Termination Damages Appropriate. Subscriber Organization agrees and acknowledges that (i) the damages that Company would incur due to early termination of the Contract would be difficult or impossible to calculate with certainty, (ii) the Termination Damages are an appropriate approximation of such damages, and (iii) payment of Termination Damages does not relieve Subscriber Organization of liability for costs and balances incurred prior to the effective date of such termination. The Termination Damages are not intended to limit Company's rights or remedies, or Subscriber Organization's liabilities or duties, with respect to losses arising independent of the termination of this Contract for an Event of Default before the Commercial Operations Date, including, without limitation, Company's right to recover under Section 16. (Limitation of Liability).

16. LIMITATION OF LIABILITY.

- A. Each Party shall at all times indemnify, defend, and save the other Party harmless from any and all damages, losses, claims, including claims and actions relating to injury or death of any person or damage to property, costs and expenses, reasonable attorneys' fees and court costs, arising out of or resulting from the Party's performance of its obligations under this Contract, except to the extent that such damages, losses or claims were caused by the negligence or intentional acts of the other Party.
- B. Each Party's liability to the other Party for failure to perform its obligations under this Contract shall be limited to the amount of direct damage actually incurred. In no event shall either Party be liable to the other Party for any punitive, incidental, indirect, special, or consequential damages of any kind whatsoever, including for loss of business opportunity or profits, regardless of whether such damages were foreseen.
- C. Notwithstanding any other provision of the Contract or this Section 16., with respect to the Company's duties or performance or lack of performance under this Contract, the Company's liability to the Subscriber Organization shall be limited as set forth in the Company's rate book and terms and conditions for electric service, which shall not be affected by the terms of this Contract. There are no third-party beneficiaries of any Company duty under this Contract other than the Company's duty to Subscribers to issue Bill Credits as set forth in this Contract.
- D. Indemnification of Company Against Third Party Claims. Subscriber Organization shall indemnify, defend, and hold harmless Company, its successors, permitted assigns, affiliates, controlling persons, directors, officers, employees, agents, contractors, subcontractors and the employees of any of them (collectively referred to as an "Indemnified Company Party"), from and against any Losses suffered, incurred or sustained by any Indemnified Company Party due to any Claim (whether or not well founded, meritorious or unmeritorious) by a third party not controlled by, or under common ownership and/or control with, Company relating to (i) the Subscriber Agreement between Subscriber Organization and its Subscribers or (ii) Subscriber Organization's development, permitting, construction, ownership, operation and/or maintenance of the CBRE Facility.

17. DISPUTE RESOLUTION.

- A. Notwithstanding the provisions of this Contract allowing for early termination following an Event of Default, each Party agrees to attempt to resolve all disputes arising hereunder promptly, equitably and in a good faith manner.
- B. Before submitting any claims, controversies or disputes ("Dispute(s)") under this Contract to the Dispute Resolution Procedures set forth below in Section C., the presidents, vice presidents, or authorized delegates from both Subscriber Organization and Company having full authority to settle the Dispute(s), shall personally meet in Hawai'i and attempt in good faith to resolve the Dispute(s) (the "Management Meeting").
- C. Dispute Resolutions Procedures, Mediation. Any and all Dispute(s) arising out of or relating to this Contract, (i) which remain unresolved for a period of 20 Days after the Management Meeting takes place or (ii) for

which the Parties fail to hold a Management Meeting within sixty (60) Days of the date that a Management Meeting was requested by a Party, may upon the agreement of the Parties, first be submitted to confidential mediation in Honolulu, Hawai'i pursuant to the administration by, and in accordance with the Mediation Rules, Procedures and Protocols of, Dispute Prevention & Resolution, Inc. (or its successor) or, in their absence, the American Arbitration Association ("DPR") then in effect. If the Parties agree to submit the dispute to confidential mediation, the parties shall each pay 50% of the cost of the mediation (i.e., the fees and expenses charged by the mediator and DPR) and shall otherwise each bear their own mediation costs and attorneys' fees. If the Parties do not submit the Dispute(s) to mediation, or if they do submit the Dispute(s) to mediation but settlement of the Dispute(s) is not reached within 60 Days after commencement of the mediation, either Party may initiate legal proceedings in a court of competent jurisdiction in the State of Hawai'i.

18. ENVIRONMENTAL CREDITS. Included in the purchase and sale of renewable energy are all of the Environmental Credits associated with the renewable energy. Company will not reimburse Subscriber Organization for any taxes or fees imposed on Subscriber Organization including, but not limited to, State of Hawai'i general excise tax. To the extent not prohibited by law, Company shall have the sole and exclusive right to use the renewable energy purchased hereunder to meet RPS and any Environmental Credit shall be the property of Company; provided, however, that such Environmental Credits shall be to the benefit of Company's ratepayers in that the value must be credited "above the line." Subscriber Organization shall use all commercially reasonable efforts to ensure such Environmental Credits are vested in Company, and shall execute all documents, including, but not limited to, documents transferring such Environmental Credits, without further compensation; provided, however, that Company agrees to pay for all reasonable costs associated with such efforts and/or documentation.

19. REPRESENTATIONS AND WARRANTIES.

A. Company and Subscriber Organization represent and warrant, respectively, that:

1. Each respective Party has all necessary right, power and authority to execute, deliver and perform this Contract.
2. The execution, delivery and performance of this Contract by each respective Party will not result in a violation of any Laws, or conflict with, or result in a breach of, or cause a default under, any agreement or instrument to which such Party is also a party or by which it is bound. No consent of any person or entity not a Party to this Contract, other than governmental agencies whose approval is necessary for construction of the CBRE Facility and interconnection facilities, is required for such execution, delivery and performance by either Party.

B. Subscriber Organization represents, warrants and covenants that:

1. Subscriber Organization has obtained all Land Rights necessary for the construction, ownership, operation and maintenance of the CBRE Facility during the Term, and Subscriber Organization shall maintain such Land Rights in effect throughout the Term.
2. As of the commencement of construction, Subscriber Organization shall have obtained all permits or approvals from any applicable governmental agency necessary for the construction, ownership, operation and maintenance of the CBRE Facility and all interconnection facilities.
3. Subscriber Organization warrants that the CBRE Facility complies with all applicable federal and state Laws, including but not limited to (a) all applicable securities Laws and shall continue to be in compliance for the duration of the Term; (b) complies with all applicable Laws concerning the dissemination of personally identifiable information, and shall continue to be in compliance for the longer of (i) the Term and (ii) for as long as Subscriber Organization continues to hold or otherwise have access to any personally identifiable information of Subscribers or customers of Company; (c) complies with all applicable Laws concerning consumer protection, and shall continue to be in compliance for the duration of the Term; (d) complies with all applicable Laws and regulations concerning renewable energy grid interconnections, and shall continue to be in compliance for the duration of the Term.

20. SUBSCRIBER ORGANIZATION AND CBRE FACILITY INFORMATION. By signing this Contract, the Subscriber Organization expressly agrees and authorizes the Company to request and obtain from Subscriber

Organization and its contractors, vendors, subcontractors, installers, suppliers or agents (collectively “Subscriber Organization Agents”), at no cost to Company, information related to the CBRE Facility, including but not limited to Watts, Vars, Watt Hours, current and voltage, status of the CBRE Facility, inverter settings, any and all recorded event or alarm logs recorded, (collectively “CBRE Facility Data”) that Company reasonably determines are needed to ensure the safe and reliable operation of the CBRE Facility or the Company’s system. Subscriber Organization expressly agrees and irrevocably authorizes Subscriber Organization Agents to disclose such Subscriber Organization Data to Company upon request by Company.

21. **ADDITIONAL INFORMATION.** The Company reserves the right to request additional information from Subscriber Organization relating to the CBRE Facility, where reasonably necessary, to serve the Subscriber Organization under this Contract or to ensure reliability, safety of operation, and power quality of the Company’s system.
22. **NO MATERIAL CHANGES TO CBRE FACILITY.** The Subscriber Organization agrees that no material changes or additions to the CBRE Facility shall be made without having obtained prior written consent from the Company, which consent shall not be unreasonably withheld. In no event may the Total Rated Capacity of the CBRE Facility exceed _____ kW. If the CBRE Facility changes ownership, the Company may require the new Subscriber Organization to complete and execute an amended Contract or new Contract, as may be applicable.
23. **CERTIFICATION BY LICENSED ELECTRICAL CONTRACTOR.** The CBRE Facility and all interconnection systems must comply with all applicable safety and performance standards of the National Electrical Code (NEC), Institute of Electrical and Electronic Engineers (IEEE), and accredited testing laboratories such as the Underwriters Laboratories (UL), and where applicable, the rules of the Commission, or other applicable governmental laws and regulations, and the Company’s interconnection requirements, in effect at the time of signing this Contract. This requirement shall include, but not be limited to, the interconnection standards and procedures of the Company’s Rule 14H, as well as any other requirements as may be specified in this Contract, its Attachments, Exhibits, and as authorized by the Commission. Upon request by Company, Subscriber Organization shall cause a Licensed Electrical Contractor, as agent for Subscriber Organization, to certify that once approved by the Company, the proposed CBRE Facility will be installed to meet all preceding requirement(s).
24. **GOOD ENGINEERING PRACTICE.**
 - A. Each Party agrees to install, operate and maintain its respective equipment and facilities and to perform all obligations required to be performed by such Party under this Contract in accordance with good engineering practice in the electric industry and with applicable laws, rules, orders and tariffs.
 - B. Wherever in this Contract and its Attachments and Exhibits the Company has the right to give specifications, determinations or approvals, such specifications, determinations and/or approvals shall be given in accordance with the Company’s standard practices, policies and procedures, which may include the Company’s Electric Service Installation Manual, the Company’s Engineering Standard Practice Manual and the IEEE Guides and Standards for Protective Relaying Systems.
25. **INSURANCE.** The following insurance provisions are only applicable to CBRE Facilities with a Total Rated Capacity 250 kW or greater but not exceeding 2.5 MW:
 - A. The Subscriber Organization shall, at its own expense and during the term of the Contract and any other time that the CBRE Facility is interconnected with the Company’s system, maintain in effect with a responsible insurance company authorized to do insurance business in Hawai‘i and with a rating by A.M. Best Company, Inc. of “A-VII” or better, the following insurance or its equivalent at Company’s discretion that will protect the Subscriber Organization and the Company with respect to the CBRE Facility, the CBRE Facility’s operations, and the CBRE Facility’s interconnection with the Company’s system:
 1. A Commercial General Liability policy covering bodily injury and property damage with combined single limit of liability of at least the following amounts based on the Total Rated Capacity of the generator (for

solar systems—Total Rated Capacity of the generator or inverter, whichever is lower, can be used with appropriate technical documentation on inverter, if not higher Total Rated Capacity will be used), for any occurrence. The limits below may be satisfied through the use of umbrella or excess liability insurance sufficient to meet these requirements:

COMMERCIAL GENERAL LIABILITY COVERAGE AMOUNT	TOTAL RATED CAPACITY OF THE CBRE FACILITY
\$5,000,000	Greater than 1 MW and less than or equal to 5 MW
\$2,000,000	250 kW and less than or equal to 1 MW

2. Said insurance by endorsement to the policy or policies shall: name the Company, its directors, officers, agents, and employees as additional insured; include contractual liability coverage for written agreements; include provisions stating that the insurance will respond to claims or suits by additional insureds against the Subscriber Organization or any other insured thereunder; provide that the insurance is primary with respect to the Subscriber Organization and the Company; and provide that the insurance company waives all rights of subrogation which Subscriber Organization or the insurance company may have against Company, its directors, officers, agents, and employees. Any insurance carried by Company will be excess only and not contribute with this insurance.
- B. Said insurance by endorsement to the policy or policies shall provide written notice within thirty (30) Days to the Company should the required insurance be cancelled, limited in scope, or not renewed upon expiration. “Claims made” policies are not acceptable, unless the Subscriber Organization agrees to maintain coverage in full effect at all times during the term of this Contract and for three (3) years thereafter. The adequacy of the coverage afforded by the required insurance shall be subject to review by the Company from time to time, and if it appears in such review that risk exposures require an increase in the coverages and/or limits of this insurance, the Subscriber Organization shall make such increase to that extent and any increased costs shall be borne by the Subscriber Organization. The Subscriber Organization has the responsibility to determine if higher limits are desired and purchased. The Subscriber Organization shall provide certificates of insurance to the Company prior to executing the Contract and any parallel interconnection. Receipt of any certificate showing less coverage than required shall not operate as a waiver by the Company of the Subscriber Organization’s obligation to fulfill the applicable requirements of this Section 25. The Subscriber Organization’s indemnity and other obligations shall not be limited by the foregoing insurance requirements. Any deductible shall be the responsibility of the Subscriber Organization.
- C. Alternatively, where the Subscriber Organization is a governmental entity, Subscriber Organization may elect to be self-insured for the amounts set forth above in lieu of obtaining insurance coverage to those levels from an insurance company.

26. MISCELLANEOUS.

- A. Disconnection and Survival of Obligations. Upon termination of this Contract, the CBRE Facility shall be disconnected from the Company’s system. The termination of this Contract shall not relieve the Parties of their respective liabilities and obligations, owed or continuing at the time of termination.
- B. Governing Law and Regulatory Authority. This Contract was executed in the State of Hawai‘i and must in all respects be interpreted, governed, and construed under the laws of the State of Hawai‘i. This Contract is subject to, and the Parties’ obligations hereunder include, operating in full compliance with all valid, applicable federal, state, and local laws or ordinances, and all applicable rules, regulations, orders of, and tariffs approved by, duly constituted regulatory authorities having jurisdiction.
- C. Amendment, Modifications, or Waiver. This Contract may not be altered or modified by either of the Parties, except by an instrument in writing executed by each of them. None of the provisions of this Contract shall be

considered waived by a Party unless such waiver is given in writing. The failure of a Party to insist in any one or more instances upon strict performance of any of the provisions of this Contract or to take advantage of any of its rights hereunder shall not be construed as a waiver of any such provisions or the relinquishment of any such rights for the future, but the same shall continue and remain in full force and effect. This Contract contains the entire agreement and understanding between the Parties, their agents, and employees as to the subject matter of this Contract. Each Party also represents that in entering into this Contract, it has not relied on any promise, inducement, representation, warranty, agreement or other statement not set forth in this Contract.

- D. Notices. Any notice required under this Contract shall be in writing and mailed at any United States Post Office with postage prepaid and addressed to the Party, or personally delivered to the Party at the address identified on the last page of the Contract. Changes in such designation may be made by notice similarly given. Notice sent by mail shall be deemed to have been given on the date of actual delivery or at the expiration of the fifth day after the date of mailing, whichever is earlier.
- E. Assignment. This Contract may not be assigned by either Party without the prior written consent of the other Party. Such consent shall not be unreasonably withheld. In the event of an assignment for financing, to the extent necessary, Company shall, if requested by Subscriber Organization and if its costs (including reasonable attorneys' fees of outside counsel) in responding to such request are paid by Subscriber Organization execute such Hawai'i-law-governed documents as may be reasonably requested by a lender in connection with CBRE Facility debt and reasonably acceptable to Company, to acknowledge an assignment of such debt and/or pledge/mortgage.
- F. Binding Effect. This Contract shall be binding upon and inure to the benefit of the Parties hereto and their respective successors, legal representatives, and permitted assigns.
- G. Relationship of Parties. Nothing in this Contract shall be deemed to constitute any Party hereto as partner, agent or representative of the other Party or to create any fiduciary relationship between the Parties.
- H. Limitations. Nothing in this Contract shall limit the Company's ability to exercise its rights or expand or diminish its liability with respect to the provision of electrical service pursuant to the Company's tariffs as filed with the Commission, or the Commission's Standards for Electric Utility Service in the State of Hawai'i, which currently are included in the Commission's General Order Number 7, as either may be amended from time to time.
- I. Non-Warranty. Neither by inspection, if any, or non-rejection, nor in any other way, does the Company give any warranty, express or implied, as to the adequacy, safety, or other characteristics of any structures, equipment, wires, appliances or devices owned, installed or maintained by the Subscriber Organization or leased by the Subscriber Organization from third parties, including without limitation the CBRE Facility and any structures, equipment, wires, appliances or devices appurtenant thereto.
- J. Hawai'i General Excise Tax. Subscriber Organization shall, when making payments to Company under this Contract, pay such additional amount as may be necessary to reimburse Company for the Hawai'i general excise tax on gross income and all other similar taxes imposed on Company by any Governmental Authority with respect to payments in the nature of gross receipts tax, sales tax, privilege tax or the like, but excluding federal or state net income taxes. By way of example and not limitation, as of the Execution Date, all payments subject to the Hawai'i general excise tax, (i) on the islands of Maui, Moloka'i and Lana'i (totaling 4.0% as of the Execution Date) would include an additional 4.166% so that the underlying payment will be net of such tax liability; and (ii) all payments subject to general excise tax plus surcharge on Hawai'i island (totaling 4.5% as of the Execution Date) would include an additional 4.7120% so the underlying payment will be net of such tax liability.
- K. Execution of Contract; Multiple Counterparts. The Parties agree that this Contract, including amendments, may be executed and delivered by exchange of electronic signatures, which may be transmitted by facsimile, e-mail, or other acceptable means. A party's electronic signature shall be considered an "original" signature which is binding and effective for all purposes. This Contract may be executed in counterparts, each of which shall be deemed an original, and all of which shall together constitute one and the same instrument binding all Parties.

- L. Survival. The rights and obligations of the Parties in this Contract which, by its express terms or nature and context is intended to survive termination or expiration of this Contract, will survive any such termination or expiration.

27. FORCE MAJEURE.

- A. Definition of Force Majeure. The term "Force Majeure", as used in this Contract, means any occurrence that:
1. In whole or in part delays or prevents a Party's performance under this Contract;
 2. Is not the direct or indirect result of the fault or negligence of that Party;
 3. Is not within the control of that Party notwithstanding such Party having taken all reasonable precautions and measures in order to prevent or avoid such event; and
 4. The Party has been unable to overcome by the exercise of due diligence.
- B. Events That Could Qualify as Force Majeure. Subject to the foregoing, events that could qualify as Force Majeure include, but are not limited to, the following: acts of God, flooding, lightning, landslide, earthquake, fire, drought, explosion, epidemic, quarantine, storm, hurricane, tornado, volcano, other natural disaster or unusual or extreme adverse weather-related events; war (declared or undeclared), riot or similar civil disturbance, acts of the public enemy (including acts of terrorism), sabotage, blockade, insurrection, revolution, expropriation or confiscation; or strikes, work stoppage or other labor disputes (in which case the affected Party shall have no obligation to settle the strike or labor dispute on terms it deems unreasonable).
- C. Exclusions From Force Majeure. Force Majeure does not include:
1. any acts or omissions of any Third Party, including, without limitation, any vendor, materialman, customer, or supplier of Subscriber Organization, unless such acts or omissions are themselves excused by reason of Force Majeure;
 2. any full or partial reduction in the electric output of Facility that is caused by or arises from (i) a mechanical or equipment breakdown or (ii) other mishap or events or conditions attributable to normal wear and tear or defects, unless such mishap is caused by Force Majeure;
 3. changes in market conditions that affect the cost of Subscriber Organization's supplies, or that affect demand or price for any of Subscriber Organization's products, or that otherwise render this Contract uneconomic or unprofitable for Subscriber Organization;
 4. Subject to Section 10. I. of this Contract, Subscriber Organization's inability to obtain Governmental Approvals or Land Rights for the construction, ownership, operation and maintenance of Facility and the Company-Owned Interconnection Facilities, or Subscriber Organization's loss of any such Governmental Approvals or Land Rights once obtained;
 5. the lack of wind, sun or any other resource of an inherently intermittent nature;
 6. Subscriber Organization's inability to obtain sufficient fuel, power or materials to operate its Facility, except if Subscriber Organization's inability to obtain sufficient fuel, power or materials is caused solely by an event of Force Majeure;
 7. Subscriber Organization's failure to obtain additional funds, including funds authorized by a state or the federal government or agencies thereof, to supplement the payments made by Company pursuant to this Contract;
 8. a Forced Outage except where such Forced Outage is caused by an event of Force Majeure;
 9. litigation or administrative or judicial action pertaining to the Contract, the Site, the Facility, the Land Rights, the acquisition, maintenance or renewal of financing or any Governmental Approvals, or the design, construction, ownership, operation or maintenance of the Facility, the Company-Owned Interconnection Facilities or the Company System;
 10. a strike, work stoppage or labor dispute limited only to any one or more of the Indemnified Subscriber Organization Parties or any other third party employed by Subscriber Organization to work on the Project; or
 11. any full or partial reduction in the availability of the Facility to produce and deliver to the Point of Interconnection electric energy in response to Company Dispatch which is caused by any Third Party including, without limitation, any vendor or supplier of Subscriber Organization or Company, except to the extent due to Force Majeure.

- D. Satisfaction of Certain Conditions. This Contract defer or limit certain liabilities of a Party for delay and/or failure in performance to the extent such delay or failure is the result of conditions or events of Force Majeure; provided, however, that a Non-performing Party is only entitled to such limitations or deferrals of liabilities as and to the extent the following conditions are satisfied:
1. the Non-performing Party gives the other Party, within five (5) Days after the Non-performing Party becomes aware or should have become aware of the Force Majeure condition or event, but in any event no later than thirty (30) Days after the Force Majeure condition or event begins, written notice (the "Force Majeure Notice") stating that the Non-performing Party considers such condition or event to constitute Force Majeure and describing the particulars of such Force Majeure condition or event, including the date the Force Majeure commenced;
 2. the Non-performing Party gives the other Party, within fourteen (14) Days after the Force Majeure Notice was or should have been provided, a written explanation of the Force Majeure condition or event and its effect on the Non-performing Party's performance, which explanation shall include evidence reasonably sufficient to establish that the occurrence constitutes Force Majeure;
 3. the suspension of performance is of no greater scope and of no longer duration than is required by the condition or event of Force Majeure;
 4. the Non-performing Party exercises commercially reasonable efforts to remedy its inability to perform and provides written weekly progress reports to the other Party describing actions taken to end the Force Majeure; and
 5. when the condition or event of Force Majeure ends and the Non-performing Party is able to resume performance of its obligations under this Contract, that Party shall give the other Party written notice to that effect.
- E. Termination for Force Majeure. If Force Majeure delays or prevents a Party's performance for more than three hundred sixty-five (365) Days from the occurrence or inception of the Force Majeure, as stated in the Force Majeure Notice, and such delay or failure of performance would have otherwise constituted an Event of Default under Section 13. (Event of Default), the other Party shall have the right to terminate this Contract by written notice. Such notice shall designate the date such termination is to be effective, which date shall be no later than thirty (30) Days after such notice is deemed to be received by the Party whose performance has been delayed or prevented. In the event of termination pursuant to this Section 27.E (Termination for Force Majeure), neither Party shall be liable for any damages nor have any obligations to the other, except as provided in Section 26.L (Survival).
- F. Effect of Force Majeure. Other than as provided in Section 27.E. (Termination for Force Majeure), neither Party shall be responsible or liable for any delays or failures in its performance under this Contract as and to the extent (i) such delays or failures are substantially caused by conditions or events of Force Majeure, and (ii) the conditions of Section D. (Satisfaction of Certain Conditions) are satisfied.
- G. No Relief of Other Obligations. Except as otherwise expressly provided for in this Contract, the existence of a condition or event of Force Majeure shall not relieve the Parties of their obligations under this Contract (including, but not limited to, payment obligations) to the extent that performance of such obligations is not precluded by the condition or event of Force Majeure.
- H. No Extension of the Term. In no event will any delay or failure of performance caused by any conditions or events of Force Majeure extend this Contract beyond its stated Term.

28. COMMUNITY OUTREACH.

- A. The Parties acknowledge that, prior to the Execution Date, Subscriber Organization provided to Company a comprehensive community outreach and communications plan to work with and inform neighboring communities and stakeholders to gain their support for the Project ("Community Outreach and Engagement Plan"). Subscriber Organization agrees to work with neighboring communities and stakeholders and provide them timely information during all phases of the Project, including but not limited to the following information: Project description, Project stakeholders, community concerns and Subscriber Organization's efforts to address such concerns, Project benefits, government approvals, Project schedule, and a Community Outreach and Engagement Plan. Subscriber Organization's Community Outreach and Engagement Plan is a public document

and shall remain available to members of the community on the Subscriber Organization's website for the Term of this Contract and upon request. Subscriber Organization shall also provide Company with links to its Project website and Community Outreach and Engagement Plan.

- B. Public Meeting; Public Comment Period. The Parties also acknowledge that, prior to the Execution Date, Subscriber Organization provided reasonable advance notice and hosted a public meeting for community and neighborhood groups in and around the vicinity of the Project site that provided neighboring community, stakeholders, and the general public with: (i) a reasonable opportunity to learn about the proposed Project; (ii) an opportunity to engage in a dialogue about concerns, mitigation measures, and potential community benefits of the proposed Project; and (iii) information concerning the process and/or intent for the public's input and engagement, including advising attendees that they will have thirty (30) Days from the date of said public meeting to submit written comments to Company and/or Subscriber Organization. Subscriber Organization shall collect all public comments, and then provide Company copies of all comments received in their original, unedited form. Subscriber Organization agrees that it will post all comments with personal information redacted on its website for public review. Comments should remain on the Subscriber Organization's website for at least two years after the Commercial Operations Date.
- C. Subscriber Organization acknowledges and agrees that any written comments from the public regarding the CBRE Project it receives after the 30-day public comment period will be submitted to Company in their original, unedited form. Subscriber Organization further agrees to post these subsequent public comments, with personal information redacted, on its website for public review for at least two years after the Commercial Operations Date.
- D. The Parties acknowledge and agree that Subscriber Organization is responsible for community outreach and engagement for the Project, and that the public meeting and comment solicitation process described in this Section 28 (Community Outreach) do not represent the only community outreach and engagement activities that can or should be performed by Subscriber Organization. Without limitation to the generality of the preceding sentence, Subscriber Organization agrees to take into account the Project's potential impacts on historical and cultural resources and, at a minimum, Subscriber Organization shall describe: (i) any valued cultural, historical, or natural resources in the area in question, including the extent to which traditional and customary native Hawaiian rights are exercised in the area; (ii) the extent to which those resources – including traditional and customary native Hawaiian rights – will be affected or impaired by the Project; and (iii) the feasible action, if any, to be taken to reasonably protect native Hawaiian rights if they are found to exist. Subscriber Organization shall determine and implement such additional means as may be reasonably necessary to share information with and involve the community and neighborhood groups in and around the vicinity of the Facility during the Project planning and development process through the Term of this Contract, and shall timely inform Company of its plans and activities in this regard.
- E. Upon the Execution Date and at all times during the Term of this Contract, Subscriber Organization shall designate an individual as the "Subscriber Organization's Community Representative." The Subscriber Organization's Community Representative shall be the primary contact between the community and the Subscriber Organization and shall be available during the Term of this Contract to receive and answer questions from the community. As of the Execution Date, the Subscriber Organization's Community Representative shall be:
- Name: [name of Subscriber Organization's Community Representative]
 - Contact Information: [email address]
 - Subscriber Organization shall notify Company in writing upon designation of any new Subscriber Organization's Community Representative. R

29. **GENERATOR/EQUIPMENT CERTIFICATION.** CBRE Facilities that utilize inverter technology must be compliant with Institute of Electrical and Electronics Engineers IEEE Std 1547-2018, Underwriters Laboratories UL 1741 and the Company's Source Requirement Document Version 2.0 (though not preferred, Company will accept compliance with the Company's Source Requirement Document Version 1.1 for CBRE Projects executed

prior to or on June 30, 2021) as well as the Company’s Rule 14H and any additional requirements contained herein that apply to CBRE Facilities. CBRE Facilities that use a rotating machine must be compliant with applicable National Electrical Code, Underwriters Laboratories, and Institute of Electrical and Electronics Engineers standards and rules and orders of the Commission in effect at the time this Contract is executed. By signing below, the Applicant certifies that the installed generating equipment will meet the appropriate preceding requirement(s) and can supply documentation that confirms compliance, including a certification of the same from the Installing Electrical Contractor upon request by the Company. Notwithstanding the above, the CBRE Facility must still comply with the Performance Standards required in this Contract.

30. NOTICE AND DISCLAIMER REGARDING FUTURE TARIFF MODIFICATIONS.

- A. This Contract shall, at all times, be subject to modification by the Commission as said Commission may, from time to time, direct in the exercise of its jurisdiction. Without limiting the foregoing, Subscriber Organization expressly acknowledges the following:
1. The CBRE Tariff is subject to modification by the Commission.
 2. The CBRE Facility shall be subject to any future modifications ordered by the Commission. Subscriber Organization agrees to abide by and comply with and to pay for any costs related to such Commission-ordered modifications for the term of the Contract.
- B. **BY SIGNING BELOW, SUBSCRIBER ORGANIZATION ACKNOWLEDGES IT HAS READ, UNDERSTANDS AND AGREES TO ABIDE BY THE ABOVE SECTION 30, NOTICE AND DISCLAIMER.**

IN WITNESS WHEREOF, the Parties hereto have caused this Contract to be executed by their duly authorized representatives. This Contract is effective as of the Effective Date set forth above.

[Subscriber Organization]	[Hawai‘i Electric Light Company, Inc. Maui Electric Company, Limited], a Hawai‘i corporation
By: _____ Name: _____ Date: _____	By: _____ Name: _____ Date: _____

By: _____
Name: _____
Date: _____

MAILING ADDRESS [select as appropriate]
[Maui Electric Company, Ltd.
Attn: Renewable Energy Projects Division
P.O. Box 398

Kahului, HI 96733-6898]

[Hawai'i Electric Light Company, Inc.

Hilo:

Hawai'i Electric Light Engineering

Attn: DER Program

54 Halekaula Street

Hilo, HI 96720

Kona:

Hawai'i Electric Light Engineering

Attn: DER Program

74-5519 Kaiwi Street

Kailua Kona, HI 96740]

ATTACHMENT A

SCHEDULE OF DEFINED TERMS

For the purposes of this Contract, the following capitalized terms shall have the meanings set forth below:

"Acceptance Test": A test conducted by Subscriber Organization and witnessed by Company, within thirty (30) Days of completion of all Interconnection Facilities and in accordance with criteria and test procedures determined by Company to determine conformance with Attachment F (Facility Owned by Subscriber Organization) and in accordance with Good Engineering and Operating Practices. Exhibit F-8 (Acceptance Test General Criteria) provides general criteria to be included in the written protocol for the Acceptance Test. Successful completion of the Acceptance Test shall be a condition precedent for the performance of the Control System Acceptance Test and the Commercial Operations Date.

"Active Power Control Interface": Shall have the meaning set forth in Section 1(g) (Active Power Control Interface) of Attachment F (Facility Owned by Subscriber Organization) of this Contract.

"Account Holder": The primary account holder for each physical residence or business address on the island serviced by the Company, as identified in Company's records. An Account Holder is not a Subscriber until such Account Holder has been successfully enrolled in Facility's CBRE Program.

"Actual Output": The total quantity of electric energy (measured in kilowatt hours) produced by the CBRE Facility over a given time period and delivered to the Point of Interconnection, as measured by the Revenue Meter. "Actual Output" is the equivalent of "Net Energy."

"Allowed Capacity": Shall have the meaning set forth in Section 5(f) of Exhibit F-1 (Description of Generation and Battery Storage Facilities) to this Contract.

"Applicable Period Lump Sum Payment": For each applicable period, the total amount of Lump Sum Payment payable during such period, as such amount may be calculated and adjusted from time to time as set forth in Section 4.B (Lump Sum Payment) of this Contract and/or Section 3 (Calculation of Lump Sum Payment) of Attachment B to this Contract.

"Applicable NEP Verification Date": For the Initial OEPR, the Initial NEP Verification Date. For any Subsequent OEPR, the first Day of the calendar month following the calendar month during which there occurs the first anniversary of the event (e.g., completion of equipment replacement) which occasioned the preparation of such Subsequent OEPR.

"Battery Energy Storage System" or "BESS": The battery energy storage system as described in Attachment F (Facility Owned by Subscriber Organization) to the Contract, together with all other equipment, devices, and associated appurtenances owned, controlled, operated and managed by Subscriber Organization in connections, with or to facilitate, the storage, transmission, delivery or furnishing by Subscriber Organization to Company of the electric energy stored in the BESS.

"BESS Allocated Portion of the Lump Sum Payment": For each BESS Measurement Period and for any other applicable period, an amount equal to fifty percent (50%) of the total of the three monthly Lump Sum Payments for such period without taking into account any set-offs against such monthly Lump Sum Payments.

"BESS Annual Equivalent Availability Factor": Shall be as described in Attachment C, Section 4. (BESS Annual Equivalent Availability Factor) to this Contract.

"BESS Capacity Performance Metric": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) to this Contract.

"BESS Capacity Cure Period": Shall have the meaning set forth in Attachment C, Section 3. (BESS Capacity Test; Liquidated Damages; Termination Rights).

"BESS Capacity Ratio": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) to this Contract.

"BESS Capacity Test": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) to this Contract.

"BESS Contract Capacity": The storage capacity, in MWh, of the BESS, or ___ MWh.

"BESS EAF Performance Metric": Shall have the meaning set forth in Attachment C Section 4. (BESS Annual Equivalent Availability Factor and Liquidated Damages).

"BESS EFOF Performance Metric": Shall have the meaning set forth in Attachment C Section 4. (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages).

"BESS Measurement Period": Shall mean, in any Contract Year, the following periods of three calendar months each: (i) the period beginning on the first day of the first calendar month of such Contract Year and extending through the last day of the third calendar month of such Contract Year; (ii) the period beginning on the first day of the fourth calendar month of such Contract Year and extending through the last day of the sixth calendar month of such Contract Year; (iii) the period beginning on the first day of the seventh calendar month of such Contract Year and extending through the last day of the ninth calendar month of such Contract Year; and (iv) the period beginning on the first day of the tenth calendar month of such Contract Year and extending through the last day of the twelfth calendar month of such Contract Year.

"BESS Measurement Period Report": For each BESS Measurement Period, the report of the data necessary for calculation of the Performance Metrics for such BESS Measurement Period to be provided by Subscriber Organization to Company in the form set forth in Section 1 (Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract or such other form as the Company may approve in writing.

"Bill Credit": shall mean the dollar amount ~~credited~~ payable by means of a credit by the Company to each Subscriber on the Subscriber's retail electric service bill, which represents the Subscriber's beneficial share of the Contract Capacity by which renewable energy is produced by the CBRE Facility and exported to the Company, and offsetting Subscriber's current renewable energy usage on such service bill.

"Bill Credit Rate": shall mean the then current applicable "Credit Rate" as determined by the CBRE Tariff. The CBRE Tariff prescribes a specific Credit Rate in the event that CBRE Small Project Phase 2 Capacity (as defined in the CBRE Tariff) is not filled for any island and a competitive credit rate procurement ("CCRP") mechanism to set the Credit Rate if there are more applications for CBRE Small Project Phase 2 Capacity than is available for any island.

"Bill of Material": A list of equipment to be installed at the Facility including, but not necessarily limited to, items such as relays, breakers, and switches.

"Business Day": Any calendar day that is not a Saturday, a Sunday, or a federal or Hawai'i state holiday.

"CBRE Facility": Subscriber Organization's renewable electric energy facility that is the subject of this Contract, including the PV System, the BESS, all Subscriber Organization-Owned Interconnection Facilities and all other equipment, devices, associated appurtenances owned, controlled, operated and managed by Subscriber Organization in connection with, or to facilitate, the production, generation, storage, transmission, delivery or furnishing of electric energy by Subscriber Organization to Company and required to interconnect with the Company System.

"CBRE Framework": means the CBRE Framework (Phase 1), as amended and supplemented by the CBRE Framework (Phase 2).

"CBRE Framework (Phase 1)": means that certain "Community-Based Renewable Energy – A Program Framework" issued by the PUC and attached as Attachment A to that certain Decision and Order No. 35137, filed December 22, 2017, in Docket No. 2015-0389, portions of which are applicable to Phase 2 of the CBRE Program as specified in the CBRE Tariff.

"CBRE Framework (Phase 2)": means ~~the framework CBRE Phase 2 established by the Commission pursuant to that certain~~ Order No. 37070, ~~issued~~ April 9, 2020, in Docket No. 2015-0389. The CBRE Framework (Phase 2) provides the basis and framework for Phase 2 of the CBRE Program and is implemented by the CBRE Tariff.

"CBRE IO": means the Independent Observer contracted with the Company but answering to the PUC to carry out the responsibilities assigned to the Independent Observer under the Phase 2 CBRE Framework.

"CBRE Online Portal": is the interactive, internet website-based interface maintained by or on behalf of the Company through which the Subscriber Organization may establish qualifications, provide information and complete documents necessary for acceptance in the CBRE Program, and may enter or change the Monthly Subscription Information reflecting updated information for each Subscriber, including any changes to any Subscriber's name, account number, address, and Subscriber Allocation. For Phase One of the CBRE Program, the CBRE Online Portal will be a manually administered application form-based process managed by Company until the CBRE Online Portal is online and ready for commercial operation. The CBRE Online Portal should be completed in time for the commencement of Phase Two of the CBRE Program.

"CBRE Program": The program established under the CBRE Tariff to allow developers of renewable energy projects to provide Account Holders with an opportunity to avail themselves of the benefits of the CBRE Tariff

"CBRE Project": A community-based renewable energy project subject to the CBRE Tariff.

"CBRE Subscriber Thresholds": Each of the following is a CBRE Subscriber Threshold: (i) the requirement that Unsubscribed RDG not exceed 15% of Contract Capacity; (ii) the requirement that the Facility's CBRE Program have a minimum of four individual Subscribers; (iii) the requirement that the total Subscriber Allocations for all Residential Subscribers be not less than 40% of Contract Capacity; (iv) the requirement that, if Seller's Subscriber Organization's Response to RFP included an Enhanced Residential Threshold, the total Subscriber Allocations for all Residential Subscribers be not less than the Enhanced Residential Threshold; and (v) if Seller's Subscriber Organization's Response to RFP included an LMI Minimum Threshold, the total Subscriber Allocations for all LMI Subscribers be not less than the LMI Minimum Threshold.

"CBRE Tariff": The rules for Phase 2 of the CBRE Program approved by the PUC as Tariff Rule 29 based on the CBRE Framework (Phase 2).

"Commercial Operations": Upon satisfaction of the following conditions, the Facility shall be considered to have achieved Commercial Operations on the Day specified in Subscriber Organization's written notice described below: (i) the Acceptance Test has been passed, (ii) all generating units have passed Control System Acceptance Tests, (iii) the Transfer Date has occurred, (iv) Subscriber Organization has (1) provided to Company the Required Models (as defined in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of Attachment F (Facility Owned by Subscriber Organization)) in the form of Source Code, (2) placed the current version of the Source Code for the Required Models with the Source Code Escrow Agent as required in Section 6(b)(i)(A) (Establishment of Source Code Escrow) of Attachment F (Facility Owned by Subscriber Organization), or (3) if Subscriber Organization is unable to arrange for the placement of the appropriate Source Code into the Source Code Escrow account, placed the required funds with the Monetary Escrow Agent as required in Section 6(b)(ii)(A) (Establishment of Monetary Escrow) of Attachment F (Facility Owned by Subscriber Organization), and (v) Subscriber Organization provides Company with written notice that (aa) Subscriber Organization is ready to declare the Commercial Operations Date and (bb) the Commercial Operations Date will occur within 24 hours (i.e., the next Day).

"Commercial Operations Date" or "COD": The date on which Facility first achieves Commercial Operations.

"Commercial Operations Date Deadline": Shall have the meaning set forth in Section 10.I.1 of this Contract.

"Company": Shall have the meaning set forth in the preamble to this Contract.

"Company-Designated NEP Estimate": The estimated Net Energy Potential of the CBRE Facility as designated by Company pursuant to Section 1.C. (NEP IE Estimate and Company-Designated NEP Estimate) of Attachment D (Calculation and Adjustment of Net Energy Potential) this Contract.

"Company Dispatch": Company's right, through supervisory equipment or otherwise, to direct or control both the capacity and the energy output of the CBRE Facility from its minimum output rating to its maximum output rating

consistent with this Contract (including, without limitation, Good Engineering and Operating Practices, which dispatch shall include real power, reactive power, voltage, frequency, the determination to ~~eyele a unit off linetake generating~~ or ~~to restart a unit, the storage equipment offline or online, frequency droop-control~~ setting, the ramp rate setting, and other characteristics of such electric energy output whose parameters are normally controlled or accounted for in a utility dispatching system.

"Company-Owned Interconnection Facilities": Shall have the meaning set forth in of Attachment G (Company-Owned Interconnection Facilities).

"Company System": The electric system owned and operated by Company (to include any non-utility owned facilities) consisting of power plants, transmission and distribution lines, and related equipment for the production and delivery of electric power to the public.

"Company System Operator": The authorized representative of Company who is responsible for carrying out Company dispatch and curtailment of electric energy generation interconnected to the Company System.

"Company's Recommendations": Shall have the meaning set forth in Section 4(c) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Competitive Bidding Framework": The Framework for Competitive Bidding contained in Decision and Order No. 23121 issued by the Public Utilities Commission on December 8, 2006, and any subsequent orders providing for modifications from those set forth in Order No. 23121 issued December 8, 2006.

"Consultants List": Shall have the meaning set forth in Exhibit F-2 (Consultants List) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Contract Capacity": Shall have the meaning set forth in Attachment F - Exhibit F-1 (Description of Generation and Battery Storage Facilities) to this Contract.

"Contract Year": A twelve (12) calendar month period commencing on either: (i) the Commercial Operations Date (if the Commercial Operations Date occurs on the first Day of a calendar month) and thereafter on each anniversary of the Commercial Operations Date; or (ii) the first Day of the calendar month following the month during which the Commercial Operations Date occurs, and thereafter on each anniversary of the first Day of such month; provided, however, that, in the latter case, the initial Contract Year shall also include the Days from the Commercial Operations Date to the first Day of the succeeding calendar month.

"Control System Acceptance Test(s)" or "CSAT": A test or tests performed on the centralized and collective control systems and Active Power Control Interface of the CBRE Facility, which includes successful completion of the Control System Telemetry and Control List, in accordance with procedures set forth in Exhibit F-7 (Control System Acceptance Test Criteria) to Attachment F (Facility Owned by Subscriber Organization) of the Contract.

"Control System Telemetry and Control List": The Control System Telemetry and Control List includes, but is not limited to, all of the Facility's equipment and generation performance/quality parameters that will be monitored, alarmed and/or controlled by Company's Energy Management System (EMS) throughout the Term of this Contract.

Examples of the Control System Telemetry and Control List include:

Subscriber Organization's substation/equipment status – breaker open/closed status, equipment normal/alarm operating status, etc.

Subscriber Organization's ~~generation~~ generating [and storage] data (analog values) – number of ~~generators~~ inverters available/online, voltage, current, MW, MVAR, etc. [Storage state of charge]

~~Subscriber Organization's generation performance (status and/or analog values) – ramp rate, generator frequency, etc.~~

Active Power control interface – dispatch MW setpoint, etc.

Voltage control interface – voltage kV setpoint, etc.

~~Power factor control interface – power factor setpoint, etc.~~

"Day": A calendar day.

"Disconnection Event": Shall have the meaning set forth in Section 4(a) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Dispute": Shall have the meaning set forth in Section 17. of this Contract.

"DPR": Shall have the meaning set forth in Section 17. of this Contract.

"EMS" or "Energy Management System": The real-time, computer-based control system, or any successor thereto, used by Company to manage the supply and delivery of electric energy to its consumers. It provides the Company System Operator with an integrated set of manual and automatic functions necessary for the operation of the Company System under both normal and emergency conditions. The EMS provides the interfaces for the Company System Operator to perform real-time monitoring and control of the Company System, including but not limited to monitoring and control of the Facility for system balancing, supplemental frequency control and economic dispatch as prescribed in this Contract.

"Enhanced Residential Threshold": A specific percentage of Contract Capacity in excess of 40% committed to by Subscriber Organization in its proposal as the percentage to be represented by Subscriber Allocations for Residential Subscribers. The Enhanced Residential Threshold for this Contract is __%. [**Drafting note: If there is no Enhanced Residential Threshold enter "N/A" in the blank.**]

"Environment": Shall have the meaning set forth in Section 1(b) (iii) (G) (iii) (Malware) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Environmental Credits": Any environmental credit, offset, or other benefit allocated, assigned or otherwise awarded by any Governmental Authority, international agency, or non-governmental renewable energy certificate accounting and verification organization to Company or Subscriber Organization based in whole or in part on the fact that the CBRE Facility is a non-fossil fuel facility. Such Environmental Credits shall include, without limitation, the non-energy attributes of renewable energy including, but not limited to, any avoided emissions of pollutants to the air, soil, or water such as sulfur dioxide, nitrogen oxides, carbon monoxide, particulate matter, and hazardous air pollutants; any other pollutant that is now or may in the future be regulated under the pollution control laws of the United States; and avoided emissions of carbon dioxide and any other greenhouse gas, along with the renewable energy certificate reporting rights to these avoided emissions, but in all cases shall not mean tax credits.

"Event of Default": Shall have the meaning set forth in Section 13. (Events of Default by Subscriber Organization) of this Contract.

"Excess Energy Conditions": An operating condition on the Company System that may occur when Company has more energy available than is required to meet the load on the Company System at any point in time and the generating assets interconnected with the Company System are operating at or near their minimum levels, taking into consideration factors such as the need to maintain system reliability and stability under changing system conditions and configurations, the need for downward regulating reserves, the terms and conditions of power purchase Contracts for base-loaded firm capacity or scheduled energy, and the normal minimum loading levels of such units.

"Execution Date": The date designated as such on the first page of this Contract or, if no date is so designated, the date the Parties exchanged executed signature pages to this Contract.

"Facility's CBRE Program": The program offered by Subscriber Organization whereby Subscribers are afforded the opportunity to obtain benefits of the CBRE Tariff by acquiring a beneficial interest in the Contract Capacity by which renewable energy is produced by the Facility and exported to Company. The Facility's CBRE Program includes the entire process of marketing and sales of, or subscriptions to, the Subscriber Allocations, enrolling Subscribers,

providing Company with the information necessary to afford each Subscriber the Bill Credit to which such Subscriber is entitled, responding to Subscriber inquiries, facilitating the transfer of Subscriber interests and buying back Subscriber interests. The Facility's CBRE Program shall have a duration of 20 years commencing on the Commercial Operations Date.

"Federal Non-Refundable Tax Credit": Shall mean any U.S. federal tax credit for which the federal government is not required to refund any tax credit which exceeds the tax payments due to the federal government by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"Federal Refundable Tax Credit": Shall mean any U.S. federal tax credit for which the federal government is required to refund any tax credit which exceeds the tax payments due to the federal government by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"First Benchmark Period": The period commencing on the Commercial Operations Date and ending on the last Day of the calendar month during which an OEPR Evaluator issues the Initial OEPR. During the First Benchmark Period, the First NEP Benchmark shall be the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment as provided in Section 3.A. (Lump Sum Payment During First Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.

"First NEP Benchmark": The estimate of Net Energy Potential that is used to calculate the Lump Sum Payment during the First Benchmark Period as provided in Section 3.A. (Lump Sum Payment During First Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. The "First NEP Benchmark" shall consist of whichever of the following is applicable as of the Commercial Operation Date, as more fully provided in Section 1.C. (NEP IE Estimate and Company-Designated NEP Estimate) and Section 1.D. (NEP IE Estimate, Liquidated Damages and Subscriber Organization's Null and Void Right) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract: (i) NEP RFP Projection, (ii) NEP IE Estimate, (iii) Company-Designated NEP Estimate or (iv) such other amount as the Parties may agree in writing.

"First OEPR": Shall have the meaning set forth in Section 2.F. (Timeline and Fees) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Force Majeure": An event that satisfies the requirements of Section 27.A. (Definition of Force Majeure), Section 27.B. (Events That Could Qualify as Force Majeure) and Section 27.C. (Exclusions from Force Majeure).

"Forced Outage": A start failure or unplanned outage reported consistently with the principles in the NERC GADS REPORTING INSTRUCTIONS for SF, U1, U2 and U2 events. This may be a startup failure, a condition resulting in immediate shutdown or trip, or an outage which requires removal from the in-service state before the end of the next weekend (Sunday at 2400 or before Sunday turns into Monday). This type of outage can only occur while the resource is in service.

"Full Dispatch": A time period during which all inverters are available and there are no technical restrictions or limitations affecting generation imposed to meet Company Dispatch.

"Good Engineering and Operating Practices": The practices, methods and acts engaged in or approved by a significant portion of the electric utility industry for similarly situated U.S. facilities, considering Company's isolated island setting, that at a particular time, in the exercise of reasonable judgment in light of the facts known or that reasonably should be known at the time a decision is made, would be expected to accomplish the desired result in a manner consistent with law, regulation, reliability for an island system, safety, environmental protection, economy and expedition. With respect to the CBRE Facility, Good Engineering and Operating Practices include, but are not limited to, taking reasonable steps to ensure that:

Adequate materials, resources and supplies, are available to meet the CBRE Facility's needs under normal conditions and reasonably foreseeable abnormal conditions.

Sufficient operating personnel are available and are adequately experienced and trained to operate the CBRE Facility properly, efficiently and within manufacturer's guidelines and specifications and are capable of responding to emergency conditions.

Preventive, routine and non-routine maintenance and repairs are performed on a basis that ensures reliable long-term and safe operation, and are performed by knowledgeable, trained and experienced personnel utilizing proper equipment, tools, and procedures.

Appropriate monitoring and testing is done to ensure equipment is functioning as designed and to provide assurance that equipment will function properly under both normal and reasonably foreseeable abnormal conditions.

Equipment is operated in a manner safe to workers, the general public and the environment and in accordance with equipment manufacturer's specifications, including, without limitation, defined limitations such as temperature, current, frequency, polarity, synchronization, control system limits, etc.

"Governmental Approvals": All permits, licenses, approvals, certificates, entitlements and other authorizations issued by Governmental Authorities, as well as any agreements with Governmental Authorities, required for the construction, ownership, operation and maintenance of the CBRE Facility and the Company-Owned Interconnection Facilities, and all amendments, modifications, supplements, general conditions and addenda thereto.

"Governmental Authority": Any federal, state, local or municipal governmental body; any governmental, quasi-governmental, regulatory or administrative agency, commission, body or other authority exercising or entitled to exercise any administrative, executive, judicial, legislative, policy, regulatory or taxing authority or power; or any court or governmental tribunal.

"GPR": Shall have the meaning set forth in Section 3.C. (Assurance of Capability of CBRE Facility to Deliver Net Energy Potential and Availability of BESS) of this Contract.

"GPR Performance Metric": Shall be as determined under Attachment C, Section 1.B. (Determination of GPR Performance Metric) of this Contract.

"Hawai'i Investment Tax Credit": Shall mean a credit against Hawai'i source income for which Subscriber Organization is eligible on the Commercial Operations Date or thereafter because of investment in renewable energy technologies incorporated into the CBRE Facility.

"Hawai'i Non-Refundable Tax Credit": Shall mean any Hawai'i Investment Tax Credit for which the State of Hawai'i is not required to refund any tax credit which exceeds the tax payments due to the State of Hawai'i by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"Hawai'i Production Tax Credit": Shall mean a credit against Hawai'i source income for which Subscriber Organization is eligible on the Commercial Operations Date or thereafter because of the energy produced by the CBRE Facility.

"Hawai'i Refundable Tax Credit": Shall mean any Hawai'i Investment Tax Credit for which the State of Hawai'i is required to refund any tax credit which exceeds the tax payments due to the State of Hawai'i by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"Hawai'i Renewable Energy Tax Credit": The Hawai'i Investment Tax Credit and the Hawai'i Production Tax Credit.

"HERA": The Hawai'i Electricity Reliability Administrator.

"HERA Law": Act 166 (Haw. Leg. 2012), which was passed by the 27th Hawai'i Legislature in the form of S.B. No. 2787, S.D. 2, H.D.2, C.D.1 on May 2, 2012 and signed by the Governor on June 27, 2012. The effective date for the law is July 1, 2012. The HERA Law authorizes (i) the PUC to develop, adopt, and enforce reliability standards and interconnection requirements, (ii) the PUC to contract for the performance of related duties with a party that will serve

as the HERA, and (iii) the collection of a Hawai'i electricity reliability surcharge to be collected by Hawai'i's electric utilities and used by the HERA. Reliability standards and interconnection requirements adopted by the PUC pursuant to the HERA Law will apply to any electric utility and any user, owner, or operator of the Hawai'i electric system. The PUC also is provided with the authority to monitor and compel the production of data, files, maps, reports, or any other information concerning any electric utility, any user, owner or operator of the Hawai'i electric system, or other person, business, or entity, considered by the eCommission to be necessary for exercising jurisdiction over interconnection to the Hawai'i electric system, or for administering the process for interconnection to the Hawai'i electric system.

"House Power": shall mean the electricity needed to assist in the operation of the CBRE Facility including system performance monitoring and associated communications, except for energy directly required for the local control and safe operation of the PV System and BESS. It also means other electricity used by the CBRE Facility, such as for perimeter lighting, a visitor's center or any other structures or facilities at the CBRE Facility site.

"Independent AF Evaluator": A person empowered, pursuant to Section 2(e) (Appointment of Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to resolve disagreements due to failure of the Parties to resolve a Monthly Report Disagreement.

"Initial NEP OEPR Estimate": The NEP OEPR Estimate set forth in or derived from the Initial OEPR, as more fully set forth in Section 2.E (Terms of Engagement) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Initial NEP Verification Date": The first Day of the calendar month following the fifteenth (15th) calendar month after the Commercial Operations Date.

"Initial OEPR": The OEPR to be prepared pursuant in Section 1.E. (Initial OEPR) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Interconnection Facilities": The equipment and devices required to permit the CBRE Facility to operate in parallel with, and deliver electric energy to, the Company System and provide reliable and safe operation of, and power quality on, the Company System (in accordance with applicable provisions of the PUC's General Order No. 7, Company tariffs, operational practices, interconnection requirements studies, and planning criteria), such as, but not limited to, transmission and distribution lines, transformers, switches, and circuit breakers.

"Interconnection Requirements Study" or "IRS": A study consisting of a system impact study and a Facility study, performed in accordance with the terms of the IRS Letter Agreement to determine, among other things, (a) the system requirements and equipment requirements to interconnect the CBRE Facility with the Company System, (b) the Performance Standards for the CBRE Facility, and (c) an estimate of interconnection costs and project schedule for interconnection of the CBRE Facility.

"IRS Amendment": Shall have the meaning ascribed to such term in Section 3.C.1 (Interconnection Requirements Study).

"IRS Amendment Deadline": The 75th Day following the date the completed IRS is provided to Subscriber Organization, or such later date as Company and Subscriber Organization may agree to by written agreement.

"IRS Letter Agreement or IRS Letter Agreements": The system impact study and Facility study letter agreements (which may combined into one letter agreement) and any written, signed amendments thereto, between Company and Subscriber Organization that collectively describe the scope, schedule, and payment arrangements for the Interconnection Requirements Study.

"IRS Termination Deadline": The 30th Day following the date the completed IRS is provided to Subscriber Organization, or such later date as Company and Subscriber Organization may agree to by a written agreement.

"Interface Block Diagram": The visual representation of the signals between Subscriber Organization and Company, including but not limited to, Telemetry and Control points, digital fault recorder settings, telecommunications and protection signals.

"kV": Kilovolt.

"kW": Kilowatt. Unless expressly provided otherwise, all kW values stated in this Contract are alternating current values and not direct current values.

"kWh": Kilowatt-hour.

"Land Rights": All easements, rights of way, licenses, leases, surface use agreements and other interests or rights in real estate.

"Laws": All federal, state and local laws, rules, regulations, orders, ordinances, permit conditions and other governmental actions.

"LD Assessment Date": For the last month of each LD Period, the Day following the expiration of the 10-Business Day period provided for Company to submit a Notice of Disagreement pursuant to Section 2(a) (Notice of Disagreement With Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"LDT": Shall have the meaning set forth in Attachment C, Section 6.A. (RTE Test and Liquidated Damages).

"LMI Minimum Threshold": A specific percentage of Contract Capacity committed to by Subscriber Organization in its proposal as the percentage to be represented by Subscriber Allocations for LMI Subscribers. The Minimum LMI Threshold for this Contract is __%. **[Drafting note: The percentage shall be taken from Subscriber Organization's proposal if that proposal included a LMI Minimum Threshold. If there is no LMI Minimum Threshold enter "N/A" in the blank. For dedicated LMI projects, the LMI Minimum Threshold is 100%.]**

"LMI Subscriber": A Subscriber who satisfies the LMI requirements set forth in the CBRE Tariff.

"LD Period": A rolling period of twelve (12) calendar months each. At the end of each calendar month, the LD Period rolls forward to include the next calendar month. The initial "LD Period" shall consist of the 12 full calendar months of the initial Contract Year.

"Losses": Any and all direct, indirect or consequential damages, fines, penalties, deficiencies, losses, liabilities (including settlements and judgments), costs, expenses (including reasonable attorneys' fees and court costs) and disbursements.

"Lowest BESS Capacity Bandwidth": Shall have the meaning set forth in Attachment C Section 3. (BESS Capacity Test; Liquidated Damages; Termination Rights).

"Lump Sum Payment": The monthly lump sum as provided in Section 2. (Lump Sum Payment for Purchase of Dispatchability) of Attachment B to this Contract (Company Payments for Energy, Dispatchability and Availability of BESS).

"Malware": means computer software, code or instructions that: (a) intentionally, and with malice intent by a third party, adversely affect the operation, security or integrity of a computing, telecommunications or other digital operating or processing system or environment, including without limitation, other programs, data, databases, computer libraries and computer and communications equipment, by altering, destroying, disrupting or inhibiting such operation, security or integrity; (b) without functional purpose, self-replicate without manual intervention; (c) purport to perform a useful function but which actually performs either a destructive or harmful function, or perform no useful function other than utilize substantial computer, telecommunications or memory resources with the intent of causing harm; or (d) without authorization collect and/or transmit to third parties any information or data; including such software, code or instructions commonly known as viruses, Trojans, logic bombs, worms, adware and spyware.

"Management Meeting": Shall have the meaning set forth in Section 17.B. (Dispute Resolution).

"Maximum Rated Output": Net maximum output of the BESS in MW, which shall not exceed the Allowed Capacity.

"Measured Performance Ratio" or "MPR": Shall have the meaning set forth in Attachment C, Section 2.A. (Calculation of Measured Performance Ratio) of this Contract.

"MMS": Meteorological monitoring station.

"Monthly Progress Report": Shall have the meaning set forth in Attachment E (Monthly Progress Report).

"Monthly Report": The report of the data (for the calendar month and the LD Period, the MPR Assessment Period and the BESS Measurement Period ending with such calendar month) necessary for the calculation of the Performance Metrics to be provided by Subscriber Organization to Company as set forth in Section 1. (Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract. Without limitation to the generality of the preceding sentence, references to the Monthly Report for a month that constitutes the last month of a BESS Measurement Period shall be deemed to include the BESS Measurement Period Report for such BESS Measurement Period.

"Monthly Report Disagreement": Any disagreement arising out of the same Monthly Report.

"Monthly Subscription Information": shall mean the information stored within the CBRE Online Portal, as timely entered or changed by the Subscriber Organization via the CBRE Online Portal, setting forth the name, account number and service address each Subscriber holding subscriptions in the CBRE Facility, and the Subscriber Allocation applicable to each such Subscriber's subscription, reflecting each Subscriber's allocable portion of renewable energy produced by the CBRE Facility during a particular Production Month.

"Most Recent Prior NEP Benchmark": In the event a Subsequent OEPR is prepared for an OEPR Period of Record ending on or after the commencement of the fourth (4th) Contract Year, the "Most Recent Prior NEP Benchmark" shall be (i) for the first such Subsequent OEPR, the Second NEP Benchmark that was used to calculate the Lump Sum Payment for the last month of the Second Benchmark Period pursuant to Section 3.B. of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract and (ii) for all Subsequent OEPRs prepared after the aforementioned first Subsequent OEPR, the NEP OEPR Estimate obtained from the immediately preceding Subsequent OEPR.

"MPR": Shall have the meaning set forth in Attachment C Section 2. of this Contract.

"MPR Assessment Period": Shall mean, for purposes of demonstrating a Measured Performance Ratio, a rolling period of twelve (12) calendar months each. At the end of each calendar month, the MPR Assessment Period rolls forward to include the next calendar month. The initial "MPR Assessment Period" shall consist of the 12 full calendar months of the initial contract year.

"MPR Assessment Period Lump Sum Payment": For each MPR Assessment Period, the monthly Lump Sum Payment for the twelfth month of such MPR Assessment Period after deducting the amounts (if any) payable as liquidated damages under Attachment C Section 1. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages) for the same calendar month in question.

"MPR Test": Shall have the meaning set forth in Attachment C, Section 2.B. (MPR Test) of this Contract.

"MW": Megawatt. Unless expressly provided otherwise, all MW values stated in this Contract are alternating current values and not direct current values.

"MWh": Megawatt-hour.

"NEP IE Estimate": The estimated Net Energy Potential of the CBRE Facility to which the IE Energy Assessment Report assigns a P-Value of 95 for a ten-year period.

"NEP OEPR Estimate": For each OEPR, the estimated Net Energy Potential of the CBRE Facility to which such OEPR assigns a P-Value of 95 for a ten-year period.

"NEP RFP Projection": The Net Energy Potential of the CBRE Facility to which the Subscriber Organization in Subscriber Organization's RFP Proposal assigns a P-Value of 95 for a ten-year period.

"NERC GADS": Shall have the meaning set forth in Section 4.C, (Assurance of Capability of CBRE Facility to Deliver Net Energy Potential and Availability of BESS) of this Contract.

"Net Amount": Shall mean, with respect to any Hawai'i Renewable Tax Credit, the amount remaining after deducting any documented and reasonable financial, legal, administrative and other costs and expenses of applying for, pursuing, monetizing and receiving the applicable Hawai'i Renewable Tax Credit, ~~payments by (or reserves established for the payment by) Subscriber Organization and/or its investors on account of federal or state income taxes (at the highest applicable marginal corporate rate) payable with respect to receipt of such Hawai'i Renewable Tax Credit~~, and all payments to or reserves required by Subscriber Organization's lenders or other financing parties in connection with the application for or receipt of such Hawai'i Renewable Tax Credit.

"Net Energy": The total quantity of electric energy (measured in kilowatt hours) produced by the CBRE Facility over a given time period and delivered to the Point of Interconnection, as measured by the Revenue Meter. "Net Energy" the equivalent of "Actual Output."

"Net Energy Potential": The estimated single number with a P-Value of 95 for the annual Net Energy that could be produced by the CBRE Facility based on the estimated long-term monthly and annual total of such production over a ten-year period. The Net Energy Potential is subject to adjustment as provided in Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract, but in no circumstances shall the Net Energy Potential exceed the NEP RFP Projection.

"Notice of Disagreement": Shall have the meaning set forth in Section 2(a) (Notice of Disagreement with Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"OEPR": An Operational Energy Production Report, including the Initial OEPR and each Subsequent OEPR.

"OEPR Conference": Shall have the meaning set forth in Section 2.G, (Review of the First OEPR Evaluator Report) of this Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"OEPR Consultants List": The engineering firms listed in Section 2.J, (Acceptable Persons and Entities) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract, as such list may be expanded or contracted by the Parties as provided in Section 2.B, (Eligibility for Appointment as OEPR Evaluator) of said Attachment D (Calculation and Adjustment of Net Energy Potential) or Section 2.(f) (Eligibility for Appointment as Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"OEPR Evaluator": Shall have the meaning set forth in Section 4(a) (Selection of OEPR Evaluator) of Attachment D (Calculation and Adjustment of Net Energy Potential) of this Contract.

"OEPR Period of Record": For each OEPR, the twelve-month period preceding the Applicable NEP Verification Date for such OEPR.

"Parties": Subscriber Organization and Company, collectively.

"Party": Each of Subscriber Organization or Company.

"Performance Metrics": Each of the applicable PV System Equivalent Availability Factor Performance Metric, the GPR Performance Metric, the BESS Capacity Performance Metric, the BESS EAF Performance Metric, the BESS EFOF Performance Metric, and the RTE Performance Metric.

"Performance Metrics LDs": Shall have the meaning set forth in Attachment C Section 8, (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damage).

"Performance Standards": The various performance standards for the operation of the Facility and the delivery of electric energy from the Facility to Company specified in Section 3. (Performance Standards) of Attachment F (Facility Owned by Subscriber Organization), as such standards may be revised from time to time pursuant to this Contract.

"Point of Interconnection": The point of delivery of electric energy and/or capacity supplied by Subscriber Organization to Company, where the CBRE Facility owned by the Subscriber Organization interconnects with the Company System. The Subscriber Organization shall own and maintain the facilities from the CBRE Facility to the Point of Interconnection, excluding any Company-Owned Interconnection Facilities located on the Site. The Company shall own and maintain the facilities from the Point of Interconnection to the Company's system. The Point of Interconnection will be identified in the IRS and set forth on the Single-Line Drawing and Interface Block Diagram in Attachment F, Exhibit F-5 (Single-Line Drawing and Interface Block Diagram).

"Prime Rate" shall mean the current "U.S. Prime Rate" of interest, as published from time to time by The Wall Street Journal in the "Money Rates" section of its Western Edition Newspaper. The Prime Rate shall change without notice with each change in the U.S. Prime Rate reported by The Wall Street Journal, as of the date such change is reported.

"Project": The Facility as described in Attachment F (Facility Owned by Subscriber Organization).

"Project Documents": This Contract, any ground lease or other agreement or instrument in respect of the Site and/or the Land Rights, all construction contracts to which Subscriber Organization is or becomes a party thereto, operation and maintenance agreements, and all other agreements, documents and instruments to which Subscriber Organization is or becomes a party thereto in respect of the Facility, other than the Financing Documents, as the same may be modified or amended from time to time in accordance with the terms thereof.

"PUC" or "Commission": Shall have the meaning set forth in the Recitals.

"PUC's Standards": Standards for Small Power Production and Cogeneration in the State of Hawai'i, issued by the Public Utilities Commission of the State of Hawai'i, Chapter 74 of Title 6, Hawai'i Administrative Rules, currently in effect and as may be amended from time to time.

"PV System": The photovoltaic solar electric generating project as more particularly described in Exhibit F-1 to Attachment F to the Contract (Description of Generation and Battery Storage Facilities).

"PV System Equivalent Availability Factor Performance Metric": Shall have the meaning set forth in Attachment C, (Required Performance Metrics; Liquidated Damages).

"Renewable Portfolio Standards" or "RPS": The Hawai'i law that mandates that Company and its subsidiaries generate or purchase certain amounts of their net electricity sales over time from qualified renewable resources. The RPS requirements in Hawai'i are currently codified as Hawai'i Revised Statutes (HRS) 269-91 through 269-95.

"Renewable Resource Baseline": The estimated renewable resource potential of the Site for a typical meteorological year. For avoidance of doubt, the purpose of this term is to provide a short-hand characterization of the nature of the renewable resource risk assumed by the Subscriber Organization under this Contract in making its Site selection.

"Renewable Resource Variability": The variations, above and below the Renewable Resource Baseline, of the renewable resource actually available at the Site on a moment-to-moment basis. For avoidance of doubt, the purpose of this term is to provide a short-hand characterization of the nature of the renewable resource risk assumed by the Company under this Contract in agreeing to make fixed payments in an amount calculated on the basis of the CBRE Facility's capability to deliver the Net Energy Potential regardless of whether or not sufficient renewable resource is in fact available at any particular moment.

"Required Model" or "Required Models": Shall have the meaning set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of Attachment F (Facility Owned by Subscriber Organization) of this Contract.

"Residential Subscriber": A subscriber served by Company under any of the following Company rate schedules: Schedule R, TOU-R, TOU-RI, TOU-EV or any other residential option.

"Revenue Meter": The revenue meter packaging, revenue metering PTs and CTs, and secondary wiring, which will record the renewable energy produced by the CBRE Facility and dispatched to the Company at the Point of Interconnection.

"RFP": Company's Request for Proposals issued on [_____], 202_.

"RFP Proposal": The documents and submissions comprising Subscriber Organization's proposal selected in response to the RFP.

"RTE Performance Metric": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) to this Contract- and as referenced in Attachment C, Section 6. (Bess Round Trip Efficiency Test; Liquidated Damages; Termination Rights) to this Contract.

"RTE Ratio": Shall have the meaning set forth in in Section 1 (BESS Tests) of Attachment H to this Contract.

"SCADA" or "Supervisory Control and Data Acquisition": The Company system that provides remote control and monitoring of Company's transmission and sub-transmission systems and enables Company to perform real-time control of equipment in the field and to monitor the conditions and status of the Company System.

"Second Benchmark Period": The period commencing on the first Day of the calendar month following the month during which an OEPR Evaluator issues the Initial OEPR and ending with the expiration of the third (3rd) Contract Year. For avoidance of doubt, the effect of the foregoing definition is that the Second Benchmark Period will follow immediately upon the expiration of the First Benchmark Period.

"Second NEP Benchmark": For each calendar month during the Second Benchmark Period, the estimate of Net Energy Potential to be used during such calendar month to calculate the Lump Sum Payment pursuant to Section 3. (Calculation of Lump Sum Payment) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. For avoidance of doubt, the Second NEP Benchmark may vary during the Second Benchmark Period as and to the extent provided in Section 3.B. of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.

"Second OEPR": Shall have the meaning set forth in Section 2.G. (Review of the First OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Second OEPR Evaluator": Shall have the meaning set forth in Section 2.G. (Review of the First OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Site": The parcel of real property on which the CBRE Facility will be constructed and located, together with any Land Rights reasonably necessary for the construction, ownership, operation and maintenance of the CBRE Facility. The Site is identified in Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Source Code": Shall mean the human readable source code of the Required Models which: (i) will be narrated documentation related to the compilation, linking, packaging and platform requirements and any other materials or software sufficient to enable a reasonably skilled programmer to build, modify and use the code within a commercially reasonable period of time for the purposes of a Source Code Authorized Use; and (ii) can reasonably be compiled by a computer for execution.

"Source Code Authorized Use": Shall have the meaning set forth in Section 6(b) (i) (E) (Authorized Use) of Attachment F (Facility Owned by Subscriber Organization) of this Contract.

"Source Code Escrow": Shall mean the escrow established with the Source Code Escrow Agent under the terms of the Source Code Escrow Agreement under which Source Code shall be confidentially deposited by a Source Code Owner for safekeeping and, upon the satisfaction of certain conditions, release to the Company.

"Source Code Escrow Agent": Shall mean Iron Mountain Intellectual Property Management, Inc. or such other similar escrow agent approved by Company.

"Source Code Escrow Agreement": Shall mean a multi-party escrow agreement between Company, Source Code Escrow Agent and any and all Source Code Owners depositing Source Code into the Source Code Escrow which, among other matters, names Company as beneficiary thereunder, and is otherwise acceptable in form and substance to Company.

"Source Code Owner": Shall mean the developer and/or owner of the Required Models utilizing Source Code authorized to deposit the Source Code with the Source Code Escrow Agent upon the terms of the Source Code Escrow Agreement.

"SOX 404": Shall have the meaning set forth in Section 8.F. (Financial Compliance) of the Contract.

"State of Charge": Energy in the BESS stated as a percentage of BESS Contract Capacity.

"Submission Notice": Shall have the meaning set forth in Section 2(e) (Appointment of Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"Study": Shall have the meaning set forth in Section 4(e) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Submission Notice": Shall have the meaning set forth in Section 2(e) (Appointment of Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"Subscriber" means a retail customer of the Company who owns one or more subscriptions of a CBRE Facility interconnected with the Company.

"Subscriber Agency Agreement and Consent Form" means the consent agreement between Subscriber Organization and Subscriber that authorizes disclosure of certain ~~Account Information~~account information and ~~Energy Usage Data~~energy usage data, the form of which is included in the CBRE Tariff.

"Subscriber Agreement" means the written Agreement between Subscriber Organization and its Subscribers required to contain standard information and provisions to ensure transparency and proper consumer protection in accordance with the CBRE Tariff and applicable law.

"Subscriber Allocation" shall mean, for each Subscriber, such Subscriber's percentage interest in the total nameplate capacity of the PV System, reflecting each Subscriber's allocable portion of renewable energy available for dispatch by the CBRE Facility in a particular calendar month.

"Subscriber's Confidential Account Information" consists of the Subscriber's name, account number, service address, telephone number, email address, web site URL, information on Subscriber participation in other distributed generation serving the premises of the Subscriber, and Subscriber specific Bill Credit(s).

"Subscriber Organization": Shall have the meaning set forth in the preamble to this Contract.

"Subscriber Organization Affiliate": Shall have the meaning set forth in Section 6(b) (ii) (A) (Establishment of Monetary Escrow) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Subscriber Organization-Attributable Non-Generation": Time periods during which the inverter in question (or the CBRE Facility as a whole) is not dispatched or is derated or shutdown (or the CBRE Facility is disconnected) because of any of the following:

- (i) The CBRE Facility's failure to comply with any of the Performance Standards, Good Engineering and Operating Practices, Governmental Approvals, applicable Laws or Subscriber Organization's other obligations under this Contract;

- (ii) Subscriber Organization-Attributable System Conditions;
- (iii) Conditions at or on either side of the Point of Interconnection arising from the acts or omissions of Subscriber Organization or any of its affiliates, employees, agents, contractors, vendors, materialmen, independent contractors or suppliers of Subscriber Organization, acting in such capacity for the benefit of Subscriber Organization ("Subscriber Organization Representatives"), unless such acts or omissions are themselves excused by reasons of Force Majeure pursuant to Section 27. (Force Majeure) of the Contract;
- (iv) A disconnection initiated by the Company pursuant to Section 12. (Personnel and System Safety) of this Contract that is caused by Subscriber Organization or any Subscriber Organization Representatives;
- (v) The Company has reasonably decided that it is inadvisable for such ~~WTG, generating equipment, inverter, or BESS~~, (or the CBRE Facility as a whole) to continue normal operations without a further Control System Acceptance Test as provided in Attachment F to the Contract;
- (vi) The CBRE Facility is deemed to be in Subscriber Organization-Attributable Non-Generation status under any of the following sections of Attachment F: Section 1(g) (vi), Section 1(j) (Demonstration of Facility) or Section 4(e);
- (vii) The CBRE Facility is shutdown at the direction of Company, and such shutdown is caused by Subscriber Organization or any Subscriber Organization Representatives or the lack of reliable real time data; and
- (viii) The CBRE Facility fails to comply with Company Dispatch or other outage or duration as provided in Section 5.C. (Company Rights of Dispatch)

Each time period of Subscriber Organization-Attributable Non-Generation shall constitute an Outage or Deration, as applicable.

"Subscriber Organization-Attributable System Conditions": Conditions on the Company System:

- (i) that result from either (a) the CBRE Facility's generation and delivery of electric power to the Company System or (b) any condition arising from the acts or omissions of Subscriber Organization or any Subscriber Organization Representative, unless such acts or omissions are themselves excused by reasons of Force Majeure pursuant to Section 27. of the Contract; and
- (ii) caused by or attributable to the CBRE Facility or Subscriber Organization or any Subscriber Organization Representatives that Company reasonably determines to either (a) be inconsistent with Good Engineering and Operating Practices on the Company System or (b) jeopardize the safety, reliability or stability of the Company System.

For avoidance of doubt, the Company's inability to dispatch the CBRE Facility due to the existence of Excess Energy Conditions on the Company System shall not constitute Subscriber Organization-Attributable System Conditions.

"Subscriber Organization-Owned Interconnection Facilities": The Interconnection Facilities constructed and owned by Subscriber Organization.

"Subscriber's Confidential Account Information" consists of the Subscriber's name, account number, service address, telephone number, email address, web site URL, information on Subscriber participation in other distributed generation serving the premises of the Subscriber, and Subscriber specific Bill Credit(s).

"Subscriber's Usage Data" refers to data collected from the utility Subscriber meters that reflects the quantity, quality, or timing of electric usage or renewable energy production attributable to the Subscriber for the service address and account number identified for participation in the CBRE Facility.

"Subsequent NEP OEPR Estimate": For each Subsequent OEPR, the NEP OEPR Estimate derived from such Subsequent OEPR.

"Subsequent OEPR": Any OEPR prepared pursuant to Section 1.F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Subsequent NEP OEPR Estimate": For each Subsequent OEPR, the NEP OEPR Estimate derived from such Subsequent OEPR.

"Subsequent OEPR": Any OEPR prepared pursuant to Section 1.F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Substantial Progress": means that on or before the last Day of the 18-month period (including day-for-day extensions) to achieve the Commercial Operations Date, the Subscriber Organization has achieved all of the following: (1) installed one-hundred percent (100%) of the PV System foundation (including pier, helical screw, ballasts, or similar) to enable mounting of the nameplate capacity as collectively set forth in Attachment F to this Contract; (2) built, or otherwise has in place, a permanent drivable (road) surface on the parcel or parcels of land associated with the CBRE Facility so that (i) Company on a 24 hour a day, seven days a week, basis can access its equipment, including but not limited to lines, poles, transformers, billing meters, underground facilities and other facilities, but excluding production meters; and (ii) the drivable road surface is reasonably sufficient to support operation and maintenance vehicles; and (3) built, or otherwise has in place, a permanent fence surrounding the entirety of the CBRE Facility location.

"Telemetry and Control": The interface between Company's EMS and the physical equipment at the Facility.

"Term": means the term of this Contract and shall begin when this Contract is signed by the Parties and end twenty (20) years after the Commercial Operations Date unless otherwise provided for in this Contract.

"Termination Damages": Liquidated damages calculated in accordance with Section 15. (Damages in the Event of Termination by Company) of this Contract.

"Third OEPR": Shall have the meaning set forth in Section 2.H. (Review of the Second OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Third OEPR Evaluator": Shall have the meaning set forth in Section 2.H. (Review of the Second OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Third Party": Any person or entity other than Company or Subscriber Organization, and includes, but is not limited to, any subsidiary or affiliate of Subscriber Organization.

"Tier 1 Bandwidth": The Tier 1 bandwidth set forth in Attachment C, Section 2. C. (GPR Performance Metric and Liquidated Damages) of this Contract.

"Tier 2 Bandwidth": The Tier 2 bandwidth set forth in Attachment C, Section 2. C. (GPR Performance Metric and Liquidated Damages) of this Contract.

"Total Estimated Interconnection Costs": Shall have the meaning set forth in Section 11.E.3 of this Contract and as further described in Attachment G (Company-Owned Interconnection Facilities).

"Transfer Date": The date, prior to the Commercial Operations Date, upon which Subscriber Organization transfer to Company all right, title and interest in and to Company-Owned Interconnection Facilities to the extent, if any, that such facilities were constructed by Subscriber Organization and/or its contractors.

"Unit Price": \$ ___ per ___ MWh of Net Energy Potential annually. [TO BE CALCULATED FROM RESPONSE TO RFP.]

"Unsubscribed RDG": That portion of the Contract Capacity during a particular calendar month that is not associated with any Subscriber and is therefore not included in any Subscriber Allocation for such month. ~~The Unsubscribed RDG for a particular calendar month is the balance of the Contract Capacity remaining~~The Unsubscribed RDG for a particular calendar month is the balance of the Contract Capacity remaining after subtracting the Contract Capacity represented by the total of the Subscriber Allocations for such month. For purposes of allocating to Subscriber Organization a portion of the monthly Lump Sum Payment for a particular month: (i) the Unsubscribed RDG for such month is associated with the Subscriber Organization; and (ii) the portion of the monthly Lump Sum Payment for such month that is payable to Subscriber Organization for such Unsubscribed RDG is the balance of such monthly Lump Sum Payment remaining after subtracting that portion of the monthly Lump Sum Payment that is payable in the form of Bill Credits or any payment reduction attributable to Subscriber Organization's failure to meet any of the CBRE Subscriber Thresholds.

⋮

--END--

ATTACHMENT B

COMPANY PAYMENTS FOR ENERGY, DISPATCHABILITY AND AVAILABILITY OF BESS

1. PRICE FOR PURCHASE OF ELECTRIC ENERGY. Commencing on the Commercial Operations Date, Company shall pay Subscriber Organization for electric energy produced by the Facility and delivered to the Point of Interconnection in response to Company Dispatch in accordance with this Contract at the rate of \$0.00/MWh. Company shall also not pay for electric energy delivered to the Point of Interconnection from the BESS.

2. LUMP SUM PAYMENT. Commencing on the Commercial Operations Date, Company shall pay for (i) the Actual Output produced by the Facility and delivered to the Point of Interconnection in response to Company Dispatch of the Facility; (ii) the availability of the Facility's Net Energy Potential for Company Dispatch in accordance with this Contract, and (iii) the ~~availability of the BESS Services~~, a monthly Lump Sum Payment as calculated and adjusted as set forth in Section 3, (Calculation of Lump Sum Payment), below. The monthly Lump Sum Payment shall be calculated and adjusted to reflect changes in the estimate of the Facility's Net Energy Potential as such estimate is revised from time to time as more fully set forth in Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

3. CALCULATION OF LUMP SUM PAYMENT. The monthly Lump Sum Payment shall be calculated and adjusted as follows:

A. Lump Sum Payment ~~d~~During First Benchmark Period. During the First Benchmark Period, the monthly Lump Sum Payment shall be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the First NEP Benchmark.

B. Lump Sum Payment ~~d~~During Second Benchmark Period.

(a) One purpose of the Second Benchmark Period is to provide the Subscriber Organization, in the event that the Initial NEP OEPR Estimate is less than NEP RFP Projection, with a limited period during which Subscriber Organization will have an opportunity, by having a Subsequent OEPR prepared pursuant to Section 1.F.2, (Voluntary Subsequent OEPR) of Attachment D (Calculation Adjustment of Net Energy Potential) to this Contract, to obtain an adjustment to the NEP OEPR Estimate used to calculate the Lump Sum Payment, subject to (i) the cap on any upward adjustment imposed by the limitation that the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment shall not exceed the NEP RFP Projection and (ii) the risk that any Subsequent OEPR might result in a downward adjustment to the NEP OEPR Estimate used to calculate the Lump Sum Payment. Accordingly, for each calendar month during the Second Benchmark Period, the monthly Lump Sum Payment shall be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the lesser of (w) the NEP RFP Projection or (x) the NEP OEPR Estimate of the OEPR that is most recent as of the first Day of such calendar month. For avoidance of doubt:

a. On the first Day of the Second Benchmark Period, the most recent OEPR will be the Initial OEPR;

b. If no Subsequent OEPR is issued under Section 1. F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract for an OEPR Period of Record ending prior to the end of the third (3rd) Contract Year, the "most recent OEPR" during the entirety of the Second Benchmark Period will be the Initial OEPR;

c. If any Subsequent OEPR is prepared for an OEPR Period of Record ending prior to the commencement of the fourth (4th) Contract Year, the monthly Lump Sum Payment shall, for the period commencing on the first Day of the calendar month following the month during which an OEPR Evaluator issues such Subsequent OEPR, be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the lesser of (w) the NEP OEPR Estimate obtained from such Subsequent OEPR or (x) the NEP RFP Projection. The monthly Lump Sum

Payment calculated as aforesaid shall remain in effect through the first to occur of (y) the end of the Term or (z) the end of the calendar month during which an OEPR Evaluator issues the next Subsequent OEPR (if any) that is required or permitted under Section 2. (Preparation of OEPR) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

C. Lump Sum Payment Following Second Benchmark Period.

(a) As of the first Day of the fourth (4th) Contract Year, the estimate of Net Energy Potential that was used to calculate the Lump Sum Payment for the last calendar month of the Second Benchmark Period shall continue in effect as the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment until the end of the calendar month during which an OEPR Evaluator issues the first Subsequent OEPR for an OEPR Period of Record ending on or after the commencement of the fourth (4th) Contract Year and, effective at the end of such calendar month, the Second NEP Benchmark that was in effect immediately prior to the issuance of such Subsequent OEPR shall constitute the "Most Recent Prior NEP Benchmark" under clause (i) of the definition of that term set forth in this Contract. For avoidance of doubt, if no Subsequent OEPR is issued for an OEPR Period of Record ending on or after the commencement of the fourth (4th) Contract Year, the Second NEP Benchmark that was used to calculate the Lump Sum Payment for the last calendar month of the Second Benchmark Period shall continue in effect for the balance of the Term as the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment.

(b) In order to facilitate planning for the Company System, no increase in Net Energy Potential (and hence in the monthly Lump Sum Payment) shall be permitted under this Contract as a consequence of any Subsequent OEPR that is prepared for an OEPR Period of Record ending on or after the expiration of the Second Benchmark Period. Accordingly, if any such Subsequent OEPR is prepared, the monthly Lump Sum Payment shall, for the period commencing on the first Day of the calendar month following the month during which an OEPR Evaluator issues such Subsequent OEPR, be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the lesser of (w) the NEP OEPR Estimate obtained from such Subsequent OEPR or (x) the Most Recent Prior NEP Benchmark. The monthly Lump Sum Payment calculated as aforesaid shall remain in effect through the first to occur of (y) the end of the Term or (z) the end of the calendar month during which an OEPR Evaluator issues the next following Subsequent OEPR (if any) that is required or permitted under Section 1.F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract. If any such next following Subsequent OEPR is issued, the monthly Lump Sum Payment shall, for the period commencing on the first Day of the calendar month following the calendar month during which an OEPR Evaluator issues such Subsequent OEPR, be re-calculated and adjusted as provided in this and shall continue in effect for the period provided in the preceding sentence.

D. Lump Sum Pro-Rata Adjustments.

(a) Under the Company's previous forms of as-available power purchase agreements for renewable energy, the independent power producer was compensated for the production and delivery of electrical energy and assumed the risk of non-payment for events such as Force Majeure that prevented such production and delivery. Although under this Contract most or all of Subscriber Organization's compensation will be in the form of a Lump Sum Payment rather than for the production and delivery of electrical energy, it is not the intent of the Parties that Subscriber Organization should be entitled to unrestricted compensation in circumstances in which an independent power producer would not have been able to earn compensation under the Company's prior form of power purchase agreements (*i.e.*, if the Facility or any portion thereof is unable to produce and deliver electric energy). Although the liquidated damages that are payable if the PV System Equivalent Availability Factor fails to satisfy the PV System Equivalent Availability Factor Performance Metric address this issue in certain of the circumstances when the PV System or a portion thereof is unable to generate electric energy, the PV System Equivalent Availability Factor does not account for events of Force Majeure because months containing such events are excluded from the PV System Equivalent Availability Factor calculation under Section 1.A. (Calculation of the PV System Equivalent Availability Factor) of Attachment C (Required Performance

Metrics; Liquidated Damages) to this Contract. Similarly, in the case of the BESS, although the liquidated damages that are payable if the BESS Annual Equivalent Availability Factor fails to satisfy the BESS EAF Performance Metric addresses this issue in certain of the circumstances when the BESS or a portion thereof is unable to respond to Company Dispatch, the BESS Annual Equivalent Availability Factor does not account for events of Force Majeure because months containing such events are excluded from the calculation under Section 2 of Attachment H (BESS Annual Equivalent Availability) of this Contract.

(b) Accordingly, and without limitation to the generality of the foregoing provisions of this Section 3. (Calculation of Lump Sum Payment) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), the monthly Lump Sum Payment shall be adjusted downward pro rata for each hour or portion thereof during the calendar month in question that the CBRE Facility or a portion thereof was not available to respond to Company Dispatch because of a Force Majeure condition (i) affecting the Facility or any portion thereof or (ii) that otherwise delays or prevents the Subscriber Organization from making the CBRE Facility or any portion thereof generate energy or be available for Company Dispatch.

(c) In the case of a BESS Force Majeure, such downward adjustment in the Lump Sum Payment shall be limited to the BESS Allocated Portion of the Lump Sum Payment. Further, during any periods in which there is a Force Majeure affecting both the PV System and the BESS, the Lump Sum Payment shall only be adjusted for the effect of the Force Majeure on the PV System.

(d) The hours the Facility is affected by a Force Majeure are converted to equivalent full outage hours by multiplying the actual duration of the event (hours) by (i) the size of the reduction in MWs or number of devices, divided by (ii) the Contract Capacity if the size of the reduction is in MWs or the total number of devices in the affected system if the size of the reduction is a device count. These equivalent hour(s) are then summed. The summation of equivalent full outage hours is then divided by the months total period hours (number of days in the month x 24hrs/day) to determine the pro-rated factor the Lump Sum Payment will be adjusted by.

EXAMPLE 1: if the PV System has ten inverter(s) and, during the month of May (which has 31 calendar days or 744 period hours), one inverter is not available to respond to Company Dispatch for a period of 360 hours due to a Force Majeure condition as aforesaid, the monetary amount of the resulting downward adjustment to the monthly Lump Sum Payment for the month of May would be calculated as follows:

$$\text{Monetary Amount of Downward Adjustment} = \underline{\underline{(\text{MLSP} \times 1/10) \times 360/744}}$$

where:

MLSP = The monthly Lump Sum Payment that would be payable for such month but for the downward adjustment.

EXAMPLE 2: if a Facility BESS System has forty inverters and, during the month of June (which has 720 period hours), one BESS module is not available to respond to Company Dispatch for a period of 240 hours due to a Force Majeure condition as aforesaid, the monetary amount of the resulting downward adjustment to the monthly Lump Sum Payment for the month of June would be calculated as follows:

$$\frac{\text{Monetary Amount of Downward Adjustment}}{\text{Monetary Amount of Downward Adjustment}} = \frac{(\text{BLSP} \times 1/40) \times 240/720}{240/720}$$

$$\underline{\underline{\text{Monetary Amount of Downward Adjustment} = (\text{BLSP} \times 1/40) \times 240/720}}$$

where:

BLSP = The BESS Allocated Portion of the Lump Sum Payment that would be payable for such month but for the downward adjustment.

Note: The foregoing monetary amount of downward adjustments shall be rounded to the nearest cent.

4. UPDATING MONTHLY SUBSCRIBER INFORMATION USED TO CALCULATE BILL CREDITS AND OTHER MATTERS.

A. No later than the last Day of each calendar month, the Subscriber Organization shall provide to the Company any and all changes to the Monthly Subscription Information to be used for such calendar month by entering new or updating previously-entered data through the CBRE Online Portal. Such data to be entered or changed by the Subscriber Organization shall include additions, deletions or changes to the listing of Subscribers, including any changes occurring by said last Day of such calendar month to the Subscriber's account number and service address attributable to each subscription and the Subscriber Allocation for each subscription.

B. For each calendar month, the purchase or transfer of all or any portion of a Subscriber's Allocation occurring on or before the 20th Day of such calendar month of which the Company is notified, as provided for in the preceding paragraph, shall have retroactive effect as of the first Day of such calendar month; the purchase or transfer of all or any portion of a Subscriber's Allocation occurring on or after the 21st Day of such calendar month, but prior to the first Day of the following calendar month, shall have effect as of the first Day of such following calendar month. The following shall be recalculated as of the last Day of each calendar month to account for the effectiveness of such purchases and transfers as aforesaid: (i) Unsubscribed RDG; (ii) the percentage of the Contract Capacity represented by the Subscriber Allocations for all Residential Subscribers; (iii) the number of individual Subscribers; and (iv) the percentage of Contract Capacity represented by all LMI Subscribers.

5. PAYMENT TO SUBSCRIBER ORGANIZATION; ~~PAYMENT REDUCTIONS-LIQUIDATED DAMAGES FOR FAILURE TO ACHIEVE CBRE SUBSCRIBER THRESHOLDS.~~

The dollar amount payable to Subscriber Organization for the Unsubscribed RDG for a particular calendar month shall be as follows:

(a) The balance of the monthly Lump Sum Payment remaining after deducting the total dollar value of the Bill Credits for that month.

(b) Beginning with the seventh calendar month following the Commercial Operations Date, the Subscriber Organization shall pay, and Company shall accept, payment reductions (from Subscriber Organization's payment for Unsubscribed RDG) or liquidated damages for failure of the Subscriber Organization to achieve, during the calendar month in question, any one or more of the applicable CBRE Subscriber Thresholds. The amount of such payment reductions-liquidated damages shall be determined as set forth in the CBRE Tariff. For purposes of this Section 5 (Payment to Subscriber Organization; Payment Reductions-Liquidated Damages for Failure to Achieve CBRE Subscriber Thresholds) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), a provision in the CBRE Tariff that provides for a reduction in the amount to be paid to the Subscriber Organization for Unsubscribed RDG shall be deemed to provide for liquidated damages in the ~~amount of such reduction-event that Subscriber Organization's payment for Unsubscribed RDG is insufficient to cover such payment reduction, which liquidated damages shall be in the amount of such insufficiency.~~ The Company shall have the right to set-off liquidated damages for failure to achieve one or more of the CBRE Subscriber Thresholds from the amounts to be paid to the Subscriber Organization or to draw such liquidated damages from the Operating Period Security.

6. **TEST ENERGY.** Company shall use reasonable efforts to accept test energy that is delivered as part of the normal testing for generators (such as energy delivered to Company during the Control System Acceptance Test but not during the Acceptance Test), provided Subscriber Organization shall use reasonable efforts to coordinate such normal testing with Company so as to minimize adverse impacts on the Company System and operations. Company shall not compensate Subscribers or Subscriber Organization for test energy.

7. **TAX CREDIT PASS THROUGH.** Company acknowledges and agrees that the Federal Refundable Tax Credit and Federal Non-Refundable Tax Credit shall inure to the benefit of the Claiming Entity; provided, however, that Subscriber Organization acknowledges and expressly agrees that the Federal Refundable Tax Credit and Federal Non-Refundable Tax Credit, with regard to Subscriber Organization's Facility, have been calculated into the Contract Pricing based on the maximization of such credits. In the event that Subscriber Organization's Facility does not gain the benefit of the Federal Refundable Tax Credit and/or the Federal Non-Refundable Tax Credit, Subscriber Organization expressly acknowledges and agrees that it shall not seek to amend the Contract Pricing.

A. Because the Hawai'i tax treatment that will apply to renewable energy technologies on the Commercial Operations Date is uncertain, the parties acknowledge that the Contract Pricing was set assuming Subscriber Organization will not be eligible for any Hawai'i Renewable Energy Tax Credit. The intent of this Section 7. (Tax Credit Pass Through) is to entitle Company, for the benefit of its customers, to a payment equal to 100% of the maximum Hawai'i Renewable Energy Tax Credit for which Subscriber Organization is eligible with respect to the Facility and receives during the Term, as more fully set forth in this Section 7. (Tax Credit Pass Through).

B. If, as of the Commercial Operations Date, or, if not available at the Commercial Operations Date, at any subsequent time during the Term, a Hawai'i Refundable Tax Credit is reasonably available to Subscriber Organization or its Affiliates with respect to the Facility, the following shall apply:

(a) Subscriber Organization or Subscriber Organization's Affiliate will apply for such Hawai'i Refundable Tax Credit, it being understood and agreed that if Subscriber Organization applies for a Hawai'i Refundable Tax Credit as of the Commercial Operations Date, it shall have fulfilled its obligations hereunder to apply for the Hawai'i Refundable Tax Credit;

(b) Subscriber Organization shall make a payment to Company in an amount equal to one hundred percent (100%) of the Net Amount of such Hawai'i Refundable Tax Credit within thirty (30) Days after funds are received from the Hawai'i Department of Taxation;

(c) Upon application for the Hawai'i Refundable Tax Credit, an officer of Subscriber Organization will deliver to Company a notice (A) describing Subscriber Organization's efforts to apply for and obtain the Hawai'i Refundable Tax Credit, (B) confirming that Subscriber Organization has applied for the Hawai'i Refundable Tax Credit, and (C) certifying that Subscriber Organization has used commercially reasonable efforts to apply for and obtain the maximum reasonably available Hawai'i Refundable Tax Credit as provided in this Section 7. (Tax Credit Pass Through);

(d) Upon receipt of any funds from the Hawai'i Department of Taxation for the Hawai'i Refundable Tax Credit, an officer of Subscriber Organization or an Affiliate of Subscriber Organization, if applicable, will deliver a notice to Company certifying (A) the amount of funds received, (B) and the amount of payment that will be made to Company, net of any documented and reasonable financial, legal, administrative, and other costs required to claim and transfer such funds to Subscriber Organization, as supported by the officer's certificate as to the amount of such costs and the reasonableness thereof.

C. If, as of the Commercial Operations Date, a Hawai'i Refundable Tax Credit is unavailable, but a Hawai'i Non-Refundable Tax Credit is available to Subscriber Organization or its Affiliates with respect to the Facility, or at any subsequent time during the Term, a Hawai'i Non-Refundable Tax Credit becomes available to Subscriber Organization or its Affiliates with respect to the Facility, notwithstanding that Subscriber Organization may have applied for a Hawai'i Refundable Tax Credit, and in either case Subscriber

Organization can claim, or enable its investors to claim, such Hawai'i Non-Refundable Tax Credit, the following shall apply:

- (a) Subscriber Organization or an Affiliate of Subscriber Organization will apply for any available Hawai'i Non-Refundable Tax Credit, it being understood and agreed that if Subscriber Organization applies for a Hawai'i Non-Refundable Tax Credit as of the Commercial Operations Date, it shall have fulfilled its obligations hereunder to apply for the Hawai'i Non-Refundable Tax Credit;
- (b) Subscriber Organization shall make a payment to Company in an amount equal to one hundred percent (100%) of the Net Amount of such Hawai'i Non-Refundable Tax Credit that Subscriber Organization can claim in the tax year in question within sixty (60) Days after the filing date of the applicable tax return for the tax year in which such Hawai'i Non-Refundable Tax Credit is utilized;
- (c) Upon the filing of the applicable tax return(s), an officer of Subscriber Organization or an Affiliate of Subscriber Organization, if applicable, will deliver a notice to Company (A) describing Subscriber Organization's efforts to apply for and obtain the Hawai'i Non-Refundable Tax Credit, (B) confirming that Subscriber Organization has applied for the Hawai'i Non-Refundable Tax Credit, and (C) certifying that Subscriber Organization has used commercially reasonable efforts to apply for and obtain the maximum reasonably available Hawai'i Non-Refundable Tax Credit as provided in this Section 7. (Tax Credit Pass Through);
- (d) Upon receipt of any funds for the Hawai'i Non-Refundable Tax Credit, an officer of Subscriber Organization or an Affiliate of Subscriber Organization, if applicable, will deliver a notice to Company certifying (A) the amount of funds received, (B) and the amount of payment that will be made to Company, net of any documented and reasonable financial, legal, administrative, and other costs required to claim, monetize and transfer such funds to Subscriber Organization, as supported by the officer's certificate as to the amount of such costs and the reasonableness thereof.

D. Subscriber Organization shall use commercially reasonable efforts to apply for and obtain the maximum reasonably available Hawai'i Refundable and/or Non-Refundable Tax Credit as provided in this Section 7 (Tax Credit Pass Through). If Subscriber Organization fails to apply for and to use commercially reasonable efforts to obtain such Hawai'i Renewable Energy Tax Credit as described above, then Company shall be entitled to liquidated damages in an amount equal **[\$150,000 per MW of Contract Capacity]**. Subscriber Organization and Company agree and acknowledge that (i) the failure to use commercially reasonable efforts as provided in the preceding sentence would result in damages to Company in the form of reduction or loss of a benefit for Company's customers that would be difficult or impossible to calculate with certainty and (ii) **[Note - Insert Amount That Equals \$150,000 Per Mw Of Contract Capacity]** is an appropriate approximation of such damages. Company's right to collect liquidated damages as described in this Section 7.D. shall constitute Company's exclusive remedy and fulfillment of all Subscriber Organization's liability with respect to its obligations to maximize the amount of Hawai'i Renewable Energy Tax Credit. Such liquidated damages shall be provided to Company in the form of a lump sum payment by Subscriber Organization or as a credit against any amounts due by Company to Subscriber Organization under this Contract, as Company reasonably determines.

E. If, prior to the application in Section 7.B. or filing in Section 7.C. of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), as applicable, a change in tax law occurs to introduce a Hawai'i Production Tax Credit or an alternative renewable tax credit, Subscriber Organization will use commercially reasonable efforts to determine which tax strategy is likely to result in the larger Net Amount (based on net present value for tax credits earned over time) of claimable tax credits. If, based on such efforts, Subscriber Organization determines that either Section 7.B. or Section 7.C. would result in a larger Net Amount of usable tax credits, an officer of Subscriber Organization will deliver a notice to Company certifying that Subscriber Organization has reasonably determined that the selected form of Hawai'i Renewable Energy Tax Credit is likely to result in the larger Net Amount (based on net present value for tax credits earned over time) of claimable tax credits and explaining the rationale for such determination. If, however, Subscriber

Organization reasonably determines that such Hawai'i Production Tax Credit is likely to result in the larger Net Amount (based on net present value for tax credits earned over time) of claimable tax credits and that it reasonably can obtain such Hawai'i Production Tax Credit, Subscriber Organization shall promptly notify Company in writing and explain the rationale for such determination, and Subscriber Organization and Company shall negotiate in good faith and use commercially reasonable efforts to agree upon lump sum payments and/or credits or adjustments to the Contract Pricing and other terms of this Contract as may be required to best benefit Company's customers with 100% of the Net Amount of such tax benefits and preserve the intended economic benefits to the Parties arising from this Contract.

F. Company reserves the right to have Subscriber Organization's application for the Hawai'i Renewable Energy Tax Credit in Section 7.B. or Section 7.C., or the Hawai'i Production Tax Credit or alternative tax credit under Section 7.E. of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) reviewed by an Independent Tax Expert to determine if such application is expected to maximize available tax credits to best benefit Company's customers, in which case, the provisions of this Section 7.F. shall apply. Company shall deliver to Subscriber Organization a written notice (the "Nomination Notice") of: (i) the names of three persons qualified and willing to accept appointment as an Independent Tax Expert; (ii) a description provided by each nominee of his or her qualifications to serve as an Independent Tax Expert; (iii) a written undertaking by each nominee to review Subscriber Organization's tax credit strategy and application, and (iv) each nominee's fee proposal. Subscriber Organization and Company shall agree on a mutually acceptable person to serve as the Independent Tax Expert within ten (10) Business Days of Subscriber Organization's receipt of Company's written notice. If the Parties fail to agree upon a mutually acceptable Independent Tax Expert within the aforesaid ten Business Day period, such disagreement shall be resolved pursuant to Section 7.G. of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS). Company shall pay the fees and expenses of the Independent Tax Expert and Subscriber Organization shall promptly reimburse Company for one-half of such fees and expenses.

G. Any dispute arising under this Section 7. (Tax Credit Pass Through) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) shall constitute a "Dispute" within the meaning of Section 17. (Dispute Resolution) of the Contract and shall be resolved as provided in said Section 17. (Dispute Resolution).

H. For purposes of this Section 7. (Tax Credit Pass Through) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), an Affiliate of Subscriber Organization is a company that directly or indirectly controls, is controlled by, or is under common control with Subscriber Organization, and Subscriber Organization may perform its obligations under this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) directly or through one or more Affiliates.

--END--

ATTACHMENT C

REQUIRED PERFORMANCE METRICS; LIQUIDATED DAMAGES

1. PV SYSTEM EQUIVALENT AVAILABILITY FACTOR; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

- A. Calculation of the PV System Equivalent Availability Factor. Following the end of each LD Period, the PV System Equivalent Availability Factor shall be calculated for such LD Period as follows:

$$\text{PV System Equivalent Availability Factor} = 100\% \times \frac{AH - EDH}{PH}$$

where:

Period Hours (PH) is the total number of hours in the LD Period counting twenty-four (24) hours per day. In a normal year, PH = 8,760, and in a leap year PH = 8,784.

Available Hours (AH) is the number of hours that the PV System is not on Outage. It is the sum of all Service Hours (SH) + Reserve Shutdown Hours (RSH).

An "Outage" exists whenever the entire PV System is not online producing electric energy and is not in a Reserve Shutdown state.

Service Hours (SH) is the number of hours during the LD Period the PV System is online and producing electric energy to meet Company Dispatch and/or to maintain the BESS State of Charge.

Reserve Shutdown Hours (RSH) is the number of hours the PV System was available to the Company System but not providing electric energy or is offline at the Company's request for reasons other than Subscriber Organization-Attributable Non-Generation, or is offline due to insufficient irradiance levels based on the inverter manufacturer's minimum irradiance level for production. All hours between 7:00 pm and 6:00 am will be considered RSH. The PV System will be considered RSH in these hours, even if the system would otherwise be in an outage or derated state.

A "PV System Derating" exists if the Facility is available for Company Dispatch, but at less than full potential output for the given irradiance conditions, including deratings due to Subscriber Organization-Attributable Non-Generation or deratings by Company pursuant to Section 5.C (Company Rights of Dispatch).

For avoidance of doubt, if there is a PV System Outage occurring, there cannot also be a PV System Derating.

Equivalent Derated Hours (EDH) is the sum of ESADH, EPDH, and EUDH. For deratings due to PV System inverter unavailability, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the number of inverters in the PV System unavailable and dividing by the total number of inverters in the PV System. For deratings that do not impact the availability of an entire inverter or set of entire inverters, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the size of the derating (in MW) divided by the Contract Capacity.

Equivalent Subscriber Organization-Attributable Derated Hours (ESADH): A Subscriber Organization-Attributable Derating occurs when a derating exists due to Subscriber Organization-Attributable Non-Generation or deratings by Company pursuant to Section 5.3 (Company Rights of Dispatch) of the Contract. Each individual derating is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed.

Equivalent Planned Derated Hours (EPDH) includes Planned Deratings (PD) and Maintenance Deratings (D4). A Planned Derating is when the PV System experiences a derating scheduled well in advance and for a predetermined duration. A Maintenance Derating is a derating that can be deferred beyond the end of the next weekend (Sunday at midnight or before Sunday turns into Monday) but requires a reduction in capacity before the next Planned Derating (PD). Each individual Deration is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed.

Equivalent Unplanned Derated Hours (EUDH): An Unplanned Derating (Forced Derating) occurs when the PV System experiences a derating that requires a reduction in availability before the end of the nearest following weekend. Unplanned Derations include those due to Subscriber Organization-Attributable Non-Generation. Each individual Unplanned Derating is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed.

The effect of Force Majeure is taken into account in calculating the PV System Equivalent Availability Factor over the 12 calendar month LD Period as follows: When an LD Period contains any hours in a month during which the PV System or a portion of the PV System is unavailable due to Force Majeure, then such month shall be excluded from the LD Period and the LD Period shall be extended back in time to include the next previous month during which there was no such unavailability of the PV System or a portion thereof due to Force Majeure. This means the PV System Equivalent Availability Factor would not change from that determined in the month directly preceding a month containing Forced Majeure.

EXAMPLE: The following is an example of a PV System Equivalent Availability Factor calculation and is included for illustrative purposes only. Assume the following:

- PV System has 10 inverters and the Facility has a Contract Capacity of 30 MWs.
- LD Period = first 12 calendar months of the Contract (non-leap year).
- PV System was online and producing electric energy for 4,000 hours and was available but not producing electric energy due to lack of sufficient irradiance for production (i.e., not Subscriber Organization-Attributable Non-Generation) for 500 hours.
- 3 Inverters were offline for 100 hours due to a Planned Derating while not otherwise in RSH.
- 2 Inverters were offline for 50 hours due to an Unplanned Derating while not in RSH.
- The PV System had a 3 MW derating for 100 hours due to Subscriber Organization-Attributable Non-Generation while not otherwise in RSH.
- The PV System Equivalent Availability Factor would be calculated as follows:

$$PH = 8,760 \text{ hours in 12 calendar months} = 8,760 \text{ hours}$$

$$SH = 4,000 \text{ hours}$$

$$RSH = 500 \text{ hours} + (11 \text{ hours/day} \times 365 \text{ days}) = 4,515 \text{ hours}$$

$$AH = SH + RSH = 4,000 \text{ hours} + 4,515 \text{ hours} = 8,515 \text{ hours}$$

$$ESADH = 100 \text{ hours} \times \left(\frac{3 \text{ MW}}{30 \text{ MW}}\right) = 10 \text{ hours}$$

$$EPDH = 100 \text{ hours} \times \left(\frac{3 \text{ inverters}}{10 \text{ inverters}}\right) = 30 \text{ hours}$$

$$EUDH = 50 \text{ hours} \times \left(\frac{2 \text{ inverters}}{10 \text{ inverters}}\right) = 10 \text{ hours}$$

$$EDH = ESADH + EPDH + EUDH = 10 \text{ hours} + 30 \text{ hours} + 10 \text{ hours} = 50 \text{ hours}$$

$$EAF = 100\% \times \frac{8,515 - 50}{8,760} = 96.6\%$$

- B. PV System Equivalent Availability Factor Performance Metric and Liquidated Damages. For each LD Period, a PV System Equivalent Availability Factor shall be calculated as provided in accordance with Section 1. A. (Calculation of PV System Equivalent Availability Factor) of this Contract. In the event the PV System Equivalent Availability Factor is less than **98%** (the "PV System Equivalent Availability Factor Performance Metric") for any LD Period, Subscriber Organization shall be subject to liquidated damages as set forth in this Section 1. B. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages). For avoidance of doubt, because the PV System Equivalent Availability Factor is calculated over an LD Period of 12 calendar months, the first month for which liquidated damages would be calculated under this Section 1.B. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages) would be the last calendar month of the initial Contract Year. If the PV System Equivalent Availability Factor for a LD Period is less than the PV System Equivalent Availability Factor Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C, Section 8 (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for Subscriber Organization's failure to achieve the PV System Equivalent Availability Factor Performance Metric for such LD Period, an amount calculated in accordance with the following formula:

<u>PV System Equivalent Availability Factor</u>	<u>Amount of Liquidated Damages Per Calendar Month</u>
97.9% and below	For each one-tenth of one percent (0.001) by which the PV System Equivalent Availability Factor for such LD Period falls below the PV System Equivalent Availability Factor Performance Metric, an amount equal to 0.001917 of the Applicable Period Lump Sum Payment for the last calendar month of such LD Period.

For purposes of determining liquidated damages under the preceding formula, the amount by which the PV System Equivalent Availability Factor for the LD Period in question falls below the applicable threshold shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the

damages that Company would incur if the Subscriber Organization fails to achieve the PV System Equivalent Availability Factor Performance Metric for a LD Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

EXAMPLE: The following is an example calculation of liquidated damages for the PV System Equivalent Availability Factor Performance Metric and is included for illustrative purposes only. Assume the monthly Lump Sum Payment is \$1,000,000 and the PV System Equivalent Availability Factor is 96.9% as calculated in the example in Section 2.5(a) (Calculation of the PV System Equivalent Availability Factor) above.

The liquidated damages would be calculated as follows:

Applicable Period Lump Sum Payment = \$1,000,000

\$1,000,000 x .001917 = \$1,917

98.0% - 96.9% = 1.1%

1.1%/0.1% = 11

\$1,917 x 11 = \$21,087

- C. PV System Equivalent Availability Factor Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 1.B. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages) is to compensate Company for the damages that Company would incur if the Subscriber Organization fails to achieve the PV System Equivalent Availability Factor Performance Metric for a LD Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the PV System is likely to continue to substantially underperform the PV System Equivalent Availability Factor Performance Metric. Accordingly, and without limitation to Company's rights under said Section 1.B. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages) for those LD Periods during which the Subscriber Organization failed to achieve the PV System Equivalent Availability Factor Performance Metric, the failure of the Facility to achieve a PV System Equivalent Availability Factor of not less than **84%** for each of three consecutive Contract Years shall constitute an Event of Default under this Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 13. (Events of Default by Subscriber Organization) and Section 15. (Damages in the Event of Termination by Company).

2. MEASURED PERFORMANCE RATIO; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

A. Calculation of Measured Performance Ratio.

1. The Measured Performance Ratio ("MPR") represents the PV System's measured AC power output compared to its theoretical DC power output as adjusted for the plane of array irradiance and weather conditions measured at the Site [**DRAFTING NOTE: MAY REQUIRE REVISION FOR DC OUTPUT**]. The ~~grossnet~~ PV System output in MW ~~and MVAR~~ will be measured at such points mutually agreed to by the Parties on the Facility's single-line diagram attached hereto as Attachment F, Exhibit F-5 (Single-Line Drawing and Interface Block Diagram) to this Contract.
- Following the end of each MPR Assessment Period, the MPR shall be calculated for such MPR Assessment Period (using the previous 12 months of data) as follows:

$$MPR_{corr} = \frac{\sum_i P_{AC_i}}{\sum_i \left[P_{DC_{STC}} \left(\frac{G_{POA_i}}{G_{STC}} \right) \left(1 - \frac{8}{100} (T_{cell_type_avg} - T_{cell_i}) \right) \right]}$$

Where:

i = each 15-minute interval during the MPR Assessment Period where the conditions set forth in Section 2.A.1. are met.

P_{AC_i} is the measured AC power output of the PV System measured at the Point of Interconnection and BESS inverters' AC input averaged over time period i in MW.

G_{STC} = plane of array irradiance at the standard condition of $1,000 \text{ W/m}^2$.

$P_{DC_{STC}}$ is the DC rated capacity of the PV System at the standard test conditions of $1,000 \text{ W/m}^2$ and 25°C (MW), (i.e., the DC power rating of the PV panels at standard test conditions multiplied by the number of PV panels in the Facility).

G_{POA_i} is the measured plane of array irradiance averaged over time period i (W/m^2).

T_{cell_i} = cell temperature computed from measured meteorological data averaged over time period i using the equation provided below. ($^\circ\text{C}$)

$T_{cell_typ_avg}$ = annual average irradiance-weighted cell temperature computed from one year of weather data using the GPR performance metric weather file and the equation below. ($^\circ\text{C}$) Calculated once per GPR.

δ = temperature coefficient for power ($\%/^\circ\text{C}$, negative in sign) that corresponds to the installed photovoltaic modules.

$$T_{cell_typ_avg} = \frac{\sum_j [G_{POA_typ_j} \times T_{cell_typ_j}]}{\sum_j G_{POA_typ_j}}$$

Where:

j = each hour of the year in the GPR performance metric weather file (hours 1-8760).

$G_{POA_typ_j}$ = Plane of array irradiance for each hour of the year determined from the GPR performance metric weather file and tracker orientation. This irradiance is zero (0) when the sun is not up. (W/m^2).

$T_{cell_typ_j}$ = calculated cell operating temperature for each hour of the year computed using the GPR performance metric weather file for the weather variables in the equation for T_{cell_i} below.

$$T_{cell_i} = G_{POA_i} \times e^{(a+b \times WS_i)} + T_{a_i} + \left(\frac{G_{POA_i}}{G_{STC}} \times dT_{cond} \right)$$

Where:

T_{a_i} = the measured ambient temperature averaged over time period i [$^\circ\text{C}$]

WS_i = the measured wind speed corrected to a measurement height of 10 meters (using the anemometer height and proper Hellmann coefficient) averaged over time period i [m/s]

a = empirical constant reflecting the increase of module temperature with sunlight as presented in Table 2 below.

b = empirical constant reflecting the effect of wind speed on the module temperature as presented in Table 2 below [s/m]

e = Euler's constant and the base for the natural logarithm.

dT_{cond} = conduction temperature coefficient from module to cell as presented in Table 2 below.

Table 2. Empirical Convective Heat Transfer Coefficients Module Type	Mount	a	b	dT_{cond}
Glass/cell/glass	Open rack	- 3.47	- 0.0594	3
Glass/cell/glass	Close-roof mount	- 2.98	- 0.0471	1
Glass/cell/polymer sheet	Open rack	- 3.56	- 0.0750	3
Glass/cell/polymer sheet	Insulated back	- 2.81	- 0.0455	0
Polymer/thin-film/steel	Open rack	- 3.58	- 0.1130	3

The time periods used in the foregoing calculation shall be only periods during which, for the entire 15-minute interval, the PV System output is allowed to convert all irradiance to ~~gross~~ AC power (whether directed to the BESS or Point of Interconnection) and ~~is not offline due to insufficient~~ the plane of array irradiance levels based on the inverter minimum requirements for production is not less than 600 W/m². Data points that will be excluded are limited to data points where: (A) the GPOA is below ~~minimum threshold~~ 600 W/m², (B) GPOA ~~is~~ is above the maximum threshold (C) the PV System is in ~~RSH~~ Reserve Shutdown, (D) when ~~there is~~ the PV System has a ~~EUDH~~ Planned or ~~EPDH~~ Unplanned Derating, (E) the PV System was not allowed to convert the full DC output to AC energy; ~~or (F) when there is any other~~ to deliver to the BESS and Point of Interconnection due to Company Dispatch being less than the PV System potential at the measured irradiance and the BESS reaching its maximum State of Charge; (F) there is a PV System Outage; ~~or (G) the BESS is discharging.~~ The aforementioned 15-minute intervals are fixed intervals that commence, in sequence, at the top of each hour and at 15, 30 and 45 minutes past the hour. At the end of each month, Subscriber Organization shall provide Company a report that lists all hours when such excluded data points occur (from the Facility's SCADA system as necessary) to validate the exclusion of any data points from the calculation set forth in Section 2.A., above. This information shall be validated on a monthly basis.

- The effect of the Force Majeure is taken into account in calculating the MPR for the MPR Assessment Period as follows: When an MPR Assessment Period contains any hours in a month during which the PV System or a portion of the PV System is unavailable due to Force Majeure, then such month shall be excluded from the MPR Assessment Period and the MPR Assessment Period shall be retroactively extended to include the next previous month during which there was no such unavailability of the PV System or a portion thereof due to Force Majeure. This means the MPR would not change from that determined in the month directly preceding a month containing Force Majeure.
- B. MPR Test.** In the event that the set of operational data points under Section 2.A. that is available for any month to calculate the MPR cannot be validated to Company's reasonable satisfaction or in the event there were not at least 16 such data points during such month that could be used to calculate the MPR, the Company shall have the right to perform a test ("MPR Test") to collect the data points for such month to be used to calculate the MPR in lieu of the use of operational data for such month. The Company shall

retain sole discretion as to when to conduct the MPR Test and the MPR Test may be conducted at any point during the month following the month for which Company was either unable to validate the set of operational data points for such month or there were not at least 16 data points available during such month, provided that Company will provide Subscriber Organization three (3) Business Days' notice prior to conducting the MPR Test. The MPR Test shall have a minimum duration of four (4) hours and shall run until at least 16 data points are collected that meet the criteria set forth in Section 2.A, subject to the limitation set forth in the last sentence of this Section 2.B). To the extent possible, the Company shall schedule the MPR Test for a period where all inverters in the PV System and BESS are fully available and weather conditions are expected to be optimum allowing the PV System to generate at full capacity for the duration of the MPR Test (if possible). However, if Company chooses a period where some of the Facility inverter(s) are unavailable, P_{DCSTC} shall be adjusted to account for any reduction in capability to accept energy from the PV System due to the unavailable inverter(s).

- For each MPR Assessment Period that includes one or more months for which a MPR Test was performed, the data points collected during said MPR Test for such month(s) shall be used together with the data points for months for which an MPR Test was not conducted to calculate the MPR for the MPR Assessment Period in question using the formula set forth in Section 2.A.1, above. The result of the calculation based on the MPR Test shall be the MPR for the MPR Assessment Period in question.

EXAMPLE: The following is an example of a Measured Performance Ratio calculation and is included for illustrative purposes only. Assume the following:

- Facility with 120,000 panels with a standard test condition rating of 300 W
- $P_{DCSTC} = 120,000 \times 300 \text{ W} = 36 \text{ MW}$
- For illustrative purposes only, 4 hours of data which met the criteria specified in 2.6(a) (iii) have been recorded over the MPR Assessment Period. It should be noted that all available operational data that meets the criteria specified in Section 2.A.1 shall be included in the actual calculation.

Time Period	Average Measured Plane of Array Irradiance (W/m^2)	Average Measured Net AC Power at POI and BESS Inverters (MW)	Average Measured Ambient Temperature ($^{\circ}\text{C}$)	10 Meter Elevation Average Measured Wind Speed (m/s)
1	690	16	27	3
2	850	11	26	8
...
i	750	19	29	7

$$MPR_{corr} = \frac{\sum_i P_{AC_i}}{\sum_i \left[P_{DCSTC} \left(\frac{G_{POA_i}}{G_{STC}} \right) \left(1 - \frac{\delta}{100} (T_{cell_typ_avg} - T_{cell_i}) \right) \right]}$$

where:

$$T_{cell_i} = G_{POA_i} \times e^{(a+b \times WS_i)} + T_{a_i} + \left(\frac{G_{POA_i}}{G_{STC}} \times dT_{cond} \right)$$

Assuming:

The temperature coefficient (δ) of the installed modules is $-0.4\%/^{\circ}\text{C}$

The average irradiance-weighted cell temperature ($T_{cell_typ_avg}$) has been calculated as 28°C

The installed modules are a glass/cell/polymer sheet module type using an open rack mount.
(a = -3.56; b = -0.0750; $dT_{cond} = 3$)

$$\sum_i P_{AC_i} = 16 \text{ MW} + 11 \text{ MW} + \dots + 19 \text{ MW} = \mathbf{305 \text{ MW}}$$

$$\begin{aligned} \sum_i \left[P_{DCSTC} \left(\frac{G_{POA_i}}{G_{STC}} \right) \left(1 - \frac{\delta}{100} (T_{cell_type_avg} - T_{cell_i}) \right) \right] &= 36 \text{ MW} \times [(690/1000) \times (1 - \\ &(0.4/100) \times (28 - ((690 \times e^{(-3.56 - 0.075 \times 3)} + 27) + ((690/1000) \times 3)))) + \\ &(850/1000) \times (1 - (0.4/100) \times (28 - ((850 \times e^{(-3.56 - 0.075 \times 8)} + 26) + ((850/1000) \times 3)))) + \\ &\dots + \\ &(750/1000) \times (1 - (0.4/100) \times (28 - ((750 \times e^{(-3.56 - 0.075 \times 7)} + 29) + ((750/1000) \times 3))))] \\ &= \mathbf{374.76 \text{ MW}} \end{aligned}$$

$$\text{MPR} = 305 \text{ MW} / 374.76 \text{ MW} = \mathbf{0.814}$$

C. Determination of GPR Performance Metric.

1. Upon Commencement of Commercial Operations. If a copy of the IE Energy Assessment Report together with the supporting Year 1 P-Value of 50 8760 data (plane of array irradiance, ~~Year 1 P-Value of 50 8760 ambient temperature, windspeed~~ and corresponding power output) is not provided to Company in accordance with Section 1.C. (NEP IE Estimate and Company-Designated NEP Estimate) of Attachment D (Calculation and Adjustment of Net Energy Potential), the GPR Performance Metric for the period commencing on the Commercial Operations Date through the end of the calendar month during which the Initial OEPR is issued shall be 0.85. If a copy of the IE Energy Assessment Report together with the supporting data (plane of array irradiance, ambient temperature, windspeed and corresponding power output) is provided to Company in accordance with Section 1.C. (NEP IE Estimate and Company-Designated NEP Estimate) of Attachment D (Calculation and Adjustment of Net Energy Potential), the GPR Performance Metric shall be the GPR set forth in the IE Energy Assessment Report, ~~and based on the Year 1 P-Value of 50 8760 data,~~ provided that such GPR is justified by such supporting data and consistent with the ~~and based on the Year 1 P-Value of 50 8760 data,~~ minimum irradiance level and points of power measurement specified in Section 2.A. of this Attachment C. In the event that the IE Assessment Report includes the supporting data (plane of array irradiance, ambient temperature, windspeed and corresponding power output) relied upon in arriving at the NEP IE Estimate, but does not set forth a GPR, the GPR Performance Metric shall be calculated using such supporting data and the Measured Performance Ratio formula in Section 2.A. of this Attachment C. Within 30 Days of Company's receipt of the IE Energy Assessment Report together with the aforementioned supporting data, Company shall provide written notice to Subscriber Organization of either (aa) the GPR Performance Metric derived from such supporting data or (bb) Company's inability to reasonably derive a GPR Performance Metric from such supporting data, in which case the GPR Performance Metric shall be 0.85.

Commencing With Initial OEPR. For the period commencing with the first Day of the calendar month following the establishment of the NEP OEPR Estimate for the Initial OEPR (as provided in Section 1.E (Initial OEPR) and Sections 2.G. (Review of the First OEPR Evaluator Report) and 2.H. (Review of the Second OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract through the end of the calendar month during which the NEP OEPR Estimate for the first Subsequent OEPR is established as provided in Section (Subsequent OEPRs) and Sections 2.G. (Review of the First OEPR Evaluator Report) and 2.H. (Review of the Second OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract, the GPR Performance Metric shall be the GPR as established through the Initial OEPR process as aforementioned. If no GPR has been established through the Initial OEPR process, the GPR Performance Metric shall be 0.85.

Commencing With the First Subsequent OEPR and Thereafter. Commencing with the establishment of the NEP OEPR Estimate for the first Subsequent OEPR as provided in Section F.1. (Subsequent OEPRs) and Sections 2.G. (Review of the First OEPR Evaluator Report) and 2.H. (Review of the Second OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract, for each period commencing with the first Day of the calendar month following the establishment of the NEP OEPR Estimate for a Subsequent OEPR (including but not limited to the first Subsequent OEPR) through the end of the calendar month during which the NEP OEPR Estimate is established for the next Subsequent OEPR, the GPR Performance Metric shall be the GPR established for the applicable Subsequent OEPR. If no GPR has been established through the then applicable Subsequent OEPR process, the GPR Performance Metric shall be 0.85.

D. GPR Performance Metric and Liquidated Damages. For each MPR Assessment Period, a Measured Performance Ratio shall be calculated as provided in Attachment C Section 2.A. (Calculation of Measured Performance Ratio) to this Contract. In the event the MPR is less than 95% of the GPR Performance Metric as adjusted by the degradation factor set forth below, Subscriber Organization shall pay, in accordance with Attachment C Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for Subscriber Organization's failure to achieve the GPR Performance Metric for such MPR Assessment Period, an amount calculated in accordance with the following formula:

TIER	MEASURED PERFORMANCE RATIO	AMOUNT OF LIQUIDATED DAMAGES PER MPR ASSESSMENT PERIOD
Tier 1	GPR Performance Metric x DF x 0.95 > Measured Performance Ratio ≥ GPR Performance Metric x DF x 0.90	For each one-tenth of one percent (0.001) by which the Measured Performance Ratio for such MPR Assessment Period falls below the upper limit of the bandwidth specified in this subparagraph, an amount equal to one-tenth of one percent (0.001) of the MPR Assessment Period Lump Sum Payment. The upper end of the aforementioned bandwidth is equal to the product of the GPR Performance Metric, the applicable degradation factor (DF), and 95%. The lower limit of the aforementioned bandwidth consists of and includes the product of the GPR Performance Metric, the applicable degradation factor (DF), and 90%; plus
Tier 2	GPR Performance Metric x DF x 0.90 > Measured Performance Ratio ≥ GPR Performance Metric x DF x 0.80 Measured Performance Ratio < GPR Performance Metric x DF x 0.80	For each one-tenth of one percent (0.001) by which the Measured Performance Ratio for such MPR Assessment Period falls below the upper limit of the bandwidth specified in this subparagraph, an amount equal to two-tenths of one percent (0.002) of the MPR Assessment Period Lump Sum Payment. The upper end of the aforementioned bandwidth is equal to the product of the GPR Performance Metric, the applicable degradation factor (DF), and 90%. The lower limit of the aforementioned bandwidth consists of and includes the product of the GPR Performance Metric, the applicable degradation factor (DF), and 80%; plus For each one-tenth of one percent (0.001) by which the Measured Performance Ratio for such MPR Assessment Period falls below the product of the GPR Performance Metric, the applicable degradation factor (DF), and 80%, an amount equal to four-tenths of one percent (0.004) of the MPR Assessment Period Lump Sum Payment.

For purposes of the foregoing calculations under this Section 2. (Measured Performance Metric; Liquidated Damages; Termination Rights), the degradation factor (DF) is calculated for each Contract Year (e.g., second Contract Year, third Contract Year, fourth Contract Year, etc.) as follows: $DF = 1 - 0.005 * (\text{Applicable Contract Year} - 1)$. For purposes of the foregoing formula, the "Applicable Contract Year" is the Contract Year within which the calendar month in question falls. If all of the months of an MPR Assessment Period fall within the same Contract Year, the Contract Year is the "Applicable Contract Year." For example, if all of the months of MPR Assessment Period fall within the third Contract Year, the value assigned to the "Applicable Contract Year" would be "3" and the formula for calculating the DF for such LD Period would be: $DF = 1 - 0.005 * (3 - 1)$. However, because the MPR Assessment Period is a rolling 12-month period, the MPR Assessment Period will often straddle two consecutive Contract Years. In such cases, all of the months falling within the same Contract Year will be assigned the value for such Contract Year and the value assigned to the "Applicable Contract Year" for purposes of the foregoing formula shall be the average of the assigned monthly values for such 12-month MPR Assessment Period. For example, for an MPR Assessment Period which has four months in the third Contract Year and eight months in the fourth Contract Year, the value assigned to the "Applicable Contract Year" for such MPR Assessment Period would be 3.67, as calculated as follows:

$$(3 \times 4) + (4 \times 8)$$

$$12$$

And the formula for calculating the DF for such MPR Assessment Period would be $DF = 1 - 0.005 * (3.67 - 1)$. For purposes of determining liquidated damages under this Section 2. (Measured Performance Metric; Liquidated Damages; Termination Rights). The amount by which the Measured Performance Ratio for the MPR Assessment Period in question falls below the applicable threshold shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the GPR Performance Metric for a MPR Assessment Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

EXAMPLE: The following is an example calculation of liquidated damages for the GPR Performance Metric and is included for illustrative purposes only. Assume the following facts:

- The MPR Assessment Period has five months in the second Contract Year and seven months in the third Contract Year.
- The GPR for the Facility as determined by the OEPR is 0.9.
- The MPR has been calculated to be 0.694.
- Applicable Contract Year = $[(5 \times 2) + (7 \times 3)]/12 = 2.58$
- $DF = 1 - 0.005 * (2.58 - 1) = 0.9921$
- Upper limit of the Tier 1 bandwidth = $0.9 \times 0.9921 \times 0.95 = 0.848$
- Lower limit of the Tier 1 bandwidth/Upper limit of the Tier 2 bandwidth = $0.9 \times 0.9921 \times 0.9 = 0.804$
- Lower limit of the Tier 2 bandwidth = $0.8 \times 0.9921 \times 0.9 = 0.714$
- $LD = [((0.848 - 0.804) \times 1) + ((0.804 - 0.714) \times 2) + ((0.714 - 0.694) \times 4)] \times \text{MPR Assessment Period Lump Sum Payment} = 0.304 \times \text{MPR Assessment Period Lump Sum Payment}$

E. MPR Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 2 (Measured Performance Ratio; Liquidated Damages; Termination Rights) is to compensate Company for the damages that Company would incur if the Subscriber Organization fails to achieve the GPR Performance Metric for a MPR Assessment Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes

a reasonable expectation that the Facility is likely to continue to substantially underperform the GPR Performance Metric. Accordingly, and without limitation to Company's rights under said Section 2. (Measured Performance Metric; Liquidated Damages; Termination Rights) for those MPR Assessment Periods during which the Subscriber Organization failed to achieve the GPR Performance Metric, the failure of the PV System to achieve, for each of three consecutive Contract Years, a Measured Performance Ratio of not less than the Tier 2 Bandwidth for such Contract Year shall constitute an Event of Default under Section 13.A.4. of this Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 13. (Events of Default) and Section 15. (Damages in the Event of Termination by Company).

3. BESS CAPACITY TEST; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

A. BESS Capacity Test and Liquidated Damages. For each BESS Measurement Period following the Commercial Operations Date, the BESS shall be required to complete a BESS Capacity Test, as more fully set forth in Section 1. (BESS Tests) to Attachment H (BESS Requirement) to this Contract. For each BESS Measurement Period for which the BESS fails to demonstrate that it satisfies the BESS Capacity Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for such shortfall, the amount set forth in the following table (on a progressive basis) upon proper demand at the end the BESS Measurement Period in question:

BESS Capacity Ratio	Liquidated Damage Amount
Tier 1 95.0% - 99.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 100% and is equal to or greater than 95.0%, an amount equal to one-tenth of one percent (0.001) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 2 85.0% - 94.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 95% and is above 84.9%, an amount equal to one and a half-tenths of one percent (0.0015) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 3 75.0% - 84.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 85% and is above 74.9%, an amount equal to two-tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 4 60.0% - 74.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 75% and is above 59.9%, an amount equal to two and a half-tenths of one percent (0.0025) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 5 50.0% - 59.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 60% and is above 49.9%, an amount equal to three-tenths of one percent (0.003) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 6 49.9% and below ("Lowest BESS Capacity Bandwidth")	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 50%, an amount equal to three and a half-tenths of one percent (0.0035) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question.

For purposes of determining liquidated damages under this Section 3. (BESS Capacity Test and Liquidated Damages), the starting and end points for the duration of the period that the BESS discharges shall be rounded to the nearest MWh. Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the BESS Capacity Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

EXAMPLE: The following is an example calculation of liquidated damages for the BESS Capacity Performance Metric and is included for illustrative purposes only. Assume the following:

- The Maximum Rated Output for the BESS is 25 MW.
- A BESS Capacity Test was conducted, and the BESS was measured to have discharged 65 MWh
- BESS Contract Capacity = 25 MW x 4 hours = 100 MWh
- BESS Capacity Ratio = MWh Discharged/BESS Contract Capacity = 65 MWh/100 MWh = 0.65
- $LD = [(1 - 0.950) \times 1] + [(0.950 - 0.850) \times 1.5] + [(0.850 - 0.750) \times 2] + [(0.750 - 0.65) \times 2.5] \times \text{BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question} = 0.65 \times \text{BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question.}$

B. BESS Capacity Test Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 3. (BESS Capacity Test and Liquidated Damages) is to compensate Company for the damages that Company would incur if the BESS fails to demonstrate satisfaction of the BESS Capacity Performance Metric during a BESS Measurement Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the BESS is likely to continue to substantially underperform the Company's expectations. Accordingly, and without limitation to Company's rights under said Section 3. (BESS Capacity Test and Liquidated Damages) for those BESS Measurement Periods during which the BESS fails to demonstrate satisfaction of the BESS Capacity Performance Metric, substantial underperformance shall give rise to a termination right as set forth in this Section 3.B. (BESS Capacity Test Termination Rights). If the BESS is in the Lowest BESS Capacity Bandwidth for any two BESS Measurement Periods during a 12-month period, an 18-month cure period (the "BESS Capacity Cure Period") will commence on the Day following the close of the second such BESS Measurement Period. For each BESS Measurement Period during such BESS Capacity Cure Period, BESS Capacity Tests shall continue to be conducted as set forth in Attachment H (BESS Requirements) to this Contract and liquidated damages paid and accepted as set forth in Section 3. (BESS Capacity Test and Liquidated Damages); provided, however, that if the Subscriber Organization fails to demonstrate satisfaction of the BESS Capacity Performance Metric prior to the expiration of the BESS Capacity Cure Period, such failure shall constitute an Event of Default under this Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 13. (Events of Default) Section 14. (Termination for Cause) and Section 15. (Damages in the Event of Termination by Company).

4. BESS ANNUAL EQUIVALENT AVAILABILITY FACTOR; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

A. BESS Annual Equivalent Availability Factor and Liquidated Damages. For each BESS Measurement Period following the Commercial Operations Date, a BESS Annual Equivalent Availability Factor shall be calculated as set forth in Section 2. (BESS Annual Equivalent Availability Factor) of Attachment H. (BESS Requirements). If the BESS Annual Equivalent Availability Factor for such BESS Measurement Period is less than **97%** (the "BESS EAF Performance Metric"), Subscriber Organization shall pay, in accordance with Attachment C Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for such shortfall, the amount set forth in the following table (on a progressive basis) upon proper demand at the end the current BESS Measurement Period:

BESS Annual Equivalent Availability Factor	Liquidated Damage Amount
Tier 1 85.0% - 96.9%	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 97% but equal to or above 85%, an amount equal to one-tenth of one percent (0.001) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus

Tier 2 80.0% - 84.9%	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 85% but equal to or above 80%, an amount equal to two-tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 3 75.0% - 79.9%	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 80% but equal to or above 75%, an amount equal to three-tenths of one percent (0.003) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 4 Below 75.0%	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 75%, an amount equal to four-tenths of one percent (0.004) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question.

For purposes of determining liquidated damages under this Section 4. (BESS Annual Equivalent Availability Factor and Liquidated Damages), the BESS Annual Equivalent Availability Factor for the BESS Measurement Period in question shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the BESS EAF Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

EXAMPLE: The following is an example calculation of liquidated damages for the BESS Annual Equivalent Availability Factor Performance Metric and is included for illustrative purposes only. Assume the following:

The monthly Lump Sum Payment is \$1,000,000

The BESS Annual Equivalent Availability Factor Performance Metric was calculated to be 72.9%.

BESS Allocated Portion of the Lump Sum Payment = 50% x 3 calendar months x \$1,000,000 = \$1,500,000

LD = [((0.970-0.850)x1)+((0.850-0.800)x2)+((0.800-0.750)x3)+((0.750-0.729)x4)] x \$1,500,000

= [0.120 + 0.100 + 0.150 + 0.084] x \$1,500,000 = \$681,000

B. BESS Annual Equivalent Availability Factor Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 4. (BESS Annual Equivalent Availability Factor and Liquidated Damages) is to compensate Company for the damages that Company would incur if the Subscriber Organization fails to achieve the BESS EAF Performance Metric for a BESS Measurement Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the BESS is likely to continue to substantially underperform the BESS EAF Performance Metric. Accordingly, and without limitation to Company's rights under said Section 4. (BESS Annual Equivalent Availability Factor and Liquidated Damages) for those BESS Measurement Periods during which the Subscriber Organization failed to achieve the BESS EAF Performance Metric, the failure of the Subscriber Organization to achieve, for each of six consecutive BESS Measurement Periods, a BESS Annual Equivalent Availability Factor of not less than **75%** shall constitute an Event of Default under Section 13.A. of this Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 13. (Events of Default), Section 14. (Termination for Cause), and Section 15. (Damages in the Event of Termination by Company); provided, however, that if a BESS Measurement Period for which the aforementioned 75% threshold is not achieved falls within a BESS Capacity Cure Period, such BESS Measurement Period shall be excluded from the calculation of the aforementioned "six consecutive BESS Measurement Periods" if the failure to achieve the aforementioned 75% threshold was the result of unavailability caused by the process of carrying out the repairs

to or replacements of the BESS necessary to remedy the failure of the BESS to achieve the BESS Capacity Performance Metric.

5. BESS ANNUAL EQUIVALENT FORCED OUTAGE FACTOR; LIQUIDATED DAMAGES.

A. For each BESS Measurement Period following the Commercial Operations Date, the BESS shall maintain a BESS Annual Equivalent Forced Outage Factor of not more than **4%** (the "BESS EFOF Performance Metric") as calculated as set forth in Section 5. (BESS Annual Equivalent Forced Outage Factor). If the BESS Annual Equivalent Forced Outage Factor for such BESS Measurement Period exceeds the BESS EFOF Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for exceeding the BESS EFOF Performance Metric, the amount set forth in the following table (on a progressive basis) upon proper demand by the Company at the end of the BESS Measurement Period in question:

BESS Annual Equivalent Forced Outage Factor	Liquidated Damage Amount
0.0% - 4.0%	-0-
4.1% - 6.9%	For each one-tenth of one percent (0.001) that the BESS Annual Equivalent Forced Outage Factor is above 4.0% but less than 7.0%, an amount equal to two-tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
7.0% and above	For each one-tenth of one percent (0.001) that the BESS Annual Equivalent Forced Outage Factor is above 6.9%, an amount equal to four-tenths of one percent (0.004) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question

For purposes of determining liquidated damages under this Attachment C Section 5. (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages), the BESS Annual Equivalent Forced Outage Factor for the BESS Measurement Period in question shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the BESS EFOF Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

For example, if the BESS Equivalent Annual Forced Outage Factor was 4.1% as calculated in the example in Section 5. (BESS Annual Equivalent Forced Outage Factor) attached hereto and the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question is \$1,000,000, the liquidated damages would be \$2,000, calculated as follows:

- $4.1\% - 4.0\% = 0.1\%$
- $0.1\%/0.1 = 1$
- $\$1,000,000 \times .002 = \$2,000$
- $\$2,000 \times 1 = \$2,000$

6. BESS ROUND TRIP EFFICIENCY TEST; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

- A. RTE Test and Liquidated Damages. For each BESS Measurement Period following the Commercial Operations Date, the BESS shall be required to complete an RTE Test or otherwise demonstrate satisfaction of the RTE Performance Metric, as more fully set forth in Attachment H (BESS Requirements) to this Contract. For each BESS Measurement Period for which the BESS fails to demonstrate that it satisfies the RTE Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for such shortfall, in the amount to be calculated as provided in this Section 6.A. (RTE Test and Liquidated Damages) and in Attachment B (Company Payments for Energy, Dispatchability and Availability of Bess), upon proper demand at the end of the BESS Measurement Period in question.

The RTE Performance Metric is %. The RTE Performance Metric represents the lowest acceptable efficiency of the BESS for a full charge and discharge cycle if all energy to achieve the full cycle was taken from and delivered to the Point of Interconnection. **[DRAFTING NOTE: PERCENTAGE TO BE TAKEN FROM RESPONSE TO RFP. The metric will remain a “theoretical” POI to POI worse acceptable performance, even though the intake energy measurement used in the RTE test will move electrically closer to the BESS. This is in the Subscriber Organization's favor, as it can expect to gain efficiency (less losses) by moving the intake energy measurement point closer to the BESS as set forth in Attachment H.]**

The liquidated damages threshold ("LDT") is equal to the RTE Performance Metric minus 2 percentage points.

The Selected RTE Test is the RTE Test most recently completed during the BESS Measurement Period in question.

Subscriber Organization shall be liable for liquidated damages if:

$$(PM - RTE Ratio) > 2\%$$

Where:

PM = RTE Performance Metric stated as percentage

RTE Ratio = RTE Ratio from Selected RTE Test stated as percentage

For each percentage point by which the RTE Ratio is below the LDT, Subscriber Organization shall pay, and Company shall accept, liquidated damages in an amount equal to two-tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question.

Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the RTE Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

- B. RTE Test Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 6.A. (RTE Test and Liquidated Damages) is to compensate Company for the damages that Company would incur if the BESS fails to demonstrate satisfaction of the RTE Performance Metric during a BESS Measurement Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the BESS is likely to continue to substantially underperform the Company's expectations. Accordingly, and without limitation to Company's rights under said Section 6. A. (RTE Test and Liquidated Damages) for those BESS Measurement Periods during which the BESS fails to demonstrate satisfaction of the RTE Performance Metric, substantial underperformance shall give rise to a

termination right as set forth in this Section 6.B. (RTE Test Termination Rights). If the RTE Ratio for the Selected RTE Test for the BESS Measurement Period in question is more than 15 percentage points below the RTE Performance Metric for any two BESS Measurement Periods during a 12-month period, an 18-month cure period (the "RTE Cure Period") will commence on the Day following the close of the second such BESS Measurement Period. For each BESS Measurement Period during such RTE Cure Period, RTE Tests shall continue to be conducted as set forth in Attachment H (BESS Requirements) and liquidated damages paid and accepted as set forth in Section 6.A. (RTE Test and Liquidated Damages); provided, however, that if the Subscriber Organization fails to demonstrate satisfaction of the RTE Performance Metric prior to the expiration of the RTE Cure Period, such failure shall constitute an Event of Default under Section 13. of this Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 13. (Events of Default) and Section 15. (Damages in the Event of Termination by Company) of this Contract.

7. **[RESERVED]**

8. **PAYMENT OF LIQUIDATED DAMAGES FOR FAILURE TO ACHIEVE PERFORMANCE METRICS; LIMITATION ON LIQUIDATED DAMAGE.**

A. Payment of Performance Metrics LDs by Subscriber Organization. With respect to the liquidated damages payable under Section 1. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages), Section 2. (Measured Performance Metric; Liquidated Damages; Termination Rights) Section 3. (BESS Capacity Test and Liquidated Damages), Section 4. (BESS Annual Equivalent Availability Factor and Liquidated Damages), Section 5. (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages) and Section 6. (BESS Round Trip Efficiency Test; Liquidated Damages; Termination Rights) (collectively, the "Performance Metrics LDs"), Company shall have the right, at any time on or after the LD Assessment Date for the liquidated damages in question, at Company's option, to set-off such liquidated damages from the amounts to be paid to Subscriber Organization for the Unsubscribed RDG or, to draw such liquidated damages from the Operating Period Security, as follows:

~~1. if the BESS fails to achieve the BESS Capacity Performance Metric for a BESS Measurement Period, the Company shall have the right to set-off or draw the amount owed for such failure as calculated as provided in Section 3. (BESS Capacity Test and Liquidated Damages); and~~

1. [Reserved]

2. if the Monthly Report for the calendar month, MPR Assessment Period, or BESS Measurement Period in question, as applicable, shows a failure to achieve one or more of the Performance Metrics required for the LD Period in question, the MPR Measurement Period in question, or the BESS Measurement Period in question, as applicable, and Company does not submit a Notice of Disagreement with respect to such Monthly Report, the Company shall have the right to set-off or draw the amount of liquidated damages owed for such failure as calculated as provided in Section 1. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages), Section 2. (Measured Performance Metric; Liquidated Damages; Termination Rights), Section 3. (BESS Capacity Test and Liquidated Damages), Section 4. (BESS Annual Equivalent Availability Factor and Liquidated Damages), Section 5. (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages), and Section 6. (BESS Round Trip Efficiency Test; Liquidated Damages; Termination Rights) as applicable;

3. in all cases in which Company submits a Notice of Disagreement for a given Monthly Report, Company shall have the right to set-off or draw all or any portion of the amount of liquidated damages for the calendar month in question, MPR Assessment Period in question, or BESS Measurement Period in question, as applicable, as calculated on the basis of the shortfall(s) in the achievement of the Performance Metric(s) in question, as shown in such Notice of Disagreement; and

4. in the event of any disagreement as to the liquidated damages owed under clause 8.A.1. and 8.A.3.above:

- a. if the amount set-off or drawn by the Company exceeds the amount of liquidated damages for such calendar month, BESS Measurement Period or MPR Assessment Period that are eventually found to be payable for the LD Period in question as determined under Section 2. (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract, Company shall promptly (and in no event more than forty-five (45) Business Days from the date of such determination) repay such excess to Subscriber Organization together with, unless the Parties otherwise agree in writing, interest from the date of Company's set-off or draw until the date that such excess is repaid to Subscriber Organization at the average Prime Rate for such period; and
- b. if Company does not exercise its rights to set-off or draw liquidated damages for such calendar month, BESS Measurement Period or MPR Assessment Period, or does not set-off or draw the full amount of the liquidated damages for such calendar month, BESS Measurement Period or MPR Assessment Period that are eventually found to be payable for the LD Period, BESS Measurement Period or MPR Assessment Period in question as determined under Section 2. (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract, Subscriber Organization shall promptly, upon such determination as aforesaid, pay to Company the amount of liquidated damages that are found to be owing together with, unless otherwise agreed by the Parties in writing, interest on the amount of such liquidated damages that went unpaid from the applicable LD Assessment Date for such liquidated damages until the date such liquidated damages are paid to Company in full at the average Prime Rate for such period, and Company shall have the right, at its option, to set-off such interest from the amounts to be paid to Subscriber Organization for the Unsubscribed RDG or to draw from the Operating Period Security.

Any delay by Company in exercising its rights to set-off liquidated damages and/or interest from the amounts to be paid to Subscriber Organization for the Unsubscribed RDG or to draw such liquidated damages and/or interest from the Operating Period Security shall not constitute a waiver by Company of its right to do so.

- B.** Limitation on Liquidated Damages. Notwithstanding any other provision of this Contract to the contrary, the aggregate liquidated damages paid by Subscriber Organization during each Contract Year for the Performance Metrics LDs, such payments by Subscriber Organization to include but not be limited to any set-offs or draws made by Company during such Contract Year pursuant to Section 8 A. (Payment of Performance Metrics LDs by Subscriber Organization) of this Attachment C (Required Performance Metrics; Liquidated Damages), shall not exceed the total of the twelve (12) monthly Lump Sum Payments payable during such Contract Year pursuant to Section 4.B. (Lump Sum Payment) and Section 4.G. (Payment Procedures) of the Contract. For avoidance of doubt: A monthly Lump Sum Payment that is invoiced by Subscriber Organization to Company pursuant to Section 4.F. (Subscriber Organization's Preparation of the Monthly Invoice) for, e.g., the twelfth (12th) calendar month of Contract Year N but is paid during Contract Year N+1 as provided in Section 4.G. (Payment Procedures) shall, for purposes of determining the limitation on Performance Metrics LDs under this Section 8.B. (Limitation on Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages), be included in the total of the twelve (12) monthly Lump Sum Payments payable during Contract Year N+1. As a result of the foregoing, the total of the monthly Lump Sum Payments used to establish the limitation on Performance Metrics LDs for the initial Contract Year under this Section 8.B. (Limitation on Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) will be less than twelve (12). The Parties acknowledge that, because the monthly Lump Sum Payment is subject to adjustment (including downward adjustment) as provided in Section 4.B. of the Contract (Lump Sum Payment), it is possible that a downward adjustment in some or all of the monthly Lump Sum Payments payable during a Contract Year might cause the Performance Metrics LDs paid by Subscriber Organization during the course of such Contract Year to exceed the limitation on the Performance Metrics LDs for such Contract Year established at the close of such Contract Year pursuant to the first sentence of this Section 8.B. (Limitation on Liquidated Damages). In such case, Company shall promptly upon the determination that the Performance Metrics LDs paid during the

course of such Contract Year exceeded the limitation on Performance Metrics LDs for such Contract Year (and in no event more than forty-five (45) Business Days from the end of such Contract Year) repay such excess amount to Subscriber Organization without interest.

C. Payment of Shortfall Performance Metrics LDs by Reduction of Bill Credits.

1. If Performance Metrics LDs remain unpaid after Company has exercised its rights under Attachment C Section 8.A. (Payment of Performance Metrics LDs by Subscriber Organization) to set off such liquidated damages from the amounts to be paid to Subscriber Organization and to draw such liquidated damages from the Operating Period Security, the Company shall have the right to pay such unpaid Performance Metrics LDs ("Shortfall Performance Metrics LDs") by reducing Bill Credits in the aggregate amount of such unpaid Shortfall Performance Metrics LDs. The reduction in Bill Credits shall be proportionate so that the burden of paying the Shortfall Performance Metrics LDs is shared equitably among the Subscribers.
2. In the event of any disagreement under Attachment C Section 8.A. (Payment of Performance Metrics LDs by Subscriber Organization) as to the amount of liquidated damages owing:
 - a. Upon the resolution of such disagreement pursuant to Section 2. (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract, if such resolution has the effect of reducing the Shortfall Performance Metrics LDs, and if such reduction in the Shortfall Performance Metrics LDs has the effect of causing the reduction in Bill Credits previously implemented by Company to exceed the actual amount of the Shortfall Performance Metrics LDs (the amount of such excess being referred to herein on the "Excess Reduction in Bill Credits"), Company shall promptly (and in no event later than the second billing cycle for each Subscriber following the date of the resolution of such disagreement as aforesaid) afford to such Subscriber a Bill Credit (referred to herein as a "Compensatory Bill Credit") in an amount equivalent to the total of (i) such Subscriber's proportionate share of the Excess Reduction in Bill Credits and (ii), unless the Company and Subscriber Organization otherwise agree in writing as provided Section 4.A., interest on the amount of the Excess Reduction in Bill Credits from the date Company implemented such Excess Reduction in Bill Credits with respect to such Subscriber until the date that Company applies the Compensatory Bill Credit against such Subscriber's retail electric service bill, at the average Prime Rate for such period; and
 - b. upon the resolution of such disagreement pursuant to Section 2. (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract, if Company has not previously exercised -its rights to set-off or draw liquidated damages pursuant to Section 8.A. (Payment of Performance Metrics LDs by Subscriber Organization), or has not previously set-off or drawn from the Performance Security the full amount of the liquidated damages that are eventually found to be payable as a result of the resolution of such disagreement, ,Company shall have the right to reduce Subscriber Bill Credits in an amount equal to the total of Subscribers' share of pay such Shortfall Performance Metrics LDs.

--END--

ATTACHMENT D

CALCULATION AND ADJUSTMENT OF NET ENERGY POTENTIAL

1. NET ENERGY POTENTIAL.

A. Net Energy Potential and the Intent of the Parties. The essence of this Attachment D is that Company is paying to Subscriber Organization a Lump Sum Payment in exchange for Company's right to dispatch, subject to Renewable Resource Variability, the Facility's Net Energy Potential. Under this Attachment D, "Net Energy Potential": (i) constitutes an estimated single number with a P-Value of 95 for annual Net Energy that could be produced by the Facility based on the estimated long-term monthly and annual total of such production over a period of ten years excluding losses due to availability and Company Dispatch; (ii) is subject to adjustment from time to time as provided in this Attachment D (Calculation and Adjustment of Net Energy Potential); and (iii) as so adjusted, provides a basis for calculating and adjusting the Lump Sum Payment, as provided in Section 3. (Calculation of Lump Sum Payment) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to the Contract. The Net Energy Potential shall be calculated using, but not limited to, long-term resource data correlated with on-site measurements (if available), the most current construction design and equipment specifications, and industry-accepted energy simulation models. Loss factors and uncertainty analysis are to be determined using industry best practices and standard assumptions. Loss factors shall include, but not be limited to, electrical losses. Loss factors will exclude losses due to availability and Company Dispatch. In the case of the Initial OEPR and any Subsequent OEPR evaluation, the Net Energy Potential shall also consider historical operational data further described in this Attachment D Section 2.E. It is the intent of the Parties that the estimate of Net Energy Potential, as calculated and adjusted as aforesaid, should reflect the following risk allocation between the Parties under the Contract:

1. Subscriber Organization has assumed the risk of downward adjustment to the Net Energy Potential (and hence the Lump Sum Payment) to account for any of the following circumstances:
 - a. if the Renewable Resource Baseline (as estimated on the basis of the typical meteorological year as derived from the Site's measured meteorological data) is lower than Subscriber Organization had assumed when it submitted its RFP Proposal;
 - b. if the as-built design and construction of the Facility is not as efficient in generating electrical energy and delivering such electric energy to the Point of Interconnection as Subscriber Organization had assumed when it submitted its RFP Proposal; and
 - c. if the Facility's level of operational efficiency is below the standard of comparable facilities;
 - d. Company has assumed the risk of the following (i.e., the following are to be disregarded for purposes of estimating Net Energy Potential (and hence the Lump Sum Payment)):
 - e. Renewable Resource Variability; and
 - f. the possibility that, at any given moment, Company does not need to dispatch any or all of the electric energy that the Facility is then capable of generating and delivering to the Point of Interconnection.
2. The foregoing is not intended as an exhaustive list of the risks assumed by either Party under this Attachment D or as a limitation on the circumstances that an OEPR Evaluator, in its professional judgment, may decide to take into account in preparing its OEPR under Section 2.E. (Terms of Engagement) of this Attachment D (Calculation and Adjustment of Net Energy Potential).

- B. NEP RFP Projection.** In its RFP Proposal, the Subscriber Organization projected that the Facility would have a Net Energy Potential (as defined in this Attachment D) of [REDACTED] MWh [NOTE – INSERT NEP FROM RFP PROPOSAL] and provided the plane of array irradiance data used in arriving at the NEP RFP Projection, and Company relied on Subscriber Organization's NEP RFP Projection in deciding to contract with Subscriber Organization in lieu of other developers. Among the fundamentals of the bargain evidenced in this Attachment D is that there will be consequences to Subscriber Organization if (i) the IE Energy Assessment does not support the NEP RFP Projection and/or (ii) the operational performance of the Facility indicates a Net Energy Potential that is below the applicable thresholds set forth in this Attachment D (Calculation and Adjustment of Net Energy Potential).
- C. NEP IE Estimate and Company-Designated NEP Estimate.** Prior to the closing of the construction financing for the Facility but in no event later than the Commercial Operations Date, the Subscriber Organization shall provide Company with a copy of the IE Energy Assessment Report and the data on plane of array irradiance and corresponding power output used in arriving at the NEP IE Estimate. In addition, Subscriber Organization shall obtain from the administrative agent of the Facility Lender and provide to Company, at financial close of the construction debt financing, a confirmation letter confirming to Company that the IE Energy Assessment Report including the data on plane of array of irradiance and corresponding power output used in arriving at the NEP IE Estimate provided by Subscriber Organization to Company is the final energy assessment prepared for the Facility Lender as part of the Facility Lender's due diligence leading up to the Facility Lender's legally binding commitment (subject to certain conditions precedent) to provide a specific amount of financing for the Project as evidenced by the Facility Lender's execution of the Financing Documents. If the IE Energy Assessment Report fails to provide a NEP IE Estimate that is consistent with the requirements of this Attachment D in all material respects, or if the data on plane of array of irradiance and corresponding power output used in arriving at the NEP IE Estimate is not provided, or if the aforementioned confirmation letter is not provided, Company shall have the option, exercisable by written notice to Subscriber Organization issued no later than 30 Days, or such longer period as the Parties may agree in writing, following the first to occur of Company's receipt of (i) the IE Energy Assessment Report or (ii) notice that Company will not be provided with a copy of the IE Energy Assessment Report and the data on plane of array of irradiance, ambient temperature, wind speed and corresponding power output used in arriving at the NEP IE Estimate, to designate such Company-Designated NEP Estimate as Company, in its sole discretion, determines to be reasonable in light of the information then available to Company. In connection with Company's decision as to whether to designate a Company-Designated NEP Estimate, Company shall have the right to require Subscriber Organization to pay for an energy assessment to be performed by an independent engineer selected by Company. In such case, the aforesaid 30-Day period for Company's decision to designate a Company-Designated NEP Estimate shall be tolled for the time necessary to prepare such assessment. If Company fails, within the aforesaid 30-Day period as such period may be tolled as provided in the preceding sentence, to designate a Company-Designated NEP Estimate, the NEP RFP Projection shall constitute the First NEP Benchmark, unless the Parties agree in writing on a lower First NEP Benchmark.
- D. NEP IE Estimate, Liquidated Damages and Subscriber Organization's Null and Void Right.** If the NEP IE Estimate is higher than the NEP RFP Projection, the NEP RFP Projection shall constitute the First NEP Benchmark. In any other case, Subscriber Organization shall have the option to declare the Contract null and void by written notice to Company as follows:
1. if (aa) the NEP IE Estimate is lower than the NEP RFP Projection and (bb) Subscriber Organization issues its null and void notice to Company not later than 30 Days after issuance of the IE Energy Assessment Report; or
 2. if (aa) Company exercises its right to designate a Company-Designated NEP Estimate under Section 1. C. (NEP IE Estimate and Company-Designated NEP Estimate) of this Attachment D (Calculation and Adjustment of Net Energy Potential), (bb) such Company-Designated NEP Estimate is lower than the NEP RFP Projection, and (cc) Subscriber Organization issues its null and void notice to Company not later than 30 Days after Company's notice of the Company-Designated NEP Estimate.

3. If Subscriber Organization fails to declare this Contract null and void under the conditions set forth in either clause (1) or clause (2) above, then: (x) the NEP IE Estimate or the Company-Designated NEP Estimate, as applicable, shall thereafter constitute the First NEP Benchmark and (y) Subscriber Organization shall, within five (5) Business Days following the expiration of the applicable 30-Day period for the issuance of Subscriber Organization's null and void notice, pay liquidated damages equal to \$10 for every MWh by which the NEP RFP Projection exceeds the First NEP Benchmark for the initial Contract Year.
- E. Initial OEPR.** Following the Initial NEP Verification Date, the Initial OEPR shall be prepared pursuant to the process set forth in Section 2. (Preparation of OEPR) of this Attachment D (Calculation and Adjustment of Net Energy Potential) and the Initial NEP OEPR Estimate shall be as set forth in or derived from the Initial OEPR, as more fully set forth in Section 2. E. (Terms of Engagement) of this Attachment D (Calculation and Adjustment of Net Energy Potential). If the Initial NEP OEPR Estimate differs from the First NEP Benchmark, the Lump Sum Payment shall be recalculated and adjusted as provided in Section 3.B. (Lump Sum Payment during Second Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to the Contract.
- F. Subsequent OEPRS.**
1. Required Subsequent OEPR. If Subscriber Organization makes any changes to the Facility that involve (i) replacing any step-up transformer(s) or (ii) making any other changes (e.g., changing the characteristics of the Facility equipment or the specifications used in the IRS) that Company reasonably determines require an updated IRS, then Subscriber Organization shall also be required to have a subsequent OEPR prepared as of the first Day of the calendar month following the second anniversary of the date such change to the Facility was completed.
 2. Voluntary Subsequent OEPR. Without limitation to the generality of Section F.1. (Required Subsequent OEPR) of this Attachment D (Calculation and Adjustment of Net Energy Potential), if the Subscriber Organization makes any changes to the Facility (e.g., replacing original equipment) that does not trigger a required Subsequent OEPR but which changes Subscriber Organization has reasonable grounds to believe will improve the Facility's Net Energy Potential, Subscriber Organization shall have a one-time option, exercisable by written notice to Company issued not less than 120 Days prior to the Applicable NEP Verification Date, of having a subsequent OEPR prepared as of a date no sooner than 12 months following completion of the then most recent OEPR.
 3. Subsequent OEPR and Adjustment to Lump Sum Payment. If the Subsequent NEP OEPR Estimate differs from ~~the 1. F. Most~~ the Most Recent Prior NEP Benchmark, the Lump Sum Payment shall be recalculated and adjusted as provided in Section 3.B. (Lump Sum Payment Following Second Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to the Contract.
- 2. PREPARATION OF OEPR.** The following provisions apply to the Initial OEPR and any Subsequent OEPR:
- A. Selection of OEPR Evaluator.** No later than 90 Days prior to the Applicable NEP Verification Date, Company and Subscriber Organization shall select, in accordance with the terms of this Section 2.A. (Selection of OEPR Evaluator), an independent engineering firm from the firms listed on the OEPR Consultants List (the "OEPR Evaluator") to prepare an operational energy production report ("OEPR"). Each party shall select the names of two (2) firms from the OEPR Consultants List. If there is mutual agreement on one or both of the named firms, then the Subscriber Organization shall select one of the named firms to serve as the OEPR Evaluator. If there is no agreement on any of the named firms, then Subscriber Organization shall select one of the firms named by the Company.
 - B. Eligibility for Appointment as OEPR Evaluator.** Both Parties agree that the engineering firms listed in Section 2. J. of this Attachment D (Calculation and Adjustment of Net Energy Potential) are fully qualified to prepare the OEPR. By mutual agreement between the Parties in writing, both Parties acting reasonably, a name or

names may be added to or removed from the OEPR Consultants List at any time. In no event shall there be less than three (3) names on the OEPR Consultants List.

- C. OEPR Period of Record. It is the intent of the Parties that the OEPR shall be prepared using measured meteorological and production data from the OEPR Period of Record. However, although the OEPR Period of Record is a twelve-month period, the Parties acknowledge that, in certain circumstances (e.g., Force Majeure), there may not be twelve months of data available for the OEPR Period of Record. In such case, (i) it is the intent of the Parties that the OEPR be prepared using such measured meteorological and production data that is available from the OEPR Period of Record and (ii) Parties may, by written agreement, direct the OEPR Evaluator to use such additional data outside of the OEPR Period of Record as the Parties may agree. The preceding sentence does not constitute a limitation on the professional judgment of the OEPR Evaluator as to the appropriateness of using measured meteorological and/or production from outside of the OEPR Period of Record.
- D. Participation of Parties. Promptly following the Applicable NEP Verification Date, Subscriber Organization and Company shall provide the OEPR Evaluator with such data from the OEPR Period of Record as they consider to be material to the preparation of the OEPR. Subscriber Organization and Company shall also provide such additional data and information as the OEPR Evaluator may reasonably request. The Parties shall assist the OEPR Evaluator throughout the process of preparing the OEPR, including making key personnel and records available to the OEPR Evaluator, but neither Party shall be entitled to participate in any meetings with personnel of the other Party or review of the other Party's records. However, the OEPR Evaluator will have the right to conduct meetings, hearings or oral arguments in which both Parties are represented. Subscriber Organization and Company shall have forty-five (45) Days from issuance of the draft OEPR Report to review and provide feedback to the OEPR Evaluator on such report.
- E. Terms of Engagement. Upon selection of the OEPR Evaluator, as set forth in this Attachment D (Calculation and Adjustment of Net Energy Potential), the Subscriber Organization shall retain and contract with the OEPR Evaluator in accordance with the terms of this Attachment D (Calculation and Adjustment of Net Energy Potential). The OEPR Evaluator's scope of work and expected deliverables for all OEPRs must be acceptable to Company and shall, among other things, require the OEPR Evaluator to provide (i) an estimated single number with a P-Value of 95 for annual Net Energy that could be produced by the Facility based on the estimated long-term monthly and annual total of such production over a period of ten years; (ii) the data on plane of array of irradiance and corresponding power output used in arriving at the aforementioned estimated annual Net Energy; (iii) the GPR Performance Metric as provided in Section 1.E. (Commencing With Initial OEPR) or Section 1.F. (Commencing With First Subsequent OEPR and Thereafter) of this Attachment D, as applicable; and (iv) any additional information that may be reasonably required by a Party with respect to the methodology used by the OEPR Evaluator to reach its conclusion. The provisions of this Attachment D (Calculation and Adjustment of Net Energy Potential) do not impose a limit on the OEPR Evaluator's professional judgment as to what other estimates (if any) to include in the OEPR. Without limiting the professional judgment of the OEPR Evaluator in estimating the Net Energy Potential and GPR Performance Metric, the following is a general description of how the Parties anticipate that the OEPR Evaluator will proceed:
1. The purpose of an OEPR is to implement the intent of the Parties as set forth in Section 1. A. (Net Energy Potential and the Intent of the Parties) of this Attachment D (Calculation and Adjustment of Net Energy Potential) by evaluating (i) whether, when the Renewable Resource Baseline (as estimated by the OEPR Evaluator on the basis of the typical meteorological year as derived from the Site's measured meteorological data) is present and the Facility is in Full Dispatch, the Facility is capable of doing what the Parties expected the Facility to do: i.e., generating and delivering to the Point of Interconnection electric energy in an amount consistent with the then applicable Net Energy Potential of the Facility (i.e., the estimate of Net Energy Potential then being used to calculate the monthly Lump Sum Payment pursuant to Section 3. (Calculation of Lump Sum Payment) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS to the Contract); and (ii) if the Facility is not doing what the parties expected in this regard, identifying a new estimated single number with a P-Value of 95 for annual Net Energy that could be

generated and delivered by the Facility based on the estimated long-term monthly and annual total of such production over a period of the next ten years.

2. At a high level, the analysis relies on reported Actual Output (i.e., energy delivered to the Point of Interconnection) during the OEPR Period of Record to estimate Facility performance over a future evaluation period of ten years. The data from the OEPR Period of Record are first quality screened and evaluated. One-time events are assessed and removed from the record where appropriate. Values for potential energy are then calculated from the reported energy production measured at the Point of Interconnection by adjusting for 100% availability and undischarged energy. Suitable long-term reference data sets are then identified by analyzing the reference for irradiance and the normalized values for potential energy production at the Point of Interconnection over the OEPR Period of Record. Relationships between selected long-term reference irradiance data sets and normalized values for potential energy production at the Point of Interconnection are used to calculate long-term values for such on a monthly and annual basis. Finally, estimates of future Facility availability (taking into account anticipated maintenance) and losses (such as system degradation and balance of plant losses) are applied in order to calculate the Net Energy Potential. For this purpose, no reductions are made for future estimates of energy that Company may choose not to dispatch. If a copy of the IE Energy Assessment Report is available to the OEPR Evaluator, the OEPR Evaluator should review such Report before commencing preparation of the OEPR and evaluate whether it is appropriate for the OEPR Evaluator to take into account any of the work reflected in the IE Energy Assessment Report.
- F. Timeline and Fees. The terms of engagement with the OEPR Evaluator shall require the OEPR Evaluator to provide, for Party review, a draft OEPR that shall include a NEP OEPR Estimate and a Guaranteed Measured Performance Ratio Benchmark within 30 Days following the NEP Applicable Verification Date ("First OEPR"). The OEPR Evaluator shall be required to provide its completed OEPR within 30 Days following the end of the Parties' 45-Day review period under Section 2.D. (Participation of the Parties) of this Attachment D (Calculation and Adjustment of Net Energy Potential). The Parties shall each pay fifty percent (50%) of the fees and expenses charged by the OEPR Evaluator in connection with the Initial OEPR. For the Initial OEPR, the OEPR Evaluator's fees and costs must be acceptable to Company. Subscriber Organization shall pay all of the fees and expenses charged by the OEPR Evaluator in connection with any Subsequent OEPR. Subscriber Organization shall also pay for any reasonable internal fees and costs incurred by the Company as a result of its participation in the process set forth in Section 2.D. (Participation of Parties) of this Attachment D (Calculation and Adjustment of Net Energy Potential).
- G. Review of the First OEPR or and Subsequent OEPR Report. In the event Company or Subscriber Organization does not agree with the NEP OEPR Estimate or GPR Performance Metric determined by the First OEPR Evaluator, Subscriber Organization or Company may, within 30 Days of issuance of the First OEPR, engage, at its own cost, a different expert evaluator from the OEPR Consultants List (the "Second OEPR Evaluator") to prepare a second OEPR that shall include a NEP OEPR Estimate or GPR Performance Metric, as applicable ("Second OEPR"). The terms of engagement with the Second OEPR Evaluator shall require the Second OEPR Evaluator to issue the Second OEPR within 60 Days following the date of its appointment. In the event the NEP OEPR Estimates or GPR Performance Metric, as applicable, provided by the First OEPR Evaluator and the Second OEPR Evaluator are different then, within ten (10) Days of the issuance of the Second OEPR, the Parties shall, with the two evaluators, confer in an attempt to mutually agree upon a NEP OEPR Estimate or GPR Performance Metric, as applicable ("OEPR Conference").
- H. Review of the Second OEPR Evaluator Report. If the Parties are unable to agree upon an NEP OEPR Estimate or GPR Performance Metric, as applicable, within 30 Days of the OEPR Conference, then within ten (10) Days thereafter the First OEPR Evaluator and Second OEPR Evaluator shall, by mutual agreement, select a third firm from the OEPR Consultants List to act as an independent OEPR Evaluator ("Third OEPR Evaluator"). The Third OEPR Evaluator shall not be a person from the same entity as the First OEPR Evaluator or the Second OEPR Evaluator. The Parties shall direct the Third OEPR Evaluator to review the First OEPR and Second OEPR and select one as the final and binding NEP OEPR Estimate and/or GPR Performance Metric, as applicable ("Third OEPR"). The Third OEPR Evaluator shall complete its review and selection of the NEP

OEPR Estimate within thirty (30) Days following his or her retention. If the Third OEPR Evaluator selects the First OEPR, then the Party requesting the Second OEPR shall pay for the cost of the Third OEPR. If the Third OEPR Evaluator selects the Second OEPR, then the Parties shall each pay fifty percent (50%) of the fees and expenses charged by the Third OEPR Evaluator in connection with the Third OEPR.

- I. Final, Binding and Conclusive. The Parties acknowledge the inherent uncertainty in estimating the Net Energy Potential and GPR Performance Metric and hereby assume the risk of such uncertainty and waive any right to dispute any of the qualification of the person or entity appointed as the OEPR Evaluator pursuant to Section 2. A. (Selection of OEPR Evaluator) and Section 2.B. (Eligibility for Appointment as OEPR Evaluator) of this Attachment D (Calculation and Adjustment of Net Energy Potential), the appropriateness of the methodology used by OEPR Evaluator in preparing the OEPRs, the NEP OEPR Estimate and/or the GPR Performance Metric. Without limitation to the generality of the preceding sentence, the determination of the NEP OEPR Estimate and GPR Performance Metric in the First OEPR, Second OEPR (if applicable), or final decision of the Third OEPR Evaluator (if applicable) shall be final, conclusive and binding upon Company and Subscriber Organization and shall not be subject to further dispute under Section 17. (Dispute Resolution) of the Contract; provided that, nothing in this Section 2. I. (Final, Binding and Conclusive) of this Attachment D (Calculation and Adjustment of Net Energy Potential) shall preclude Subscriber Organization from engaging an OEPR Evaluator to issue a Subsequent OEPR as allowed pursuant to Section 1.F. (Subsequent OEPRs) of this Attachment D (Calculation and Adjustment of Net Energy Potential).
- J. Acceptable Persons and Entities. The OEPR Evaluator and Second OEPR Evaluator shall be selected from the following engineering firms listed below, subject to such additions or deletions effectuated by the Parties as provided in Section 2.(f) (Eligibility for Appointment as Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to the Contract and Section 2. B. (Eligibility for Appointment as OEPR Evaluator) of this Attachment D (Calculation and Adjustment of Net Energy Potential):
- DNV GL
 - UL
 - Black & Veatch
 - Leidos Engineering

--END--

ATTACHMENT E

**MONTHLY REPORTING AND DISPUTE
RESOLUTION BY INDEPENDENT AF EVALUATOR**

1. **MONTHLY REPORT.** Commencing with the month during which the Commercial Operations Date is achieved, and for each calendar month thereafter during the Term, Subscriber Organization shall provide to Company a Monthly Report in Excel, Lotus or such other format as Company may require (“Monthly Report”), which Monthly Report shall include (i) the data for the calendar month in question populated into the form of the “PV System Monthly Report” below, (ii) the data for the BESS Measurement Period ending with the calendar month in question populated into the form of "BESS Measurement Period Report" below, and (iii) Subscriber Organization's calculations of the performance metrics and any liquidated damages assessments for the LD Period ending with such calendar month as set forth below. Subscriber Organization shall deliver such Monthly Report to Company by the tenth (10th) Business Day following the close of the calendar month in question. Subscriber Organization shall deliver the Monthly Report electronically to the address provided by the Company. Company shall have the right to verify all data set forth in the Monthly Report by inspecting measurement instruments and reviewing Facility operating records. Upon Company's request, Subscriber Organization shall promptly provide to Company any additional data and supporting documentation necessary for Company to audit and verify any matters in the Monthly Report.

PV System Monthly Report

NAME OF IPP FACILITY: [Facility Name]

MONTHLY REPORT PERIOD: [Month Day, Year] to [Month Day, Year]

Enter the information for each Force Majeure event effecting the PV System during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of devices for item (D), total number of devices is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of effect in MW or Number of devices that are offline (D)	Contract Capacity or Total number of devices in the effected system (E)	Equivalent Hours (hrs) (C x D)/E
...					

Calendar hours in the reporting period: _____

Total equivalent hours for the reporting period (from above, with proper accounting for any simultaneous events): _____

Please provide the following availability information even in months containing Force Majeure even though it will not be applied in the PV System EAF Calculation.

Enter the information for each Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 2 decimal places.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (B-A)
...		

Calendar hours in the reporting period: _____

Total Outage hours for the reporting period (from above): _____

Available Hours (AH) in the reporting period: _____

AH from the last eleven (11) reporting periods: _____

AH for the last twelve (12) reporting periods: _____

Enter the information for each Subscriber Organization Attributable Derating events during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of inverters for item (D), total number of inverters is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of derating in MWs or Number of Inverters (D)	Contract Capacity or Total number of Inverters in the PV System (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total Equivalent Subscriber Organization Attributable Derated hours (ESADH) for the reporting period: _____

ESADH from the last eleven (11) reporting periods: _____

ESADH for the last twelve (12) reporting periods: _____

Enter the information for each Planned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of inverters for item (D), total number of inverters is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of derating in MWs or Number of Inverters (D)	Contract Capacity or Total number of Inverters in the PV System (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total equivalent planned derated hours (EPDH) for the reporting period: _____

EPDH from the last eleven (11) reporting periods: _____

EPDH for the last twelve (12) reporting periods: _____

Enter the information for each Unplanned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of inverters for item (D), total number of inverters is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of derating in MWs or Number of Inverters (D)	Contract Capacity or Total number of Inverters in the PV System (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total equivalent unplanned derated hours (EUDH) for the reporting period: _____

EUDH for the last eleven (11) reporting periods: _____

EUDH for the last twelve (12) reporting periods: _____

Period Hours (PH) is : (8760 hours if no 29th day in February in that last twelve months; otherwise 8784 hours; also can be adjusted appropriately depending on any month(s) containing Force Majeure in the last 12 reporting periods.)

Enter the Available Hours, ESADH, EPDH, and EUDH for the last twelve (12) reporting periods as calculated above **and use the correct PH.**

AH (A)	ESADH (B)	EPDH (C)	EUDH (D)	PV System Annual Equivalent Availability Factor 100% x (A – B – C – D)/PH

If the month for which this monthly report has been prepared contains a Force Majeure event, please indicate the PV System Annual Equivalent Availability Factor calculated in the previous month’s monthly report.

Enter the following properties for the facility’s PV panels that are used in the calculation of the Measured Performance Ratio. Refer to Attachment C (Required Performance Metrics; Liquidated Damages) to the Contract for the definitions of terms.

- DC rated capacity of the system at standard test conditions ($P_{DC_{STC}}$): _____
- Temperature coefficient of power in %/°C(δ): _____
- Temperature empirical constant (a): _____
- Wind speed empirical constant (b): _____
- Conduction temperature coefficient (dT_{cond}): _____
- Annual average irradiance-weighted cell temperature ($T_{cell_typ_avg}$) _____

For the reporting period, provide the 15-minute interval averaged site data for the following measurements in .csv format (refer to Attachment C (Required Performance Metrics; Liquidated Damages) for the definitions of terms). The data set should include an indication of whether each interval is included or excluded in the calculation of the Measured Performance Ratio and the reason for exclusion (refer to Attachment C (Required Performance Metrics; Liquidated Damages) for data requirements).

Measured data:

- P_{AC_i} is the apparent power output of the PV System measured at the POI averaged over time period i (MW)
- P_{DC_i} is the measured DC power output of the PV System measured at the DC input to the BESS charging system averaged over time period i (MW)
- G_{POA_i} is the measured plane of array irradiance averaged over time period i (W/m^2);
- T_{a_i} is the measured ambient temperature averaged over time period i [°C]
- WS_i is the measured wind speed corrected to a measurement height of 10 meters (using the anemometer height and proper Hellmann coefficient) averaged over time period i [m/s]

Calculated data:

- Computed cell temperature (T_{cell_i})

Using the data provided above, enter the calculated values for Measured Performance Ratio rounded to the third decimal place (0.001).

Measured Performance Ratio for the reporting period: _____

Measured Performance Ratio for this reporting period and the previous eleven
(11) reporting periods: _____

Enter the Applicable Contract Year and calculated Degradation Factor for the reporting period. Refer to Attachment C (Required Performance Metrics; Liquidated Damages) for how these should be calculated.

Applicable Contract Year: _____

Degradation Factor: _____

BESS Measurement Period Report

NAME OF IPP FACILITY: [Facility Name]

BESS MEASUREMENT PERIOD: [Month Day, Year] to [Month Day, Year]

Enter the applicable information operational data collected during the most recently completed BESS Capacity Test to demonstrate satisfaction of the BESS Capacity Performance Metric during the reporting period. This can either be from the most recent BESS Capacity Test performed during the period or taken from operating data reflecting the net output of the BESS.

Date/Time Start	Date/Time End	Total MWh delivered to the POI (A)	BESS Contract Capacity (MWh) (B)	BESS Capacity Ratio 100% x (A/B)

Enter the applicable information ~~from operational data collected during the most recently completed BESS RTE Test~~ to demonstrate satisfaction of the BESS Round Trip Efficiency Performance Metric during the reporting period. This can either be from the most recent BESS RTE Test performed during the period or taken from operational data reflecting the charging/discharging of the BESS.

Date/Time Start	Date/Time End	Total MWh delivered to the POI (A)	Charging Energy (MWh) (B)	BESS RTE Ratio 100% x (A ÷ B)

Enter the information for each Force Majeure event effecting the BESS during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E
...					

Calendar hours in the reporting period: _____

Total equivalent hours for the reporting period (from above, with proper accounting for any simultaneous events): _____

Please provide the following BESS availability information even in months containing Force Majeure even though it will not be applied in the PV System EAF Calculation.

Enter the information for each BESS Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (B-A)
...		

Calendar hours in the reporting period: _____

Total Outage hours for the reporting period (from above): _____

Available Hours (AH) in the reporting period: _____

AH from the last three (3) reporting periods: _____

AH for the last four (4) reporting periods: _____

Enter the information for each BESS Planned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total equivalent planned derated hours (EPDH) for the reporting period: _____

EPDH from the last three (3) reporting periods: _____

EPDH for the last four (4) reporting periods: _____

Enter the information for each BESS Unplanned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total equivalent unplanned derated hours (EUDH) for the reporting period: _____

EUDH for the last three (3) reporting periods: _____

EUDH for the last four (4) reporting periods: _____

Period Hours (PH) is : _____ (8760 hours if no 29th day in February in the last twelve months; otherwise 8784 hours; also can be adjusted appropriately depending on any month(s) containing Force Majeure in last 12 reporting periods.)

Enter the Available Hours, EPDH and EUDH for the last four (4) reporting periods as calculated above.

AH (A)	EPDH (B)	EUDH (C)	PH (D)	BESS Annual Equivalent Availability Factor 100% x (A - B - C)/PH

Enter the information for each Unplanned (Forced) Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (B-A)
...		

Total Forced Outage Hours (FOH) for the reporting period (from above): _____

FOH from the last three (3) reporting periods: _____

FOH for the last four (4) reporting periods: _____

Enter the FOH and EUDH for the last four (4) reporting periods as calculated above.

FOH (A)	EUDH (B)	BESS Annual Equivalent Forced Outage Factor $100\% \times (A + B)/8760$

If the BESS Measurement Period for which this report has been prepared contains a month with a BESS Force Majeure event, please indicate the proper 12-month period used to calculate the BESS Annual Equivalent Availability Factor for this report.

2. MONTHLY REPORT DISAGREEMENTS.

- (a) Notice of Disagreement with Monthly Report. Within ten (10) Business Days following the close of the calendar month in question, Subscriber Organization shall provide to Company the Monthly Report for such calendar month and the LD Period, the MPR Assessment Period and the BESS Measurement Period (if any) ending with such calendar month, as provided in Section 1. (Monthly Report) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator). Within ten (10) Business Days after Company's receipt of a Monthly Report, Company shall provide written notice to Subscriber Organization of any Monthly Report Disagreement, including with respect to the data for the calendar month covered by such Monthly Report and Subscriber Organization's calculation of, as applicable, (i) the PV System Equivalent Availability Factor for the LD Period ending with such calendar month, (ii) the MPR for the MPR Assessment Period ending with such calendar month, or (iii) any of the BESS Capacity Ratio, the RTE Ratio, the BESS Annual Equivalent Availability Factor or the BESS Equivalent Forced Outage Factor for the BESS Measurement Period (if any) ending with such calendar month ("Notice of Disagreement"). Together with any such Notice of Disagreement, the Company shall include its own calculations and other support for its position. If Company fails to provide a Notice of Disagreement within said 10-Business Day period, the Monthly Report provided by Subscriber Organization shall be deemed to be accepted by Company and shall no longer be subject to dispute by Company or Subscriber Organization.
- (b) [~~RESERVED~~Reserved]
- (c) Submission of Monthly Report Disagreement to Independent AF Evaluator. Upon issuance of a Notice of Disagreement, the Parties shall review the contents of the Monthly Report(s) together with such Notice of Disagreement and attempt to resolve such Monthly Report Disagreement. If the Parties are able to agree on a resolution of any Monthly Report Disagreement, the resulting corrected Monthly Report(s) in question shall be set forth in a writing executed by both Parties, following which (i) such corrected Monthly Reports shall no longer be subject to dispute by either Party and (ii) to the extent such resolution of such Monthly Report Disagreement affects future Monthly Reports, such future Monthly Reports shall be prepared, and the PV System Equivalent Availability Factor, the MPR, the BESS Annual Equivalent Factor and the BESS Annual Equivalent Forced Outage Factor in such future Monthly Reports shall be calculated, in a manner consistent with such resolution. If the Parties are unable to resolve such Monthly Report Disagreement within ten (10) Business Days after Company's issuance of such Notice of Monthly Report Disagreement, either Party may, within five (5) Business Days after the end of such 10-Business Day period, submit the unresolved Monthly Report Disagreement to an Independent AF Evaluator for resolution.
- (d) [~~RESERVED~~Reserved]
- (e) Appointment of Independent AF Evaluator. If either Party decides to submit an unresolved Monthly Report Disagreement to an Independent AF Evaluator, it shall provide written notice to that effect (the "Submission Notice") to the other Party, which notice shall designate which of the engineering firms on the OEPR Consultants List is to act as the Independent AF Evaluator for purposes of resolving such dispute; provided, however, for purposes of facilitating consistency in the resolution of Monthly Report

Disagreements, all Monthly Report Disagreements concerning the same Performance Metric arising out of any one or more of the twelve (12) Monthly Reports issued for a given Contract Year shall be submitted to the same Independent AF Evaluator unless such Independent AF Evaluator declines to accept any such submission(s). A Submission Notice must be provided within the 5-Business Day period provided in Section 2.C. (Submission of Monthly Report Disagreement to Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator). The Parties shall each pay fifty percent (50%) of the fees and expenses charged by the Independent AF Evaluator.

- (f) Eligibility for Appointment as Independent AF Evaluator. Both Parties agree that the engineering firms listed in Section 2.J. (Acceptable Persons and Entities) of Attachment D. (Calculation and Adjustment of Net Energy Potential) are fully qualified to serve as Independent AF Evaluator. By mutual agreement between the Parties in writing, a name or names may be added to or removed from the OEPR Consultants List at any time. In no event shall there be less than three (3) names on the OEPR Consultants List.
- (g) Participation of Parties. Promptly following the issuance of a Submission Notice as provided in Section 2.E. (Appointment of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator), Subscriber Organization and Company shall provide the Independent AF Evaluator which such data as they consider to be material to the resolution of the disputed issue(s). Subscriber Organization and Company shall also provide such additional data and information as the Independent AF Evaluator may reasonably request. The Parties shall assist the Independent AF Evaluator throughout the process of resolving such dispute, including making key personnel and records available to the Independent AF Evaluator, but neither Party shall be entitled to participate in any meetings with personnel of the other Party or review of the other Party's records. However, the Independent AF Evaluator will have the right to conduct meetings, hearing or oral arguments in which both Parties are represented.
- (h) Written Decision of Independent AF Evaluator. The terms of engagement with the Independent AF Evaluator shall require the Independent AF Evaluator to issue its written decision resolving the disputed issues submitted to it within the applicable time period set forth below, which time periods are subject to any tolling that may be applicable pursuant to Section 2.I. (Sequence to Resolving Interrelated Disagreements) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator): (a) 30 Days as measured from the issuance of the Submission Notice; or (b) such other time period as the Parties may agree in writing. Unless otherwise agreed by the Parties in writing:
 - (i) for a Monthly Report Disagreement concerning the PV System Equivalent Availability Factor, the written decision of the Independent AF Evaluator shall set forth (aa) for the calendar month in question, the correct values for AH, EPDH, EUDH and PH to be used in calculations under Section 1. (PV System Equivalent Availability Factor Performance Metric and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract as determined by such Independent AF Evaluator if any such values were in dispute and (bb) for the LD Period ending with the calendar month in question, the PV System Equivalent Availability Factor for such LD Period as determined by such Independent AF Evaluator if such PV System Equivalent Availability Factor was in dispute;
 - (ii) for a Monthly Report Disagreement concerning the MPR, the written decision of the Independent AF Evaluator shall set forth (aa) the correct data points from the operational data set for the calendar month in question to be used in the calculation of MPR under Section 2.A. (Calculation of Measured Performance Ratio) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract, for the MPR Assessment Periods that include such calendar month if any such data points were in dispute, (bb) if a MPR Test was conducted during the month in question, the correct data points from such MPR Test to be used in the calculation of MPR under Section 2.A. (Calculation of Measured Performance Ratio) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract. for the MPR Assessment Periods that include the month preceding the month covered by the Monthly Report in question if any such data points were in dispute and (cc) for the MPR Assessment Period ending with the calendar month in question, the Measured Performance Ratio if such Measured Performance Ratio was in dispute;

- (iii) for a Monthly Report Disagreement concerning the BESS Capacity Ratio or the RTE Ratio, the written decision of the Independent AF Evaluator shall set forth the BESS Capacity Ratio and/or the RTE Ratio for the BESS Measurement Period ending with the calendar month in question;
 - (iv) for a Monthly Report Disagreement concerning the BESS Annual Equivalent Availability Factor, the written decision of the Independent AF Evaluator shall set forth (aa) the correct values to be used for AH, EPDH, EUDH and PH under Attachment H (BESS Requirements) Section 2. (BESS Annual Equivalent Availability Factor) for the calendar month in question if any such values were in dispute and (bb) the BESS Annual Equivalent Availability Factor for the BESS Measurement Period ending with the calendar month in question if such BESS Annual Equivalent Availability Factor was in dispute; and
 - (v) for a Monthly Report Disagreement concerning the BESS Annual Equivalent Forced Outage Factor, the written decision of the Independent AF Evaluator shall set forth (aa) the correct values for FOH and EUDH under Attachment H (BESS Requirements) Section 3 (BESS Annual Equivalent Forced Outage Factor) for the calendar month in question if any such values were in dispute and (bb) the BESS Annual Equivalent Forced Outage Factor for the BESS Measurement Period ending with the calendar month in question if such BESS Annual Equivalent Forced Outage Factor was in dispute.
- (i) Sequence for Resolving Interrelated Disagreements. If at the time a Monthly Report Disagreement is submitted to an Independent AF Evaluator pursuant to Section 2 (Appointment of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) there are one or more other unresolved Monthly Report Disagreements concerning the same Monthly Report and the same LD Period that are pending before a different Independent AF Evaluator, and the resolution of such other Monthly Report Disagreement(s) is necessary to the resolution of the Monthly Report Disagreement that has been newly submitted to a new Independent AF Evaluator as aforesaid, the time period for such new Independent AF Evaluator to issue its written decision resolving such newly submitted Monthly Report Disagreement shall be tolled until such pending Monthly Report Disagreement(s) have been resolved. For avoidance of doubt, it is the intent of the Parties that disagreements over performance ratio data and calculations for a given calendar month or a given BESS Measurement Period shall (i) not be subject to resolution twice and (ii) once resolved, shall not be reopened.
 - (j) Final, Conclusive and Binding. The Parties acknowledge the inherent uncertainty in calculating the Monthly Reports, and hereby assume the risk of such uncertainty and waive any right to dispute the qualification of the person or entity appointed as the Independent AF Evaluator pursuant to Section 2E. (Appointment of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) and/or the appropriateness of the methodology used by Independent AF Evaluator in resolving such Monthly Report Disagreements. Without limitation to the generality of the preceding sentence, the decision of the Independent AF Evaluator as to each Monthly Report Disagreement submitted to an Independent AF Evaluator shall be final, conclusive and binding upon Company and Subscriber Organization and shall not be subject to further dispute under Section 17. (Dispute Resolution) of the Contract.
3. **PERIODIC REVIEW OF METHOD OF CALCULATING AND REPORTING MONTHLY REPORT.** At least once per Contract Year, Company shall review the method of calculating and reporting Monthly Report under this Contract to determine if other variables should be incorporated into such calculations. Any revisions to the Monthly Report calculations in this Contract shall be mutually agreed to by both Subscriber Organization and Company.
4. **FUTURE CHANGES IN REPORTING REQUIREMENTS.** Subscriber Organization shall reasonably cooperate with any Company requested revisions to the Monthly Report to include additional data that may be necessary from time to time to enable Company to comply with any new reporting requirements directed by the PUC or otherwise imposed under applicable Laws.

ATTACHMENT F
FACILITY OWNED BY SUBSCRIBER ORGANIZATION

1. THE FACILITY.

(a) Drawings, Diagrams, Lists, Settings and As-Built.

- (i) Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme. A preliminary single-line drawing (including notes), Interface Block Diagram, relay list, relay settings, and trip scheme of the Facility shall, after Subscriber Organization has obtained prior written consent from Company, be attached to this Contract on the Execution Date as Exhibit F-5 (Single-Line Drawing and Interface Block Diagram) and Exhibit F-6 (Relay List and Trip Scheme). A final single-line drawing (including notes), Interface Block Diagram, relay list and trip scheme of the Facility shall, after having obtained prior written consent from Company, be labeled the "Final" Single-Line Drawing, the "Final" Interface Block Diagram and the "Final" Relay List and Trip Scheme and shall supersede Exhibit F-5 (Single-Line Drawing and Interface Block Diagram) and Exhibit F-6 (Relay List and Trip Scheme) to this Contract and shall be made a part hereof on the Commercial Operations Date. After the Commercial Operations Date, no changes shall be made to the "Final" Single-Line Drawing, the "Final" Interface Block Diagram and the "Final" Relay List and Trip Scheme without the prior written consent of Subscriber Organization and Company. The single-line drawing shall expressly identify the Point of Interconnection of Facility to Company System.
- (ii) As-Built. Subscriber Organization shall provide final as-built drawings of the Subscriber Organization-Owned Interconnection Facilities within 30 Days of the successful completion of the Acceptance Test.
- (iii) Modeling. Subscriber Organization shall provide the models as set forth in Exhibit F-4.
- (iv) No Material Changes. Subscriber Organization agrees that no material changes or additions to the Facility as reflected in the "Final" Single-Line Drawing (including notes), the "Final" Interface Block Diagram and the "Final" Relay List and Trip Scheme, shall be made without Subscriber Organization first having obtained prior written consent from Company. The foregoing are subject to changes and additions as part of any Performance Standards Modifications. If Company directs any changes in or additions to the Facility, records and operating procedures that are not part of any Performance Standards Modifications, Company shall specify such changes or additions to Subscriber Organization in writing, and, except in the case of an emergency, Subscriber Organization shall have the opportunity to review and comment upon any such changes or additions in advance.

(b) Certain Specifications for the Facility.

- (i) Subscriber Organization shall furnish, install, operate and maintain the Facility including breakers, relays, switches, synchronizing equipment, monitoring equipment and control and protective devices approved by Company as suitable for parallel operation of the Facility with Company System. The Facility shall be accessible at all times to authorized Company personnel.
- (ii) The Facility shall include:

[LIST OF THE FACILITY

Examples may include, but are not limited to:

- **Subscriber Organization-Owned Interconnection Facilities**
- **Substation**
- **Control and monitoring facilities**
- **Transformers**
- **Generating and ~~BESS~~/or Battery Energy Storage System ("BESS") equipment (as described in Exhibit F-1)**
- **"Lockable" cabinets or housings suitable for the installation of the Company-Owned Interconnection Facilities located on the Site**
- **Relays and other protective devices**
- **Leased telephone line and/or equipment to facilitate microwave communication]**

(iii) The Facility shall comply with the following [~~includes excerpts of language that some requirements may be requested removed~~ by Company following Completion of Technical Review or IRS]:

- A. Subscriber Organization shall install a ___ kV gang operated, load breaking, lockable disconnect switch and all other items for its switching station (relaying, control power transformers, high voltage circuit breaker). Bus connection shall be made to a manually and automatically (via protective relays) operated high-voltage circuit breaker. The high-voltage circuit breaker shall be fitted with bushing style current transformers for metering and relaying. Downstream of the high-voltage circuit breaker, a structure shall be provided for metering transformers. From the high-voltage circuit breaker, another bus connection shall be made to another pole mounted disconnect switch, with surge protection.
- B. Subscriber Organization shall provide within the Subscriber Organization-Owned Interconnection Facilities a separate, fenced area with separate access for Company. Subscriber Organization shall provide all conduits, structures and accessories necessary for Company to install the Revenue Metering Package. Subscriber Organization shall also provide within such area, space for Company to install its communications, supervisory control and data acquisition ("SCADA") equipment (remote terminal unit or equivalent) and certain relaying if necessary for the interconnection. Subscriber Organization shall also provide AC and DC source lines as specified by Company. Subscriber Organization shall provide a telephone line for Company-owned meters. Subscriber Organization shall work with Company to determine an acceptable location and size of the fenced-in area. Subscriber Organization shall provide an acceptable demarcation cabinet on its side of the fence where Subscriber Organization and Company wiring will connect/interface.
- C. Subscriber Organization shall ensure that the Subscriber Organization-Owned Interconnection Facilities have a lockable cabinet for switching station relaying equipment. Subscriber Organization shall select and install relaying equipment acceptable to Company. At a minimum, the relaying equipment will provide over and under frequency (81) negative phase sequence (46), under voltage (27), over voltage (59), ground over voltage (59G), over current functions (50/51) and direct transfer trip (if required). The settings shall be consistent with the requirements for over/under frequency and voltage ride-through. Subscriber Organization shall install protective

relays that operate a lockout relay (86), which in turn will trip the main circuit breaker and not allow it to be reclosed without reset.

- D. [~~RESERVED~~Reserved]
- E. Subscriber Organization's equipment also shall provide at a minimum:
- (i) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide telemetry of electrical quantities such as total Facility net MW, MVar, power factor, voltages, currents, and other quantities as identified by the Company;
 - (ii) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide status for circuit breakers, reactive devices, switches, and other equipment as identified by the Company;
 - (iii) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide control to incrementally raise and lower the voltage target at the point of regulation operating in automatic voltage regulation control;
 - (iv) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide the active power control requirements of this Contract. More than one interface may be required if Facility energy components, such as a BESS and variable generation resource are controlled separately by the Company (as in grid-charging BESS);
 - (v) Interface with Company's Telemetry and Control, or designated communications and control interface, for the Company to specify control system modes of operation and parameters, for remotely configurable parameters and operating states required under this Contract;
 - (vi) For Variable Energy Facilities: Interface with Company's Telemetry and Control, or designated communications and control interface, to provide telemetry of equipment availability and meteorological and production data required under Section 8 (Data and Forecasting) of this Attachment F (Facility Owned by Subscriber Organization) and the Facility's Power Possible; and
 - (vii) Provision for Loss of Telemetry and Control: If Company's Telemetry and Control, or designated communications and control interface, is unavailable, due to loss of communication link, Telemetry and Control failure, or other event resulting in loss of the remote control by Company, provision must be made for Subscriber Organization to be able to institute via local controls, within 5 minutes (or such other period as Company accepts in writing) of the verbal directive by the Company System Operator, such change in voltage regulation target and real power export or import as directed by the Company System Operator. If all local and remote active power controls become unavailable or fail, the Facility may be required disconnect from the Company's System [to be based upon the size of the system]
 - (viii) If the direct transfer trip is required and is unavailable due to loss of communication link, Telemetry and Control failure, or other event resulting in the loss of the remote control by the Company, provision must be made for the

Subscriber Organization to shutdown Facility and open and lockout the main circuit breaker.

- F. If Subscriber Organization adds, deletes and/or changes any of its equipment, or changes its design in a manner that would change the characteristics of the equipment and specifications used in the IRS, Subscriber Organization shall be required to obtain Company's prior written approval. If an analysis to revise parts of the IRS is required, Subscriber Organization shall be responsible for the cost of revising those parts of the IRS, and modifying and paying for the cost of the modifications to the Facility and/or the Company-Owned Interconnection Facilities based on the revisions to the IRS.
- G. Cybersecurity and Critical Infrastructure Protection.

[DRAFTING NOTE: COMPANY RETAINS SOLE DISCRETION TO CONSIDER THE LESS STRINGENT REQUIREMENTS (WHICH ARE INCLUDED IN THE FIRST SET OF ALTERNATIVE CYBER-SECURITY PROVISIONS UNDER G. (i) THROUGH (iv)) FOR PROJECTS THAT DO NOT EXCEED 1 MW.]

- (i) Safety and Security Procedures. The Subscriber Organization shall maintain and enforce safety and security procedures to safeguard: all data provided by Company to Subscriber Organization pursuant to this Contract or in any way connected with the CBRE Program and the administration of the CBRE Program including but not limited to Subscriber names, Subscriber account numbers and information on such accounts, Subscriber addresses, Subscriber rate schedules and Subscriber CBRE bill credit information ("Company CBRE Data"); and all information regarding Company's customers, customer lists, any of the data and testing results produced under this Contract and any information identified by Company as confidential ("Company Customer Data" and together with Company CBRE Data, collectively referred to as "Company Confidential Information"); all generation and telemetry data provided by the Subscriber Organization to the Company ("SO Data"); in Subscriber Organization's possession, including Company Confidential Information that Subscriber Organization provides to any contractors, consultants, and other third parties retained by Subscriber Organization to assist Subscriber Organization to perform under this Contract in the course of Subscriber Organization's performance pursuant to this Contract. Subscriber Organization warrants that it shall (A) use the National Institute of Standards and Technology ("NIST") industry best practices for physical and systems security measures to prevent destruction, loss, alteration or unauthorized access to, use of, or tampering with, the CBRE Facility, Subscriber Organization software, and Company Confidential Information, including to protect the confidentiality and integrity of any of Company Confidential Information, operation of Company's systems, and to prevent viruses and similar destructive code from being placed in any software or data provided to Company, on Subscriber Organization's or Company's website, or in Subscriber Organization's or Company's programming; and (B) use NIST industry best practices physical security and precautionary measures to prevent unauthorized access or damage to the CBRE Facility, including to protect the confidentiality and integrity of any of Company's Confidential Information as well as the operation of Company's systems. Subscriber Organization shall, at a minimum, protect Company's Confidential Information and provide the standard of care required by NIST cybersecurity requirements, and the same measures it uses to protect its own confidential information.

- (ii) Exception to Certain NIST Requirements. Company, at its sole and absolute discretion, may waive the requirements concerning NIST industry best practices as set forth in subsection (i)(A) and (B) above provided that Subscriber Organization implements alternate measures that Company deems acceptable and not inconsistent with Company's standards with respect to (A) physical and systems security measures to prevent destruction, loss, alteration or unauthorized access to, use of, or tampering with, the CBRE Facility, software and Company's Confidential Information, including to protect the confidentiality and integrity of any of Company's Confidential Information, operation of Company's systems, and to prevent viruses and similar destructive code from being placed in any software provided to Company, on Subscriber Organization's or Company's website, or in Subscriber Organization's or Company's programming; and (B) physical security and precautionary measures to prevent unauthorized access or damage to the CBRE Facility, including to protect the confidentiality and integrity of any of Company's Confidential Information as well as the operation of Company's systems.
- (iii) Security Breach. In the event that Subscriber Organization discovers or is notified of a breach, potential breach of security, or security incident at the CBRE Facility or of Subscriber Organization's systems (a "Security Breach"), Subscriber Organization shall immediately (i) notify Company of such Security Breach, whether or not such breach has compromised any of Company Confidential information, (ii) investigate and remediate the effects of the Security Breach, (iii) cooperate with Company with respect to any such Security Breach and provide necessary information on the Security Breach as requested by Company; and (iv) comply with all applicable privacy and data protection laws, including any notification obligations. Any remediation of any Security Breach will be at Subscriber Organization's sole expense.
- (iv) "Subscriber" means a retail customer of the Company who owns a subscription of Subscriber Organization's CBRE project interconnected with the Company.

**[ALTERNATIVE ENHANCED CYBER-SECURITY PROVISIONS-
WAIVED SOLELY AT DISCRETION OF COMPANY.]**

- (i) Security Policies and Documentation. Subscriber Organization shall implement and document security policies and standards in accordance with industry best practices (e.g., aligned with the intent of NERC CIP-003-6 ~~R2~~R1) and consistent with Company's security policies and standards. Subscriber Organization shall submit documentation describing the approach, methodology, and design to provide physical and cyber security (i.e., aligned with the intent of NERC CIP-003-6 R2) with its submittal of the design drawings pursuant to Section 1(c) (Design Drawings, Bill of Materials, Relay Settings and Fuse Selection) of Attachment F (Facility Owned by Subscriber Organization) which shall be at least sixty (60) Days prior to the Acceptance Test.
- (aa) The design shall meet industry standards and best practices, consistent with the National Institute of Standards and Technology ("NIST") guidelines as indicated in Special Publication 800-53 Rev. 4 "Security and Privacy Controls for Federal Information Systems and Organizations" and Special Publication 800-82 Rev. 2 "Guide to Industrial Control Systems (ICS) Security". The system shall be designed with the criteria to meet applicable compliance requirements

and identify areas that are not consistent with NIST guidelines and recommendations.

- (bb) The cybersecurity documentation shall include a block diagram of the control system with all external connections clearly described.
- (cc) Subscriber Organization shall provide such additional information as Company may reasonably request as part of a security posture assessment.

~~(a) Company shall be notified in advance when there is any condition that would compromise physical or cyber security.~~

- (dd) Subscriber Organization shall, at the request of Company or, in the absence of any request from Company, at least annually during the term of this Contract, provide Company with updated documentation and diagrams including a record of changes.

(ii) Network and Application Security. Subscriber Organization shall implement appropriate network and application security processes and practices commensurate with the level of risk as determined by periodic risk assessments (i.e., aligned with the intent of NERC CIP-005-5):

- (aa) Segment and segregate networks and functions, including physical and logical separation between business networks and control system networks (i.e., aligned with the intent of NERC CIP-005-5 R1).
- (bb) Limit unnecessary lateral communications (i.e., aligned with the intent of NERC CIP-005-5 R1).
- (cc) Harden network devices (i.e., aligned with the intent of NERC CIP-007-6 R1).
- (dd) Secure access to infrastructure devices (i.e., aligned with the intent of NERC CIP-004-6 R4).
- (ee) Perform out-of-band (OoB) network management (i.e., aligned with the intent of NERC CIP-005-5 R2).
- (ff) Validate integrity of hardware and software (i.e., aligned with the intent of NERC CIP-010-3 R1 and NERC CIP-006-6 R1 Part 10).

(iii) Endpoint and Server Security. Subscriber Organization shall implement appropriate endpoint and server security processes and practices commensurate with the level of risk as determined by periodic risk assessments:

- (aa) Mechanisms to identify vulnerabilities and apply security patches in a timely manner (i.e., aligned with the intent of NERC CIP-007-6 R2).
- (bb) Malware defense and anti-phishing capabilities (i.e., aligned with the intent of NERC CIP-007-6 R3).
- (cc) Access Controls to enforce the least privilege principle and provide access to resources only for authorized users (i.e., aligned with the intent of NERC CIP-004-6 R4).

- (dd) Secure authentication mechanisms including multi-factor authentication for systems with higher risk exposure (i.e., aligned with the intent of NERC CIP-007-6 R5 and NERC CIP-005-5 R2).
- (ee) Data confidentiality, protection, and encryption technologies for endpoints, servers, and mobile devices (i.e., aligned with the intent of NERC CIP-011-2 R1 and NERC CIP-005-5 R2).

Subscriber Organization shall (consistent with the following sentence) ensure that no malicious software ("Malware") or unauthorized code is introduced into any aspect of the Facility, Interconnection Facilities, the Company Systems interfacing with the Facility and Interconnection Facilities, and any of Subscriber Organization's critical control systems or processes used by Subscriber Organization to provide energy, including the information, data and other materials delivered by or on behalf of Subscriber Organization to Company, (collectively, the "Environment"). Subscriber Organization shall periodically review, analyze and implement improvements to and upgrades of its Malware prevention and detection programs and processes that are commercially reasonable and consistent with the then current technology industry's standards and, in any case, not less robust than the programs and processes implemented by Subscriber Organization with respect to its own information systems.

- (iv) Cybersecurity Program. Subscriber Organization shall establish and maintain a continuous cybersecurity program (i.e., aligned with the intent of NERC CIP-003-6) that enables the Subscriber Organization (or its designated third party) to:
 - (aa) Define the scope and boundaries, policies, and organizational structure of the cybersecurity program.
 - (bb) Conduct periodic risk assessments to identify the specific threats to and vulnerabilities of the Subscriber Organization's Organization consistent with guidance provided in NIST Special Publication 800-30 Rev. 1 "Guide for Conducting Risk Assessments".
 - (cc) Implement appropriate mitigating controls and training programs and manage resources.
 - (dd) Monitor and periodically test the cybersecurity program to ensure its effectiveness. Subscriber Organization shall review and adjust their cybersecurity program as appropriate for any assessed risks.
 - (ee) Applicability is extended to Cloud Service providers and other third-party services the Subscriber Organization may use.
- (v) Security Monitoring and Incident Response. Company and Subscriber Organization shall collaborate on security monitoring and incident response, define points of contact on both sides, establish monitoring and response procedures, set escalation thresholds, and conduct training (i.e., aligned with the intent of NERC CIP-008-5). Subscriber Organization shall, at the request of Company or, in the absence of any request from Company, at least quarterly, provide Company with a report of the incidents that it has identified and describe measures taken to resolve or mitigate.

In the event that Subscriber Organization discovers or is notified of a breach, potential breach of security, or security incident at Subscriber Organization's Facility or of Subscriber Organization's systems, Subscriber Organization shall immediately (aa) notify Company of such potential, suspected or actual security breach, whether or not such breach has compromised any of Company's confidential information; (bb) investigate and promptly remediate the effects of the breach, whether or not the breach was caused by Subscriber Organization; (cc) cooperate with Company with respect to any such breach or unauthorized access or use; (dd) comply with all applicable privacy and data protection laws governing Company's or any other individual's or entity's data; and (ee) to the extent such breach was caused by Subscriber Organization, provide Company with reasonable assurances satisfactory to Company that such breach, potential breach, or security incident shall not recur. Subscriber Organization shall provide documentation to Company evidencing the length and impact of the breach. Any remediation of any such breach will be at Subscriber Organization's sole expense.

If malicious software or unauthorized code is found to have been introduced into the Environment, Subscriber Organization will promptly notify Company. Subscriber Organization shall take immediate action to eliminate and remediate the effects of the Malware, at Subscriber Organization's expense. Subscriber Organization shall not modify or otherwise take corrective action with respect to the Company Systems except at Company's request. Subscriber Organization shall promptly report to Company the nature and status of all efforts to isolate and eliminate malicious software or unauthorized code.

- (vi) Monitoring and Audit. Subscriber Organization shall provide information on available audit logs and reports relating to cyber and physical and security (i.e., aligned with the intent of NERC CIP-007-6 R4). Company may audit Subscriber Organization's records to ensure Subscriber Organization's compliance with the terms of this Section 1(b) (iii) G (Cybersecurity and Critical Infrastructure Protection) of this Attachment F (Facility Owned by Subscriber Organization), provided that Company has provided reasonable notice to Subscriber Organization and any such records of Subscriber Organization's will be treated by Company as confidential.
- (vii) Contingency Plans. Subscriber Organization shall implement and maintain a business continuity plan, a disaster recovery plan, and an incident response plan ("Contingency Plans" – i.e., aligned with the intent of NERC CIP-009-6) appropriate for the level of risk ~~associated with the Work under this Contract based on the impact of Subscriber Organization's associated facilities, systems and equipment, which, if destroyed, degraded, misused, or otherwise rendered unavailable, would affect the reliable operation of the Company System~~. The Contingency Plans shall be provided to Company upon request. Such Contingency Plans shall be updated to reflect lessons learned from real recovery events.

H. Available Power Production.

- (i) Variable Energy Systems. Subscriber Organization's available power production considering equipment and resource availability (Power Possible) will be determined at any given time using the best-available data and methods for an accurate representation of the amount of available active power at the Point of Interconnection.

(ii) Variable Energy Systems Paired with Storage Operated through a Single Active Power Control Interface. For variable energy systems paired with storage operated through a single active power control interface (i.e., charging indirectly controlled through dispatch), Subscriber Organization's available power production considering equipment and resource availability and BESS state of charge ~~of the storage ("Power Possible")~~ will be determined at any given time using the best-available data and methods for an accurate representation of the amount of available active power at the Point of Interconnection. Telemetry will be provided to indicate state of charge, including available estimated duration at the current dispatch given state of charge and forecast production.

~~(iii) Storage Directly Controlled by the Company. Subscriber Organization's available power production considering state of charge (Power Possible) will be supplied as an accurate representation of the amount of maximum and minimum (negative) available active power at the Point of Interconnection and the duration available at the current dispatch. If the Facility allows for allocation of capacity to different modes of operation (i.e., reservation of capacity for regulation or contingency response), then the available capacity in each allocated region shall be reported individually and controlled separately through separately designated dispatch or active power control interface.~~

I. ~~I.~~ For variable resources where Power Possible is derived, in part or in whole, from a measured available variable energy source such as solar or wind: To the extent available, the Parties shall use Subscriber Organization's real time Power Possible communicated to Company through the SCADA ~~S~~system except to the extent that the ~~Potential Energy~~potential energy does not accurately reflect the actual available active power at the Point of Interconnection (plus or minus 0.1 MW). During those periods of time when the SCADA derived Power Possible is unavailable or does not accurately represent the available power production considering equipment and resource availability and BESS State of Charge, the Parties shall use the best available data obtained through commercially reasonable methods to determine the Power Possible. Follow up actions to resolve the discrepancy will be as provided in Section 1(j) (Demonstration of Facility) of this Attachment F (Facility Owned by Subscriber Organization).

~~(a) If, at any time during the Term, there is a material discrepancy or pattern of discrepancies in the accuracy of Power Possible, the Parties shall review the method for determining Power Possible and develop modifications with the objective of avoiding future discrepancies. If the Parties are unable to resolve the issue, then (aa) the Parties shall promptly commission a study to be performed by one of the engineering firms then included on the Qualified Independent Third-Party Consultants List attached to the Agreement as Attachment D (Consultants List) to evaluate the cause of the Power Possible discrepancy and to make recommendations with the objective of avoiding future Power Possible discrepancies ("Study"); and (bb) if the Company decides that its ability to effectively optimize the benefits of its right of Company Dispatch to dispatch the Facility's Net Energy Potential is materially impaired by the lack of an accurate method to determine Power Possible, the Company shall have the right to derate the Facility and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status until the Study has been completed and the Study's recommendations have been implemented by Subscriber Organization to Company's reasonable satisfaction. Subscriber Organization shall pay for the cost of the Study. The Study shall be completed within ninety (90) days from the date the Study is commissioned, unless otherwise reasonably agreed to in~~

writing by Subscriber Organization and Company. The Consultant shall send the Study to Company and Subscriber Organization. Subscriber Organization (and/or its Third-Party consultants and contractors), at Subscriber Organization's expense, shall take such action as the Study shall recommend (e.g., modifications to the model, modifications and/or additions to the data inputs used in the model, modifications to the procedures for maintaining and/or recalibrating the Monitoring and Communication Equipment used to provide data inputs, replacement of such Monitoring and Communication Equipment, modifications of procedures for Facility operations) with the objective of avoiding future Power Possible discrepancies. Such recommendations shall be implemented by Subscriber Organization to Company's reasonable satisfaction no later than forty-five (45) Days from the Day the completed Study is issued by the consultant, or such other longer commercially reasonable timeframe otherwise agreed to in writing by Company.

- J. Subscriber Organization shall reserve space within the Site for possible future installation of Company-owned meteorological equipment (such as wind speed, direction and relative humidity monitors, SODAR and irradiance monitors) and AC and DC source lines for such equipment as may be required depending on the Facility resource type and location. In the event Company decides to install such meteorological equipment: (i) Subscriber Organization shall work with Company to determine an acceptable location for such equipment and any associated wiring, interface or other components; and (ii) Company shall pay for the needed equipment, and installation of such equipment, unless otherwise agreed to by the Parties. Company and Subscriber Organization shall use commercially reasonable efforts to facilitate installation and minimize interference with the operation of the Facility.
- K. The Facility shall, at a minimum, satisfy the wind load and seismic load requirements of the International Building Code and any more stringent requirements imposed under applicable Laws.
- (c) Design Drawings, Bill of Material, Relay Settings and Fuse Selection. Subscriber Organization shall provide to Company for its review the design drawings, Bill of Material, relay settings and fuse selection for the Facility, and Company shall have the right, but not the obligation, to specify the type of electrical equipment, the interconnection wiring, the type of protective relaying equipment, including, but not limited to, the control circuits connected to it and the disconnecting devices, and the settings that affect the reliability and safety of operation of Company's and Subscriber Organization's interconnected system. Subscriber Organization shall provide the relay settings and protection coordination study, including fuse selection and AC/DC Schematic Trip Scheme (part of design drawings), for the Facility to Company during the 60% design. Company, at its option, may, with reasonable frequency, witness Subscriber Organization's operation of control, synchronizing, and protection schemes and shall have the right to periodically re-specify the settings. Subscriber Organization shall utilize relay settings prescribed by Company, which may be changed over time as Company System requirements change.
- (d) Disconnect Device. Subscriber Organization shall provide a manually operated disconnect device which provides a visible break to separate Facility from Company System. Such disconnect device shall be lockable in the OPEN position and be readily accessible to Company personnel at all times.
- (e) Other Equipment. Subscriber Organization shall install, own and maintain the infrastructure associated with the Revenue Metering Package, including but not limited to all enclosures (meter cabinets, meter pedestals, meter sockets, pull boxes, and junction boxes, along with their grounding/bonding connections), CT/PT mounting structures, conduits and duct lines, enclosure support structures, ground

buses, pads, test switches, terminal blocks, isolation relays, telephone surge suppressors, and analog phone lines (one per meter), subject to Company's review and approval.

- (f) Maintenance Plan. Subscriber Organization shall maintain Subscriber Organization-Owned Interconnection Facilities in accordance with Good Engineering and Operating Practices.
- (g) Active Power Control Interface. **[COMPANY TO REVISE THIS SECTION BASED ON SPECIFICS OF THE PROJECT.]**
 - (i) Subscriber Organization shall provide and maintain in good working order all equipment, computers and software associated with the control system (the "Active Power Control Interface") necessary to interface the Facility active power controls with the Company System Operations Control Center for real power control of the Facility by the Company System Operator.

The detailed design will be tailored to the specific resource type and configuration to achieve the functional requirements of the Facility.

The Active Power Control Interface will be used to control the net real power export (or import, as applicable) from the Facility for load following, system balancing, energy arbitrage, and/or supplemental frequency control as required under this Attachment F (Facility Owned by Subscriber Organization).

For variable resources paired with storage: The implementation of the Active Power Control Interface will allow the Company System Operator to control the net real power import or export (or import, as applicable for facilities with grid-charging storage) from the entire Facility, up to Power Possible, remotely from the Company System Operations Control Center through control signals from the Company System Operations Control Center. The Facility will maintain the power level specified by the Company through the variable resource and BESS available energy, subject to the availability of resource and BESS State of Charge.

For facilities with grid charging storage, the Active Power Control interface ~~may also direct the will provide for a negative signal resulting in~~ charging/~~discharging of energy from~~ the BESS.

~~The BESS~~The Facility real power output (or import, if grid storage charging is enabled) will automatically adjust to a change in frequency in accordance with the frequency response requirements provided in this Attachment F (Facility Owned by Subscriber Organization).

- (ii) Company shall review and provide prior written approval of the design for the Active Power Control Interface to ensure compatibility with Company's centralized control systems and use of Facility available energy and storage capabilities. To ensure such continued compatibility, Subscriber Organization shall not materially change the approved design without Company's prior review and written approval. This will include design description and parameters for the Subscriber Organization's control system(s), which determine provision of net real power from the variable resource System (~~i.e., wind or WTGPV~~) and/or the BESS storage, and charging of the BESS storage, in response to the Active Power Control signal or signals.
- (iii) The Active Power Control Interface shall include, but not be limited to, a demarcation cabinet, ancillary equipment and software necessary for Subscriber Organization to connect to Company's Telemetry and Control, located in Company's portion of the Facility switching station which shall provide the control signals to the Facility and send feedback status to the Company System Operations Control Center. The control type shall be analog output (set point) or raise/lower controls and will be established by the Company prior to final design approval.
- (iv) The Active Power Control Interface shall also include provision for feedback points from the Facility indicating when active power target in MW for the Active Power Control signal(s). The

Facility shall provide the MW target feedback to the Company SCADA system immediately upon receiving the respective control signal from the Company.

- (v) Subscriber Organization shall provide to the telemetry interface analogs for the gross production of the energy resource(s) at the Facility (for example, DC or AC MW production of the variable resource generator(s), depending on design; gross DC MW of the BESS, etc.). Subscriber Organization shall also provide the total net AC MW production at the Point of Interconnection.
- (vi) The Active Power Control Interface shall provide for remote control of the real power output of the Facility by the Company at all times. If the Active Power Control Interface is unavailable or disabled, the Facility may not export electric energy to Company and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status, unless the Company, in its sole discretion, agrees on an alternate means of dispatch. The alternate means of dispatch, including but not limited to local controls, is to be the temporary dispatch mechanism until the Active Power Interface is returned to service and must be capable of changing the real power export or import as directed by the Company System Operator within 30 minutes (or such other period as Company accepts in writing) of the Subscriber Organization receiving the directive by the Company System Operator, verbal or otherwise permitted by such alternate means. If Subscriber Organization fails to provide such remote control capability (whether temporarily or throughout the Term), then, notwithstanding any other provision of this Attachment F (Facility Owned by Subscriber Organization), Company shall have the right to derate or disconnect the entire Facility during those periods that such control capability is not provided and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status for such periods.
- If all local and remote active power controls become unavailable or fail, the Facility shall immediately disconnect from the Company's System.
 - If the direct transfer trip is unavailable due to loss of communication link, Telemetry and Control failure, or other event resulting in the loss of the remote control by the Company, provision must be made for the Subscriber Organization to shutdown Facility and open and lockout the main circuit breaker.
- (vii) The rate at which the Facility changes net real power in response to the active power control shall not be less than the greater of 2 MW per minute or 10% of the Facility capacity per minute, and shall make available through agreed parameters, such faster ramp as the installed equipment can support. The Facility's Active Power Control Interface will be used by Company to control the rate at which electric energy is changed to achieve the active power limit for load-following and regulation. The Facility will respond to the active power control request immediately with an echo of the set point and measurable change within the 4 second control cycle.
- (viii) The Facility shall accept the following controls related to active power and frequency response to or from the Company centralized control system:
- Power Reference Setpoint from Company (based on the input to the Facility, from the Active Power Control Interface): The Facility output shall match this setting from the Variable Resource and/or BESS so long as it can be supported by the variable resource and/or BESS State of Charge (Power Possible does not change). This net output should be accurate within +/- 0.1 MW under normal frequency conditions. This setpoint will be modified as appropriate in the controls by the appropriate frequency response consistent with Section 1(g)(xi) (Active Power – Frequency Response (DROOP)), Section 1(g)(xii) (Dynamic Active Power – Frequency Performance), and **[FOR FACILITIES WITH STORAGE]** Section 1(g)(xiii) (Alternate Active Power / Frequency Response Modes) of this Attachment F (Facility Owned by Subscriber Organization).

- For variable energy resources: The Facility shall include Variable Resource Enable/Disable control. When "Disable" is selected, the Facility shall ramp down, shutdown, and leave offline variable resource generators. When "Enable" is selected, the Facility variable resource generators can start up, ramp up, and remain in normal operations subject to Company active power dispatch.
- ~~From Company: Frequency Response Mode (DROOP, isochronous) state (where alternate modes of operation are required).~~
- **From Subscriber Organization:**
 - Power Possible (Available maximum capacity): See above, instantaneous limit for available energy, represents max level the Facility can produce under present resource, BESS State of Charge (if applicable) and equipment conditions. This is used as upper limit for Company Dispatch.
 - For variable energy resources, maximum level the variable generation resources can produce under present variable resource and equipment conditions.
 - Minimum Sustained Limit: Minimum output level the Facility can be reduced to continuously without delay (ecomn). For projects with BESS: If BESS charging from the grid is permitted, and charging capacity is available, this will be a negative value.
 - Minimum Transient Limit (for frequency response, regulation) (lfcmn). For projects with BESS: If BESS charging from the grid is permitted, and charging capacity is available, this will be a negative value.
 - Maximum Dispatchable Ramp Rate: Controlled ramp rate available for controlled changes in output.
 - For projects with a BESS, Subscriber Organization shall also provide the following:
 - ~~BESS potential (BESS State of Charge and projected number of hours at present dispatch, minimum dispatch, and maximum dispatch).~~
 - ~~Frequency Response Mode (DROOP, isochronous) state.~~
 - (ix) Subscriber Organization shall not override Company's active power controls without first obtaining specific approval to do so from the Company System Operator unless there is a system emergency. Disabling of the remote Active Power Control shall initiate telemetry notification to the Company.
- (x) The requirements of the Active Power Control Interface may be modified as mutually agreed upon in writing by the Parties.

Active Power Communications between Company and Subscriber Organization. Company will receive and send AGC Set-Point and related data through the communications interface in accordance with Company standards. The data points covered under this Contract, as described below, may overlap with data requirements described elsewhere.

AGC Data Points to be sent from Subscriber Organization to Company via SCADA. The following data points will be transmitted via SCADA from Subscriber Organization to Company and represent Facility level data [Note: **May be modified based on resource type and Facility requirements**]:

DESCRIPTION	UNITS
AGC Set-Point (echo)	MW
Power demand	MW
Actual power	MW
Power Possible	MW
Actual reactive power	Mvars

Average Voltage	Kv
Variable Generation potential	MW
[Wind only] Number of turbines online and running	Integer
BESS State of Charge	Pct
[PV only] Inverters online	Integer
Facility duration at current output	HRS
AGC Status	Remote/Local
[For facilities with alternate modes of frequency response] Indication of Frequency Response Mode	Integer Droop, ISOCH

Response times and limitations of Facility in regard to Active Power Control

The following protocols outline the expectations for responding to the AGC Set-Point.

Frequency of Changes. Company may send a new AGC Set-Point to the Facility at up to the AGC control cycle (presently 4 seconds).

Range of AGC Set-Point. The range of set point values can be between 0% and 100% of Power Possible. For projects offering grid-charging storage, negative set-point values may be required.

Backup Communications

In the event of an AGC failure, Company and Subscriber Organization shall communicate via telephone, or other method mutually agreeable between the Parties, in order to correct the failure.

(xi) Active Power - Frequency Response (DROOP).

The Facility shall provide a primary frequency response with a frequency droop characteristic reacting to system frequency at the Point of Interconnection in both the overfrequency and underfrequency directions except as limited by the minimum and maximum available capacity and energy potential at the time of the event including BESS state of charge. This response must be timely and sustained rather than injected for a short period and then withdrawn. For over-frequency events, response may include absorption through charging (as applicable under the terms of this Contract). Subscriber Organization shall provide minimum operational limits for each online resource and the Facility for primary frequency response.

Frequency will be calculated over a period of time (e.g., three to six cycles, or other period as specified by Company), and filtered to take control action on the fundamental frequency component of the calculated signal. Calculated frequency may not be susceptible to spikes caused by phase jumps on the Company system.


The active power-frequency control system, and overall response of the inverter-based resource (plant), must meet the following performance aspects (see figure below):

The active power-frequency control system shall have an adjustable proportional droop characteristic with a default value of 4% percent. The droop setting shall permit a setting from 0.1% to 10%. This setting shall be changed upon Company's written request as necessary for grid droop response coordination. The droop setting shall be tunable and may be specified during commissioning. The droop shall be a permanent value based on Pmax (maximum nominal active power output of the plant) and Pmin (typically 0 for an inverter-based resource). This keeps the proportional droop constant across the full range of operation. The curve for an inverter-based BESS may include the negative active power quadrant of this

curve. The droop response must include the capability to respond in both the upward (underfrequency) and downward (overfrequency) directions. Frequency droop will be based on the difference between maximum nameplate active power output (Pmax) and zero output (Pmin) such that the 4% percent droop line is always constant for a resource.

Subscriber Organization shall make commercially reasonable efforts to provide frequency response without a deadband, but in any case, not to exceed +/- 0.0166 Hz. If the active power-frequency control system has a deadband, it shall be a nonstep deadband that is adjustable between 0 Hz and the full frequency range of the droop characteristic with a default value not to exceed ± 0.036 Hz. (Nonstep deadband is where the change in active power output starts from zero deviation on either side of the deadband.) (Frequency deadband is the range of frequencies in which the unit does not change active power output.)

Inverter-based resources may consider a small hysteresis characteristic where linear droop meets any deadband to reduce dithering of inverter output when operating near the edges of the deadband. The hysteresis range may not exceed ± 0.005 Hz on either side of the deadband. If measurement resolution is not sufficient to measure this frequency, hysteresis may not be used.

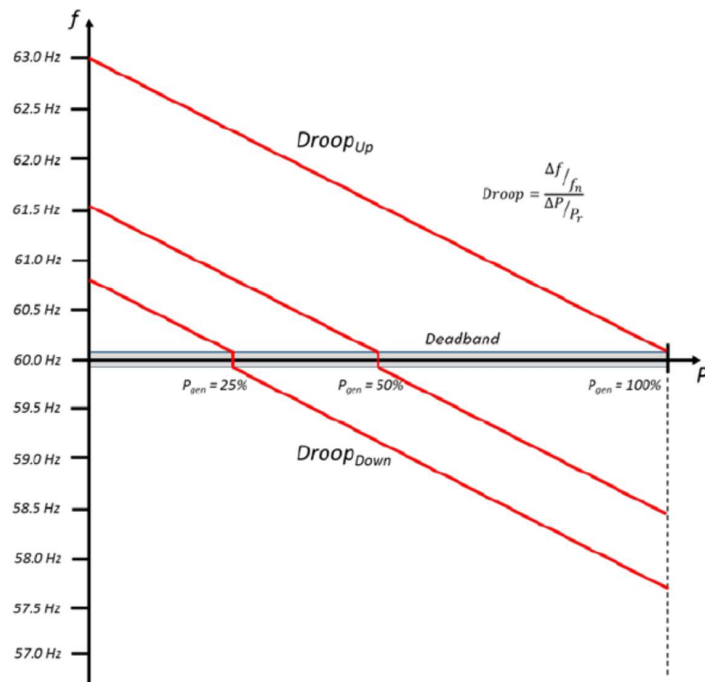

Active Power - Frequency Control Characteristic

Nominal System Frequency is 60.00 Hz.

The closed-loop dynamic response of the active power-frequency control system of the overall inverter-based resources, as measured at the POI must have the capability to meet or exceed the performance specified in below. Subscriber Organization shall ensure that the models and parameters for the resources and control equipment are consistent with those provided during the IRS process and that any updates have been provided to the Company reflecting currently implemented settings and configuration.

(xii) Dynamic Active Power-Frequency Performance.

For a step change in frequency at the point of measure of the inverter-based resource [NOTE - MAY BE ADJUSTED AS THE RESULT OF IRS]:

Reaction time: The time between a step change in frequency and the time when the resource active power output begins responding to the change shall be less than 500 ms or as otherwise specified by Company.¹

Rise time: The time when the resource has reached 90% of the new steady-state (target) active power output shall be less than 4 seconds, or as otherwise specified by Company.²

Settling Time: Time in which the resource has entered into, and remains within, the settling band of the new steady-state active power (target) output shall be less than 10 seconds, or as otherwise specified by Company.

Overshoot: Percentage of the rated active power output that the resource can exceed while reaching the settling band shall be less than 5% or as otherwise specified by Company.³

Settling Band: Percentage of rated active power output that the resource should settle to within the settling time shall be less than 2.5%.

When operating in parallel with the Company System, the Facility shall operate with its primary frequency response control in automatic operation and in accordance with Company directions. Notification of changes in the status of the frequency response controls and, where applicable, mode of operation must be provided to the Company System Operator immediately through SCADA telemetry indication.

The Facility frequency response control shall adjust, without intentional delay and without regard to the ramp rate limits in Section 3(c) (Ramp Rates) of this Attachment F (Facility Owned by Subscriber Organization), the Facility's net real power export based on frequency deadband and frequency droop settings specified by the Company.

The Facility frequency response control shall increase the net real power export above the Power Reference Setpoint set under Section 1(g)(viii) of this Attachment F (Facility Owned by Subscriber Organization) or further decrease the net real power export from the Power Reference Limit in its operations in accordance with the frequency response settings.

The Facility frequency response control shall be in continuous operation unless directed otherwise by the Company.

~~(xiii) [FOR FACILITIES WITH STORAGE]. Alternate Active Power/ Frequency Response Modes. The Facility will provide the capability to supply an isochronous mode of operation, in addition to normal droop, which can be set remotely or locally. The control design shall allow for a bump less transfer between modes of operation.~~

~~A. Reserved.~~

~~B. Isochronous / Black Start: The Facility will be capable of operating in a zero droop (isochronous) mode of operation. When in this mode of operation, the frequency droop characteristic will be configured as needed to keep system frequency at a target. In a black start configuration, the target shall be 60 Hz. If isochronous is specified while in operation, the target shall be initialized to the grid frequency and~~

¹ Time between step change in frequency and the time to 10 percent of new steady-state value can be used as a proxy for determining this time.

² Percentage based on final (expected) settling value.

³ Percentage based on final (expected) settling value.

~~the target increased or decreased from the Company System through the control interface.~~

~~(xiii) [Reserved]~~

- (h) Control System Acceptance Test Procedures.
- (i) Conditions Precedent. The following conditions precedent must be satisfied prior to conducting the Control System Acceptance Test:
- Successful completion of the Acceptance Test.
 - Facility has been successfully energized.
 - All of the Facility's generators (as applicable) have been fully commissioned.
 - The control system computer has been programmed for normal operations.
 - All equipment that is relied upon for normal operations (including ancillary devices such as capacitors/inductors, energy storage device, statcom, etc.) shall have been commissioned and be operating within normal parameters.
- (ii) Facility Energy Equipment. In the event that all or any portion of the Facility's energy equipment is not available for the duration of the Control System Acceptance Test, the Control System Acceptance Test will have to be re-run from the beginning unless Subscriber Organization demonstrates to the satisfaction of the Company that the test results attained are consistent with the results that would have been attained if all of the equipment had been available for the duration of the test.
- (iii) Procedures. The Control System Acceptance Test will be conducted on Business Days during normal working hours on a mutually agreed upon schedule. No Control System Acceptance Test will be scheduled during the final 21 Days of a calendar year. No later than thirty (30) Days prior to conducting the Control System Acceptance Test, Company and Subscriber Organization shall agree on a written protocol setting out the detailed procedure and criteria for passing the Control System Acceptance Test. Exhibit F-7 (Control System Acceptance Test Criteria) provides general criteria to be included in the written protocol for the Control System Acceptance Test. Within fifteen (15) Business Days of completion of the Control System Acceptance Test, Company shall notify Subscriber Organization in writing whether the Control System Acceptance Test(s) has been passed and, if so, the date upon which such Control System Acceptance Test(s) was passed. If any changes have been made to the technical specifications of the Facility or the design of the Facility in accordance with Section 5(f) of Exhibit F-1 (Description of Generation and Battery Storage Facility), such changes shall be reflected in an amendment to this Contract, and the written protocol for the Control Systems Acceptance Test shall be based on the Facility as modified. Such amendment shall be executed prior to conducting the Control System Acceptance Test and Company shall have no obligation for any delay in performing the Control Systems Acceptance Test due to the need to complete and execute such amendment.
- (i) Facility Security and Maintenance. Subscriber Organization is responsible for securing the Facility. Subscriber Organization shall have personnel available to respond to all calls related to security incidents and shall take commercially reasonable efforts to prevent any security incidents. Subscriber Organization is also responsible for maintaining the Facility, including vegetation management, to prevent security breaches. Subscriber Organization shall comply with all commercially reasonable requests of Company to update security and/or maintenance if required to prevent security breaches.

- (j) Demonstration of Facility. Company shall have the right at any time, other than during maintenance or other special conditions, including Force Majeure, communicated by Subscriber Organization, to notify Subscriber Organization in writing of Subscriber Organization's failure, as observed by Company and set forth in such written notice, to meet the operational and performance requirements specified in Section 1(b)(iii)(I), Section 1(g) (Active Power Control Interface) and Section 3 (Performance Standards) of this Attachment F (Facility Owned by Subscriber Organization), and to require documentation or testing to verify compliance with such requirements. Upon receipt of such notice, Subscriber Organization shall promptly investigate the matter, implement corrective action and provide to Company, within thirty (30) Days of such notice or such longer time period agreed to in writing by Company, a written report of both the results of such investigation and the corrective action taken by Subscriber Organization; ~~provided, that, if thirty (30) Days is not a reasonable time period to investigate the matter, implement corrective action and provide such written report, Subscriber Organization shall complete the foregoing within such longer commercially reasonable period of time agreed to by the Parties in writing.~~ If the Subscriber Organization's report does not resolve the issue to Company's reasonable satisfaction, the Parties shall promptly commission a study to be performed by one of the engineering firms then included on the Qualified Independent Third-Party Consultants List attached to the Contract as Exhibit F-2 (Consultants List) to evaluate the cause of the non-compliance and to make recommendations to remedy such non-compliance. Subscriber Organization shall pay for the cost of the study. The study shall be completed within ninety (90) Days, unless the selected consultant determines that such study cannot reasonably be completed within ninety (90) Days, in which case, such longer commercially reasonable period of time as it takes the ~~selected~~ consultant ~~determines is necessary~~ to complete ~~such~~the study ~~shall apply~~. The consultant shall send the study to Company and Subscriber Organization. Subscriber Organization (and/or its Third-Party consultants and contractors), at Subscriber Organization's expense, shall take such action as the study shall recommend with the objective of resolving the non-compliance. Such recommendations shall be implemented by Subscriber Organization to Company's reasonable satisfaction no later than forty-five (45) Days from the Day the completed study is issued by the consultant, unless the consultant determines that such recommendations cannot reasonably be implemented within forty-five (45) Days, in which case, ~~Subscriber Organization shall implement such recommendations within~~ such longer commercially reasonable period of time agreed to by the Parties in writing to implement such recommendation as determined by the consultant. Failure to implement such recommendations within this period shall constitute a material breach of this Contract. ~~Unless the aforementioned written report and study are being completed, and any recommendations are being implemented, solely to address Subscriber Organization's failure to satisfy the requirements of Section 3(w) (Round Trip Efficiency) of this Attachment F (Facility Owned by Subscriber Organization), the~~ Company shall have the right to ~~declare derate the Facility and~~ the Facility ~~derated and shall be deemed to be~~ in Subscriber Organization-Attributable Non-Generation status until the Subscriber Organization's aforementioned written report has been completed, any subsequent study commissioned by the Parties has been completed and any recommendations to resolve the non-compliance have been implemented to Company's reasonable satisfaction.

2. OPERATING PROCEDURES. [NOTE: NUMERICAL SPECIFICATIONS IN THIS SECTION 2 MAY VARY DEPENDING ON THE SPECIFIC PROJECT AND THE RESULTS OF THE PROJECT-SPECIFIC INTERCONNECTION REQUIREMENT STUDY.]

- (a) Reviews of the Facility. Company may require periodic reviews of the Facility, maintenance records, available operating procedures and policies, and relay settings, and Subscriber Organization shall implement changes Company deems necessary for parallel operation or to protect the Company System from damages resulting from the parallel operation of the Facility with the Company System.
- (b) Separation. Subscriber Organization must separate from Company System whenever requested to do so by the Company System Operator pursuant to Section 5. (Company Dispatch) and Section 12. (Personnel and System Safety) of the Contract.

- (c) Subscriber Organization Logs. Logs shall be kept by Subscriber Organization for information on unit availability including reasons for planned and forced outages, circuit breaker trip operations, relay operations, including target initiation, and other unusual events. Company shall have the right to review these logs, especially in analyzing system disturbances. Subscriber Organization shall maintain such records for a period of not less than six (6) years.
- (d) Reclosing and Return to Service. Under no circumstances shall Subscriber Organization, when separated from the Company System for any reason, including tripping during disturbances or due to equipment failure, reclose into the Company System without first obtaining specific approval to do so from the Company System Operator. Ramp rates, behavior and mode of operation upon return to service shall conform to verbal instructions from the System Operator or Active Power control from Company. Following "system black" conditions, the Facility shall not attempt to automatically reconnect to the grid (unless directed by the Company System Operator) so as to not interfere with ~~blackstart~~system restoration procedures.
- (e) ~~[Reserved.]~~
- (f) ~~[Reserved.]~~
- (g) Critical Infrastructure Protection. Subscriber Organization shall comply with the critical infrastructure protection requirements set forth in Section 1(b) (iii) (G) of this Attachment F (Facility Owned by Subscriber Organization).
- (h) Allowed Operations. Facility shall be allowed to export energy to the Company System only when the [] circuit is in normal operating configuration served by breaker [] at [] Substation. **[TO BE DETERMINED BY COMPANY BASED ON THE RESULTS AND REQUIREMENTS OF THE IRS]**

3. **PERFORMANCE STANDARDS**. **[NOTE: FACILITIES CONNECTING TO THE DISTRIBUTION SHALL FOLLOW THE PERFORMANCE STANDARDS FOR DISTRIBUTION SET FORTH BELOW.]**

-

PROVISIONS FOR DISTRIBUTION CONNECTION

- (a) Rule 14H. The Facility shall follow the performance standards of Rule 14H Appendix I and the additional provisions set forth below in Section 3(b) (Voltage Ride-Through) through Section 3(g) (Unintentional Islanding). To the extent any of those additional provisions conflict with Rule 14H, the ~~additional~~ provisions of ~~Section 3(b) through Section 3(g)~~this Contract shall control.
- ~~(b) Voltage Ride Through. Whenever the utility Distribution System voltage at the Point of Interconnection varies from and remains outside the normal operating high and normal operating low region voltage for the predetermined parameters set forth in Table 4A-1.1. The Facility's protective functions shall cause the Facility's Advanced Inverter(s) to Cease to Energize the utility Distribution System. Unless provided alternate settings by the Company, the Facility must comply with the voltage ride through and trip settings specified in Table 4A-1.1:~~
 - ~~1. The Facility shall stay connected to the utility Distribution System while the grid remains within the "Ride Through Until" voltage time range and must operate in accordance with the "Operating Mode" specified for each "Operating Region".~~
 - ~~2. In the Continuous Operation region, the Facility's Advanced Inverter shall reduce power output as a function of voltage, in accordance with section (iv) Volt Watt of Rule 14H.~~
 - ~~3. Different settings than those specified in Table 4A-1.1 may be specified by the Company~~

TABLE 4A-1.1: VOLTAGE RIDE-THROUGH TABLE				
Operating Region	Voltage at Point of Interconnection (% of Nominal Voltage)	Operating Mode	Ride-Through Until (s)	Default Maximum Trip Time (s)
OV2	$V > 120$	Cease to Energize	N/A	0.16 (1)
OV1	$120 \geq V > 110$	Mandatory operation	.92	±
EO	$110 \geq V > 100$	Continuous Operation (Volt-Watt)	N/A	N/A
EO	$100 > V \geq 88$	Continuous Operation	N/A	N/A
UV1	$88 > V \geq 70$	Mandatory Operation	20	2±
UV2	$70 > V \geq 50$	Mandatory Operation	10-20	11-21(2)
UV3	$50 > V$	Momentary Cessation	N/A	±

⁽¹⁾Must trip time under steady state condition. Inverters will also be required to meet the Company's Transient Overvoltage criterion (TrOV-2) or Limitation of overvoltage contribution requirement stated in IEEE 1547-2018 (or latest version), "IEEE Standard for Interconnection and Interoperability of Distributed Energy Resources with Associated Electric Power System Interfaces." Ride-Through shall not inhibit TrOV-2 or limitation of overvoltage contribution of IEEE 1547-2018 requirements.

⁽²⁾May be adjusted within these ranges at manufacturer's discretion.

~~(e) Fault Ride Through. For fault related voltage dips at the Point of Interconnection that stay within the limits of the under voltage ride through requirements in Section 3(b) (Voltage Ride Through), upon clearing of the fault, Subscriber Organization shall within 1 second of restoration, provide at least 90% of the real power output at the point of interconnection immediately before the fault to the extent allowed by the availability of the solar resource. The fault ride through requirement does not apply if the Generating Facility is operating at less than five percent (5%) of the Generating Facility's nameplate capacity.~~

~~(d)(b) Voltage Ride-Through. The Facility shall have under-voltage and over-voltage ride through capability. This Facility shall behave as follows during the under-voltage disturbances and over-voltage disturbances ("V" is the voltage of any three voltage phases at the Point of Interconnection). For alarm conditions the Facility should not disconnect from the Company System unless the Subscriber Organization reasonably determines based upon Good Engineering and Operating Practices that the Facility's equipment is at risk of damage. The is necessary in order to coordinate with the existing Company System. [THESE VALUES MAY BE CHANGED BY COMPANY UPON COMPLETION OF THE IRS. WITHOUT LIMITATION, FOR A DISTRIBUTION-CONNECTED FACILITY, UPON COMPLETION OF THE IRS THE COMPANY MAY SPECIFY REQUIREMENTS FOR A MANDATORY DISCONNECTION FROM THE COMPANY SYSTEM.];~~

(c) Undervoltage Ride-Through: The Facility, as a whole, will meet the following undervoltage ride-through requirements during low voltage affecting one or more of the three voltage phases ("V" is the voltage of any three voltage phases at the Point of Interconnection).

$V \geq 0.80$ pu The Facility remains connected to the Company's System in continuous operation.

$0.70 \text{ pu} \leq V < 0.80 \text{ pu}$ The Facility remains connected to the Company's System and in continuous operation for a minimum of twenty (20) seconds per event (while "V" remains in this range). The duration of the event is measured from the point at which the voltage drops below 0.80 pu and ends when the voltage is at or above 0.80 pu.

$0.50 \text{ pu} \leq V < 0.70 \text{ pu}$ The Facility remains connected to the Company's System and in continuous operation for a minimum of ten (10) seconds (while "V" remains in this range); the duration of the event is measured from the point at which the voltage drops below 0.70 pu. and ends when the voltage is at or above 0.70 pu.

$0.00 \text{ pu} \leq V < 0.50 \text{ pu}$ The Facility remains connected to the Company's System and in continuous operation for a minimum of 600 milliseconds (while "V" remains in this range); the duration of the event is measured from the point at which the voltage drops below 0.50 pu. and ends when the voltage is at or above 0.50 pu.

(d) Overvoltage Ride-Through: The overvoltage protection equipment at the Facility shall be set so that the Facility will meet the following overvoltage ride-through requirements during high voltage affecting one or more of the three voltage phases (as described below) ("V" is the voltage of any of the three voltage phases at the Point of Interconnection).

$1.00 \text{ pu} \leq V < 1.10 \text{ pu}$ The Facility remains connected to the Company's System and in continuous operation.

$1.10 \text{ pu} \leq V < 1.15 \text{ pu}$ The Facility remains connected to the Company's System and in continuous operation no less than thirty (30) seconds; the duration of the event is measured from the point at which the voltage increases at or above 1.10 pu and ends when voltage is at or below 1.10 pu.

$1.15 \text{ pu} \leq V$ The Facility remains connected to the Company's System and in continuous operation for as long as possible as allowed by the equipment operational limitations.

(e) Fault Ride Through. Ride-Through requires that the resource continues to inject current within the "No Trip" zone of the voltage and frequency ride-through requirements. Unless approved during the Interconnection Requirements Study analysis, resources should not use "momentary cessation" within the ride-through regions for any of the ride-through requirements.

(f) Grid Forming Capabilities. **[NOTE APPLICABILITY BASED ON RESOURCE TYPE AND DESIGN, FOR PV INVERTER BASED RESOURCES PAIRED WITH STORAGE, TO BE DELETED IF SUBSCRIBER ORGANIZATION DOES NOT PROPOSE GRID FORMING]** Subscriber Organization Facility ~~inverters shall~~may be capable of operating in grid forming mode ~~supporting system operation under normal and emergency conditions without relying on~~if intended to serve load in the ~~characteristics absence of synchronous machines. the power system. .~~ Grid forming

is required for facilities that provide black start capability. This includes operation as a current independent AC voltage source during normal and transient conditions (as long as no limits are reached within the inverter) and the ability to synchronize to other voltage sources or operate autonomously if a grid reference is unavailable. The grid-forming design and operation shall be reviewed and agreed upon by the company to ensure compatibility with system operation under normal and restoration procedures.

~~(i) Subscriber Organization shall operate the Facility in grid forming mode only as directed by the Company System Operator, in its sole discretion. Such mode of operation shall be indicated to the Company System Operator through telemetry.~~

~~(ii) The Facility shall include safeguards to prevent the unintentional switching of the Facility into and out of grid forming mode. The safeguards shall be approved in writing by the Company and implemented by the Subscriber Organization prior to control system testing.~~

~~(e)(g) Black Start Capability. [NOTE - APPLICABILITY BASED ON RESOURCE TYPE AND DESIGN, FOR PV INVERTER BASED RESOURCES PAIRED WITH STORAGE, TO BE DELETED IF SUBSCRIBER ORGANIZATION DOES NOT PROPOSE BLACK START] The BESS shall be capable of grid forming inverter capability so it can generate its own AC waveform rather than relying on a grid voltage to synchronize and maintain frequency. Further, inverter based resources shall ensure they have sufficient energy storage to maintain power injection to the grid during system restoration (i.e., have power available when and if called upon). Inverter based facilities should be capable of support as a black start cranking path to start synchronous generators for restoration.~~

~~(f)(h) Frequency Response. Subscriber Organization shall comply with the requirements of Section 1(g)(xi) (Frequency Response (DROOP)), Section 1(g)(xii) (Dynamic Active Power – Frequency Performance), and [FOR FACILITIES WITH STORAGE] Section 1(g)(xiii) (Alternate Active Power / Frequency Response Modes) of this Attachment F (Facility Owned by Subscriber Organization).~~

~~(g) Unintentional Islanding. A Facility's inverters shall be certified to meet the unintentional islanding requirement stated in IEEE 1547-2018 (or latest version), "IEEE Standard for Interconnection and Interoperability of Distributed Energy Resources with Associated Electric Power System Interfaces." Ride through requirements specified herein shall not inhibit the islanding detection performance where a valid unintentional islanding condition exists.~~

4. MAINTENANCE OF SUBSCRIBER ORGANIZATION-OWNED INTERCONNECTION FACILITIES.

(a) Subscriber Organization must address any Disconnection Event (as defined below) according to the requirements of this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities) of Attachment F (Facility Owned by Subscriber Organization). For the purposes of this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities), a "Disconnection Event" is the removal of 80% of capacity or more from Company System and/or disconnection of the Facility from the Company's System (i) that is not the result of Company dispatch, frequency droop response, or isolation of the Facility resulting from designed protection fault clearing, and (ii) for which Company does not issue the written notice for failure to meet operational and performance requirements as set forth in Section 1(j) (Demonstration of Facility) of this Attachment F (Facility Owned by Subscriber Organization). Company's election to exercise its rights under Section 1(j) (Demonstration of Facility) shall not relieve Subscriber Organization of its obligation to comply with the requirements of this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities) for any future Disconnection Event during the pendency of such election or thereafter.

(b) For every Disconnection Event ~~from the Company System~~, Subscriber Organization shall investigate the cause. Within three (3) Business Days of the Disconnection Event, Subscriber Organization shall

provide, in writing to Company, an incident report that summarizes the sequence of events and probable cause.

- (c) Within forty-five (45) Days of a Disconnection Event, Subscriber Organization shall provide, in writing to Company, Subscriber Organization's findings, data relied upon for such findings, and proposed actions to prevent reoccurrence of a Disconnection Event ("Proposed Actions"). Company may assist Subscriber Organization in determining the causes of and recommendations to remedy or prevent a Disconnection Event ("Company's Recommendations"). Subscriber Organization shall implement such Proposed Actions (as modified to incorporate the Company's Recommendations, if any) and Company's Recommendations (if any) in accordance with the time period agreed to by the Parties.
- (d) In the event Subscriber Organization and Company disagree as to (i) whether a Disconnection Event occurred, (ii) the sequence of events and/or probable cause of the Disconnection Event, (iii) the Proposed Actions, (iv) Company's Recommendations, and/or (v) the time period to implement the Proposed Actions and/or Company's Recommendations, then the Parties shall follow the procedure set forth in Section 5 (Expedited Dispute Resolution) of this Attachment F (Facility Owned by Subscriber Organization).
- (e) Upon the fourth (4th) Disconnection Event (and each subsequent Disconnection Event) within any Contract Year, the Parties shall follow the procedures set forth in Section 4(a) and Section 4(d) of Attachment F (Facility Owned by Subscriber Organization), to the extent applicable. If after following the procedures set forth in this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities) of Attachment F (Facility Owned by Subscriber Organization), Subscriber Organization and Company continue to have a disagreement as to (1) the probable cause of the Disconnection Event, (2) the Proposed Actions, (3) the Company's Recommendations, and/or (4) the time period to implement the Proposed Actions and/or the Company's Recommendations, then the Parties shall commission a study to be performed by a qualified independent Third-Party consultant ("Qualified Consultant") chosen from the Qualified Independent Third-Party Consultants List ("Consultants List") attached to the Contract as Exhibit F-2 (Consultants List). Such study shall review the design of, review the operating and maintenance procedures dealing with, recommend modifications to, and determine the type of maintenance that should be performed on Subscriber Organization-Owned Interconnection Facilities ("Study"). Subscriber Organization and Company shall each pay for one-half of the total cost of the Study. The Study shall be completed within ninety (90) Days from such fourth Disconnection Event (and each subsequent Disconnection Event) within any Contract Year, unless ~~the Qualified Consultant determines the Study cannot otherwise~~ reasonably ~~be completed within ninety (90) Days, in which case, such longer period of time as the Qualified Consultant determines is necessary~~ agreed to complete the Study shall apply in writing by the Subscriber Organization and Company. The Qualified Consultant shall send the Study to Company and Subscriber Organization. Subscriber Organization (and/or its Third-Party consultants and contractors), at Subscriber Organization's expense, shall change the design of, change the operating and maintenance procedures dealing with, implement modifications to, and/or perform the maintenance on Subscriber Organization-Owned Interconnection Facilities recommended by the Study. Such design changes, operating and maintenance procedure changes, modifications, and/or maintenance shall be completed no later than forty-five (45) Days from the Day the completed Study is issued by the Qualified Consultant, unless such design changes, operating and maintenance procedure changes, modifications, and/or maintenance cannot reasonably be completed within forty-five (45) Days, in which case, Subscriber Organization shall complete the foregoing within such longer commercially reasonable period of time agreed to by the Parties in writing. Company shall have the right to derate the Facility to a level that maintains reliable operations in accordance with Good Engineering and Operating Practices, and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status, until the study has been completed and the study's recommendations have been implemented by Subscriber Organization to Company's reasonable satisfaction. Nothing in this provision shall affect Company's right to dispatch the Facility as provided for in this Contract.

- (f) The Consultants List attached hereto as Exhibit F-2 (Consultants List) contains the names of engineering firms which both Parties agree are fully qualified to perform the Study. At any time, except when a Study is being conducted, either Party may remove a particular consultant from the Consultants List by giving written notice of such removal to the other Party. However, neither Party may remove a name or names from the Consultants List without approval of the other Party if such removal would leave the list without any names. Intended deletions shall be effective upon receipt of notice by the other Party, provided that such deletions do not leave the Consultants List without any names. Proposed additions to the Consultants List shall automatically become effective thirty (30) Days after notice is received by the other Party unless written objection is made by such other Party within said thirty (30) Day period. By mutual agreement between the Parties, a new name or names may be added to the Consultants List at any time.

5. EXPEDITED DISPUTE RESOLUTION.

If there is a disagreement between Company and Subscriber Organization regarding (i) whether a Disconnection Event occurred, (ii) the sequence of events and/or probable cause of the Disconnection Event, (iii) the Proposed Actions, (iv) the Company's Recommendations, and (v) the time period to implement the Proposed Actions and/or the Company's Recommendations, then authorized representatives from Company and Subscriber Organization, having full authority to settle the disagreement, shall meet in Hawai'i (or by telephone conference) and attempt in good faith to settle the disagreement. Unless otherwise agreed in writing by the Parties, the Parties shall devote no more than five (5) Business Days to settle the disagreement in good faith. In the event the Parties are unable to settle the disagreement after the expiration of the time period, then such disagreement shall constitute a Dispute for which either Party may pursue the dispute resolution procedure set forth in Section 17. (Dispute Resolution) of this Contract.

6. MODELING.

- (a) Subscriber Organization's Obligation to Provide Models. Within 30 Days of Company's written request, but no later than the Commercial Operations Date, Subscriber Organization shall provide detailed data regarding the design and location of the Facility, in a form reasonably satisfactory to Company, to allow the modeling of the inverters and any other equipment within the Facility identified in the IRS which utilizes Source Code (such as energy storage system, STATCOM or DVAR equipment), including, but not limited to, integrated and validated power flow and transient stability models (such as PSS/E models), a short circuit model (such as an ASPEN model), and an electro-magnetic transient model (such as a PSCAD model) of the inverters and any additional equipment identified in the IRS as set forth above, applied assumptions, and pertinent data sets (each a "Required Model") and collectively, the "Required Models"). Thereafter, during the Term, Subscriber Organization shall provide working updates of any Required Model within 30 Days of (i) Company's written request, or (ii) Subscriber Organization obtaining knowledge or notice that any Required Model has been modified, updated or superseded by the Source Code Owner.
- (b) Escrow Establishment. If, pursuant to Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization), the Required Models are provided to the Company in a form other than Source Code, Subscriber Organization shall arrange for and ensure that the Source Code for the relevant Required Model is deposited into the Source Code Escrow as set forth below in Section 6(b)(i) (Source Code Escrow) of this Attachment F (Facility Owned by Subscriber Organization) no later than the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization) for delivery of the Required Models. Subscriber Organization shall be responsible for all costs associated with establishing and maintaining the Source Code Escrow. If, however, Subscriber Organization is unable to deposit the required Source Code into the Source Code Escrow within the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models), Subscriber Organization shall, no later than such time periods, instead establish a monetary escrow as set forth below in Section 6(b)(ii) (Monetary Escrow) of this Attachment F (Facility Owned by Subscriber Organization).

(i) Source Code Escrow.

(A) Establishment of Source Code Escrow. If the Required Models are not provided to the Company in the form of Source Code pursuant to Section 6(a) of this Attachment F (Facility Owned by Subscriber Organization), Subscriber Organization shall: (a) arrange for and ensure the deposit of a copy of the current version of the Source Code and relevant documentation for all Required Models with the Source Code Escrow Agent under the terms and conditions of the Source Code Escrow Agreement, and (b) arrange for and ensure the update of the deposited Source Code and relevant documentation for Major Releases and Minor Releases of the Required Models as soon as reasonably possible after they are made generally available.

(B) Release Conditions. Company shall have the right to obtain from the Source Code Escrow Agent one copy of the escrowed Source Code for the Required Models, under the following conditions upon Company's request:

(i) A receiver, trustee, or similar officer is appointed, pursuant to federal, state or applicable foreign law, for the Source Code Owner;

(ii) Any voluntary or involuntary petition or proceeding is instituted, under (x) U.S. bankruptcy laws or (y) any other bankruptcy, insolvency or similar proceeding outside of the United States, by or against the Source Code Owner; or

(iii) Failure of the Source Code Owner to function as a going concern or operate in the ordinary course; or

(iv) Subscriber Organization and the Source Code Owner fail to provide to Company the Required Models or updated Required Models, or, alternatively, fail to issue a Source Code LC, within the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization), Company gives written notice of such failure to Subscriber Organization and the Source Code Owner, and Subscriber Organization and Source Code Owner fail to remedy such breach within five (5) Days following receipt of such notice.

(C) Remedies. If Company has the right to obtain from the Source Code Escrow Agent one copy of the escrowed Source Code for the Required Models pursuant to Section 6(b)(i)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization), and Company finds that Subscriber Organization failed to arrange for and ensure the update the Source Code Escrow with the modified and/or updated Source Code and relevant documentation for Major Releases and Minor Releases of the Required Models as provided in Section 6(b)(i) (Establishment of Source Code Escrow) of Attachment F (Facility Owned by Subscriber Organization) or that the Source Code for the Required Models is incomplete or otherwise unusable, Subscriber Organization shall be liable to Company for liquidated damages in the amount of \$500 per Day for each Day Subscriber Organization fails to provide such Source Code to Company or such update to the Source Code to Company from the date such Major Release or Minor Release was first made available by the Source Code Owner to customers of the Source Code Owner. Failure to provide the updated Source Code of the Required Models within 30 Days' notice from Company of a breach of Section 6(b)(i)(A) (Establishment of Source Code Escrow) of Attachment F (Facility Owned by Subscriber Organization); provided, that Subscriber Organization has also failed to provide a satisfactory Source Code LC as set forth in Section 6(b)(ii) (Source Code Security) of this Attachment F (Facility Owned by Subscriber Organization) shall constitute an Event of Default pursuant to Section 13, under the Contract.

(D) Certification. The Source Code Escrow Agent shall release the Source Code of the Required Models to Company upon receipt of a signed statement by a representative of Company that reads substantially as follows:

For Maui Facilities: The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Maui Electric Company, Limited ("Maui Electric"), and (ii) Maui Electric

is entitled to a copy of the Source Code of the Required Models Pursuant to Section 6(b) (i) (B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Maui Electric.

For Hawai‘i Facilities: The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf Hawai‘i Electric Light Company, Inc. ("Hawai‘i Electric Light"), and (ii) Hawai‘i Electric Light of is entitled to a copy of the Source Code of the Required Models Pursuant to Section 6(b) (i) (B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Hawai‘i Electric Light.

(E) Authorized Use. If Company becomes entitled to a release of the Source Code of the Required Models from escrow, Company may thereafter correct, modify, update and enhance the Required Models for the sole purpose of providing itself the support and maintenance it otherwise would have been entitled to if it had been provided the Required Models by Subscriber Organization under Section 6(a) (Subscriber Organization’s Obligation to Provide Models) of this Attachment F (Facility Owned By Subscriber Organization) (the “Source Code Authorized Use”).

(F) Confidentiality Obligations. Company shall keep the Source Code of the Required Models confidential pursuant to the confidentiality obligations of the Source Code Escrow Agreement. Company shall restrict access to the Source Code of the Required Models to those employees, independent contractors and consultants of Company who have agreed in writing to be bound by confidentiality and use obligations consistent with those specified in the Escrow Agreement, and who have a need to access the Source Code of the Required Models on behalf of Company to carry out their duties for the Source Code Authorized Use. Promptly upon Subscriber Organization’s request, Company shall provide Subscriber Organization with the names and contact information of all individuals who have accessed the Source Code of the Required Models, and shall take all reasonable actions required to recover any such Source Code in the event of loss or misappropriation, or to otherwise prevent their unauthorized disclosure or use.

(ii) Source Code Security.

(A) Establishment of Source Code Security. If the Required Models and their relevant Source Code are not provided to the Company in the form of Source Code pursuant to Section 6(a) (Subscriber Organization’s Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization) and if the Subscriber Organization is unable to arrange for and ensure the deposit of the Source Code into the Source Code Escrow established for the benefit of the Company pursuant to Section 6(b)(i) (Source Code Escrow) of this Attachment F (Facility Owned by Subscriber Organization) then, no later than the time periods set forth in Section 6(a) (Subscriber Organization’s Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization) for delivery of the Required Models and Source Code, Subscriber Organization shall provide an irrevocable standby letter of credit (the “Source Code LC”) with no documentation requirement in the amount of Two Hundred Fifty Thousand Dollars (\$250,000) per Required Model (and its relevant Source Code) substantially in the form attached to this Contract as Exhibit G-1 (Form of Letter of Credit) from a bank chartered in the United States with a credit rating (as measured by Standard & Poor’s) of “A-“ or better ~~from Standard & Poor’s~~ or A3 or better from Moody’s. Such letter of credit shall be issued for a minimum term of one (1) year. Furthermore, at the end of each year the security shall be renewed for an additional one (1) year term so that at the time of such renewal, the remaining term of any such security shall not be less than one (1) year. The letter of credit shall include a provision for at least thirty (30) Days’ advance notice to Company of any expiration or earlier termination of the letter of credit so as to allow Company sufficient time to exercise its rights under said security if Subscriber Organization fails to extend or replace the security. In all cases, the reasonable costs and expenses of establishing, renewing, substituting, canceling, increasing, reducing, or otherwise administering the letter of credit shall be borne by Subscriber Organization.

(B) Release Conditions. Company shall have the right to draw on the letter of credit the funds necessary to develop and recreate the Required Model or Required Models upon Company's request if Subscriber Organization fails to provide the Company the Required Models or updated Required Models within the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) or Section 6(b)(i)(C) (Remedies) of this Attachment F (Facility Owned by Subscriber Organization), Company gives written notice of such failure to Subscriber Organization, and Subscriber Organization fails to remedy such breach within five (5) Days following receipt of such notice for a breach under Section 6(a) (Subscriber Organization's Obligation to Provide Models, or within thirty (30) Days following receipt of such notice for a breach under Section 6(b)(i)(C) (Remedies).

(C) Extend Letter of Credit. If the letter of credit is not renewed or extended no later than thirty (30) Days prior to its expiration or earlier termination, Company shall have the right to draw immediately upon the full amount of the letter of credit and to place the proceeds of such draw (the "Proceeds"), at Subscriber Organization's cost, in an escrow account in accordance with Section 6(b)(ii)(D) (Proceeds Escrow), until and unless Subscriber Organization provides a substitute form of letter of credit meeting the requirements of this Section 6(b)(ii) (Source Code Security) of this Attachment F (Facility Owned by Subscriber Organization).

(D) Proceeds Escrow. If Company draws on the letter of credit pursuant to Section 6(b)(ii)(C) (Extend Letter of Credit) of this Attachment F (Facility Owned by Subscriber Organization), Company shall, in order to avoid comingling the Proceeds, have the right but not the obligation to place the Proceeds in an escrow account as provided in this Section 6(b)(ii)(D) (Proceeds Escrow) of this Attachment F (Facility Owned by Subscriber Organization) with a reputable escrow agent acceptable to Company ("Proceeds Escrow Agent") subject to an escrow agreement acceptable to Company ("Proceeds Escrow Agreement"). Without limitation to the generality of the foregoing, a federally insured bank shall be deemed to be a "reputable escrow agent." Company shall have the right to apply the Proceeds as necessary to recover amounts Company is owed pursuant to this Section 6 (Modeling) of this Attachment F (Facility Owned by Subscriber Organization). To that end, the Proceeds Escrow Agreement governing such escrow account shall give Company the sole authority to draw from the account. Subscriber Organization shall not be a party to such Proceeds Escrow Agreement and shall have no rights to the Proceeds. Upon full satisfaction of Subscriber Organization's obligations under Section 6 (Modeling) of this Attachment F (Facility Owned by Subscriber Organization), Company shall instruct the Proceeds Escrow Agent to remit to the bank that issued the letter of credit that was the source of the Proceeds the remaining balance (if any) of the Proceeds. If there is more than one escrow account with Proceeds, Company may, in its sole discretion, draw on such accounts in any sequence Company may select. Any failure to draw upon the Proceeds for any damages or other amounts due Company shall not prejudice Company's rights to recover such damages or amounts in any other manner.

(E) Subscriber Organization's Obligation. If the letter of credit is not sufficient to cover Company's associated consultant fees, costs and expenses to develop and recreate the Required Models, Subscriber Organization shall pay to Company the difference within ten (10) Days of Company's written notice to Subscriber Organization.

(F) Model Verification. Subscriber Organization shall work with the Company to validate the new Required Models developed by or on behalf of Company within sixty (60) Days of receiving such new Required Models. Subscriber Organization shall also arrange for and ensure that Company may obtain new Required Models directly from the Source Code Owner in the event that Subscriber Organization ceases to operate as a going concern or is subject to voluntary or involuntary bankruptcy and is unable or unwilling to obtain the new Required Models from the Source Code Owner.

(G) Certification. The terms of the letter of credit shall provide for a release of the funds, or in the event the funds have been placed into a Proceeds Escrow, the Proceeds Escrow Agent shall release the necessary funds to Company upon receipt of a signed statement by a representative of Company that reads substantially as follows:

For Maui Facilities: The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Maui Electric Company, Limited (“Maui Electric”), and (ii) Maui Electric is entitled to \$ _____, pursuant to Section 6(b)(ii)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Maui Electric.

For Hawai‘i Facilities: The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Hawai‘i Electric Light Company, Inc. (“Hawai‘i Electric Light”), and (ii) Hawai‘i Electric Light is entitled to \$ _____, pursuant to Section 6(b)(ii)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Hawai‘i Electric Light.

(H) Authorized Use. If Company becomes entitled to a draw of funds from the Source Code Security or a release of funds from the Proceeds Escrow, Company may thereafter use such funds to develop, recreate, correct, modify, update and enhance the Required Models for the sole purpose of providing itself the support and maintenance it otherwise would have been entitled to if it had been provided the Required Models by Subscriber Organization under Section 6(a) (Subscriber Organization’s Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization).

- (iii) Supplementary Agreement. The parties stipulate and agree that the escrow provisions in this Section 6(b) (Escrow Establishment) of Attachment F (Facility Owned by Subscriber Organization) and the Source Code Escrow Agreement and Proceeds Escrow Agreement are “supplementary agreements” as contemplated in Section 365(n) (1) (B) of the Code. In any voluntary or involuntary bankruptcy proceeding involving Subscriber Organization, failure by Company to assert its rights to “retain its rights” to the intellectual property encompassed by the Source Code or the funds in the Proceeds Escrow, pursuant to Section 365(n) (1) (B) of the Code, under an executory contract rejected in a bankruptcy proceeding, shall not be construed as an election to terminate the ~~contract~~Agreement by Company under Section 365(n) (1) (A) of the Code.

7. TESTING REQUIREMENTS.

- (a) Testing Requirements. Once the Control System Acceptance Test has been successfully passed, Subscriber Organization shall not replace and/or change the configuration of the Facility Control, inverter control settings and/or ancillary device controls, without prior written notice to Company. In the event of any such replacement and/or change, the relevant test(s) of the Control System Acceptance Test shall be redone and must be successfully passed before the replacement or altered equipment is allowed to be placed in normal operations. In the event that Company reasonably determines that such replacement and/or change of controls makes it inadvisable for the Facility to continue in normal operations without a further Control Systems Acceptance Test, the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status until the new relevant tests of the Control System Acceptance Test have been successfully passed.
- (b) Periodic Testing. Subscriber Organization shall coordinate periodic testing of the Facility with Company to ensure that the Facility is meeting the performance standards specified under this Contract.

8. DATA AND FORECASTING.

Subscriber Organization shall provide Site, meteorological and production data in accordance with the following requirements:

- (i) Physical Site Data: Subscriber Organization shall provide Company with an accurate description of the physical Site, including but not limited to the following, [as appropriate to Facility resource type(s)]

and use of storage] which may not be changed during the Term without Company's prior written consent:

Location Facility Map showing the layout of the Facility (coverage area or footprint) and the coordinates (latitude and longitude) of generating equipment:

Solar PV: elevation (above ground), orientation angle and direction (north-east-south-west plane) of arrays/concentrators.

Location (latitude and longitude) and elevation (above ground) of each ~~MMT~~/MMS and elevation (above ground) of each field measurement device for, e.g., air density, ambient air pressure and ambient air temperature, located at each ~~MMTS~~ or each field measurement device located on such MMS.

For solar resource inverters: Inverter type, power rating, array configuration to inverters and DC rating of the Facility at the following standard test conditions: irradiance of 1000 W/m², air mass 1.5, and cell temperature 25° C.

Solar generation technology employed at the Facility with temperature dependence, mounting and module type.

BESS technology and related auxiliary equipment, location and type.

(ii) Meteorological and Production Data:

Subscriber Organization shall install and maintain a minimum of one MMS for facilities with a Contract Capacity of less than 5 MW and a coverage area of not more than one square kilometer.

Subscriber Organization shall install and maintain a minimum of two MMS for facilities that have either (i) a DC rating of the Facility of 5 MW or greater or (ii) a coverage area greater than one square kilometer.

Placement of each MMS should account for the microclimate of the area and Facility coverage area and shall be oriented with respect to the primary wind direction.

Subscriber Organization shall provide to Company, via SCADA communication and protocol acceptable to Company to support operations and forecasting needs at a continuous scan, all meteorological and production data required under this Contract updated every 2 seconds.

Subscriber Organization shall arrange for a dedicated distribution voltage line to provide separate service from Company, or for such other independent, backup power source as approved by Company in writing, to temporarily store and record the meteorological data from the field measuring devices at the MMSs. Any such backup power source must be capable of providing power for the field measurement devices for a reasonable period of time until primary power is restored. The same backup power source can serve multiple MMSs as needed by the Facility.

(c) Units and Accuracy:

~~[For PV]~~ The Table below shows minimum required solar irradiance measurements for various types of solar generation technology. This value may not be derived.

Solar Technology	Direct Normal Irradiance	Global Irradiance (GHI)	Plane of Array Irradiance (POA)
Flat Plate		X	X

(fixed horizontal, fixed angle, tracking, roof mounted)			
Flat Panel Solar Thermal (fixed angle, roof mounted, tracking)	X		X
Concentrated PV (flat, trough, tracking)	X	X	X

Units and accuracy of required measured parameters to be provided to Company in real time shall be as shown in the Table below. These represent the minimum required accuracies.

**Table of Units and Accuracy of
Meteorological and Production Data (PV)**

Parameter	Measurement Device (typical)	Unit	Range	Accuracy
Global Horizontal Irradiance at MMS	Pyranometer or equivalent	W/m ²	0 to 1500 W/m ²	Secondary standard per ISO 9060 or <= 3% from 100 W/m ² to 1500 W/m ² if using a PV Reference Cell
Plane of Array Irradiance on same axis as array	Pyranometer or equivalent	W/m ²	0 to 1500 W/m ²	Secondary standard per ISO 9060 or <= 3% from 100 W/m ² to 1500 W/m ² if using a PV Reference Cell
Back of Panel temperature at array height	Temperature probe	°C	-20 to +50 °C	+/-1 °C
Ambient air temperature at MMS	Temperature probe	°C	-20 to +50 °C	+/-1 °C
Ambient air pressure at MMS	Piezoresistive transducer or equivalent	mMbar	150 to 1150 mbar	+/-60 mbar (0 to +50°C)
Wind speed at MMS	Anemometer, sonic device or equivalent	mMph	0 to 134 mph	+/-1 mph
Wind direction at MMS	Vane, sonic device or equivalent	Degrees (from True North)	360°	+/-5°
Set point for each inverter	Reported by Subscriber Organization	MW	0 to inverter name plate	Not applicable
Power production of Facility	Measured at POI	MW	Up to <u>Allowed</u> Capacity	+/-0.1 MW
BESS Charging Power	Measured at BESS Charging Interface	MW	Up to <u>Allowed</u> Capacity	+/-0.1 MW

Parameter	Measurement Device (typical)	Unit	Range	Accuracy
Facility power production ratio	Ratio of Facility's power production (MW)/Allowed Capacity (MW)	%	0 to 100%	+/-0.1 %
Inverters Available	NA	NA	Up to the number installed inverters	
Facility Inverter Availability	Ratio of inverters online/number of inverters	%	0 to 100%	
Power Possible	Subscriber Organization's Model	MW	0 to Allowed Capacity	+/-4%

(d) Status of Generating Equipment:

For each ~~inverter, or wind turbine, Subscriber~~ ~~inverterSubscriber~~ Organization shall provide to Company, via SCADA communication and protocol acceptable to Company at a continuous scan updated not less frequently than every 2 seconds, a signal as to whether such inverter is available or unavailable, and on or offline.

(e) Data Collection.

[NOTE COMPANY TO UPDATE REQUIREMENTS; WILL BE SPECIFIC TO FACILITY EQUIPMENT AND RESOURCE TYPE]

- High Resolution Data: Subscriber Organization shall install and make available to the Company time stamped and sequential data recordings for all inverter-based resources (and all generating resources) to perform event analysis and verify Facility performance during steady state and transient disturbance events. This will include a time-synchronized phasor measurement unit at the Facility, and access to multiple sources to provide sufficient clarity as to any abnormal response or behavior within the Facility, including Facility control settings and static values, SCADA data, sequence of events recording (SER) data, dynamic disturbance recorder (DDR) data, and inverter fault codes and inverter-level dynamic recordings. This data will be used to review the Facility response to system dynamics, such as the frequency response (normal droop), reactive response, etc.
- Plant Data: **[Note: specific requirements below are representative of variable energy resources and will be tailored to the Facility resource type(s) and geographic arrangement]**

~~Subscriber Organization shall install at least three (3) meteorological tower(s), spaced so as to provide the data points set forth below for the entire Facility.~~ At least two months prior to the Commercial Operation Date, Subscriber Organization shall deliver to Company a report showing (i) manufacturer, model and year of all energy equipment (panels, inverters, energy storage devices, ~~turbine generators~~), and meteorological instrumentation, and (ii) the latitude and longitude of the center of the energy equipment (i.e., solar panels for every inverter, wind turbines) and every meteorological tower. Beginning upon COD, Subscriber Organization shall transmit and provide to Company the real-time data set forth below, refreshed as frequently as allowed by the SCADA system, not to exceed sixty (60) second intervals:

- Three (3) data points from each inverter ~~or wind turbine~~:

- Inverter/turbine generation (MW)
- Inverter/turbine availability
- Inverter/turbine on/offline status
- Two (2) data points from each meteorological tower (solar resources):
 - Global horizontal solar irradiance (instantaneous solar intensity, full sky)
 - ~~Plane of array solar irradiance (instantaneous solar intensity at the current angle of the PV array)~~
- ~~Five data points from each Meteorological Tower (wind resources):~~
 - ~~Wind Speed** (mps)~~
 - ~~Wind Direction** (degrees relative to true north)~~
 - ~~Temperature (Celsius)~~
 - ~~Pressure (mb)~~
 - ~~Air Density (kg/m³)~~
 - ~~In addition to the other requirements for data collection, if required by Company, a Facility with wind turbines shall install, maintain and operate at least one meteorological tower that is installed at hub height and is placed upstream of the prevailing wind path to provide meteorological data through a means agreed by the Company. The data stream from this meteorological tower to the Company's System must be reliable and include battery back-up at the meteorological tower and a local source of electricity to power the data collection and communication from the Facility to Company during transmission outages, or as required in the first table of this section~~

Subscriber Organization shall provide a map and key for each inverter or wind turbine sufficient to allow Company to correlate the data received through Company's data historian system to each individual resource.

9. TECHNOLOGY SPECIFIC REQUIREMENTS.

- (a) ~~[RESERVEDReserved]~~
- (b) ~~[RESERVEDReserved]~~
- (c) Inverter Systems.
 - (i) Direct current generators and non-power (i.e., other than 60 Hertz) alternating current generators can only be installed in parallel with the Company System using a non-islanding synchronous inverter unless alternate designs are approved by the Company. The design shall comply with the requirements of IEEE Std 1547-2003 (or latest version), except as described in Section 3 (Performance Standards) of this Attachment F (Facility Owned by Subscriber Organization).
 - (ii) Self-commutated inverters of the Company-interactive type shall synchronize to the Company System. Line-commutated, thyristor-based inverters are not recommended and will require additional technical study to determine harmonic and reactive power requirements. All interconnected inverter systems shall comply with the harmonic current limits of IEEE Std 519-1992 (or latest version).
- (d) Battery Energy Storage System. The operating parameters of the BESS for facilities with paired storage shall be as follows:

- (i) For facilities with variable energy and paired storage: The BESS shall directly charge storage from the variable resource when the Company Active Power Dispatch is for less than the available resource energy.
- (ii) No more than [] % of the BESS energy capacity can be charged from the grid prior to the fifth (5th) anniversary of the Commercial Operations Date. Thereafter, 100% of the BESS energy capacity can be charged from the grid. **[DRAFTING NOTE ONE: 5-YEAR LIMITATION ON GRID CHARGING WILL BE DELETED IF ITC RECAPTURE IS NOT APPLICABLE TO THE BESS.] [DRAFTING NOTE TWO: IF THE BESS WILL NEVER CHARGE FROM THE GRID, REPLACE THIS ENTIRE SUBSECTION WITH THE FOLLOWING: “None of the BESS energy capacity may be charged from the grid during the Term of this Agreement.”]**
- (iii) The BESS will not be required to discharge more energy than available relative to the available state of charge.
- (iv) For storage used primarily for energy shifting, the BESS shall be designed for an average annual use of 365 cycle(s) (a cycle is a discharge equal to the portion of the BESS Contract Capacity allocated for energy shifting, and sufficient charging to return the BESS to 100% State of Charge)
- ~~(v) For contingency storage, the BESS storage technology shall be procured based on required charging/discharging duty for the provision of disturbance frequency response. This response will require fast response outside of a specified frequency deadband (settable between 0.1 and 0.5 Hz), in accordance with specified droop and time parameters. (Historical frequency data for 2 second data resolution samples will be provided to bidders.) (Assumptions and associated restrictions on charging/discharging duty to be supplied by bidders).~~

~~10. OPERATING COMMITTEE AND OPERATING PROCEDURES.~~

~~Company and Subscriber Organization shall each appoint one representative and one alternate representative to act as the operating committee in matters relating to the Parties’ performance obligations under this Contract and to develop operating arrangements for the generation, delivery and receipt of renewable energy from the Facility.~~

~~The operating committee may develop mutually agreeable written operating procedures consistent with the requirements of this Contract, to address matters such as day to day communications; key personnel; operations center interface; metering, telemetering, telecommunications, and data acquisition procedures; operations and maintenance scheduling and reporting; reports; operations log; testing procedures; and such other matters as may be mutually agreed upon by the operating committee.~~

~~The operating committee shall review the requirements for Active Power Control, the data collection and telemetry, and control system parameters from time to time after the date hereof and may agree on modifications thereto to the extent necessary or convenient for operation of the Facility in accordance with this Contract.~~

~~The operating committee shall have authority to act in all technical and day to day operational matters relating to performance of this Contract and to attempt to resolve potential disputes, provided, however, that except as explicitly provided herein, the operating committee shall have no authority to amend or waive any provision of this Contract.~~

--END--

EXHIBIT F-1
DESCRIPTION OF GENERATION AND BATTERY STORAGE FACILITIES

1. Name of Facility:

(a) Location: (TMK No.)

(b) Telephone number (for system emergencies):

(c) E-mail Address:

(d) Contact Information for notices pursuant to the Contract:

Mailing Address:

Address for Delivery by Hand or Overnight Delivery:

Email Address:

2. Owner (If different from Subscriber Organization):

If Subscriber Organization is not the owner, Subscriber Organization shall provide Company with a certified copy of a certificate warranting that the owner is a corporation, partnership or limited liability company in good standing with the Hawai'i Department of Commerce and Consumer Affairs which shall be attached hereto as Exhibit F-1-1 (Good Standing Certificates).

3. Operator:

4. Name of person to whom payments are to be made:

(a) Mailing address: _____

(b) Hawai'i Gross Excise Tax License number:

5. Equipment:

(a) Type of facility and conversion equipment:

[For example: Small power production facility designated as a Qualifying Facility that produces electric energy using _____.]

(b) Design and capacity

Total Facility Capacity ("Contract Capacity"):

_____ kW

Total Number of Generators:

[number and size of each generator, e.g., one (1) Brand X, 200 kW; one (1) Brand Y, 300 kW]

Description of Equipment:

[For example: Describe the type of energy conversion equipment, capacity, and any special features.]

Individual Unit: **[if more than one generator, list information for each generator]**

	kW	kVAR Consumed	kVAR Produced
<u>Full load</u>			
<u>Startup</u>			

Generator:

Type _____

Rated Power _____ kW

Voltage _____ V, _____ phase

Frequency _____ Hz

Class of Protection _____

Number of Poles _____

Rated Speed _____ rpm

Rated Current _____ A

Rated Power Factor See Exhibit B-2

Batteries

Total Number of Energy Storage Units:

- (c) _____ Single or 3 phase:
- (d) Name of manufacturer:
- (e) Description of Facility SCADA and control system(s)

- (f) The “Allowed Capacity” of this Contract shall be the lower of (i) Contract Capacity or (ii) the net nameplate capacity (net for export) of the Facility installed by the Commercial Operations Date.
- (g) Subscriber Organization may propose revisions to this Section 5 (Equipment) of Exhibit F-1 (Description of Generation Battery and Storage Facilities) (“Section 5”) for Company’s approval prior to commencement of construction, provided, however, that (i) no such revision to this Section 5 shall change the type of Facility or conversion equipment deployed at the Facility from a solar energy conversion facility using photovoltaic equipment; (ii) Subscriber Organization shall be in compliance with all other terms and conditions of this Contract; and (iii) such revision(s) shall not change the characteristics of the Facility equipment or the specifications used in the IRS. Any revision to this Section 5 complying with items (i) through (iii) above shall be subject to Company’s prior approval, which approval shall not be unreasonably withheld. If Subscriber Organization’s proposed revision(s) to this Section 5 otherwise satisfies items (i) and (ii) above but not item (iii) such that Company, in its reasonable discretion, determines that a re-study or revision to all or any part of the IRS is required to accommodate Subscriber Organization’s proposed revision(s), Company may, in its sole and absolute discretion, conditionally approve such revision(s) subject to a satisfactory re-study or revision to the IRS and Subscriber Organization’s payment and continued obligation to be liable and responsible for all costs and expenses of re-studying or revising such portions of the IRS and for modifying and paying for all costs and expenses of modification to the Facility, the Company-Owned Interconnection Facilities based on the results of the re-studies or revisions to the IRS. Any changes made to this Attachment F of the Contract as a result of this Section 5(f) of Exhibit F-1 (Description of Generation and Battery Storage Facilities) shall be reflected in a written amendment to the Contract.

Subscriber Organization understands and acknowledges that Company’s review and approval of Subscriber Organization’s proposed revisions to this Section 5 and any necessary re-studies or revisions to the IRS shall be subject to Company’s then-existing time and personnel constraints. Company agrees to use commercially reasonable efforts, under such time and personnel constraints, to complete any necessary reviews, approvals and/or re-studies or revisions to the IRS.

Any delay in completing, or failure by Subscriber Organization to meet, any subsequent Subscriber Organization milestones under Article 13 (Guaranteed Project Milestones including the Commercial Operations Date) as a result of any revisions pursuant to this Section 5 by Subscriber Organization (whether requiring a re-study or revision to the IRS or not) shall be borne entirely by Subscriber Organization and Company shall not be responsible or liable for any delay or failure to meet the Commercial Operations Date any such milestones by Subscriber Organization.

6. ~~(h)~~—Insurance carrier(s): [SUBSCRIBER ORGANIZATION TO PROVIDE INFORMATION]
7. If Subscriber Organization is not the operator, Subscriber Organization shall provide a copy of the agreement between Subscriber Organization and the operator which requires the operator to operate the Facility and which establishes the scope of operations by the operator and the respective rights of Subscriber Organization and the operator with respect to the sale of electric energy from Facility no later than the Commercial Operations Date. In addition, Subscriber Organization shall provide a certified copy of a certificate warranting that the operator is a corporation, partnership or limited liability company in good standing with the Hawai‘i Department of Commerce and Consumer Affairs no later than the Commercial Operations Date.

8. Subscriber Organization shall provide a certified copy of a certificate warranting that Subscriber Organization is a corporation, partnership or limited liability company in good standing with the Hawai'i Department of Commerce and Consumer Affairs which shall be attached hereto as Exhibit F-1-1 (Good Standing Certificates).
9. Subscriber Organization, owner and operator shall provide Company a certificate and/or description of their ownership structures which shall be attached hereto as Exhibit F-1-2 (Ownership Structure).
10. In the event of a change in ownership or identity of Subscriber Organization, owner or operator, such entity shall provide within 30 Days thereof, a certified copy of a new certificate and a revised ownership structure.

--END--

**EXHIBIT F-2
CONSULTANTS LIST**

EXHIBIT F-3
MODELING REQUIREMENTS

1. Steady State and Dynamic Model Requirements and As-built Data to be provided by Subscriber Organization. The expected steady state power flow and dynamic models will be provided by the Subscriber Organization during the interconnection study process in the format compatible with the analytical tools used by Company. Depending upon Facility design, different representations may be required for steady state and dynamic simulations. Subscriber Organization will work with Company to derive a complex equivalent model if it is required to meet interconnection study needs. The as-built data and models will be provided by Subscriber Organization immediately upon commissioning with sufficient information to demonstrate that the as-built parameters match the model. Any changes to plant settings that affect its response and impact to the Company System are required to be studied prior to those changes taking effect. The modeling will include all necessary control settings such that the correct capabilities, flags, and settings can be represented in a base case. Where such parameters are settable according to this Contract, the initial models will be configured with parameters mutually agreed with Company for the interconnection study analysis. This includes, but is not limited to:
 - Plant Type: A description of the resource type (e.g., storage, solar PV or wind power resource) used as a flag to ensure that the inverter-based resource is accurately represented in the base case, where applicable.
 - Active and Reactive Capability: The overall plant “composite capability curve” shall be provided by Subscriber Organization for performance purposes. That same curve will be used for accurately modeling the P-Q capability in power flow studies.
 - Plant-Level Voltage Control Settings: Information on the plant voltage control mode to ensure correct voltage control flags and set points are set accordingly in the software tools.
 - The voltage control set point at the POI is provided by the Company. Subscriber Organization shall provide a description of the coordination of any plant-level shunt compensation (static or dynamic) to ensure it can be accurately represented in the power flow base case.The models provided by Subscriber Organization should accurately reflect the contractual requirements established under this Contract.
2. Positive Sequence Stability Modeling. Subscriber Organization shall provide a positive sequence stability model representation which provides sufficient detailed modeling for necessary reliability studies, as specified by Company. **[Note – language to be revised based on proposed Facility.]** For example, the following are typical requirements for plants with inverter equipment:
 - Inverter-Level Controller Model: This represents the overall control of the inverter as an energy or generating resource.
 - Electrical Control Model: This represents the detailed electrical controls of the resource, including large disturbance behavior.
 - Plant-Level Controller Model: This represents control of multiple individual inverters and/or generators within the plant.
3. Short Circuit Modeling. Subscriber Organization will provide appropriate and accurate models to Company to support short circuit studies. **[Company to specify requirements based on specific Facility]**
4. Electromagnetic Transient Modeling. Company will require an electromagnetic transient (“EMT”) model for the Facility. Subscriber Organization shall provide Company with an EMT model for the IRS and an updated EMT model after the Facility has been commissioned. These models are in addition to the positive sequence stability models required for interconnection-wide modeling purposes. In addition, Subscriber Organization shall provide Company with evidence that the expected (and commissioned) EMT model reasonably matches the positive sequence dynamic models provided. This should include a benchmarking report provided by the inverter OEM.

|

EXHIBIT F-4
GENERATOR AND ENERGY STORAGE CAPABILITY CURVE(S)

EXHIBIT F-5
SINGLE-LINE DRAWING AND INTERFACE BLOCK DIAGRAM

(To be attached as per Section 1(a) of Attachment F)

EXHIBIT F-6
RELAY LIST AND TRIP SCHEME

(To be attached as per Section 1(a) of Attachment F.)

EXHIBIT F-7
CONTROL SYSTEM ACCEPTANCE TEST CRITERIA

**[THIS ATTACHMENT WILL NEED TO BE MODIFIED BASED ON THE RESULTS OF
THE IRS]**

1. The Control System Acceptance Test for the Facility will be conducted, following installation of the Facility. The Control System Acceptance Test procedures will be in accordance with criteria set forth herein. The Control System Acceptance Test shall be performed in accordance with Good Engineering and Operating Practices and demonstrate to Company's satisfaction that the Facility and the interconnection portion of the Facility, including Company-Owned Interconnection Facilities, have met the provisions of Section 5. (Company Dispatch) of the Contract and Section 3 (Performance Standards) of Attachment F (Facility Owned by Subscriber Organization).
 - A. Control System Acceptance Test procedures will be developed by Company for the Subscriber Organization's review at least sixty (60) Days in advance of performing the tests based on the date provided by Company.
 - B. The procedures will include, but not be limited to, demonstration of the functional requirements of the Facility defined in Section 5. (Company Dispatch) of the Contract and Section 3 (Performance Standards) of Attachment F (Facility Owned by Subscriber Organization) such as, but not limited to:
 1. Interconnection equipment and communications to support remote monitoring of the Facility and control of Facility breakers
 2. Droop characteristic and change of frequency control / response modes (if applicable)
 3. Real power delivery under remote Company Dispatch, Active Power Dispatch. For facilities with directly controlled storage, the storage will be operated to perform at least two full charging/discharging cycles.
 4. Accurate provision of limits for Minimum and Maximum Dispatch (Power Possible, Minimum load capability)
 5. Ramp rates for controlled actions
 6. Control of Facility breakers
 7. Voltage regulation
 8. Grid forming and Black start (if applicable)
 9. BESS Capacity Test and demonstration of the round-trip efficiency of the BESS, each as described in Attachment H (BESS Requirements)
 - C. Testing of primary and redundant communications between Company System Operator and Facility Operator
 - D. The actual dynamic response of the Facility equipment will be confirmed to allow Company transient stability model to reflect the as-left conditions of the unit. During the commissioning, the following will be required:
 1. A final review by Company engineers of the equipment installed to control the operation and protect the plant will be needed upon installation and prior to the start of commercial operation.
 2. The review will include off-line tuning and testing results of the excitation and governor control and/or control system and the IEEE block diagram utilized for the PSS/E dynamics program.
 3. During the commissioning of the actual Facility, equipment system testing will be conducted to ensure that similar, well damped, expected responses will be produced by the facility. The as-left parameters obtained from real and reactive local response tuning will be determined for use in the Company planning model. The Subscriber Organization will

- provide an estimate of the earliest date for the Control System Acceptance Test at least ninety (90) Days before the date.
- E. The Control System Acceptance Test procedures for the Facility will be mutually agreed upon between Subscriber Organization and Company prior to conducting the test.
 - F. When the Facility is ready for the Control System Acceptance Test, Subscriber Organization shall notify Company at least seven (7) Days prior to the test and shall coordinate with Company. Subscriber Organization shall perform, and Company shall monitor such test no earlier than seven (7) Days from Company's receipt of such notice.
 - G. The Control System Acceptance Test is to be successfully completed prior to the Commercial Operation Date.
2. Examples of the type of tests conducted to meet the aforementioned objectives may include, but are not limited to the following:
- A. On-site Tests
 1. SCADA Test to verify the status and analog telemetry, and if the remote controls between the Company's EMS and the Facility are working properly end-to-end.
 2. Dispatch Test to verify if the Facility's active power limit controls and the Active Power Control Interface with the Company's EMS are working properly. The Test is generally conducted by setting different active power setpoints and limits and observing the proper dispatch at the appropriate ramp rate limiting of the Facility's real power output.
 - B. Control Test for Voltage Regulation to verify the Facility can properly perform automatic voltage regulation as defined in this Exhibit F-7 and pursuant to Attachment F and the Contract. Test is generally conducted by making small adjustments of the voltage setpoint and verifying by observation that the Facility regulates the voltage at the point of regulation to the setpoint by delivering/receiving reactive power to/from the Company System to maintain the applicable setpoint according to the reactive power control and the reactive amount requirements of ~~Sections 3(a) (Reactive Power Control) and Section 3(b) (Reactive Power Characteristics (Performance Standards))~~ of Attachment F (Facility Owned by Subscriber Organization) to the Contract. **[Note: Sub transmission Requirements]**
 - C. Frequency Response Test to verify the Facility provides a frequency droop response as defined in the Contract. Test is generally conducted by adjusting of the frequency reference setting and verifying by observation that the Facility responds per droop and deadband settings, and appropriately modifies the Company issued Dispatch Setpoint. If different modes of frequency response are provided, each mode is tested (i.e.; isochronous, fast frequency response, active power droop response).
 - D. Loss-of-Communication Test to verify the Facility will properly shutdown upon the failure of the direct-transfer-trip communication system. Test is generally conducted by simulating a communications failure and observing the proper shutdown of the Facility. [If DTT required for the Project]
 - E. Round trip efficiency test, as described in Attachment H (BESS Requirements) Section 1. (BESS Tests) to verify that the round-trip efficiency of the BESS is not less than [] percent ([]%). **[DRAFTING NOTE: The round-trip efficiency percentage will be taken from Subscriber Organization's response to the RFP.]**
 - F. BESS Capacity Test to verify the BESS Capacity Ratio.
 1. Monitoring Test:
 - a. The monitoring test requires the Facility to operate as it would in normal operations.
 - b. To ensure useful and valid test data is collected for variable facilities, the monitoring test shall end when one of the following criteria is met:

- i. For variable energy resources, Facility's gross power production is greater than 85% of its Allowed Capacity, for at least four (4) hours in any continuous 24-hour CSAT period.
 - ii. For solar facilities, the recorded renewable energy resource at the Facility is above 600 W/m² for least eight (8) hours in any continuous 48-hour CSAT period.
 - ~~iii. For wind facilities, the recorded wind speed is sufficient for turbines to operate for at least 8 hours in any continuous 48-hour CSAT period
14 continuous Days from the start of the CSAT.~~
- G. At the end of the test, an evaluation period is selected based on the criteria that triggered the end of the test.
- H. The performance of the Facility during the period of the successfully completed monitoring test is evaluated for, e.g., voltage regulation, frequency response, dispatch control, operating limits and ramp rate performance, to verify the performance meets the requirements of this Exhibit F-7. According to the criteria set forth in the testing procedures. Certain requirements, such as disturbance ride-through requirements, cannot be adequately tested without actual grid disturbances. These requirements will be confirmed following a grid event based on operational data, which may be after the completion of the Control System Acceptance Test. The Parties understand and agree that a successful completion of the test does not constitute a waiver of any of the performance standards of Subscriber Organization, all of which are hereby reserved, and shall not alleviate Subscriber Organization from any of its obligations under the Contract, in particular, as required in Section 5. (Company Dispatch) and the Performance Standards in Section 3. (Performance Standards) of Attachment F (Facility Owned by Subscriber Organization).

---END---

EXHIBIT F-8
ACCEPTANCE TEST GENERAL CRITERIA

**[THIS ATTACHMENT WILL NEED TO BE MODIFIED
BASED ON THE RESULTS OF THE IRS]**

Upon final completion of Company review of the Facility's drawings, final test criteria and procedures shall be agreed upon by Company and Subscriber Organization no later than thirty (30) Days prior to conducting the Acceptance Test in accordance with the Contract. The Acceptance Test shall include, but not be limited to, the following:

1. Interconnection.
 - (A) A visual inspection of all Interconnection equipment and verification of as-built drawings.
 - (B) Phase rotation testing to verify proper phase connections.
 - (C) Based on manufacturer's specification, test the local operation of the Facility's generator breaker(s) and inter-tie breaker(s), and other breaker(s) which connect the Facility equipment to Company System – must open and close locally using the local controls remotely from Company's EMS. Test and ensure that the status shown on the EMS is the same as the actual physical status in the field.
 - (D) Relay test engineers to connect equipment and simulate certain inputs to test and ensure that the protection schemes such as any under/over frequency and under/over voltage protection or the Direct Transfer Trip operate as designed. (For example, a fault condition may be simulated to confirm that the breaker opens to sufficiently clear the fault. Additional scenarios may be tested and would be outlined in the final test criteria and procedures.) Subscriber Organization to also test the synchronizing mechanisms to which the Facility would be synchronizing and closing into the Company System to ensure correct operation. Other relaying also to be tested as specified in the protection review of the IRS and on the single line diagram, Attachment E (Single-Line Drawing and Interface Block Diagram) for the Facility.
 - (E) All breaker disconnects and other high voltage switches will be inspected to ensure they are properly aligned and operated manually or automatically (if designed).
 - (F) Step-Up Transformer Enclosure(s) inspections – The Step-Up Transformer Enclosure(s) may be inspected to test and ensure that the equipment that Subscriber Organization has installed is installed and operating correctly based upon agreed to design. Wiring may be field verified on a sample basis against the wiring diagrams to ensure that the installed equipment is wired properly. The grounding mat at the Step-Up Transformer Enclosure(s) may be tested to make sure there is adequate grounding of equipment.
 - (G) Communication testing – Communication System testing to occur to ensure correct operation. Detailed scope of testing will be agreed by Company and Subscriber Organization to reflect

installed systems and communication paths that tie the Facility to Company's communications system.

- (H) Various contingency scenarios to be tested to ensure adequate operation, including testing contingencies such as loss of communications, and fault simulations to ensure that the Facility's breakers, if any, open as they are designed to open. (Back up relay testing)
- (I) Metering section inspection; verification of metering PTs, CTs, and cabinet and the installation of the two Company meters.

2. Telephone Communication.

- (A) Test to confirm Company has a direct line to the Facility control room at all times and that it is programmed correctly.
- (B) Test to confirm that the Facility operators can sufficiently reach Company System Operator.
- (C) Verification of dial-up telephone connection for metering cabinet.

3. Drawings, Documentation and Equipment Warranties.

The items below are required components of the Acceptance Test and must be satisfied for successful completion of this Test.

- (A) Electronic and three (3) hard copies of all Switchyard construction drawings, specifications, calibrations, and settings including as-built drawings.
- (B) Equipment operating and maintenance manuals, spare parts lists, commissioning notes, as-built equipment settings, and other information related to the switchyard equipment.
- (C) Contractor construction warranties and equipment warranties.
- (D) Phase rotation testing to verify proper phase connections.
- (E) Switching Station inspections – The Switching Station may be inspected to test and ensure that the equipment that Subscriber Organization has installed is installed and operating correctly based upon agreed-to design. Wiring may be field verified on a sample basis against the wiring diagrams to ensure that the installed equipment is wired properly. The grounding mat at the Switching Station may be tested to make sure there is adequate grounding of equipment.
- (F) If agreed by the Parties in writing, some requirements may be postponed to the Control Systems Acceptance Test.

ATTACHMENT G

COMPANY-OWNED INTERCONNECTION FACILITIES

(To be filled out by Company)

1. DESCRIPTION OF COMPANY-OWNED INTERCONNECTION FACILITIES.

- (a) General. Company will furnish or construct, own, operate and maintain all interconnection facilities required to interconnect the Company's system with the CBRE Facility at ___volts, up to the point of interconnection.
- (b) Site. Where any Company-Owned Interconnection Facilities are to be located on the Site, Subscriber Organization shall provide, at no expense to Company, a location and access acceptable to Company for all such Company-Owned Interconnection Facilities, as well as an easement, license or right of entry to access such Company-Owned Interconnection Facilities. If power sources (120/240VAC) are required, Subscriber Organization shall provide such sources, at no expense to Company.
- (c) IRS. If an IRS addressing Facility requirements was or will be completed for the Project in accordance with the IRS Letter Agreements, the results have been or will be incorporated in Attachment F (Facility Owned by Subscriber Organization) and this Attachment G (Company-Owned Interconnection Facilities) as appropriate
- (d) The Company-Owned Interconnection Facilities, for which the Subscriber Organization agrees to pay, include: **[Need to specify the interconnection facilities. If no interconnection facilities, state "None".]**
- (e) Responsibility of Subscriber Organization and Company. The general responsibilities of Subscriber Organization and Company for the design, procurement, installation, programming/testing, and maintenance/ownership of equipment at the Facility and the Company Owned Interconnection Facilities is specified in Matrix G-1 (Substation Responsibilities) and Matrix G-2 (Telecom Responsibilities). **[DRAFTING NOTE: MATRIXES WILL BE UPDATED FOLLOWING COMPLETION OF IRS.]**

2. Construction and Support Services By Subscriber Organization.

(a) Construction and Support Services By Subscriber Organization.

Subscriber Organization (and/or its third party consultants or contractors (collectively, "Contractors")) will design, engineer, construct, test and place in service, at Subscriber Organization's expense, the items identified in Matrix G-1 (Substation Responsibilities) and Matrix G-2 (Telecom Responsibilities) as being the responsibility of Subscriber Organization to construct; and

All design, engineering and construction performed by Subscriber Organization (and/or its Contractors) shall, without limitation, satisfy the wind load and seismic load requirements of the International Building Code and any more stringent requirements imposed under applicable Laws.

- (i) Subscriber Organization shall provide the necessary support for the Company's [REDACTED] kV overhead line extension work, which may include, but not limited to:

- A. Furnish surveyed topographical drawing including contour lines of project areas and beyond as needed in State Plane coordinates with overlay of the Facility and Company pole line route(s) indicating pole locations and anchors in CADD format acceptable to Company.
 - B. Staking of Company proposed poles and anchors by surveyor.
 - C. Graded access roads including gravel if required by Company to provide sufficient vehicle access to Company poles and anchors by Company trucks and cranes.
 - D. Graded level pads to provide vehicle working areas around all Company poles and anchors.
 - E. Grading of the areas beneath the Company's overhead lines as needed to provide required ground clearance.
 - F. Grubbing and clearing of vegetation within Company's easement area or as required.
- (b) Coordination of Construction. Prior to Subscriber Organization engaging the Contractors, Subscriber Organization shall obtain Company's written approval, which approval shall not be unreasonably withheld. Prior to Subscriber Organization and/or its Contractors first starting to work on the construction plans for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization (and/or its Contractors), such as the civil, structural, and construction drawings, specifications to vendors, vendor approved final drawings and materials lists (collectively, the "Plans"), Subscriber Organization and/or its Contractors shall meet with Company to discuss the construction of such Company-Owned Interconnection Facilities, including but not limited to subjects concerning coordination of construction milestone dates, agreement on areas of interface design, and Company's design/drawing layout and symbols standards, equipment specifications and construction specifications and standards. Company will provide the equipment specifications and construction specifications and standards information so Subscriber Organization can incorporate such information in its bid documents.
- (c) Plans. Subscriber Organization shall provide Company its complete Plans at 30%, 60% and 90% completion. No later than sixty (60) Days before Subscriber Organization and/or its Contractors first start to order materials and equipment for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization and/or its Contractors, Subscriber Organization shall provide Company with the final Plans. The Plans for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization (and/or its Contractors) shall comply with (i) all applicable Laws; (ii) Company's design/drawing layout and symbol standards, equipment specifications, and construction specifications and standards; and (iii) Good Engineering and Operating Practices (collectively, the "Standards"). Subscriber Organization shall submit design drawings in MicroStation format per Company standards.
- (d) Company's Review of the Plans. Unless otherwise agreed to by the Parties, Company shall have thirty (30) Days following receipt of the complete Plans at each stage (30%, 60%, 90% and final) for it to review and comment on the Plans, and verify in writing to Subscriber Organization that the Plans comply with the Standards, which verification shall not be unreasonably withheld. If Company reasonably determines that the Plans are not in accordance with the Standards, then it may request in writing a response from Subscriber Organization to its comments and Subscriber Organization shall respond in writing within thirty (30) Days of such request by providing (i) its justification for why its

Plans conform to the Standards or (ii) changes in the Plans responsive to Company's comments and in accordance with the Standards.

- (e) Company Inspection. Construction work will be subject to Company inspections to ensure that construction is done in accordance with the Standards. Company inspectors will be allowed access to the construction sites for inspections and to monitor construction work. The inspector shall have the authority to work with the appropriate construction supervisor to stop any work that does not meet the Standards. All equipment and materials used in Company-Owned Interconnection Facilities to be constructed by Subscriber Organization and/or its Contractors shall meet the Standards.
- (f) Acceptance Test Procedures.
- (i) Subscriber Organization acknowledges that: (aa) Company has multiple on-going projects with other developers as well as its own capital improvement projects; (bb) Company has limited resources to provide engineering oversight (such as review of plans) to such projects and to participate in the testing of such projects; (cc) in order for Company to accommodate such oversight and testing, it is necessary for Company to sequentially allocate its resources for each project a year or more in advance; (dd) the result is a queue of such projects that reflects the scheduling commitments of Company's resources to conduct such oversight and to participate in such testing; (ee) if a project is behind the schedule on which Company's resources have been scheduled for the oversight of such project, or if a project is not ready for testing at the time Company's resources have been scheduled for the testing of such project, or if a project does not complete testing within the period for which Company's resources have been scheduled for such testing, the progress of projects later in the queue may be adversely affected; and (ff) the Project will lose its place in the queue and will be assigned a new Acceptance Testing date for commencement of the Acceptance Test that will be behind the other projects then in the queue if (i) the Subscriber Organization fails to satisfy any of the conditions precedent set forth in Section 2(f)(ii) of this Attachment G (Company-Owned Interconnection Facilities) within the time period specified therein for the task in question, (ii) the Acceptance Test are not satisfactorily completed within the time allotted to complete such testing.
- (ii) The Conduct of the Acceptance Test is subject to the satisfaction of the following conditions precedent within the time period required by Company for the task in question:
- Final Single-Line Drawing, and notes, has received Company's written consent pursuant to Section 1(a)(i) (Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 - Final Relay List and Trip Scheme have received Company's written consent pursuant to Section 1(a)(i) (Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 - Final Interface Block Diagram has received Company consent pursuant to Section 1(a)(i) (Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 - Final Control System Telemetry and Control List has received Company consent.
 - Final phasor measurement unit (PMU) devices, if applicable, have received Company consent.

- Control system design and tunable parameters reviewed and mutually agreed upon as needed to meet the Company requirements in accordance with Attachment F (Facility Owned by Subscriber Organization) Performance Standards.
 - Agreement on Active Power Control Interface.
 - No later than 14 Days prior to commencement of the Acceptance Test:
 - Subscriber Organization shall have certified to Company that Subscriber Organization-Owned Interconnection Facilities have been installed and commissioned and such certification has not, prior to the commencement of the Acceptance Test, been subsequently challenged by Company on the basis of on-site observations made by the Company's representatives following the walk-through to be conducted pursuant to Section 2(f)(iii) of this Attachment G (Company-Owned Interconnection Facilities).
 - Subscriber Organization shall have certified to Company that any Company-Owned Interconnection Facilities built by Subscriber Organization (and/or its Contractors) have been installed and commissioned and such certification has not, prior to the commencement of the Acceptance Test, been subsequently challenged by Company on the basis of on-site observations made by the Company's representatives following the walk-through to be conducted pursuant to Section 2(f)(iii) of this Attachment G (Company-Owned Interconnection Facilities).
 - Any Company-Owned Interconnection Facilities not built by or on behalf of Subscriber Organization have been installed and commissioned.
 - No later than 7 Days prior to the commencement of the Acceptance Test, Subscriber Organization and Company shall have participated in walk-through of fully constructed Interconnection Facilities.
 - Redlined as-built drawings of the Subscriber Organization-Owned Interconnection Facilities and any of the Company-Owned Interconnection Facilities built by Subscriber Organization (and/or its Contractors) shall have been provided to Company.
 - Continuous power is being supplied to Company's protection and SCADA equipment.
 - Not less than four (4) weeks prior to the commencement of the Acceptance Test, the high speed communication lines required under this Contract have been commissioned and are ready for use.
 - Not less than two (2) weeks prior to the commencement of the Acceptance Test, Subscriber Organization and Company have participated in an on-Site Acceptance Test coordination meeting.
- (iii) Subscriber Organization shall provide Company with at least fourteen (14) Days advance written notice of the commencement of the Acceptance Test. The Acceptance Test will be conducted on Business Days during normal business hours and may take a minimum of 30 Days to complete. No electric energy will be delivered from Subscriber Organization to Company during the Acceptance Test. No later than thirty (30) Days prior to conducting the Acceptance Test, Company and Subscriber Organization shall agree on a written protocol setting out the detailed procedure and criteria for passing the Acceptance Test. At the time that Subscriber Organization provides its 14-Day notice of the Acceptance Test to Company, Subscriber Organization shall concurrently schedule a site walk-through of the Facility with Company to occur no later than seven (7) Days prior to the Acceptance Test. Subscriber Organization's 14-Day notice to Company of the Acceptance Test shall constitute its certification that (i) the completion of the

installation and commissioning of the Subscriber Organization-Owned Interconnection Facilities and the Company-Owned Interconnection Facilities built by Subscriber Organization (and/or its Contractors) and (ii) a walk-through by Company shall demonstrate, to Company's reasonable satisfaction, Subscriber Organization's readiness to commence with the Acceptance Test. If, after the site walk-through, Company representatives reasonably determine that Subscriber Organization is not ready to commence with the Acceptance Test, the Project will lose its place in the queue and will be assigned a new Acceptance Testing date that will be behind the other projects then in the queue. In the meantime, Subscriber Organization shall remediate the deficiencies identified by Company, and the process described in this Section 2(f) (Acceptance Test Procedures) of this Attachment G (Company-Owned Interconnection Facilities), shall commence again until Subscriber Organization's readiness for the Acceptance Test is demonstrated to Company's reasonable satisfaction. Successful completion of the Acceptance Test requires successful completion of each of the individual tests that comprise the Acceptance Test. Retesting of any individual test constitutes as restart of the Acceptance Test if such retesting is required because of a prior failure of such individual test or because of a prior test could not be completed because of a problem with the Facility. Within fifteen (15) Business Days of completion of the Acceptance Test and Company's receipt of the final report setting forth the results of the Acceptance Test, Company shall notify Subscriber Organization in writing whether the Acceptance Test has been passed and, if so, the date upon which the Acceptance Test was passed.

- (iv) Company will be present when the Acceptance Test is conducted, and Subscriber Organization shall promptly correct any deficiencies identified during the Acceptance Test. Subscriber Organization will be responsible for the cost of Company personnel (and/or Company contractors) performing the duties (such as reviewing the Plans and reviewing the construction) necessary for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization (and/or its Contractors). If Company (i) does not make any inspection or test, (ii) does not discover defective workmanship, materials or equipment, or (iii) accepts Company-Owned Interconnection Facilities (that were constructed by Subscriber Organization and or its Contractors), such action or inaction shall not relieve Subscriber Organization from its obligation to do and complete the work in accordance with the Plans approved by Company.
- (g) As-Built Drawings. Within thirty (30) Days of the successful completion of the Acceptance Test, Subscriber Organization shall provide for Company review a set of the proposed as-built drawings for the Company-Owned Interconnection Facilities constructed by Subscriber Organization (and/or its Contractors). Within thirty (30) Days of Company's receipt of the proposed as-built drawings, Company shall provide Subscriber Organization with either (i) its comments on the proposed as-built drawings or (ii) notice of acceptance of the proposed as-built drawings as final as-built drawings. If Company provides comments on the proposed as-built drawings, Subscriber Organization shall incorporate such comments into a final set of as-built drawings and provide such final as-built drawings to Company within twenty (20) Days of Subscriber Organization's receipt of Company's comments

3. SUBSCRIBER ORGANIZATION PAYMENT TO COMPANY FOR COMPANY-OWNED INTERCONNECTION FACILITIES. REVIEW OF GENERATING FACILITY, AND REVIEW OF VERIFICATION TESTING.

- (a) Subscriber Organization shall pay to the Company the total estimated interconnection costs to be incurred by the Company (Total Estimated Interconnection Costs), which is comprised of (i) the estimated cost of the Company-Owned Interconnection Facilities, (ii) the estimated engineering costs associated with (a)

developing the Company-Owned Interconnection Facilities and (b) reviewing and specifying those portions of the CBRE Facility which allow interconnected operation, and (iii) witnessing and reviewing the verification testing, which shall include testing of the telemetry and control interface which allows the Company to remotely measure, monitor, evaluate and verify technical compliance, CBRE Facility performance, and power quality and, if necessary, control the Generating Facility. The following summarizes the Total Estimated Interconnection Costs:

Description	Estimated Cost (\$) [If no cost, state "None".]
Total Estimated Interconnection Costs (\$):	

- (b) The Total Estimated Interconnection Cost, which, except as otherwise provided herein, is non-refundable, shall be paid by the Subscriber Organization fourteen (14) days after receipt of an invoice from the Company, which shall be provided not less than thirty (30) days prior to start of procurement of the Company-Owned Interconnection Facilities.

- (c) Within thirty (30) days of receipt of an invoice, which shall be provided within fourteen (14) days of the final accounting, which shall take place within sixty (60) days of completion of construction of the Company-Owned Interconnection Facilities, the Subscriber Organization shall remit to the Company the difference between the Total Estimated Interconnection Costs paid to date and the total actual interconnection cost (Total Actual Interconnection Costs). The latter is comprised of (i) the total costs of the Company-Owned Interconnection Facilities, and (ii) the total engineering costs associated with (a) developing the Company-Owned Interconnection Facilities and (b) reviewing and specifying those portions of the Generating Facility which allow interconnected operations as such are described in Exhibit F-1, and (iii) reviewing the verification testing. If in fact the Total Actual Interconnection Costs is less than the payments received by the Company as the Total Estimated Interconnection Costs, the Company shall repay the difference to the Subscriber Organization within thirty (30) days of the final accounting. If the Contract is terminated prior to the Subscriber Organization's payment for the Total Actual Interconnection Costs (or the portion of this cost which has been incurred) or prior to the Company's repayment of the over collected amount of the Total Estimated Interconnection Costs (or the portion of this cost which has been paid), such payments shall be made by the Subscriber Organization or Company, as appropriate. If payment is due to the Company, the Subscriber Organization shall pay within thirty (30) days of receipt of an invoice, which shall be provided within fourteen (14) days of the final accounting, which shall take place within sixty (60) days of the date the Contract is terminated. If

payment is due to the Subscriber Organization, the Company shall pay within thirty (30) days of the final accounting.

(d) All Company-Owned Interconnection Facilities shall be the property of the Company.

4. OPERATION, MAINTENANCE AND TESTING COSTS.

The Company will bill the Subscriber Organization monthly and the Subscriber Organization will, within 30 days after the billing date, reimburse the Company for any costs incurred in operating, maintaining or testing the Company-Owned Interconnection Facilities. The Company's costs will be determined on the basis of outside service costs, direct labor costs, material costs, transportation costs, applicable overheads at time incurred and applicable taxes. Applicable overheads will include such costs as vacation, payroll taxes, non-productive wages, supervision, tools expense, employee benefits, engineering administration, corporate administration, and materials handling. Applicable taxes will include the Public Service Company Tax, and Public Utility Fee and Hawai'i general excise tax

5. RELOCATION OF COMPANY-OWNED INTERCONNECTION FACILITIES.

(a) In the event that the Land Rights include a relocation clause and such clause is exercised or if Company-Owned Interconnection Facilities must be relocated for any other reason not caused by Company, Subscriber Organization shall bear the cost of such relocation. Prior to the relocation of the Company-Owned Interconnection Facilities Company shall invoice Subscriber Organization for the total estimated cost of relocating the Company-Owned Interconnection Facilities (the "Total Estimated Relocation Cost"). Subscriber Organization shall, within thirty (30) Days after the invoice date, pay to Company the Total Estimated Relocation Cost.

(b) Once the relocation of the Company-Owned Interconnection Facilities is complete, Company shall conduct a final accounting of all costs related thereto. Within thirty (30) Days of the final accounting, which shall take place within one hundred and twenty (120) Days of completion of the relocation of Company-Owned Interconnection Facilities, Subscriber Organization shall remit to Company the difference between the Estimated Relocation Cost paid to date and the total actual relocation cost incurred by Company (the "Total Actual Relocation Cost"). If the Total Actual Relocation Cost is less than the payments received by Company as the Total Estimated Relocation Cost, Company shall repay the difference to Subscriber Organization within thirty (30) Days of the final accounting.

6. LAND RESTORATION

(a) Definition of "Land". For the purposes of this Attachment G (Company-Owned Interconnection Facilities), "Land" means any portion of the Site and any other real property where any Company-Owned Interconnection Facilities are located.

(b) Removal of Interconnection Facilities. After termination of this Contract, if requested by Company, Subscriber Organization shall, at its sole cost and expense, remove (i) the Company-Owned Interconnection Facilities from the Land and (ii) the Subscriber Organization-Owned Interconnection Facilities from the Land, and, in conjunction with such removal, shall develop and implement a program to recycle, to the fullest extent possible, or to otherwise properly dispose of, all such removed infrastructure; provided, however, that, Company may elect to remove all or part of the Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities from the Land because of operational concerns over the removal of such Interconnection Facilities, in which case Subscriber Organization shall reimburse Company for its costs to remove such Company-Owned Interconnection Facilities and/or Subscriber Organization-

Owned Interconnection Facilities. To the extent Subscriber Organization is obligated to remove Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities, Subscriber Organization shall complete such removal within ninety (90) Days of termination of this Contract, or as otherwise agreed to by both Parties in writing.

- (c) Restoration of the Land. After the termination of this Contract and removal of the Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities, as the case may be, Subscriber Organization shall, at its sole cost and expense, restore the Land to its condition prior to construction of such Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities, as applicable. Land restoration shall be completed within ninety (90) Days of termination of this Contract, or as otherwise agreed to by both Parties in writing.

7. TRANSFER OF OWNERSHIP/TITLE.

- (a) Transfer of Ownership and Title. On the Transfer Date, Subscriber Organization shall transfer to Company all right, title and interest in and to Company-Owned Interconnection Facilities to the extent such facilities were designed and constructed by Subscriber Organization and/or its Contractors together with (i) all applicable manufacturers' or Contractors' warranties which are assignable and (ii) all Land Rights necessary to own, operate and maintain Company-Owned Interconnection Facilities on and after the Transfer Date. Subscriber Organization shall provide a written list of the manufacturers' and Contractors' warranties which will be assigned to Company and the expiration dates of such warranties no later than thirty (30) Days before the Transfer Date.
- (b) No Liens or Encumbrances. Company's title to and ownership of Company-Owned Interconnection Facilities that were designed and constructed by Subscriber Organization and/or its Contractors shall be free and clear of liens and encumbrances.
- (c) Form of Documents. The transfers to be made to Company shall not require any further payment by Company. The form of the document to be used to convey title to the Company-Owned Interconnection Facilities that were designed and constructed by or on behalf of Subscriber Organization shall be in the form set forth by Company. The form of the document(s) to be used to assign leases shall be substantially in the form set forth by Company.

8. GOVERNMENTAL APPROVALS FOR ANY COMPANY-OWNED INTERCONNECTION FACILITIES.

For all other Governmental Approvals for Company-Owned Interconnection Facilities, Subscriber Organization shall provide these prior to the Transfer Date. On or before the Transfer Date, Subscriber Organization shall provide Company with (i) copies of all such Governmental Approvals obtained by Subscriber Organization regarding the construction, ownership, operation and maintenance of Company-Owned Interconnection Facilities that Subscriber Organization and/or its Contractors constructed and (ii) documentation regarding the satisfaction of any condition or requirement set forth in any Governmental Approvals for Company-Owned Interconnection Facilities (excluding on-going reporting or monitoring requirements that may continue beyond the Transfer Date in accordance with such Governmental Approval) or that such Governmental Approvals have otherwise been closed with the issuing Governmental Authority.

9. LAND RIGHTS

Subscriber Organization shall, prior to the commencement of construction of the Company-Owned Interconnection Facilities (whether to be built by Subscriber Organization or by Company) obtain at

its sole cost and expense all Land Rights that are required to construct, own, operate and maintain the Company-Owned Interconnection Facilities. At least one (1) month prior to commencement of construction, Subscriber Organization shall provide Company with Land Rights documents, which may be redacted to the limited extent as set forth below. Without limitation to the preceding sentences, Subscriber Organization shall pay all surveying and mapping costs, appraisal fees, document preparation fees, recording fees or other costs. Subscriber Organization shall use commercially reasonable efforts to obtain on behalf of the Company perpetual Land Rights for the Company-Owned Interconnection Facilities. Such Land Rights shall contain terms and conditions which are acceptable to Company and the documents setting forth the Land Rights shall be provided in advance of execution to Company for its review and approval and shall be recorded if required by Company. Following the Execution Date, Subscriber Organization shall provide as part of the Monthly Progress Report the status of negotiations with landowner(s) regarding the Land Rights. Notwithstanding the foregoing, Company shall have the right in its sole discretion, at any time upon notice to Subscriber Organization, to communicate directly with the landowner(s) and/or participate in the negotiations with landowner(s) for the Land Rights. For so long as Subscriber Organization has the right under this Contract to sell the availability of the Facility to Company, Subscriber Organization shall pay for any rents and other payments due under such Land Rights that are associated with Company-Owned Interconnection Facilities.

10. CONTRACTS FOR COMPANY-OWNED INTERCONNECTION FACILITIES

For all contracts entered into by or on behalf of Subscriber Organization for Company-Owned Interconnection Facilities to be designed, engineered and constructed, in whole or in part, by or on behalf of Subscriber Organization, the following shall apply: (i) Company shall be made an intended third-party beneficiary of such contracts; and (ii) Company shall be provided with copies of such executed contracts, which may be redacted but only to the extent required to prevent disclosure of confidential or proprietary information of Subscriber Organization or the counterparty to such agreement; provided, however, that such redactions may not conceal information that is necessary for the Company to determine and exercise Company's rights under such contracts as a third-party beneficiary.

[MATRIX TO BE INSERTED]

EXHIBIT G-1

FORM OF LETTER OF CREDIT

Page 1 of 2

[Bank Letterhead]

[Date]

Beneficiary: [designate appropriate entity according to where Facility is located] **Maui Electric Company, Limited [or] Hawai'i Electric Light Company, Inc.**

[Address]

[Bank's Name]

[Bank's Address]

Re: **[Irrevocable Standby Letter of Credit Number]**

Ladies and Gentlemen:

We hereby establish, in your favor, our irrevocable standby Letter of Credit Number _____ (this "Letter of Credit") for the account of **[Applicant's Name]** and **[Applicant's Address]** in the initial amount of \$ _____ **[dollar value]** and authorize you, Maui Electric Company, Limited **[or]** Hawai'i Electric Light Company, Inc. ("**Beneficiary**"), to draw at sight on **[Bank's Name]**.

Subject to the terms and conditions hereof, this Letter of Credit secures **[Project Entity Name]**'s certain obligations to Beneficiary under the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____ between **[Project Entity Name]** and Beneficiary.

This Letter of Credit is issued with respect to the following obligations: _____.

This Letter of Credit may be drawn upon under the terms and conditions set forth herein, including any documentation that must be delivered with any drawing request.

Partial draws of this Letter of Credit are permitted. This Letter of Credit is not transferable. Drafts on us at sight shall be accompanied by a Beneficiary's signed statement signed by a representative of Beneficiary as follows:

The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Maui Electric Company, Limited **[or]** Hawai'i Electric Light Company, Inc. and [(ii) the amount of the draft accompanying this certification is due and owing to Maui Electric Company, Limited **[or]** Hawai'i Electric Light Company, Inc. under the terms of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Maui Electric Company, Limited **[or]** Hawai'i Electric Light Company, Inc.][(ii) the Letter of Credit will expire in less than thirty (30) days, it has not been replaced or extended and collateral is still required under Section 11.G. 1 of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation *].

Such drafts must bear the clause "Drawn under **[Bank's Name and Letter of Credit Number _____ and date of Letter of Credit.]**"

* For draw relating to lapse of Letter of Credit while credit support is still required pursuant to the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation.

All demands for payment shall be made by presentation of originals or copies of documents, by facsimile transmission of documents to **[Bank Fax Number]** or other such number as specified from time to time by the bank, or by email transmission of documents to **[Bank Email Address]** or other such email address as specified from time to time by the bank. If presentation is made by facsimile transmission or an email transmission, you may contact us at **[Bank Phone Number]** to confirm our receipt of the transmission. Your failure to seek such a telephone confirmation does not affect our obligation to honor such a presentation. If presented by facsimile or email, original documents are not required.

This letter of credit shall expire one year from the date hereof. Notwithstanding the foregoing, however, this letter of credit shall be automatically extended (without amendment of any other term and without the need for any action on the part of the undersigned or Beneficiary) for one year from the initial expiration date and each future expiration date unless we notify you and Applicant in writing at least thirty (30) days prior to any such expiration date that this letter of credit will not be so extended. Any such notice shall be delivered by registered or certified mail, or by FedEx, both to:

Beneficiary at:

and to

And copy to Applicant at:

We hereby agree with drawers that drafts and documents as specified above will be duly honored upon presentation to **[Bank's Name]** and **[Bank's Address]** if presented on or before the then-current expiration date hereof.

Payment of any amount under this Letter of Credit by **[Bank]** shall be made as the Beneficiary shall instruct on the next Business Day after the date the **[Bank]** receives all documentation required hereunder, in immediately available funds on such date. As used in this Letter of Credit, the term "Business Day" shall mean any day other than a Saturday or Sunday or any other day on which banks in the State of **[Note – insert State of bank's location]** are authorized or required by law to be closed.

Unless otherwise expressly stated herein, this irrevocable standby letter of credit is issued subject to the rules of the International Standby Practices, International Chamber of Commerce publication no. 590 ("ISP98")

[Bank's Name]:

[Authorized Signature]

ATTACHMENT H
BESS REQUIREMENTS

SECTION 1 - BESS TESTS

Prior to achieving Commercial Operations, and in each BESS Measurement Period, unless waived by Company, Subscriber Organization shall demonstrate that the BESS satisfies the (1) BESS Capacity Performance Metric, and (2) the RTE Performance Metric, each as defined and further described below.

A. BESS Capacity Performance Metric.

- The BESS Capacity Performance Metric reflecting the net output of the BESS from the Point of Interconnection can be demonstrated either through (i) operational data or (ii) a scheduled formal BESS Capacity Test.
- The "BESS Capacity Performance Metric" shall be deemed to be satisfied where the BESS Capacity Ratio is not less than 100% for an applicable BESS Measurement Period. The "BESS Capacity Ratio" shall be the number, expressed as a percentage, equal to the total "Discharge Energy" (MWh discharge) delivered to the Point of Interconnection to bring the BESS from (i) its maximum State of Charge or (ii) 100% State of Charge to a 0% State of Charge, divided by the BESS Contract Capacity.
- A "BESS Capacity Test" is when the Company coordinates Company Dispatch to demonstrate the BESS maintains the power output required to follow the dispatch signal provided by the Company through a control set point, as measured at the Point of Interconnection, and is able to continuously discharge energy to the Point of Interconnection according to Company Dispatch to bring the BESS from (i) its maximum State of Charge or (ii) 100% State of Charge to a 0% State of Charge.
- The BESS Capacity Test can only be performed when the BESS is at the lower of: (i) its maximum State of Charge or (ii) 100% State of Charge prior to the start of the BESS Capacity Test and during the BESS Capacity Test the Company Dispatch allows for continuous discharge of the BESS to 0% State of Charge with energy delivered to the Point of Interconnection.

B. RTE Performance Metric.

- The "RTE Performance Metric" is set forth in Section 6(a) (RTE Test and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract. The RTE Performance Metric reflecting the charging/discharging of the BESS can be demonstrated either through (i) operational data or (ii) a scheduled formal RTE Test.
- Demonstration of the RTE Performance Metric requires measurement of "Charging Energy" (MWh charge) at the BESS inverters' AC input to bring the BESS from a 0% State of Charge

to a 100% State of Charge from the PV System (or grid, if grid charging is permitted) according to Company Dispatch, followed by measurement at the Point of Interconnection of the "Discharge Energy" (MWh discharge) delivered to the grid to bring the BESS to a 0% State of Charge according to Company Dispatch. The exact equipment and point used for measurement of Charging Energy will be mutually agreed to by the Parties on the Facility's single-line diagram attached as Exhibit F-5 (Single-Line Drawing and Interface Block Diagram) to Attachment F (Facility Owned by Subscriber Organization) to this Contract. For the purposes of evaluating satisfaction of the RTE Performance Metric, the "RTE Ratio" shall be the number, expressed as a percentage, equal to the total Discharge Energy delivered to the Point of Interconnection during the BESS Capacity Test, divided by the Charging Energy measured at the BESS inverters' AC input.

- The formula for the RTE Ratio is as follows: $\text{RTE Ratio} = 100\% \times (\text{MWh discharge}) / (\text{MWh charge})$
- The RTE Performance Metric will be deemed to have been "passed" or "satisfied" to the extent the RTE Ratio is not less than the RTE Performance Metric set forth in Section 6(a) (RTE Test and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract.
- An "RTE Test" is when the Company coordinates Company Dispatch to demonstrate the charging/discharging requisite to satisfy the RTE Performance Metric.
- The RTE Test may be conducted concurrently with a BESS Capacity Test.
- For purposes of the RTE Test, the charging cycle shall begin when the BESS is at a 0% State of Charge prior to a (i) 100% discharge cycle or (ii) BESS Capacity Test if being conducted concurrently and the Charging Energy is the amount of energy, as measured at the BESS inverters' AC input, that brings the BESS to a 100% State of Charge.

C. BESS Test Procedures.

- After Commercial Operations, Subscriber Organization shall demonstrate satisfaction of the BESS Capacity Performance Metric by reference to the operational data reflecting the net output of the BESS from the Point of Interconnection, or by conducting a scheduled formal BESS Capacity Test during such BESS Measurement Period. Once Subscriber Organization demonstrates satisfaction of the BESS Capacity Performance Metric through either operational data or a scheduled formal BESS Capacity Test (100% discharge cycle), the BESS shall be deemed to have met the BESS Capacity Performance Metric and satisfied ("passed") the BESS Capacity Test for the applicable BESS Measurement Period.
- After Commercial Operations, Subscriber Organization shall demonstrate satisfaction of the RTE Performance Metric by reference to the operational data reflecting the charging/discharging of the BESS, or by conducting a scheduled formal RTE Test during such BESS Measurement Period. Once Subscriber Organization demonstrates satisfaction of the RTE Performance Metric through either operational data or a scheduled formal RTE Test

(100% charge/discharge cycle), the BESS shall be deemed to have met the RTE Performance Metric and satisfied ("passed") the RTE Test for the applicable BESS Measurement Period.

- Any BESS Capacity Test or RTE Test (each a "BESS Test" and collectively, the "BESS Tests") scheduled in lieu of being demonstrated by reference to operational data shall be performed at a time scheduled by the Company in its sole discretion.
- Subscriber Organization shall be permitted up to a total of three (3) BESS Tests (100% discharge cycles) within a BESS Measurement Period to demonstrate satisfaction of the BESS Capacity Performance Metric and RTE Performance Metric for such BESS Measurement Period, unless additional such tests are authorized by Company. If upon completion of the first BESS Test, Subscriber Organization does not "pass" either the BESS Capacity Test or the RTE Test, Company shall attempt to notice up to two (2) additional BESS Tests within a BESS Measurement Period, for Subscriber Organization to further demonstrate its performance. If a scheduled formal BESS Test is requested by Subscriber Organization, Company shall attempt to schedule a formal BESS Test and Company shall provide notice to Subscriber Organization no less than three (3) Business Days prior to conducting such scheduled formal BESS Test.
- If, during a BESS Measurement Period, Subscriber Organization fails to pass a BESS Capacity Test, the BESS shall nevertheless be deemed to have satisfied the BESS Capacity Performance Metric for the applicable BESS Measurement Period if (i) Company failed to notice up to three BESS Capacity Tests in order for Subscriber Organization to further demonstrate the BESS' performance during such BESS Measurement Period, or (ii) Subscriber Organization was unable to perform at least two (2) such noticed BESS Capacity Tests during such BESS Measurement Period due to (a) conditions on the Company System other than Subscriber Organization-Attributable Non-Generation or (b) an act or omission by Company. If Subscriber Organization-Attributable Non-Generation is cause for the inability to demonstrate the BESS Capacity Performance Metric, the BESS Capacity Ratio used to assess LDs shall be the highest demonstrated in operational data or the most recently completed test during the applicable BESS Measurement Period.
- If, during a BESS Measurement Period, Subscriber Organization does not demonstrate satisfaction of the BESS Capacity Performance Metric through operational data or a BESS Capacity Test, assessment of Liquidated Damages will be based on the last of the BESS Capacity Tests performed.
- If, during a BESS Measurement Period, Subscriber Organization both fails to pass a RTE Test noticed by Company and fails to demonstrate satisfaction of the RTE Performance Metric by reference to operational data for such BESS Measurement Period, the BESS shall nevertheless be deemed to have satisfied the RTE Performance Metric for the applicable BESS Measurement Period if (i) Company failed to notice up to three RTE Tests in order for Subscriber Organization to further demonstrate the BESS' performance during such BESS Measurement Period, or (ii) Subscriber Organization was unable to perform at least two (2) such noticed RTE Tests during such BESS Measurement Period due to (a) conditions on the Company System other than Subscriber Organization-Attributable Non-Generation or (b) an act or omission by Company. If Subscriber Organization-Attributable Non-Generation is

cause for not adequately demonstrating the RTE Performance Metric, the RTE Ratio used to assess LDs shall be the highest demonstrated in operational data or the most recently completed test during the applicable BESS Measurement Period.

- If, during a BESS Measurement Period, Subscriber Organization does not demonstrate satisfaction of the RTE Performance Metric through operational data or RTE Tests, assessment of Liquidated Damages will be based on the last of the RTE Tests performed.
- Company will conduct any necessary BESS Test(s) through Company Dispatch. Company shall have the right to attend, observe and receive the results of all BESS Tests. Subscriber Organization shall provide to Company the results of each BESS Test (including time stamped graphs of system performance based in operational data or test data) no later than ten (10) Business Days after any BESS Test.

SECTION 2 – BESS ANNUAL EQUIVALENT AVAILABILITY FACTOR

- A. To the extent the Commercial Operations Date occurs on a date other than the first day of a BESS Measurement Period, the period between the Commercial Operations Date and the first day of the next BESS Measurement Period if any, shall be ignored for purposes of this BESS Availability Factor.
- B. For the purposes of calculating the BESS Annual Equivalent Availability Factor for the first three (3) full BESS Measurement Periods in the first Contract Year, the calculation will assume that the BESS is one hundred percent (100%) available for the remaining hours of the Contract Year.
- C. “BESS Annual Equivalent Availability Factor” shall be calculated as follows:

$$\text{BESS Annual Equivalent Availability Factor} = 100\% \times \frac{AH-E}{PH}$$

Where:

PH is period hours (8760 hours; except leap year is 8784)

Available Hours (AH) is the number of hours that the BESS is not on Outage. It is sum of all Service Hours (SH) + Reserve Shutdown Hours (RSH).

A “BESS Outage” exists whenever the entire BESS is offline and unable to charge or discharge electric energy and is not in Reserve Shutdown state.

Service Hours (SH) is the number of hours during the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Period that the BESS is online and (i) charging from the WTGsPV System or the Company System, or (ii) discharging electric energy to the Company System.

Reserve Shutdown Hours (RSH) is the number of hours the BESS is available but not charging or discharging electric energy or is offline at the Company's request for reasons other than Subscriber Organization-Attributable Non-Generation.

A "BESS Derating" exists when the BESS is available but at less than Maximum Rated Output, including deratings due to Subscriber Organization-Attributable Non-Generation or those by Company pursuant to Section 5 (Company Rights of Dispatch) of the Contract. For the avoidance of doubt, if there is a BESS Outage occurring, there cannot also be a BESS Derating.

Equivalent Derated Hours (EDH) is the sum of ESADH, EPDH, and EUDH. For deratings due to BESS inverter unavailability, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the number of inverters in the BESS unavailable and dividing by the total number of inverters in the BESS. For deratings that do not impact the availability of an entire BESS inverter or set of entire BESS inverters, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the size of the derating (in MW) and dividing by the Maximum Rated Output.

Equivalent Subscriber Organization-Attributable Derated Hours (ESADH): A Subscriber Organization-Attributable Derating occurs when a derating exists due to Subscriber Organization-Attributable Non-Generation or deratings by Company pursuant to Section 8.3 (Company Rights of Dispatch). Each individual derating is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods.

EPDH is the equivalent planned derated hours, including Planned Derations (PD) and Maintenance Derations. A Planned Deration is when the BESS experiences a Deration scheduled well in advance and for a predetermined duration. A Maintenance Deration is a Deration that can be deferred beyond the end of the next weekend (Sunday at midnight or before Sunday turns into Monday) but requires a reduction in capacity before the next Planned Deration (PD). Each individual Deration is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods.

EUDH is the equivalent unplanned derated hours. An Unplanned Deration (Forced Derating) occurs when the BESS experiences a derating that requires a reduction in availability before the end of the nearest following weekend. Each individual Unplanned Deration is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods.

The effect of Force Majeure is taken into account in calculating the BESS Annual Equivalent Availability Factor over a 12 calendar month period as follows: When such 12 month period contains any hours in a month during which the BESS or a portion of the BESS is unavailable due to Force Majeure, then such month shall be excluded from the 12 month period and the calculation period shall be extended back in time to include the next previous month during which there was no such unavailability of the BESS or a portion thereof due to Force Majeure. This means the BESS Equivalent Availability Factor would not change from that determined in the month directly preceding a month containing Force Majeure.

The following examples are provided as illustrative examples only:

Example A: The BESS was continuously available, with no BESS Outages or BESS Deratings during the applicable BESS Measurement Period and in the immediately preceding three (3) full BESS Measurement Periods. In this case AH = 8760 hours, EDH = 0 hours as ESADH, EPDH, and EUDH each = 0 hours

$$\text{BESS EAF} = 100\% \times \frac{8,760}{8,760} = 100\%$$

Example B: During the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods: (a) The BESS was online and charging from the PV system or discharging electric energy to the Company System for 8,400 hours and was available but not discharging electric energy due to lack of stored energy (i.e., not Subscriber Organization-Attributable Non-Generation) for 226 hours; (b) The BESS experienced a Planned Derating of 7.2 MWs for 100 hours for maintenance that was scheduled a month in advance; (c) The BESS also experienced an Unplanned Derating of 62 BESS inverters for 100 hours as the derating could not be deferred to beyond the nearest following weekend. (d) The BESS did not experience any outage or derating due to Subscriber Organization-Attributable Non-Generation during this period.

The BESS Maximum Rated Output is 10 MW and the BESS contains 100 total inverters.

PH = 8,760 hours in 12 calendar months

SH = 8,400 hours

RSH = 226 hours

AH = SH + RSH = 8,400 + 226 = 8,626 hours

ESADH = 0

EPDH = 100 hours x 7.2 MW/10 MW = 72 hours (Planned Maintenance)

EUDH = 100 hours x 62 inverters/ 100 inverters = 62 hours (Unplanned Deration (Forced Derating))

EDH = 72 hours + 62 hours = 134 hours

$$\text{BESS EAF} = 100\% \times \frac{8,626-134}{8,760} = 96.9\%$$

SECTION 3 - BESS ANNUAL EQUIVALENT FORCED OUTAGE FACTOR

$$EFOF = 100\% \times \frac{(FOH + EUDH)}{8760}$$

Where:

Equivalent Unplanned (Forced) Derated Hours (EUDH) is calculated in accordance with Attachment X (BESS Annual Equivalent Availability Factor) of this Contract.

Forced Outage Hours (FOH) = Sum of all hours the BESS experienced an Unplanned (Forced Outages) during the applicable BESS Measurement Period and the sum of all hours experienced during Unplanned (Forced) Outages during the immediately preceding three (3) full BESS Measurement Periods, in each case caused by Subscriber Organization-Attributable Non-Generation.

Unplanned (Forced) Derating: A Derating that requires a reduction in capacity of the BESS before the end of the nearest following weekend.

Unplanned (Forced) Outage: An outage that requires removal of the entire BESS from service before the end of the nearest following weekend that is not planned, including those caused by Subscriber Organization-Attributable Non-Generation or those imposed by Company pursuant to Section 5. (Company Rights of Dispatch) to the Contract .

EXAMPLE CALCULATION:

Assume a 50 MW BESS that for the BESS Measurement Period in question was completely out of service for 50 hours. For the BESS Measurement Period in question, it also had the following deratings:

Duration of Derating	MW Size Reduction
100 Hours	25 MW
20 Hours	20 MW
50 Hours	5 MW

During the three preceding BESS Measurement Periods, the BESS had a total of 150 Forced Outage Hours and a total of 100 Equivalent Forced Derated Hours.

$$FOH = 50 \text{ hours} + 150 \text{ hours} = 200 \text{ hours}$$

$$EUDH = ((100 \times 25) / 50) + ((20 \times 20) / 50) + ((50 \times 5) / 50) + 100 = 163 \text{ hours}$$

$$EFOF = 100\% \times \frac{(200 + 163)}{8760} = 4.1\%$$

ATTACHMENT I

FACILITY'S CBRE PROGRAM

1. **CBRE Program.** The purpose of the CBRE Program is to facilitate the continued expansion of renewable energy by allowing developers of renewable energy projects to provide Company's retail customers with the opportunity to avail themselves of the benefits of the CBRE Tariff by utilizing CBRE Credits to offset all or a portion of their on-going electricity usage. To this end, Subscriber Organization has established Facility's CBRE Project. Subscriber Organization acknowledges that it has been informed that Facility's CBRE Project must at all times comply with the requirements of the CBRE Program, the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and applicable Laws, including (i) the federal securities laws, including the registration requirements under the Securities Act of 1933 and the Securities and Exchange Act of 1934 and all rules and regulations promulgated thereunder (collectively, "Federal Securities Laws"); (ii) the State securities laws, including the registration requirements under the Hawai'i Uniform Securities Act and all rules and regulations promulgated thereunder (collectively, "State Securities Laws"); (iii) Laws concerning the dissemination of personally identifiable information; and (iv) Laws concerning consumer protection. The purpose of this Attachment I (Facility's CBRE Program) is to set forth certain requirements of the CBRE Program as of the Execution Date. Company reserves the right to modify the requirements of the CBRE Program upon PUC order and/or guidance from the CBRE IO where such modifications are necessary to comply with the CBRE Tariff, the CBRE Framework or applicable Laws, and Subscriber Organization shall comply with all such modifications. Without limitation to the generality of the foregoing, in the event of any conflict between the requirements of the CBRE Program, on the one hand, and any one or more of the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and/or applicable Laws, on the other hand, the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and applicable Laws, shall control and Subscriber Organization shall comply with the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and applicable Laws.
2. **Termination, Transfer and Buy-back of Subscriber Allocations.** Termination, transfer and buy-back of Subscriber Allocations shall be governed by the provisions of the CBRE Tariff contingent on whether the Facility's CBRE Program uses the Pay-As -You -Go or Pay-Up-Front model for Subscriber Allocations.
3. **Additional Representations of Subscriber Organization.** Subscriber Organization represents, warrants and covenants that:
 - (a) Subscriber Organization shall disclose to each Account Holder before enrolling such Account Holder as a Subscriber:
 - (1) Subscriber Organization's experience in developing and operating renewable energy projects similar to the Facility.
 - (2) The circumstances under which the Lump Sum Payment can be reduced through the OEPR process and the impact of such reduction on Bill Credits.
 - (3) The circumstances under which the Bill Credits can be reduced if Performance Metrics LDs are unpaid by Subscriber Organization.

- (b) Subscriber Organization shall not knowingly allow the transfer of any Subscriber Allocations at a price other than that set forth in the repurchase/resale price schedule attached to the Subscriber Agreement.
- (c) Facility's CBRE Program:
 - (1) As of the Execution Date, complies with all applicable Federal Securities Laws, and shall continue to be in compliance for the duration of Facility's CBRE Program.
 - (2) As of the Execution Date, complies with all applicable State Securities Laws, and shall continue to be in compliance for the duration of Facility's CBRE Program.
 - (3) As of the Execution Date, complies with all applicable Laws concerning the dissemination of personally identifiable information, and shall continue to be in compliance for the longer of (i) the duration of Facility's CBRE Program and (ii) for as long as Subscriber Organization continues to hold or otherwise have access to any personally identifiable information of Account Holders or former customers of Company.
 - (4) As of the Execution Date, complies with all applicable Laws concerning consumer protection, and shall continue to be in compliance for the duration of Facility's CBRE Program.
 - (5) Shall achieve the various CBRE Subscriber thresholds ~~set forth in Section 5. of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS)~~ applicable to the Facility's CBRE Program.
 - (6) As of the Execution Date, Subscriber Organization is and "approved Subscriber Organization" under the CBRE Tariff and committed to operating, maintaining and administering its CBRE Project in accordance with this Contract and the CBRE Framework for the Term.

- 5. **Marketing and Sales of the Subscriber Allocations.** Subscriber Organization represents, warrants, and covenants that Subscriber Organization's marketing and sale of the Subscriber Allocations, including but not limited to Subscriber Organization's marketing and sales materials, shall comply with all applicable Federal Securities Laws and State Securities Laws.
- 6. **CBRE Online Portal and CBRE Program Data.** Subscriber Organization shall utilize the CBRE Online Portal and provide Company with CBRE Program data as required under the CBRE Tariff and/or the CBRE Framework.
- 7. **Additional Responsibilities.** Subscriber Organization shall perform the responsibilities of "Subscriber Organizations" under the CBRE Framework and the CBRE Tariff, including but not limited to complying with the Subscriber Agreement requirements, complying with the consumer protection measures, unlocking the market for LMI Subscribers and data collection requirements. Subscriber Organization shall cooperate with the CBRE IO as and when requested by the CBRE IO to facilitate the performance of the CBRE IO's responsibilities under the CBRE Framework.
- 8. **LMI Subscribers.**

- (a) If Subscriber Organization's Facility has been awarded a project from one of Company's CBRE LMI RFP's, then Subscriber Organization has proposed, and hereby agrees, that all Subscribers enrolled for subscriptions in the Facility CBRE Program for this Facility shall be LMI Subscribers.
- (b) If Subscriber Organization, in its bid in response to any other Company CBRE RFP, has pledged to recruit a certain percentage of LMI Subscribers for its Facility CBRE Program, then Subscriber Organization hereby agrees to recruit LMI Subscribers to meet this pledged commitment for LMI Subscribers into Subscriber Organization's Facility CBRE Program.
- (c) If Subscriber Organization has an LMI Subscriber commitment under either Section 8(a) or Section 8(b) of this Attachment I (Facility's CBRE Program), then Subscriber Organization shall comply with the requirements of Part III of the CBRE Tariff to (1) qualify LMI Subscribers, (2) provide verification of Subscriber Organization's confirmation efforts to verify such LMI Subscribers' qualifications upon Company's request, and (3) comply with the minimum applicable requirements for LMI Subscribers and report monthly Subscriber Organization's LMI Subscriber percentage status for Company's review. Subscriber Organization understands and agrees that failure to maintain the required percentages of LMI Subscribers in Subscriber Organization's Facility CBRE Program may subject Subscriber Organization to payment reductions and/or liquidated damages as specified in the CBRE Tariff.

--END--

ATTACHMENT J

[RESERVED]

[This Attachment sets forth the terms and conditions which shall apply if SellerSubscriber Organization elects to utilize a Company-owned Site.]

ATTACHMENT K
COMPANY-OWNED SITE

1. Description of Company-Owned Site.

(a) **General.** At the request of SellerSubscriber Organization, Company shall make available to SellerSubscriber Organization an area on Company's property to allow performance of Seller'sSubscriber Organization's obligations under this Contract, provided that Company shall make available only as much acreage as necessary for Seller'sSubscriber Organization's performance (the "Company-Owned Site").

(i) **During Construction of the Facility.** During such time as SellerSubscriber Organization is actively constructing the Facility, the Company shall make available a reasonable area on Company's property, as determined by Company, for Seller'sSubscriber Organization's construction activities, which shall be no larger than _____ acres, as shown on the site plan attached as Exhibit K-1 (Site Plan) to this Attachment K (Company-Owned Site). The Company shall work with SellerSubscriber Organization to physically demarcate, at Seller'sSubscriber Organization's expense, the boundaries of the area that will be made available to SellerSubscriber Organization during construction of the Facility.

(ii) **Upon Completion of the Facility.**

(A) Upon Seller'sSubscriber Organization's completion of the Facility, Company shall make available to SellerSubscriber Organization only as much area as necessary for ongoing operation of the Facility under the terms of this Contract for the remainder of the Term (the "Post-Construction Area"). The Company shall work with SellerSubscriber Organization to physically demarcate, at Seller'sSubscriber Organization's expense, the boundaries of the Post-Construction Area.

(B) Upon Seller'sSubscriber Organization's request during the Term of this Contract, Company, in its sole discretion, may make available to SellerSubscriber Organization additional acreage, on a temporary basis, for Seller'sSubscriber Organization's maintenance, repair or replacement of the Facility, or any portion thereof, on an as-needed basis; provided, however, that the additional acreage shall not exceed the boundaries of the area shown on the site plan attached as Exhibit K-1 (Site Plan) to this Attachment K (Company-Owned Site). At any time during the Term, the actual available area that may be available to SellerSubscriber Organization for such maintenance, repair or replacements activities may change in accordance with the Company's needs and then-current utilization plans for the area, all of which the Company hereby reserves in its sole and absolute discretion.

(b) **Private Roadway and Landscape Buffer.** The Company-Owned Site is located within a project known as the New Central Maui Generation Site Subdivision (the "Subdivision"). SellerSubscriber Organization acknowledges and agrees that SellerSubscriber Organization will benefit from the construction of the following improvements (the "Company Improvements") on or near the Post-Construction Area on property owned by Company within the New Central Maui Generation Site

Subdivision: (i) a Private Roadway that will connect the Post-Construction Area to Pulehu Road, a public road owned by the County of Maui; (ii) a landscape buffer along Pulehu Road required to be built under the Land Use Conditions (hereinafter defined) encumbering the land within the Subdivision; and (iii) any other improvements or infrastructure required under the Land Use Conditions. SellerSubscriber Organization shall share in the cost to design, construct, operate, and maintain the Company Improvements, based on the Post-Construction Area, on a pro rata basis with others utilizing land within the Subdivision. Notwithstanding the foregoing, Company shall have the sole discretion to make reasonable adjustments to Seller'sSubscriber Organization's share of the Company Improvements based on other uses within the Subdivision. For the purposes of this Attachment K (Company-Owned Site), "Land Use Conditions" shall mean: (i) that certain Zoning Ordinance 2841 of the County of Maui, as reflected in related Unilateral Contract and Declaration for Conditional Zoning dated June 16, 2000 and recorded in the Bureau of Conveyances of the State of Hawaii as Document No. 2000-085696; and (ii) that certain Findings of Fact, Conclusions of Law, and Decision and Order dated June 22, 1998, issued by the Land Use Commission of the State of Hawaii in Docket No. A97-722, as reflected in the Document Listing Conditions to Reclassification of Land dated July 23, 1998 and recorded in said Bureau as Document No. 98-112111.

(c) **Utilization of Site.** SellerSubscriber Organization shall utilize the Company-Owned Site solely in connection with and for the purposes of constructing a Facility and meeting Seller'sSubscriber Organization's obligations to Company under this Contract. SellerSubscriber Organization waives and relinquishes any right it may have under Title 11, United States Code, and any other or successor state or federal statute relating to assignment for the benefit of creditors, appointment of a receiver or trustee, bankruptcy, composition, insolvency, moratorium, reorganization, or similar matters ("Bankruptcy Law"), in any proceeding, whether voluntary or involuntary, under any Bankruptcy Law, or otherwise to assert the Company-Owned Site should be used for any purpose other than in connection with and for the purposes of meeting Seller'sSubscriber Organization's obligations under this Contract.

(d) **Future Subdivision.** SellerSubscriber Organization acknowledges and agrees that Company, in its sole discretion, reserves the right to subdivide the Subdivision at any time during the Term of this Contract. In the event Company exercises its right to subdivide the Subdivision, (i) SellerSubscriber Organization agrees to share in the cost to subdivide the Subdivision on a pro rata basis with others utilizing land within the Subdivision, as determined by the Company, and (ii) SellerSubscriber Organization and Company shall cooperate in good faith to negotiate a lease for Seller'sSubscriber Organization's use of the Company-Owned Site under terms mutually agreeable to the parties.

2. Security and Access to Site.

(a) During Construction of the Facility.

(i) **Security.** During such time as SellerSubscriber Organization is actively constructing the Facility, SellerSubscriber Organization at its option may secure the Company-Owned Site with fencing and gates to prevent unauthorized persons or vehicles from entering or crossing through the Company-Owned Site and/or adjacent lands owned or operated by Company. Such fencing and gating shall require the prior written approval of the Company before erecting such fencing and gating.

(ii) **Access to Company-Owned Site.** During such time as SellerSubscriber Organization is actively constructing the Facility, Company shall provide access to the Company-Owned Site through a separate contractor's entrance, if available, or through other reasonable means as may be determined by Company in its sole discretion.

(b) Upon Completion of the Facility.

(i) Secured Facility. SellerSubscriber Organization shall secure the Facility on the Company-Owned Site and prevent access to the Facility by unauthorized personnel in the same manner or higher as Company secures its power generating facilities in the county in which the Company-Owned Site is located. Notwithstanding Company's then current security procedures for its other facilities, in the event of security concerns as may be determined by the Company's security personnel, Company may require SellerSubscriber Organization to temporarily maintain personnel at the Company-Owned Site 24 hours a day 7 days a week to monitor the security and safety of the Company-Owned Site and Facility.

(ii) Limited Access to Company-Owned Site. SellerSubscriber Organization shall maintain barriers on the Company-Owned Site to prevent unauthorized persons or vehicles from entering or crossing through the Company-Owned Site and/or adjacent lands owned or operated by Company.

(c) Personnel. At all times during the Term of this Contract, SellerSubscriber Organization shall conduct security and background checks on all SellerSubscriber Organization representatives, employees, independent contractors, agents, and other persons who will be allowed access to the Facility by SellerSubscriber Organization and shall require all such persons to take periodic drug tests. SellerSubscriber Organization shall not allow on the Company-Owned Site any persons who do not pass such security checks or drug tests. Due to the critical nature of Company's operations where the Company-Owned Site is situated, SellerSubscriber Organization agrees that if Company, in its sole discretion and after reasonable consultation with SellerSubscriber Organization, determines that the continued presence of any SellerSubscriber Organization representative, employee, contractor or agent on Company property is not consistent with the best interests of Company, then in such an instance Company may request that SellerSubscriber Organization remove such representative, employee, contractor or agent from the Company-Owned Site and SellerSubscriber Organization shall forthwith comply with such request. SellerSubscriber Organization may replace such representative, employee, contractor or agent with another who meets Company's standards at no additional cost to Company.

(d) Access and Inspection. At all times during the Term of this Contract, Company and its agents, representatives, and designees may enter the Company-Owned Site upon reasonable notice for any reason, including but not limited to the following: to (a) ascertain whether SellerSubscriber Organization is complying with this Contract; (b) cure any failure of SellerSubscriber Organization to comply with this Attachment K (Company-Owned Site); (c) inspect the Company-Owned Site and any construction or improvements, including the Facility; (d) perform such tests, borings, and other analyses as Company determines may be necessary or appropriate relating to (non)compliance with any Laws or possible Hazardous Substances Discharge (hereinafter defined). Company and its designees shall not unreasonably interfere with operations of the Facility and shall comply with Seller'sSubscriber Organization's reasonable instructions.

3. Compliance

(a) Generally. SellerSubscriber Organization shall, at Seller'sSubscriber Organization's expense, in all material respects: (i) comply with all Laws, ordinances, requirements, orders, proclamations, directives, rules, and regulations of any Governmental Authority affecting the Company-Owned Site; (ii) comply with all rules regulating the use of and activities and conduct upon the Company's property, including the Company-Owned Site, as may be established and amended from time to time by the Company in its sole discretion; (iii) comply with the covenants, conditions, and restrictions set forth in any

documents recorded against the Company-Owned Site; (iv) procure any and all licenses, permits (including building, demolition, alteration, use, and special permits), approvals, consents, certificates (including certificate(s) of occupancy), rulings, variances, authorizations, or amendments to any of the foregoing as shall be necessary or appropriate under any Laws to construct and operate the Facility and to perform repair, alteration, demolition, or other work affecting the Facility (“Approvals”); and (v) comply with all Approvals.

(b) **Notice of Inspections.** SellerSubscriber Organization shall give Company notice of any proposed inspection of the Company-Owned Site or the Facility by any Governmental Authority immediately upon Seller’sSubscriber Organization’s receipt of notice of such inspection.

4. Seller’sSubscriber Organization’s Investigation of the Company-Owned Site.

(a) **Investigations and Reports.** SellerSubscriber Organization shall make such independent investigations as SellerSubscriber Organization deems necessary or appropriate concerning Seller’sSubscriber Organization’s utilization of the Company-Owned Site for the purposes of meeting Seller’sSubscriber Organization’s obligations under this Contract. Notwithstanding the foregoing, if SellerSubscriber Organization wishes to conduct an environmental or soil assessment on the Company-Owned Site, including but not limited to any Baseline Assessment conducted under Section 7(a) (Baseline Assessment) of this Attachment K (Company-Owned Site), Company shall select the environmental or engineering consultant to conduct the investigation and shall contract with the consultant to provide the report at Seller’sSubscriber Organization’s cost. The provision of any such report to SellerSubscriber Organization shall be subject to the confidentiality provisions of Section 7(l) (Confidentiality) of this Attachment K (Company-Owned Site).

(b) **Permits, Assurances, and Approvals.** SellerSubscriber Organization agrees to provide Company with copies of all permits, Approvals and assurances pertaining to Seller’sSubscriber Organization’s construction on the Company-Owned Site, including but not limited to building and grading permits, special management area permits, assurances from Governmental Authorities, utility commitments and service Contracts, and any permits, Approvals or assurances regarding the development or use of water, roadways, utilities or other infrastructure.

(b) **Acceptance of Company-Owned Site.** SellerSubscriber Organization acknowledges that it has, or has had the opportunity, to inspect carefully the Company-Owned Site, and accepts the Company-Owned Site in AS IS condition WITH ALL FAULTS. SellerSubscriber Organization further acknowledges that neither Company nor its agents or employees have made any representations or warranties of any kind whatsoever as to the suitability or fitness of the Company-Owned Site for the construction or operation of the Facility or for any other purpose, nor has Company or its agents or employees agreed to make any repairs, undertake any alterations, or construct any improvements on or with respect to the Company-Owned Site other than such Company-Owned Interconnection Facilities as Company has or may agree to build or install.

(c) **No Company Services.** SellerSubscriber Organization acknowledges and agrees that Company is under no obligation to provide any services such as security, water, utilities or infrastructure to the Company-Owned Site.

5. Construction, Maintenance and Interference.

(a) Construction. At Seller'sSubscriber Organization's sole cost and expense, SellerSubscriber Organization shall construct the Facility in accordance with the requirements of this Contract. SellerSubscriber Organization shall not commence any demolition, construction, reconstruction, restoration, or other work affecting the Company-Owned Site, including construction of the Facility ("Construction") until it has the applicable necessary Approvals. Prior to commencement of any Construction, SellerSubscriber Organization shall cause each entity involved in such Construction, who is a direct contractor of SellerSubscriber Organization and who has mechanic lien rights under Chapter 507 of the Hawaii Revised Statutes, to deliver to Company a performance and payment bond in a form acceptable to Company and from a surety reasonably acceptable to Company, covering the faithful performance of such entity's contract with the SellerSubscriber Organization and the payment of all obligations arising thereunder, and naming Company as an obligee. SellerSubscriber Organization shall complete Construction of the Facility within the time periods required by this Contract. SellerSubscriber Organization shall pay for all Construction when and as required by the parties that perform such Construction. All improvements that SellerSubscriber Organization constructs on the Company-Owned Site other than Company-Owned Interconnection Facilities shall be the property of the SellerSubscriber Organization for the Term of this Contract.

(b) Plans and Specifications. SellerSubscriber Organization shall promptly provide Company with plans and specifications or surveys (including working plans and specifications and "as-built" plans and specifications and surveys) for any Construction.

(c) Applications. Upon Seller'sSubscriber Organization's request, Company shall, without cost to Company, promptly join in and execute any Application (hereinafter defined) as SellerSubscriber Organization reasonably requests, provided that: (i) such Application is in customary form and imposes no material obligations (beyond obligations ministerial in nature or merely requiring compliance with applicable Laws) upon Company; (ii) no uncured Event of Default exists; and (iii) SellerSubscriber Organization reimburses Company's attorneys' fees and costs. Promptly upon Seller'sSubscriber Organization's request and without charge (except reimbursement of Company's attorneys' fees and costs), Company shall furnish all information in its possession that SellerSubscriber Organization reasonably requests for any Application. For the purposes of this Attachment K (Company-Owned Site), "Application" shall mean any Contract, application, certificate, document, or submission (or amendment of any of the foregoing): (i) necessary or appropriate for any Construction allowed under this Attachment K (Company-Owned Site), including any application for any building permit, certificate of occupancy, utility service or hookup, easement, covenant, condition, restriction, subdivision plat, or such other instrument as SellerSubscriber Organization may from time to time reasonably request for such Construction; (ii) to enable SellerSubscriber Organization from time to time to seek any Approval or to use and operate the Facility in accordance with this Contract; or (iii) otherwise reasonably necessary and appropriate to allow SellerSubscriber Organization to meet its obligations under this Attachment K (Company-Owned Site).

(d) Obligation to Maintain. SellerSubscriber Organization shall remove trash and debris from the Company-Owned Site and the adjoining sidewalk, if any, and maintain them in a reasonably clean condition.

(e) Interference. The Company-Owned Site is located on or adjacent to property and infrastructure owned and operated by Company. SellerSubscriber Organization acknowledges and agrees that such property and infrastructure includes Company's existing communications configurations, equipment, and frequencies that exist on or adjacent to the Company-Owned Site as of the Effective Date ("Pre-existing Communications"). SellerSubscriber Organization shall not construct, install, operate, use,

maintain, repair, or remove any new or existing equipment that will materially interfere with the Pre-existing Communications and shall be responsible for resolving any technical interference problems between the Facility and the Pre-existing Communications. SellerSubscriber Organization additionally agrees to ensure that the Facility complies with any commercially reasonable communications requirements, specifications or rules developed by Company and provided to SellerSubscriber Organization with respect to the Company-Owned Site throughout the Term of this Contract. SellerSubscriber Organization shall inform and obtain Company's prior written approval before replacing any of its communications equipment or communications service providers (including internet equipment and internet service providers).

6. Prohibited Liens.

(a) **Seller'sSubscriber Organization's Covenant.** SellerSubscriber Organization shall not permit any mechanic's, vendor's, laborer's, or material supplier's statutory lien or other similar lien arising from work, labor, services, equipment, or materials supplied, or claimed to have been supplied, to SellerSubscriber Organization (or anyone claiming through SellerSubscriber Organization) ("Prohibited Lien") to attach to the Company-Owned Site or to any adjacent land owned by the Company. If a Prohibited Lien is filed, SellerSubscriber Organization shall, within 30 Days after receiving notice from Company of such filing (but in any case within 15 Days after Company notifies SellerSubscriber Organization of commencement of any application for a mechanic's lien or foreclosure proceedings), commence appropriate action to cause such Prohibited Lien to be paid, discharged, bonded, or cleared from title. SellerSubscriber Organization shall thereafter prosecute such action with reasonable diligence and continuity. If Company receives notice of any such filing, then Company shall promptly notify SellerSubscriber Organization. Nothing in this Contract shall be construed to obligate SellerSubscriber Organization regarding any lien that results from any act or omission by Company.

(b) **Protection of Company.** Nothing in this Contract shall be deemed or construed in any way to constitute Company's giving SellerSubscriber Organization any right, power or authority to contract for, or permit the rendering of, any services, or the furnishing of any materials that would give rise to the filing of any liens against the Company-Owned Site. SellerSubscriber Organization shall indemnify Company against any claims arising out of Construction undertaken by SellerSubscriber Organization or anyone claiming through SellerSubscriber Organization, and against all Prohibited Liens.

7. Hazardous Substances.

(a) **Baseline Assessment.** At Seller'sSubscriber Organization's request, Company shall obtain a Phase I and/or Phase II Environmental Assessment (hereinafter defined), at Seller'sSubscriber Organization's sole cost, revealing the environmental conditions of the Company-Owned Site prior to Seller'sSubscriber Organization's commencement of Construction on the Company-Owned Site ("Baseline Assessment") and, subject to the confidentiality provisions of Section 7(l) (Confidentiality) of this Attachment K (Company-Owned Site), shall provide SellerSubscriber Organization with a copy of the results of the Baseline Assessment. Any Hazardous Substances (hereinafter defined) not disclosed in any Baseline Assessment and discovered on the Company-Owned Site after the Effective Date shall be presumed to be present as a result of Seller'sSubscriber Organization's utilization of the Company-Owned Site during the Term, unless SellerSubscriber Organization shall prove, by clear and convincing proof, that the Hazardous Substances: (i) were present on the Company-Owned Site prior to the Term; (ii) migrated onto the Company-Owned Site as the result of the activities of a third party; or (iii) are present on the Company-Owned Site as the result of Company's improper actions.

(i) For the purposes of this Attachment K (Company-Owned Site): (A) “Phase I Environmental Assessment” means an environmental assessment and report prepared by a qualified environmental professional reasonably acceptable to Company that meets or exceeds the minimum requirements outlined in the then current version of the American Society of Testing and Materials Standard E 1527-00 (Standard Practice of Environmental Site Assessments: Phase I Environmental Site Assessment Process); and (B) “Phase II Environmental Assessment” means an environmental assessment and report prepared by a qualified environmental professional reasonably acceptable to Company that goes beyond the investigations of a Phase I Environmental Assessment and involves sampling and testing of the Company-Owned Site, including (1) an asbestos survey conducted according to the standards of the Asbestos Hazard Emergency Response Act protocol; (2) testing of any transformers on the Company-Owned Site for PCBs; (3) testing for lead based paints; (4) soil and groundwater sampling to measure the effect of any actual or suspected release or discharge of Hazardous Substances on the Company-Owned Site; and (5) such other sampling and testing reasonably necessary to determine the environmental condition of the Company-Owned Site.

(ii) For the purposes of this Attachment K (Company-Owned Site), “Hazardous Substances” shall include flammable substances, explosives, radioactive materials, asbestos, asbestos-containing materials, polychlorinated biphenyls, chemicals known to cause cancer or reproductive toxicity, pollutants, contaminants, hazardous wastes, medical wastes, toxic substances or related materials, petroleum and petroleum products, and any “hazardous” or “toxic” material, substance or waste that is defined by those or similar terms or is regulated as such under any Laws, including any material, substance or waste that is: (A) defined as a “hazardous substance” under Section 311 of the Water Pollution Control Act (33 U.S.C. §1317), as amended; (B) defined as a “hazardous waste” under Section 1004 of the Resource Conservation and Recovery Act of 1976, 42 U.S.C. §6901, et seq., as amended; (C) defined as a “hazardous substance” or “hazardous waste” under Section 101 of the Comprehensive Environmental Response, Compensation and Liability Act of 1980, as amended by the Superfund Reauthorization Act of 1986, 42 U.S.C. §9601 et seq. or any so-called “superfund” or “superlien” law; (D) defined as a “pollutant” or “contaminant” under 42 U.S.C. §9601(33); (E) defined as “hazardous waste” under 40 C.F.R. Part 260; (F) defined as a “hazardous chemical” under 29 C.F.R. Part 1910; or (G) subject to any other Laws regulating, relating to or imposing obligations, liability or standards of conduct concerning protection of human health, plant life, animal life, natural resources, property or the enjoyment of life or property free from the presence in the environment of any solid, liquid, gas, odor or any form of energy from whatever source.

(b) **Compliance with Environmental Law.** ~~Seller~~Subscriber Organization shall keep and maintain the Company-Owned Site, including the land, the air above the land, the surface and run-off water on the land, and the groundwater under the land, in compliance with, and shall not cause or permit the Company-Owned Site or any portion of the Company-Owned Site to be in violation of any Laws regarding: (i) air, environmental, ground water, soil conditions, or threatened or endangered species; or (ii) clean-up, control, disposal, generation, storage, release, transportation, or use of, or liability or standards of conduct concerning, Hazardous Substances (“Environmental Law”).

(c) **Use of Hazardous Substances.** ~~Seller~~Subscriber Organization shall not cause or allow any deposit, discharge, generation, release, or spill of Hazardous Substances at or from the Company-Owned Site, or that arises at any time from ~~Seller's~~Subscriber Organization's operation of the Facility or any activities conducted on the Company-Owned Site or any adjacent or nearby real property, or resulting from seepage, leakage, or other transmission of Hazardous Substances from other real property to the

Company-Owned Site, whether or not caused by SellerSubscriber Organization or the Company and whether occurring before or after the Effective Date (“Hazardous Substances Discharge”), except (i) in the ordinary course of Seller’sSubscriber Organization’s business (ii) in accordance with the instructions of the manufacturer and for the purpose described in such instructions, and (iii) in strict compliance with all applicable Environmental Law. SellerSubscriber Organization shall not install or remove any tank or combination of tanks (including pipes connected to the tanks) used to contain an accumulation of Hazardous Substances, and the volume of which (including the volume of the underground pipes connected to the tanks) is ten percent or more beneath the surface of the ground (“Underground Storage Tank”) on, within, under or about the Company-Owned Site without first obtaining Company’s written approval. SellerSubscriber Organization shall not accept hazardous waste (as defined under any Environmental Law) generated off the Company-Owned Site for any purpose, including treatment, storage or disposal.

(d) List of Hazardous Substances. On the Effective Date and on each anniversary of the Effective Date, and at any other time Company requests, SellerSubscriber Organization shall provide Company with a written list identifying any Hazardous Substances then used, stored, or maintained upon the Company-Owned Site, the use and approximate quantity of each such material, a copy of any material safety data sheet (MSDS) issued by the manufacturer thereof, written information concerning the removal, transportation, and disposal of the same, and such other information as Company may reasonably require or as may be required by Law.

(e) Notice of Disturbance of Any Hazardous Substances. SellerSubscriber Organization shall provide Company 30 Days’ prior notice before commencing any activities, including repair or remodeling of the Facility or the Company-Owned Site or installation or removal of any personal property from the Company-Owned Site, which could result in the disturbance of any Hazardous Substances. Together with such notice, SellerSubscriber Organization shall advise Company of protective measures to be taken by SellerSubscriber Organization to ensure that Hazardous Substances shall not be released and to ensure compliance with Environmental Law. SellerSubscriber Organization shall comply with all reasonable conditions (including adequate assurance of financial resources to comply with Environmental Law) that may be imposed by Company in connection with Seller’sSubscriber Organization’s proposed activities.

(f) Hazardous Substances Claims. SellerSubscriber Organization shall immediately notify Company of: (i) any Hazardous Substances Claims (hereinafter defined); or (ii) Seller’sSubscriber Organization’s discovery of any occurrence or condition of the Company-Owned Site which could subject SellerSubscriber Organization or Company to any liability, or restrictions on ownership, occupancy, transferability or use of the Company-Owned Site under any Environmental Law. For the purposes of this Attachment K (Company-Owned Site), “Hazardous Substances Claims” shall mean (i) any actual, alleged or threatened Hazardous Substances Discharge; (ii) any and all enforcement, cleanup, removal, mitigation, remediation or other government actions instituted, contemplated or threatened pursuant to Environmental Law affecting the Company-Owned Site; and (iii) all claims made or threatened by any third party against SellerSubscriber Organization or the Company-Owned Site relating to damage, contribution, cost recovery, compensation, loss or injury resulting from any Hazardous Substances.

(g) Remediation and Removal. Except for the use of Hazardous Substances permitted by this Attachment K (Company-Owned Site), SellerSubscriber Organization shall cause any Hazardous Substances Discharge to be: (i) remediated on-site in accordance with applicable Environmental Law; or (ii) removed from the Company-Owned Site for remediation or disposal and to be transported solely by duly licensed Hazardous Substances transporters to duly licensed disposal facilities for final disposition to

the extent required by and in accordance with applicable Environmental Law. SellerSubscriber Organization shall deliver to Company copies of any hazardous waste manifest reflecting the proper disposition of such Hazardous Substances. Except in emergencies or as otherwise required by Law, SellerSubscriber Organization shall not take any remedial or removal action in response to a Hazardous Substances Discharge without first notifying Company.

(h) Proceedings on Hazardous Substances Claims; Indemnity. SellerSubscriber Organization shall not enter into any legal proceeding or other action, settlement, consent decree or other compromise with respect to any Hazardous Substances Claims without first notifying Company of Seller'sSubscriber Organization's intention to do so and affording Company the opportunity to join and participate as a party if Company so elects in such proceedings. SellerSubscriber Organization shall be solely responsible for and shall indemnify Company against any Hazardous Substances Claims, including: (i) the costs of any required or necessary removal, repair, cleanup or remediation of the Company-Owned Site, and the preparation and implementation of any closure, removal, remedial or other required plans; and (ii) all reasonable costs and expenses incurred by Company in connection therewith, including legal costs.

(i) Assurance of Performance.

(i) Company's Phase II Environmental Assessment. Company may, but shall not be required to, engage such contractors as Company determines to be appropriate to perform from time to time a Phase II Environmental Assessment, including environmental sampling and testing, of: (A) the Company-Owned Site, the surrounding soil and any adjacent areas, and any ground water located under or surface water located adjacent to the Company-Owned Site or any adjoining property; (B) Seller'sSubscriber Organization's compliance with all Environmental Law and the provisions of this Attachment K (Company-Owned Site); and (C) the provisions made by SellerSubscriber Organization for carrying out any removal or remedial action that may be required by reason of the nature of Seller'sSubscriber Organization's business and operations on the Company-Owned Site.

(ii) Cost of Assessment. All costs and expenses incurred by Company in connection with any such Phase II Environmental Assessment shall be paid by Company, except that if any such Phase II Environmental Assessment shows that: (A) the environmental condition of the Company-Owned Site has materially declined in comparison to any Baseline Assessment; (B) SellerSubscriber Organization has failed to comply with the provisions of this Attachment K (Company-Owned Site) with respect to Hazardous Substances; (C) the Company-Owned Site (including surrounding soil and any underlying groundwater or adjacent surface water) has become contaminated due to operations or activities not attributable to the Company; or (D) an event that is the basis for a Hazardous Substances Claim occurred during the Term, then all of the costs and expenses of such assessment shall be paid by SellerSubscriber Organization.

(iii) Conducting Assessment. Each Phase II Environmental Assessment shall be conducted: (A) only after advance notice of such assessment has been provided to SellerSubscriber Organization at least 10 Days prior to the date of the assessment; and (B) in a manner reasonably designed to minimize the interruption of Seller'sSubscriber Organization's operations and use of the Company-Owned Site. Company shall repair any substantial damage to the Company-Owned Site or to the Facility that is directly caused by Company (but not the environmental consultant) during the Phase II Environmental Assessment.

(j) Seller'sSubscriber Organization's Obligations Prior to End of Term.

(i) **Seller'sSubscriber Organization's Phase I and Phase II Environmental Assessment Deposit.** No later than 18 months prior to the date upon which this Contract terminates, i.e., the end of the Term, SellerSubscriber Organization shall deposit with Company a sum equal to the then current estimated cost of conducting a Phase I and Phase II Environmental Assessment of the Company-Owned Site. Company shall hold such sum for SellerSubscriber Organization and shall apply or reimburse such sum as provided in this section.

(ii) **Phase I (or Phase II) Environmental Assessment.**

(A) No later than the beginning of the last year of the Term, or immediately upon earlier termination of the Term, Company shall cause a Phase I Environmental Assessment of the Company-Owned Site to be conducted and may apply the sums previously deposited by SellerSubscriber Organization to pay for such assessment.. If the assessment costs more than the amount of the deposit, SellerSubscriber Organization shall pay to Company, upon demand, the difference. If the assessment costs less than the amount of the deposit, and if the Phase I Environmental Assessment does not identify areas of concern that in Company's reasonable judgment indicate that further investigation is required, Company shall, no later than 30 Days after payment in full of the cost of the Phase I Environmental Assessment, return to SellerSubscriber Organization a sum equal to the amount by which the deposit exceeds the actual costs of such assessment. In addition, no later than the end of the Term, SellerSubscriber Organization shall (1) cause all Hazardous Substances previously owned, stored or used by SellerSubscriber Organization to be removed from the Company-Owned Site and disposed of in accordance with all Environmental Law; and (2) remove any Underground Storage Tanks or other containers installed or used by SellerSubscriber Organization to store any Hazardous Substances on the Company-Owned Site, and repair any damage to the Company-Owned Site caused by such removal.

(B) If Company's Phase I Environmental Assessment identifies areas of concern that in Company's reasonable judgment indicate that further investigation is required, Company shall cause a Phase II Environmental Assessment of the Company-Owned Site to be conducted and may apply the sums previously deposited by SellerSubscriber Organization to pay for such assessment. If the assessment costs more than the amount of the deposit, SellerSubscriber Organization shall pay to Company, upon demand, the difference. If the assessment costs less than the amount of the deposit, Company shall, no later than 30 Days after payment in full of such costs, return to SellerSubscriber Organization a sum equal to the amount by which the deposit exceeds the actual costs of such assessment. SellerSubscriber Organization expressly acknowledges and agrees that Seller'sSubscriber Organization's covenant and obligation to pay all costs and expenses associated with any Phase II Environmental Assessment required under this section, whether commissioned by SellerSubscriber Organization or Company, shall survive termination of this Contract.

(k) **Clean-up.**

(i) **Environmental Report.** If any written report containing results of any Phase I Environmental Assessment ("Environmental Report") shall: (A) reveal that the environmental condition of the Company-Owned Site has materially declined in comparison to the Baseline Assessment; or (B) SellerSubscriber Organization has materially violated any warranty, representation, or covenant of this Attachment K (Company-Owned Site); or (C) recommend the repair, closure, remediation, removal or other clean-up (collectively, the "Clean-up") of any Hazardous Substances found on or about the Company-Owned Site, and if Company determines that SellerSubscriber Organization is responsible for such Clean-up, then:

(A) Company shall provide SellerSubscriber Organization with a copy of such Environmental Report and with a written explanation of the reasons why Company believes that SellerSubscriber Organization is responsible under the principles of this section for conducting the Clean-up identified in such Environmental Report.

(B) If, within 30 Days after receiving a copy of such Environmental Report and such written statement, SellerSubscriber Organization fails either (1) to complete the Clean-up, or (2) with respect to any Clean-up which cannot be completed within such 30-Day period, fails to proceed with reasonable diligence to complete such Clean-up as promptly as practicable, then Company shall have the right, but not the obligation, to carry out any Clean-up recommended by the Environmental Report or required by any Governmental Authority, and to recover all of the costs and expenses of such Clean-up from SellerSubscriber Organization from the date Company incurred such costs and expenses until paid in full.

(ii) Emergency. If the Environmental Report reveals a situation which, in Company's sole discretion, constitutes an emergency, then Company shall have the right, but not the obligation, to carry out any Clean-up recommended by the Environmental Report or required by any Governmental Authority, and to recover all of the costs and expenses of such Clean-up from SellerSubscriber Organization from the date Company incurred such costs and expenses until paid in full.

(iii) Submission of Report to Government. To the extent required by Laws, Company shall be entitled to submit the Environmental Report to any Governmental Authority.

(iv) Completion of Clean-up Before Termination. SellerSubscriber Organization shall complete Clean-up prior to termination of this Contract, and shall fully comply with all Environmental Law and requirements of any Governmental Authority over the Clean-up, including any requirement to file such assessment, mitigation plan, risk assessment or other information with any such Governmental Authority prior to such termination.

(v) Seller'sSubscriber Organization's Inability to Complete. Should any such Clean-up for which SellerSubscriber Organization is responsible not be completed or should SellerSubscriber Organization not receive any Approvals regarding the Company-Owned Site or areas adjacent to the Company-Owned Site required under Environmental Law prior to the expiration or sooner termination of this Contract, including any extensions of this Contract, then SellerSubscriber Organization shall deposit with Company an amount of money equal to the balance of the estimated costs of the Clean-up.

(l) Confidentiality.

(i) Keeping Information Confidential. Except if required to do so by Law, or compelled by subpoena or discovery proceedings in any legal action or governmental proceeding, SellerSubscriber Organization agrees that SellerSubscriber Organization shall not disclose, discuss, disseminate or copy any information, data, findings, communications, conclusions and reports regarding the environmental condition of the Company-Owned Site, to any person, including any Governmental Authority, without the prior written consent of Company. Upon completion of any Clean-up of the Company-Owned Site, SellerSubscriber Organization shall deliver and return to Company, all information, data, findings, communications, conclusions and reports regarding the environmental condition of the Company-Owned Site whether provided to SellerSubscriber Organization by Company or not.

(ii) **Scope of Obligation.** Seller'sSubscriber Organization's obligation to maintain the confidentiality of all information, data, findings, communications, conclusions and reports regarding the environmental condition of the Company-Owned Site, include but are not limited to Seller'sSubscriber Organization's officers, employees, agents, attorneys, environmental consultants and contractors. Seller'sSubscriber Organization's obligation to maintain the confidentiality of all information, data, findings, communications, conclusions and reports regarding the environmental condition of the Company-Owned Site, shall survive the termination of this Contract.

(m) **Copies of Environmental Reports.** SellerSubscriber Organization shall provide Company with a copy of any and all environmental assessments, audits, studies and reports regarding Seller'sSubscriber Organization's past or current activities on the Company-Owned Site or the environmental condition of the Company-Owned Site within 30 Days of Seller'sSubscriber Organization's receipt of such materials. SellerSubscriber Organization shall be obligated to provide Company with a copy of such materials without regard to whether they are generated by SellerSubscriber Organization or prepared for SellerSubscriber Organization, or how SellerSubscriber Organization comes into possession of such materials.

(n) **Survival of Contracts.** The covenants of this section, including the indemnification provision, shall survive the expiration or termination of this Contract, or any termination of Seller'sSubscriber Organization's utilization of the Company-Owned Site.

8. Archeological and Historical Items.

(a) **Discovery of Items.** In the event any human remains, artifacts, historical items, or any of them (collectively the "Discovered Items") are discovered on the Company-Owned Site, SellerSubscriber Organization shall, at Seller'sSubscriber Organization's sole expense and subject to the approval of Company, be responsible to: (i) cause all excavation in the immediate area which may damage the Discovered Items and the potential historic site to cease; (ii) cause the site to be stabilized and secured to temporarily protect the Discovered Items against damage, theft, or both; (iii) cause the Discovered Items to be left untouched so that their archaeological or historical context may be accurately documented; and (iv) cause the discovery to be reported immediately to Company and to Governmental Authorities as required by applicable Laws. If the artifacts or historical items are found without human remains, and leaving the artifacts or historical items in their stabilized and secured site poses a substantial risk of loss or damage to all or part of them, and their removal is therefore necessary, SellerSubscriber Organization shall cause such removal and shall cause any tampering with the artifacts, the historical items, and the site to be minimized as much as possible.

(b) **Human Remains.** In the case of the discovery of human remains, SellerSubscriber Organization shall, at Seller'sSubscriber Organization's sole expense and in addition to the duties set forth in this section, cause to be prepared and executed a mitigation plan acceptable to Company and to Governmental Authorities possessing jurisdiction over such matters. SellerSubscriber Organization shall also be responsible to obtain written verification that the mitigation plan has been successfully implemented.

(c) **Company's Reservation.** If any Discovered Items are discovered, then Company shall have the right at all reasonable times to enter the Company-Owned Site upon reasonable notice for the purposes of searching for, exploring for, and removing any of the Discovered Items for preservation as permitted by applicable Laws. All objects, antiquities and specimens of Hawaiian or other ancient art or

handicraft or of prehistoric, historic or archaeological interest found on the Company-Owned Site belong to and at all times shall remain the property of Company.

(d) **No Studies by SellerSubscriber Organization.** No archaeological studies or historic preservation studies may be sought to be conducted in or on the Company-Owned Site by SellerSubscriber Organization or anyone acting by or through SellerSubscriber Organization. If SellerSubscriber Organization wishes to conduct such studies, or if SellerSubscriber Organization is required by applicable Laws to permit such studies (SellerSubscriber Organization to provide bases for conclusion that such Laws mandate any such requested studies), SellerSubscriber Organization shall obtain Company's prior written consent and shall permit Company, at its option, to commission such studies as required, or Company may permit SellerSubscriber Organization to commission such studies provided that SellerSubscriber Organization shall provide Company with prior notice of the commencement of such studies. If SellerSubscriber Organization commissions such studies, SellerSubscriber Organization shall upon completion of such studies cause a complete copy of the results of such studies to be provided to Company at the earliest opportunity but no later than 15 days after its issuance.

9. Transfers.

(a) **Company's Right to Convey.** Company may transfer title to the Company-Owned Site from time to time at any time without prior notice to, or consent from, SellerSubscriber Organization, provided that any such transfer is subject to Seller'sSubscriber Organization's right to utilize the Company-Owned Site under this Contract. Company will promptly notify SellerSubscriber Organization of such a transfer.

(b) **Seller'sSubscriber Organization's Limited Right.** SellerSubscriber Organization may only transfer the rights to utilize the Company-Owned Site under this Attachment K (Company-Owned Site) to a permitted assignee of all of the rights and obligations of the SellerSubscriber Organization under this Contract. Any attempt by SellerSubscriber Organization to separately transfer the rights to utilize the Company-Owned Site under this Attachment K (Company-Owned Site) shall be void. Any permitted assignee of SellerSubscriber Organization shall assume all obligations and liabilities of SellerSubscriber Organization under this Attachment K (Company-Owned Site). No transfer shall affect any obligations of SellerSubscriber Organization or rights of Company under this Attachment K (Company-Owned Site).

10. End of Term.

(a) **Improvements.** Upon the termination of this Contract, or in the event this Contract is declared null and void under the Null and Void Rights of this Contract ("Contract Termination"), at Company's option: (i) all improvements on the Company-Owned Site shall become Company's property; or (ii) SellerSubscriber Organization shall, at its sole cost and expense, remove all SellerSubscriber Organization-constructed improvements, including the Facility, the Company-Owned Interconnection Facilities and the SellerSubscriber Organization-Owned Interconnection Facilities ("Improvements") from the Company-Owned Site, and, in conjunction with such removal, shall develop and implement a program to recycle, to the fullest extent possible, or to otherwise properly dispose of, all such removed infrastructure.

(b) **Seller'sSubscriber Organization's Removal of Improvements.** If SellerSubscriber Organization is required to remove the Improvements upon Contract Termination, SellerSubscriber Organization shall have reasonable access to the Company-Owned Site for a period of up to 90 Days after termination of this Contract to dismantle, pack and remove the Improvements from the Company-Owned

Site (the "Removal Period"). SellerSubscriber Organization shall work promptly and diligently to remove the Improvements. The Removal Period shall end upon Seller'sSubscriber Organization's completion of removal of the Improvements from the Company-Owned Site. The terms and provisions of this Contract shall apply during the Removal Period, including Seller'sSubscriber Organization's obligations to provide insurance and to indemnify Company.

(c) **Company's Removal of Improvements.** If Company determines that SellerSubscriber Organization is not making diligent efforts to remove the Improvements, or if Company has operational concerns over the removal of the Improvements, Company shall notify SellerSubscriber Organization of Company's intention to remove the Improvements at Seller'sSubscriber Organization's cost. Company shall notify SellerSubscriber Organization of Company's election to have SellerSubscriber Organization remove the Improvements not later than 90 Days before the end of the Term.

(d) **Restoration of the Company-Owned Site.** After Contract Termination and removal of Seller'sSubscriber Organization's Improvements by SellerSubscriber Organization or by Company, as the case may be, SellerSubscriber Organization shall, at its sole cost and expense, restore the Company-Owned Site to its condition prior to Seller'sSubscriber Organization's Construction. Restoration pursuant to this Section shall be completed within 90 Days of Contract Termination, or as otherwise agreed to by both Parties in writing.

(e) **Assignment of Rights.** If Company exercise its option under Section 10(a) (Improvements) of this Attachment K (Company-Owned Site) to take title to the Improvements, SellerSubscriber Organization shall assign to Company, without recourse, and give Company copies or originals of, all assignable licenses, permits, contracts, warranties, and guarantees then in effect for the Facility.

(f) **Orderly Transition.** The parties shall cooperate to achieve an orderly transition of operations from SellerSubscriber Organization to Company without interruption, including delivery of such books and records (or copies thereof) as Company reasonably requires.

11. Miscellaneous.

(a) **Modification.** The parties reserve the right to modify this Attachment K (Company-Owned Site) by mutual Contract set forth in writing. Such modifications shall not be considered amendments to this Contract requiring PUC approval.

(b) **Security.** SellerSubscriber Organization acknowledges and agrees that Seller'sSubscriber Organization's performance under this Attachment K (Company-Owned Site) is secured by both the Development Period Security and the Operating Period Security. Any costs and expenses due to Company, or reimbursable to Company, may at Company's option, be paid or reimbursed to Company from the applicable Development Period Security or Operating Period Security.

(c) **Confidential Information.** Without limitation of the obligations set forth elsewhere in this Contract, each party (including its officers, directors, employees, representatives, brokers, attorneys and advisers) shall, except as otherwise provided by applicable Laws, or in connection with proceedings before the State of Hawaii Public Utilities Commission or other Governmental Authority with jurisdiction over the Company-Owned Site or this Contract, or in connection with the evaluation for financing, or as part of disclosure to its affiliates, attorneys, consultants, and advisers in order to conduct its business or

proceedings to enforce this Attachment K (Company-Owned Site) or this Contract, keep the contents of this Attachment K (Company-Owned Site) and any information related to the Company-Owned Site, SellerSubscriber Organization and the Seller'sSubscriber Organization's utilization of the Company-Owned Site pursuant to this Attachment K (Company-Owned Site) confidential, whether or not marked as "confidential" (collectively, the "Confidential Information"). The Confidential Information shall not include any information publicly known, or which becomes publicly known, other than through the acts of a party to the Contract, or any of their respective officers, directors, employees, representatives, brokers, attorneys or advisers. SellerSubscriber Organization may retain possession of all or any part of the Confidential Information to the extent such Confidential Information relates solely to the Facility and Seller'sSubscriber Organization's operation of the Facility.

(d) **No Real Property Interest Conveyed.** Notwithstanding anything to the contrary contained herein, this Contract shall not result in the conveyance or transfer to SellerSubscriber Organization, directly or indirectly, expressly or impliedly, or give rise to, any real property right, title, or interest.

DRAFTING NOTES:

1. ATTACHMENT K MAY BE REVISED TO ACCOUNT FOR MATTERS SUCH AS THE SPECIFICS OF THE SITE IN QUESTION, **SELLER'SSUBSCRIBER ORGANIZATION'S** FACILITY AND ANY NECESSARY ACCESS ARRANGEMENTS THROUGH COMPANY'S FACILITIES.
2. PROVISIONS OF THE CONTRACT CONCERNING MATTERS SUCH AS LAND RIGHTS, SCOPE OF INDEMNIFICATION AND DRAWS UPON DEVELOPMENT PERIOD SECURITY OR OPERATING PERIOD SECURITY WILL BE REVISED TO ACCOUNT FOR ATTACHMENT K.

EXHIBIT K-1
SITE PLAN
[TO BE DETERMINED]

**TERM SHEET FOR MID-TIER STANDARD FORM CONTRACT
for
DC-COUPLED STORAGE (PV+BESS)**

This Term Sheet summarizes the revisions that will be made to the MID-TIER STANDARD FORM CONTRACT for Renewable Dispatchable Generation (PV+BESS) for projects designed with a single Inverter System such that the PV System and BESS are "DC Coupled".

1. **Deletion and Substitution of Defined Term.** Definition of "PV System Equivalent Availability Factor Performance Metric" will be deleted from the Schedule of Defined Terms and substituted with the new defined term "Inverter System".

2. **Addition of New Defined Terms.** The following will be added to the Schedule of Defined of Terms:

"Inverter System": The electric DC to AC and AC to DC power conversion equipment as more particularly described in Attachment A (Description of Generation, Conversion and Storage Facility).

"Inverter System Equivalent Availability Factor Performance Metric": Shall have the meaning set forth in Section 1. B (Inverter System Equivalent Availability Factor Performance Metric and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages).

3. **Revisions to Defined Term.** The definition in the Scheduled of Defined Terms for the following is revised to read as follows:

"CBRE Facility": Subscriber Organization's renewable electric energy facility that is the subject of this Contract, including the PV System, Inverter System, the BESS, all Subscriber Organization-Owned Interconnection Facilities and all other equipment, devices, associated appurtenances owned, controlled, operated and managed by Subscriber Organization in connection with, or to facilitate, the production, generation, storage, transmission, delivery or furnishing by Subscriber Organization of, electric energy to Company and required to interconnect with the Company System.

4. **Global Changes.**

- All references in the Contract to "PV System Equivalent Availability Factor" will be changed to "Inverter System Equivalent Availability Factor".
- All references in the Contract to the "PV System Equivalent Availability Factor Performance Metric" will be changed to "Inverter System Equivalent Availability Factor Performance Metric".

5. **Contract Section 4.C.** This Section is revised to read as follows:

4. C. Assurance of Capability of CBRE Facility to Deliver Net Energy Potential and Availability of BESS. In order to provide Company with reasonable assurance that, subject to the Renewable Resource Variability, the CBRE Facility's Net Energy Potential will be available for Company Dispatch: (i) the Inverter System Equivalent Availability Factor Performance Metric shall be used to evaluate the availability of the Inverter System for dispatch by Company; (ii) the Guaranteed Performance Ratio ("GPR") Performance Metric shall be used to evaluate the efficiency of the PV System; (iii) the BESS Capacity Performance Metric shall be used to confirm the capability of the BESS to discharge continuously for four (4) hours at Maximum Rated Output or to discharge continuously for a

total energy (MWh) equal to the BESS Contract Capacity if the test is conducted at less than Maximum Rated Output; (iv) the BESS EAF Performance Metric shall be used to determine whether the BESS is meeting its expected availability; (v) the BESS EFOF Performance Metric shall be used to evaluate whether the BESS is experiencing excessive unplanned outages; and (vi) the RTE Performance Metric shall be used to evaluate the storage efficiency of the BESS. Whenever the PV System potential output is in excess of the Company Dispatch, the excess energy from the PV System shall be used to maximize the BESS State of Charge so long as this does not conflict with the operating parameters of the BESS set forth in Section 9(d) (Battery Energy Storage System) of Attachment F (Facility Owned by Subscriber Organization) to this Contract. Subscriber Organization shall design, operate and maintain the CBRE Facility in a manner consistent with the standard of care reasonably expected of an experienced owner/operator with the desire and financial resources necessary to design, operate and maintain the CBRE Facility to achieve the Performance Metrics. The foregoing is without limitation to Subscriber Organization's other obligations under this Contract, including the obligation to operate the CBRE Facility in accordance with Good Engineering and Operating Practices. The Performance Metrics are set forth in Attachment C (Required Performance Metrics; Liquidated Damages) of this Contract and shall be interpreted consistent with the North American Electric Reliability Corporation Generating Availability Data System ("NERC GADS") Data Reporting Instructions.

6. **Attachment C (Required Performance Metrics; Liquidated Damages) Section 1. is revised to read as follows:**

1. **INVERTER SYSTEM EQUIVALENT AVAILABILITY FACTOR; LIQUIDATED DAMAGES; TERMINATION RIGHTS.**

A. **Calculation of the Inverter System Equivalent Availability Factor.** Following the end of each LD Period, the Inverter System Equivalent Availability Factor shall be calculated for such LD Period as follows:

$$\text{Inverter System Equivalent Availability Factor} = 100\% \times \frac{AH - EDH}{PH}$$

where:

Period Hours (PH) is the total number of hours in the LD Period counting twenty-four (24) hours per day. In a normal year, PH = 8,760 and in a leap year PH = 8,784 .

Available Hours (AH) is the number of hours that the Inverter System is not on Outage. It is the sum of all Service Hours (SH) + Reserve Shutdown Hours (RSH).

An "Inverter System Outage" exists whenever the entire Inverter System is not online producing electric energy and is not in a Reserve Shutdown state.

Inverter System Service Hours (SH) is the number of hours during the LD Period the Inverter System is online and producing or consuming electric energy to meet Company Dispatch.

Inverter System Reserve Shutdown Hours (RSH) is the number of hours the Inverter System was available to the Company System but not converting electric energy or is offline at the Company's request for reasons other than Subscriber Organization-Attributable Non-Generation or the measured plane of array irradiance is below the inverter manufacturer's minimum irradiance level for production. All hours between 7:00 pm and 6:00 am will be considered RSH. The Inverter System will be considered RSH in these hours, even if the system would otherwise be in an outage or derated state. A BESS Outage or Derating can exist due to an Inverter System Outage or Derating during Inverter System Reserve Shutdown Hours and the effect of such Inverter System Outage or Derating on the BESS Availability shall be included when calculating the BESS Annual Equivalent Availability Factor in accordance with Attachment H (BESS Annual Equivalent Availability Factor).

An "Inverter System Derating" exists if the Inverter System is available for Company Dispatch, but at less than full potential output for the given irradiance and BESS conditions, including deratings due to Subscriber Organization-Attributable Non-Generation. For avoidance of doubt, if there is an Inverter System Outage there cannot also be an Inverter System Derating.

Equivalent Derated Hours (EDH) is the sum of ESADH, EPDH, and EUDH. For deratings due to inverter unavailability, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the number of inverters in the Inverter System unavailable and dividing by the total number of inverters in the Inverter System. For deratings, that do not impact the availability of an entire inverter or set of entire inverters, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the size of the derating (in MW) divided by the Contract Capacity.

Equivalent Subscriber Organization-Attributable Derated Hours (ESADH): A Subscriber Organization-Attributable Derating occurs when there is an Inverter System Derating, due to Subscriber Organization-Attributable Non-Generation or deratings by Company pursuant to Section 5.C (Company Rights of Dispatch). Each individual derating is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed.

Equivalent Planned Derated Hours (EPDH) includes Planned Deratings (PD) and Maintenance Deratings (D4). A Planned Derating is when the Inverter System experiences a derating scheduled well in advance and for a predetermined duration. A Maintenance Derating is a derating that can be deferred beyond the end of the next weekend (Sunday at midnight or before Sunday turns into Monday) but requires a reduction in capacity before the next Planned Derating (PD). Each individual derating is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed.

Equivalent Unplanned Derated Hours (EUDH): An Unplanned Derating (Forced Derating) occurs when the Inverter System experiences a derating that requires a reduction in availability before the end of the nearest following weekend. Each individual Unplanned Derating is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed.

The effect of Force Majeure is taken into account in calculating the Inverter System Equivalent Availability Factor over the 12 calendar month LD Period as follows: When an LD Period contains any hours in a month during which the Inverter System or a portion of the Inverter System is unavailable due to Force Majeure, then such month shall be excluded from the LD Period and the LD Period shall be extended back in time to include the data used to calculate the Inverter System Equivalent Availability Factor from the next previous month during which there was no such unavailability of the Inverter System or a portion thereof due to Force Majeure. This means the Inverter System Equivalent Availability Factor would not change from that determined in the month directly preceding a month containing Force Majeure.

EXAMPLE: The following is an example of an Inverter System Equivalent Availability Factor calculation and is included for illustrative purposes only. Assume the following:

- Inverter System has 10 inverters and the Facility has a Contract Capacity of 30 MWs.
- LD Period = first 12 calendar months of the Contract (non-leap year).
- Inverter System was online and producing electric energy for 8,015 hours and was available but not producing electric energy due to lack of sufficient irradiance and BESS SOC for production for 500 hours.

- 3 Inverters were offline for 100 hours due to a Planned Derating.
- 2 Inverters were offline for 50 hours due to an Unplanned Derating.
- The Inverter System had a 3 MW derating for 100 hours due to Subscriber Organization-Attributable Non-Generation.

The Inverter System Equivalent Availability Factor would be calculated as follows:

$$PH = 8,760 \text{ hours in 12 calendar months}$$

$$SH = 8,015 \text{ hours}$$

$$RSH = 500 \text{ hours}$$

$$AH = SH + RSH = 8,015 \text{ hours} + 500 \text{ hours} = 8,515 \text{ hours}$$

$$ESADH = 100 \text{ hours} \times \left(\frac{3 \text{ MW}}{30 \text{ MW}} \right) = 10 \text{ hours}$$

$$EPDH = 100 \text{ hours} \times \left(\frac{3 \text{ inverters}}{10 \text{ inverters}} \right) = 30 \text{ hours}$$

$$EUDH = 50 \text{ hours} \times \left(\frac{2 \text{ inverters}}{10 \text{ inverters}} \right) = 10 \text{ hours}$$

$$EDH = ESADH + EPDH + EUDH = 10 \text{ hours} + 30 \text{ hours} + 10 \text{ hours} = 50 \text{ hours}$$

$$EAF = 100\% \times \frac{8,515 - 50}{8,760} = 96.6\%$$

B. Inverter System Equivalent Availability Factor Performance Metric and Liquidated Damages. For each LD Period, a Inverter System Equivalent Availability Factor shall be calculated as provided in accordance with Section 1. A. (Calculation of Inverter System Equivalent Availability Factor) of Attachment C to this Contract. In the event the Inverter System Equivalent Availability Factor is less than 98% (the "Inverter System Equivalent Availability Factor Performance Metric") for any LD Period, Subscriber Organization shall be subject to liquidated damages as set forth in this Section 1. B (Inverter System Equivalent Availability Factor Performance Metric and Liquidated Damages). For avoidance of doubt, because the Inverter System Equivalent Availability Factor is calculated over an LD Period of 12 calendar months, the first month for which liquidated damages would be calculated under this Section 1.B (Inverter System Equivalent Availability Factor Performance Metric and Liquidated Damages) would be the last calendar month of the initial Contract Year. If the Inverter System Equivalent Availability Factor for a LD Period is less than the Inverter System Equivalent Availability Factor Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C, Section 8. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages),, and Company shall accept, as liquidated damages for Subscriber Organization's failure to achieve the Inverter System Equivalent Availability Factor Performance Metric for such LD Period, an amount calculated in accordance with the following formula:

<u>Inverter System Equivalent Availab Factor</u>	<u>Amount of Liquidated Damages Per Calendar Month</u>
97.9% and below	For each one-tenth of one percent (0.001) by which the Inverter System Equivalent Availability Factor for such LD Period falls below the Inverter System Equivalent Availability Factor Performance Metric, an amount equal to 0.001917 of the Applicable Period Lump Sum Payment for the last calendar month of such LD Period.

For purposes of determining liquidated damages under the preceding formula, the amount by which the Inverter System Equivalent Availability Factor for the LD Period in question falls below the applicable threshold shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the Inverter System Equivalent Availability Factor Performance Metric for a LD Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

EXAMPLE: The following is an example calculation of liquidated damages for the Inverter System Equivalent Availability Factor Performance Metric and is included for illustrative purposes only. Assume the monthly Lump Sum Payment is \$1,000,000 and the Inverter System Equivalent Availability Factor is 96.6% as calculated in the example in Section 1.A. (Calculation of the Inverter System Equivalent Availability Factor) above.

The liquidated damages would be calculated as follows:

Applicable Period Lump Sum Payment = \$1,000,000

$\$1,000,000 \times .001917 = \$1,917$

$98.0\% - 96.6\% = 1.4\%$

$1.4\% / 0.1\% = 14$

$\$1,917 \times 14 = \$26,838$

C. Inverter System Equivalent Availability Factor Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 1.B. (Inverter System Equivalent Availability Factor Performance Metric and Liquidated Damages) is to compensate Company for the damages that Company would incur if the Subscriber Organization fails to achieve the Inverter System Equivalent Availability Factor Performance Metric for a LD Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the Inverter System is likely to continue to substantially underperform the Inverter System Equivalent Availability Factor Performance Metric. Accordingly, and without limitation to Company's rights under said Section 1.B. (Inverter System Equivalent Availability Factor Performance Metric and Liquidated Damages) for those LD Periods during which the Subscriber Organization failed to achieve the Inverter System Equivalent Availability Factor Performance Metric, the failure of the Facility to achieve a Inverter System Equivalent Availability Factor of not less than **84%** for each of three consecutive Contract Years shall constitute an Event of Default under the Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 13. (Events of Default) and Section 15. (Damages in the Event of Termination by Company) of the Contract.

7. **Cross references elsewhere in the Contract to Attachment C, Section 1. A. and Section 1. B. All Cross-References elsewhere in the Contract to any of Attachment C, Sections 1. A. and 1. B. are corrected to reflect the revised captions for those Sections as set forth above.**
8. **Attachment C, Section 2. (Measured Performance Ratio; Liquidated Damages; Termination Rights) is revised to read as follows:**

2. MEASURED PERFORMANCE RATIO; LIQUIDATED DAMAGES; TERMINATION RIGHTS

A. **Calculation of Measured Performance Ratio.**

1. The Measured Performance Ratio ("MPR") represents the PV System's measured power output compared to its theoretical DC power output as adjusted for the plane of array irradiance and weather conditions measured at the Site. The net PV System output in MW will be measured at such points mutually agreed to by the Parties on the Facility's single-line diagram attached hereto as Attachment F, Exhibit F-5 (Single-Line Drawing and Interface Block Diagram).

- Following the end of each MPR Assessment Period, the MPR shall be calculated for such MPR Assessment Period (using the previous 12 months of data) as follows:

$$MPR_{corr} = \frac{\sum_i P_{AC_i} + \sum_i P_{DC_i}}{\sum_i \left[P_{DCSTC} \left(\frac{G_{POA_i}}{G_{STC}} \right) \left(1 - \frac{\delta}{100} (T_{cell_typ_avg} - T_{cell_i}) \right) \right]}$$

Where:

i = each 15-minute interval during the MPR Assessment Period where the conditions set forth in Section 2.A. 1. are met.

P_{AC_i} is the active power output of the PV System measured at the POI averaged over time period i (MW)

P_{DC_i} is the measured power output of the PV System measured at the input to the BESS charging system averaged over time period i (MW)

G_{STC} = plane of array irradiance at the standard condition of 1,000 W/m^2

P_{DCSTC} is the DC rated capacity of the PV System at the standard test conditions of 1,000 W/m^2 and 25°C (MW), (i.e., the DC power rating of the PV panels at standard test conditions multiplied by the number of PV panels in the Facility);

G_{POA_i} is the measured plane of array irradiance averaged over time period i (W/m^2);

T_{cell_i} = cell temperature computed from measured meteorological data averaged over time period i using the equation provided below. (°C)

$T_{cell_typ_avg}$ = annual average irradiance-weighted cell temperature computed from one year of weather data using the GPR Performance Metric weather file and the equation below. (°C) Calculated once per GPR.

δ = temperature coefficient for power (%/°C, negative in sign) that corresponds to the installed photovoltaic modules

$$T_{cell_typ_avg} = \frac{\sum_j [G_{POA_typ_j} \times T_{cell_typ_j}]}{\sum_j G_{POA_typ_j}}$$

Where:

j = each hour of the year in the GPR Performance Metric weather file (hours 1-8760)

$G_{POA_typ_j}$ = Plane of array irradiance for each hour of the year determined from the GPR Performance Metric weather file and tracker orientation. This irradiance is zero (0) when the sun is not up. (W/m^2)

$T_{cell_typ_j}$ = calculated cell operating temperature for each hour of the year. Computed using the equation for T_{cell_i} below but using the GPR Performance Metric weather file for the weather variables in the equation.

$$T_{cell_i} = G_{POA_i} \times e^{(a+b \times WS_i)} + T_{a_i} + \left(\frac{G_{POA_i}}{G_{STC}} \times dT_{cond} \right)$$

Where:

T_{a_i} = the measured ambient temperature averaged over time period i [$^{\circ}C$]

WS_i = the measured wind speed corrected to a measurement height of 10 meters (using the anemometer height and proper Hellmann coefficient) averaged over time period i [m/s]

a = empirical constant reflecting the increase of module temperature with sunlight as presented in Table 2 below.

b = empirical constant reflecting the effect of wind speed on the module temperature as presented in Table 2 below [s/m]

e = Euler's constant and the base for the natural logarithm.

dT_{cond} = conduction temperature coefficient from module to cell as presented in Table 2 below.

Table 2. Empirical Convective Heat Transfer Coefficients Module Type	Mount	a	b	dT_{cond}
Glass/cell/glass	Open rack	-3.47	-0.0594	3
Glass/cell/glass	Close-roof mount	-2.98	-0.0471	1
Glass/cell/polymer sheet	Open rack	-3.56	-0.0750	3
Glass/cell/polymer sheet	Insulated back	-2.81	-0.0455	0
Polymer/thin-film/steel	Open rack	-3.58	-0.1130	3

The time periods used in the foregoing calculation shall be only periods during which, for the entire 15-minute interval, the PV System output is allowed to convert all irradiance to gross power (whether directed to the BESS or POI) and the measured plane of array irradiance is not less than 600 W/m^2 . Data points that will be excluded from the calculation of the MPR are limited to data points where: (A) the G_{POA} is below 600 W/m^2 , (B) G_{POA} above the

maximum threshold, (C) the Inverter System is in Reserve Shutdown, (D) when the Inverter System has a Planned or Unplanned Derating, (E) the PV System was not allowed to convert the full gross DC output to energy to deliver to the BESS and/or POI, due to Company Dispatch being less than the PV System potential at the measured irradiance and the BESS reaching its maximum State of Charge, (F) there is an Inverter System Outage, (G) the BESS is discharging, or (H) there is Force Majeure effecting the PV System. The aforementioned 15-minute intervals are fixed intervals that commence, in sequence, at the top of each hour and at 15, 30 and 45 minutes past the hour. At the end of each month, Subscriber Organization shall provide Company a report that lists all hours when such excluded data points occur (from the Facility's SCADA system as necessary) to validate the exclusion of any data points from the calculation set forth in Section 2. A., above. This information shall be validated on a monthly basis.

The effect of Force Majeure is taken into account in calculating the MPR for the MPR Assessment Period as follows: When an MPR Assessment Period contains any hours in a month during which the PV System or a portion of the PV System is unavailable due to Force Majeure, then such month shall be excluded from the MPR Assessment Period and the MPR Assessment Period shall be retroactively extended to include the next previous month during which there was no such unavailability of the PV System or a portion thereof due to Force Majeure. This means the MPR would not change from that determined in the month directly preceding a month containing Force Majeure.

B. MPR Test. In the event that the set of operational data points under Section 2.A that is available for any month to calculate the MPR cannot be validated to Company's reasonable satisfaction or in the event there were not at least 16 such data points during such month that could be used to calculate the MPR, the Company shall have the right to perform a test ("MPR Test") to collect the data points for such month to be used to calculate the MPR in lieu of the use of operational data for such month. The Company shall retain sole discretion as to when to conduct the MPR Test and the MPR Test may be conducted at any point during the month following the month for which Company was either unable to validate the set of operational data points for such month or there were not at least 16 data points available during such month, provided that Company will provide Subscriber Organization three (3) Business Days' notice prior to conducting the MPR Test. The MPR Test shall have a minimum duration of four (4) hours and shall run until at least 16 data points are collected that meet the criteria set forth in Section 2.A, subject to the limitation set forth in the last sentence of this Section 2 B. To the extent possible, the Company shall schedule the MPR Test for a period where the Inverter System and BESS are fully available and weather conditions are expected to be optimum allowing the PV System to generate at full capacity for the duration of the MPR Test (if possible). However, if Company chooses a period where some of the Facility inverter(s) are unavailable, P_{DCSTC} shall be adjusted to account for any reduction in capability to accept energy from the PV System due to the unavailable inverter(s).

1. For each MPR Assessment Period that includes one or more months for which a MPR Test was performed, the data points collected during said MPR Test for such month(s) shall be used together with the data points for months for which an MPR Test was not conducted to calculate the MPR for the MPR Assessment Period in question using the formula set forth in Section 2.A. above. The result of the calculation based on the MPR Test shall be the MPR for the MPR Assessment Period in question.

EXAMPLE: The following is an example of a Measured Performance Ratio calculation and is included for illustrative purposes only. Assume the following:

- Facility with 120,000 panels with a standard test condition rating of 300 W
- $P_{DCSTC} = 120,000 \times 300 \text{ W} = 36 \text{ MW}$
- For illustrative purposes only, 4 hours of data which met the criteria specified in Section 2. A. have been recorded over the MPR Assessment Period. It should be noted that all available operational data that meets the criteria specified in Section 2.A. 1. shall be included in the actual calculation:

Time Period	Average Measured Plane of Array Irradiance (W/m ²)	Average Measured Active Power at POI (MW)	Average Measured DC Power at BESS Charging Input (MW)	Average Measured Ambient Temperature (°C)	10 Meter Elevation Average Measured Wind Speed (m/s)
	690	16	0	27	3
	850	2	21	26	8

	750	19	1	29	7

$$MPR_{corr} = \frac{\sum_i P_{AC_i} + \sum_i P_{DC_i}}{\sum_i \left[P_{DCSTC} \left(\frac{G_{PO_i}}{G_{STC}} \right) \left(1 - \frac{\delta}{100} (T_{cell_typ_avg} - T_{cell_i}) \right) \right]}$$

where:

$$T_{cell_i} = G_{POA_i} \times e^{(a+b \times WS_i)} + T_{a_i} + \left(\frac{G_{POA_i}}{G_{STC}} \times dT_{cond} \right)$$

Assuming:

The temperature coefficient (δ) of the installed modules is -0.4%/°C

The average irradiance-weighted cell temperature ($T_{cell_typ_avg}$) has been calculated as 28°C

The installed modules are a glass/cell/polymer sheet module type using an open rack mount. ($a = -3.56$; $b = -0.0750$; $dT_{cond} = 3$)

$$\sum_i P_{AC_i} = 16 \text{ MW} + 11 \text{ MW} + \dots + 19 \text{ MW} = \mathbf{255 \text{ MW}}$$

$$\sum_i P_{DC_i} = 0 \text{ MW} + 22 \text{ MW} + \dots + 10 \text{ MW} = \mathbf{50 \text{ MW}}$$

$$\begin{aligned} \sum_i \left[P_{DCSTC} \left(\frac{G_{POA_i}}{G_{STC}} \right) \left(1 - \frac{\delta}{100} (T_{cell_type_avg} - T_{cell_i}) \right) \right] &= 36 \text{ MW} \times [((690/1000) \times (1 - (0.4/100) \times (28 - ((690) \times e^{(-3.56 - 0.075 \times 3)} + 27) + ((690/1000) \times 3)))) + \\ &(850/1000) \times (1 - (0.4/100) \times (28 - ((850) \times e^{(-3.56 - 0.075 \times 8)} + 26) + ((850) \times 3)))] + \\ &\dots + \\ &((750/1000) \times (1 - (0.4/100) \times (28 - ((750) \times e^{(-3.56 - 0.075 \times 7)} + 29) + ((750) \times 3))))] \\ &= \mathbf{374.76 \text{ MW}} \end{aligned}$$

$$\text{MPR} = (255+50) \text{ MW} / 374.76 \text{ MW} = \mathbf{0.814}$$

8. **Attachment B, Section 3.D. (Lump Sum Pro-Rata Adjustments), Subsections D. 1. through D.4. are revised to read as follows:**

D. Lump Sum Pro-Rata Adjustments.

1. Under the Company's previous forms of as-available power purchase agreements for renewable energy, the independent power producer was compensated for the production and delivery of electrical energy and assumed the risk of non-payment for events such as Force Majeure that prevented such production and delivery. Although under the Contract most or all of Subscriber Organization's compensation will be in the form of a Lump Sum Payment rather than for the production and delivery of electrical energy, it is not the intent of the Parties that Subscriber Organization should be entitled to unrestricted compensation in circumstances in which an independent power producer would not have been able to earn compensation under the Company's prior form of power purchase agreements (i.e., if the Facility or any portion thereof is unable to produce and deliver electric energy). Although the liquidated damages that are payable if the Inverter System Equivalent Availability Factor fails to satisfy the Inverter System Equivalent Availability Factor Performance Metric address this issue in certain of the circumstances when the Inverter System or a portion thereof is unable to generate electric energy, the Inverter System Equivalent Availability Factor does not account for events of Force Majeure because months containing such events are excluded from the calculation under Attachment C Section 1.A. (Calculation of the Inverter System Equivalent Availability Factor) of the Contract. Furthermore, in the case of the PV System, the liquidated damages that are payable if the MPR fails to satisfy the GPR Performance Metric addresses this issue in certain of the circumstances when the PV System or a portion thereof is unable to generate electric energy while inverters are available, the MPR does not account for events of Force Majeure because periods containing such events are excluded from the calculation under Section 2.A. (Calculation of Measured Performance Ratio) of the Contract. Similarly, in the case of the BESS, although the liquidated damages that are payable if the BESS Annual Equivalent Availability Factor fails to satisfy the BESS EAF Performance Metric addresses this issue in certain of the circumstances when the BESS or a portion thereof is unavailable to respond to Company Dispatch, the BESS Annual Equivalent Availability Factor does not account for events of Force Majeure because months containing such events are excluded from the calculation under Attachment H Section 2 (BESS Annual Equivalent Availability Factor) of the Contract.
2. Accordingly, and without limitation to the generality of the foregoing provisions of Section 3 (Calculation of Lump Sum Payment) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), the monthly Lump Sum Payment shall be adjusted downward pro rata for each hour or portion thereof during the calendar month in question that the Facility or a portion thereof was not available to generate energy or respond to Company Dispatch because of a Force Majeure condition (i) affecting the Facility or any portion thereof or (ii) that otherwise delays or prevents the Subscriber Organization from making the Facility or a portion thereof generate energy and make it available for Company Dispatch.
3. In the case of a BESS Force Majeure, such downward adjustment in the Lump Sum Payment shall be limited to the BESS Allocated Portion of the Lump Sum Payment. Further, during any periods in which there is a Force Majeure affecting both (i) the PV System or Inverter System, and (ii) the BESS, the Lump Sum Payment shall only be adjusted for the effect of the Force Majeure on the PV System or Inverter System.
4. The hours the Facility is affected by a Force Majeure are converted to equivalent full outage hours by multiplying the actual duration of the event (hours) by (i) the size of the reduction in MWs or number of devices, divided by (ii) the Contract Capacity if the size of the reduction is in MWs or the total number of devices in the affected system if the size of the reduction is a device count. These equivalent hour(s) are then summed. The summation of equivalent full outage hours is then divided by the months total period hours (number of days in the month x

24hrs/day) to determine the pro-rated factor the Lump Sum Payment will be adjusted by. To avoid any concern of double counting in this calculation any concurrent Force Majeure affecting both the PV System and Inverter System will only consider the more significantly affected system in this calculation; if the affect is equal the equivalent full outage hours from just one of the systems will be included in the calculation. For all non-concurrent Force Majeure, the equivalent full outage hours of the non-concurrent event shall be included in the summation of equivalent full outage hours for calculating the pro-rated effect on the Lump Sum Payment.

Example 1: if a Facility has ten inverter(s) and, during the month of May (which has 31 calendar days or 744 calendar hours), one inverter is not available to respond to Company Dispatch for a period of 360 hours due to a Force Majeure condition as aforesaid, the monetary amount of the resulting downward adjustment to the monthly Lump Sum Payment for the month of May would be calculated as follows:

- Monetary Amount of Downward Adjustment = $(MLSP \times 1/10) \times 360/744$

Example 2: if a Facility has ten inverter(s) and 10 MW of PV panels, and during the month of May (which has 744 period hours) an event or events of Force Majeure cause one inverter to not be available to respond to Company Dispatch for a period of 360 hours, and 2 MW of PV panels to be unavailable for 120 hours, 60 hours of which occurred concurrently with the Inverter System as aforesaid, the monetary amount of the resulting downward adjustment to the monthly Lump Sum Payment for the month of May would be calculated as follows:

First, determine what adjustment factor to use during the concurrent Force Majeure:

PV System Concurrent FM factor = $2/10$

Inverter System Concurrent FM factor = $1/10$

Since the PV System Concurrent FM Factor is greater than the Inverter System Concurrent FM Factor it is used during the concurrent FM time:

- Monetary Amount of Downward Adjustment = $MLSP \frac{(1/10 \times (360 -)) + (2/10 \times (120 -)) + (2/10 \times 60)}{31 \times 24}$

where:

MLSP = The monthly Lump Sum Payment that would be payable for such month but for the downward adjustment.

Example 3: if a Facility has forty BESS modules and, during the month of June (which has 720 period hours), one BESS module is not available to respond to Company Dispatch for a period of 240 hours due to a Force Majeure condition as aforesaid, the monetary amount of the resulting downward adjustment to the monthly Lump Sum Payment for the month of June would be calculated as follows:

- Monetary Amount of Downward Adjustment = $(BLSP \times 1/40) \times 240/720$

where:

BLSP = The BESS Allocated Portion of the Lump Sum Payment that would be payable for such month but for the downward adjustment.

For purposes of determining the monetary amount of the foregoing downward adjustment, the product obtained by multiplying a monetary value by a fraction shall be rounded to the nearest cent.

9. **ATTACHMENT E (Monthly Reporting and Dispute Resolution By Independent AF Evaluator) SECTION 1. is revised to read as follows:**

1. **MONTHLY REPORT.** Commencing with the month during which the Commercial Operations Date is achieved, and for each calendar month thereafter during the Term, Subscriber Organization shall provide to Company a Monthly Report in Excel, Lotus or such other format as Company may require, which Monthly Report shall include (i) the data for the calendar month in question populated into the form of "Monthly Report" below, (ii) the data for the BESS Measurement Period ending with the calendar month in question populated into the form of "BESS Measurement Period Report" below, and (iii) Subscriber Organization's calculations of the performance metrics and any liquidated damages assessments for the LD Period ending with such calendar month as set forth below. Subscriber Organization shall deliver such Monthly Report to Company by the fifth (5th) Business Day following the close of the calendar month in question. Subscriber Organization shall deliver the Monthly Report electronically to the address provided by the Company. Company shall have the right to verify all data set forth in the Monthly Report by inspecting measurement instruments and reviewing Facility operating records. Upon Company's request, Subscriber Organization shall promptly provide to Company any additional data and supporting documentation necessary for Company to audit and verify any matters in the Monthly Report.

Inverter System & PV System Monthly Report

NAME OF IPP FACILITY: [Facility Name]

MONTHLY REPORT PERIOD: [Month Day, Year] to [Month Day, Year]

Enter the information for each Force Majeure event effecting the Inverter System and/or the PV System during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of devices for item (D), total number of devices is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of effect in MW or Number of devices system that are offline (D)	Contract Capacity or Total number of devices in the effected system (E)	Equivalent Hours (hrs) (C x D)/E
...					

Calendar hours in the reporting period: _____

Total equivalent hours for the reporting period (from above, with proper accounting for any simultaneous events): _____

Please provide the following availability information even in months containing

Force Majeure even though it will not be applied in the Inverter System EAF Calculation.

Enter the information for each Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 2 decimal places.

Date/Time Start (A)	Date/Time End (B)	Duration(hrs) (B-A)
...		

Calendar hours in the reporting period: _____

Total Outage hours for the reporting period (from above): _____

Available Hours (AH) in the reporting period: _____

AH from the last eleven (11) reporting periods: _____

AH for the last twelve (12) reporting periods: _____

Enter the information for each Subscriber Organization Attributable Derating events during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of inverters for item (D), total number of inverters is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of derating in MWs or Number of Inverters (D)	Contract Capacity or Total number of Inverters in the Inverter system (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total Equivalent Subscriber Organization Attributable Derated hours (ESADH) for the reporting period: _____

ESADH from the last eleven (11) reporting periods: _____

ESADH for the last twelve (12) reporting periods: _____

Enter the information for each Planned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When

using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of inverters for item (D), total number of inverters is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of derating in MWs or Number of Inverters (D)	Contract Capacity or Total number of Inverters in the Inverter system (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total equivalent planned derated hours (EPDH) for the reporting period: _____

EPDH from the last eleven (11) reporting periods: _____

EPDH for the last twelve (12) reporting periods: _____

Enter the information for each Unplanned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration and equivalent hours should be rounded to 2 decimal places. When using MWs for item (D) below, Contract Capacity is to be provided for (E); and when using number of inverters for item (D), total number of inverters is to be provided for (E).

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of derating in MWs or Number of Inverters (D)	Contract Capacity or Total number of Inverters in the Inverter system (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total equivalent unplanned derated hours (EUDH) for the reporting period: _____

EUDH for the last eleven (11) reporting periods: _____

EUDH for the last twelve (12) reporting periods: _____

Period Hours (PH) is : _____ (8760 hours if no 29th day in February in the last twelve months; otherwise 8784 hours; also, can be adjusted appropriately depending on any month(s) containing Force Majeure in the last 12 reporting periods))

Enter the Available Hours, ESADH, EPDH, and EUDH for the last twelve (12) reporting periods as calculated above.

AH (A)	ESADH (B)	EPDH (C)	EUDH (D)	verter System Annual Equivalent Availability Factor 100% x (A – B – C - D)/PH

If the month for which this monthly report has been prepared contains a Force Majeure event please indicate the Inverter System Annual Equivalent Availability Factor calculated in the previous month's monthly report.

Enter the following properties for the facility's PV panels that are used in the calculation of the Measured Performance Ratio. Refer to Attachment C (Required Performance Metrics; Liquidated Damages) for the definitions of terms.

- DC rated capacity of the system at standard test conditions ($P_{DC_{STC}}$): _____
- Temperature coefficient of power in %/°C(δ): _____
- Temperature empirical constant (a): _____
- Wind speed empirical constant (b): _____
- Conduction temperature coefficient (dT_{cond}): _____
- Annual average irradiance-weighted cell temperature ($T_{cell_typ_avg}$) _____

For the reporting period, provide 15-minute interval averaged site data for the following measurements in .csv format (refer to Attachment C (Required Performance Metrics; Liquidated Damages) for the definitions of terms). The data set should include an indication of whether each interval is included or excluded in the calculation of the Measured Performance Ratio and the reason for exclusion (refer to article 2.6 for data requirements).

Measured data:

- P_{AC_i} is the active power output of the PV System measured at the POI averaged over time period i (MW)
- P_{DC_i} is the measured DC power output of the PV System measured at the DC input to the BESS charging system averaged over time period i (MW)
- G_{POA_i} is the measured plane of array irradiance averaged over time period i (W/m^2);
- T_{a_i} = the measured ambient temperature averaged over time period i [°C]
- WS_i = the measured wind speed corrected to a measurement height of 10 meters (using the anemometer height and proper Hellmann coefficient) averaged over time period i [m/s]

Calculated data:

- Computed cell temperature (T_{cell_i})

Using the data provided above, enter the calculated values for Measured Performance Ratio rounded to the third decimal place (0.001).

Measured Performance Ratio for the reporting period: _____

Measured Performance Ratio for this reporting period and the previous eleven (11) reporting periods: _____

Enter the Applicable Contract Year and calculated Degradation Factor for the reporting period. Refer to Contract Attachment C, Section 2.C. for how these should be calculated.

Applicable Contract Year: _____

Degradation Factor: _____

BESS Measurement Period Report
NAME OF IPP FACILITY: [Facility Name]
BESS MEASUREMENT PERIOD: [Month Day, Year] to [Month Day, Year]

Enter the applicable information to demonstrate satisfaction of the BESS Capacity Performance Metric during the reporting period. This can be from either the most recent BESS Capacity Test performed during the period or taken from operational data reflecting the net output of the BESS.

Date/Time Start	Date/Time End	Total MWh delivered to the POI (A)	BESS Contract Capacity (MWh) (B)	BESS Capacity Ratio 100% x (A/B)

Enter the applicable information to demonstrate satisfaction of the BESS RTE Performance Metric during the reporting period. This can either be from the most recent BESS RTE Test performed during the period or taken from operational data reflecting the charging/discharging of the BESS.

Date/Time Start	Date/Time End	Total MWh delivered to the POI (A)	Charging Energy (MWh) (B)	BESS RTE Ratio 100% x (A/B)

Enter the information for each Force Majeure event effecting the BESS during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E
...					

Calendar hours in the reporting period: _____

Total equivalent hours for the reporting period (from above, with proper accounting for any simultaneous events): _____

Please provide the following BESS availability information even in months containing Force Majeure even though it will not be applied in the Inverter System EAF Calculation.

Enter the information for each BESS Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (B-A)
...		

Calendar hours in the reporting period: _____

Total Outage hours for the reporting period (from above): _____

Available Hours (AH) in the reporting period: _____

AH from the last three (3) reporting periods: _____

AH for the last four (4) reporting periods: _____

Enter the information for each BESS Planned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

(A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E
..					

Total equivalent planned derated hours (EPDH) for the reporting period: _____

EPDH from the last three (3) reporting periods: _____

EPDH for the last four (4) reporting periods: _____

Enter the information for each BESS Unplanned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E
...					

Total equivalent unplanned derated hours (EUDH) for the reporting period: _____

EUDH for the last three (3) reporting periods: _____

EUDH for the last four (4) reporting periods: _____

Period Hours (PH) is : _____ (8760 hours if no 29th day in February in that last twelve months; otherwise 8784 hours; also can be adjusted appropriately depending on any month(s) containing Force Majeure in the last 12 reporting periods)

Enter the Available Hours, EPDH, EUDH, and Period Hours for the last four (4) reporting periods as calculated above.

AH (A)	EPDH (B)	EUDH (C)	BESS Annual Equivalent Availability Factor 100% x (A - B - C)/PH

Enter the information for each Unplanned (Forced) Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (B-A)
...		

Total Forced Outage Hours (FOH) for the reporting period (from above): _____

FOH from the last three (3) reporting periods: _____

FOH for the last four (4) reporting periods: _____

Enter the FOH and EUDH for the last four (4) reporting periods as calculated above.

FOH (A)	EUDH (B)	BESS Annual Equivalent Forced Outage Factor 100% x (A + B)/8760

If the BESS Measurement Period for which this report has been prepared contains a month with a BESS Force Majeure event, please indicate the proper 12-month period used to calculate the BESS Annual Equivalent Availability Factor for this report.

9. **Attachment H Section 1. (BESS Tests).** This **Section 1.** is revised to read as set forth in **Attachment H** hereto.
10. **Attachment H Section 2. (BESS Annual Equivalent Forced Outage Factor .** This **Section 2.** is revised to read as set forth in **Attachment H** hereto.

ATTACHMENT H

BESS REQUIREMENTS

SECTION 1. BESS TESTS

Prior to achieving Commercial Operations, and in each BESS Measurement Period, unless waived by Company, Subscriber Organization shall demonstrate that the BESS satisfies the (1) BESS Capacity Performance Metric, and (2) the RTE Performance Metric, each as defined and further described below.

A. BESS Capacity Performance Metric

- The BESS Capacity Performance Metric reflecting the net output of the BESS from the Point of Interconnection can be demonstrated either through (i) operational data or (ii) a scheduled formal BESS Capacity Test.
- The "BESS Capacity Performance Metric" shall be deemed to be satisfied where the BESS Capacity Ratio is not less than **100%** for an applicable BESS Measurement Period. The "BESS Capacity Ratio" shall be the number, expressed as a percentage, equal to the total "Discharge Energy" (MWh discharge) delivered to the Point of Interconnection to bring the BESS from (i) its maximum State of Charge or (ii) 100% State of Charge to a 0% State of Charge, divided by the BESS Contract Capacity.
- A "BESS Capacity Test" is when the Company coordinates Company Dispatch to demonstrate the BESS maintains the power output required to follow the dispatch signal provided by the Company through a control setpoint, as measured at the Point of Interconnection, and is able to continuously

- discharge energy to the Point of Interconnection according to Company Dispatch to bring the BESS from (i) its maximum State of Charge or (ii) 100% State of Charge to a 0% State of Charge.
- The BESS Capacity Test can only be performed when the BESS is at the lower of: (i) its maximum State of Charge or (ii) 100% State of Charge prior to the start of the BESS Capacity Test and during the BESS Capacity Test, Company Dispatch allows for continuous discharge of the BESS to 0% State of Charge with energy delivered to the Point of Interconnection.

B. RTE Performance Metric.

- The "RTE Performance Metric" is set forth in Section 6.A. (RTE Test and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to the Contract. The RTE Performance Metric reflecting the charging/discharging of the BESS can be demonstrated either through (i) operational data or (ii) a scheduled formal RTE Test.
- Demonstration of the RTE Performance Metric requires measurement of "Charging Energy" (MWh charge) at the BESS charging input to bring the BESS from a 0% State of Charge to a 100% State of Charge from the PV System or grid according to Company Dispatch, followed by measurement at the Point of Interconnection of the "Discharge Energy" (MWh discharge) delivered to the grid to bring the BESS to a 0% State of Charge according to Company Dispatch. The exact point of measurement for Charging Energy will be mutually agreed to by the Parties on the Facility's single-line diagram attached to the Contract as Attachment F, Exhibit F- 5 (Single-Line Drawing and Interface Block Diagram). For the purposes of evaluating satisfaction of the RTE Performance Metric, the "RTE Ratio" shall be the number, expressed as a percentage, equal to the total Discharge Energy delivered to the Point of Interconnection during the BESS Capacity Test, divided by the Charging Energy measured at the BESS charging input.
- The formula for the RTE Ratio is as follows: $RTE\ Ratio = 100\% \times (MWh\ discharge) / (MWh\ charge)$
- The RTE Performance Metric will be deemed to have been "passed" or "satisfied" to the extent the RTE Ratio is not less than the RTE Performance Metric set forth in Section 6.A. (RTE Test and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to the Contract.
- An "RTE Test" is when the Company coordinates Company Dispatch to demonstrate the charging/discharging requisite to satisfy the RTE Performance Metric.
- The RTE Test may be conducted concurrently with a BESS Capacity Test.
- For purposes of the RTE Test, the charging cycle shall begin when the BESS is at a 0% State of Charge prior to a (i) 100% discharge cycle or (ii) BESS Capacity Test if being conducted concurrently and the Charging Energy is the amount of energy, as measured at the BESS DC charging input, that brings the BESS to a 100% State of Charge.

C. BESS Test Procedures

- After Commercial Operations, Subscriber Organization shall demonstrate satisfaction of the BESS Capacity Performance Metric by reference to the operational data reflecting the net output of the BESS from the Point of Interconnection, or by conducting a scheduled formal BESS Capacity Test during such BESS Measurement Period. Once Subscriber Organization demonstrates satisfaction of the BESS Capacity Performance Metric through either operational data or a scheduled formal BESS Capacity Test (100% discharge cycle), the BESS shall be deemed to have met the BESS Capacity Performance Metric and satisfied ("passed") the BESS Capacity Test for the applicable BESS Measurement Period.

- After Commercial Operations, Subscriber Organization shall demonstrate satisfaction of the RTE Performance Metric by reference to the operational data reflecting the charging/discharging of the BESS, or by conducting a scheduled formal RTE Test during such BESS Measurement Period. Once Subscriber Organization demonstrates satisfaction of the RTE Performance Metric through either operational data or a scheduled formal RTE Test (100% charge/discharge cycle), the BESS shall be deemed to have met the RTE Performance Metric and satisfied ("passed") the RTE Test for the applicable BESS Measurement Period.
- Any BESS Capacity Test or RTE Test (each a "BESS Test" and collectively, the "BESS Tests") scheduled in lieu of being demonstrated by reference to operational data shall be performed at a time reasonably requested by Company in its sole discretion.
- Subscriber Organization shall be permitted up to a total of three (3) BESS Tests (100% discharge cycles) within a BESS Measurement Period to demonstrate satisfaction of the BESS Capacity Performance Metric and the RTE Performance Metric for such BESS Measurement Period, unless additional such tests are authorized by Company. If upon completion of the first BESS Test, Subscriber Organization does not "pass" either the BESS Capacity Test or the RTE Test, Company shall attempt to notice up to two (2) additional BESS Tests within a BESS Measurement Period, for Subscriber Organization to further demonstrate its performance. If a scheduled formal BESS Test is requested by Subscriber Organization, Company shall attempt to schedule a formal BESS Test and Company shall provide notice to Subscriber Organization no less than three (3) Business Days prior to conducting such scheduled formal BESS Test.
- If, during a BESS Measurement Period, Subscriber Organization fails to pass a BESS Capacity Test, the BESS shall nevertheless be deemed to have satisfied the BESS Capacity Performance Metric for the applicable BESS Measurement Period if (i) Company failed to notice up to three BESS Capacity Tests in order for Subscriber Organization to further demonstrate the BESS' performance during such BESS Measurement Period, or (ii) Subscriber Organization was unable to perform at least two (2) such noticed BESS Capacity Tests during such BESS Measurement Period due to (a) conditions on the Company System other than Subscriber Organization-Attributable Non-Generation or (b) an act or omission by Company. If Subscriber Organization-Attributable Non-Generation is cause for the inability to demonstrate the BESS Capacity Performance Metric, the BESS Capacity Ratio used to assess LDs shall be the highest demonstrated in operational data or the most recently completed test during the applicable BESS Measurement Period.
- If, during a BESS Measurement Period, Subscriber Organization does not demonstrate satisfaction of the BESS Capacity Performance Metric through operational data or a BESS Capacity Test, assessment of Liquidated Damages will be based on the last of the BESS Capacity Tests performed.
- If, during a BESS Measurement Period, Subscriber Organization fails to pass an RTE Test, the BESS shall nevertheless be deemed to have satisfied the RTE Performance Metric for the applicable BESS Measurement Period if (i) Company failed to notice up to three RTE Tests in order for Subscriber Organization to further demonstrate the BESS' performance during such BESS Measurement Period, or (ii) Subscriber Organization was unable to perform at least two (2) such noticed RTE Tests during such BESS Measurement Period due to (a) conditions on the Company System other than Subscriber Organization-Attributable Non-Generation or (b) an act or omission by Company. If Subscriber Organization-Attributable Non-Generation is cause for not adequately demonstrating the RTE Performance Metric, the RTE Ratio used to assess LDs shall be the highest demonstrated in operational data or the most recently completed test during the applicable BESS Measurement Period.
- If, during a BESS Measurement Period, Subscriber Organization does not demonstrate satisfaction of the RTE Performance Metric through operational data or RTE Tests, assessment of Liquidated Damages will be based on the last of the RTE Tests performed.

- Company will conduct any necessary BESS Test(s) through Company Dispatch. Company shall have the right to attend, observe and receive the results of all BESS Tests. Subscriber Organization shall provide to Company the results of each BESS Test (including time stamped graphs of system performance based in operational data or test data) no later than ten (10) Business Days after any BESS Test.

SECTION 2 – BESS ANNUAL EQUIVALENT AVAILABILITY FACTOR

A. To the extent the Commercial Operations Date occurs on a date other than the first day of a BESS Measurement Period, the period between the Commercial Operations Date and the first day of the next BESS Measurement Period if any, shall be ignored for purposes of this BESS Availability Factor.

B. For the purposes of calculating the BESS Annual Equivalent Availability Factor for the first three (3) full BESS Measurement Periods in the first Contract Year, the calculation will assume that the BESS is one hundred percent (100%) available for the remaining hours of the Contract Year. If an Inverter System Outage or Derating exists as set forth in Attachment C (Required Performance Metrics; Liquidated Damages) Section 1.A. (Calculation of the Inverter System Equivalent Availability Factor) of the Contract, those hours will be excluded in the BESS Annual Equivalent Availability Factor, except Inverter System Outages or Deratings that effect BESS availability but which occur during Inverter System Reserve Shutdown Hours as set forth in this Attachment H (Bess Annual Equivalent Availability Factor).

C. "BESS Annual Equivalent Availability Factor" shall be calculated as follows:

$$\text{BESS Annual Equivalent Availability Factor} = 100\% \times \frac{AH-EPDH-EUDH}{PH}$$

Where:

PH is period hours (8760 hours; except leap year is 8784).

Available Hours (AH) is the number of hours that the BESS is not on Outage. It is sum of all Service Hours (SH) + Reserve Shutdown Hours (RSH).

A "BESS Outage" exists whenever the entire BESS is offline and unable to charge or discharge electric energy and is not in Reserve Shutdown state.

If the Inverter System is in Reserve Shutdown but would have otherwise been on Outage the Inverter System Outage is counted as a BESS Outage during that period due to its effect on the BESS Availability.

Service Hours (SH) is the number of hours during the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods the BESS is online and (i) charging from the PV System or Company System, or (ii) discharging electric energy to the Company System.

Reserve Shutdown Hours (RSH) is the number of hours during the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods the BESS is available but not charging or discharging electric energy or is offline at the Company's request for reasons other than Subscriber Organization-Attributable Non-Generation or there is an Inverter System Outage or Derating as set forth in Attachment C (Required Performance Metrics; Liquidated Damages), Section 1.A. (Calculation of Inverter System Equivalent Availability Factor).

A "BESS Derating" exists when the BESS is available but at less than Maximum Rated Output. For the avoidance of doubt, if there is a BESS Outage occurring there cannot also be a BESS Derating. If the Inverter System is in Reserve Shutdown but would have otherwise had a derating the Inverter System Derating is counted as a BESS Derating during that period due to its effect on the BESS availability.

EPDH is the equivalent planned derated hours, including Planned Deratings (PD) and Maintenance Deratings (D4). A Planned Derating is when the BESS experiences a derating scheduled well in advance and for a predetermined duration. A Maintenance Derating is a derating that can be deferred beyond the end of the next weekend (Sunday at midnight or before Sunday turns into Monday) but requires a reduction in capacity before the next Planned Derating (PD). Each individual derating is transformed into equivalent full outage hour(s) by multiplying the actual duration of the derating (hours) by (i) the size of the reduction (MW) divided by (ii) Maximum Rated Output. These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods. If the Inverter System is experiencing a Planned Derating as set forth in Attachment C (Required Performance Metrics; Liquidated Damages), Section 1.A. (Calculation of Inverter System Equivalent Availability Factor) any BESS Planned Derating during the Inverter System Planned Derating is excluded from the BESS EPDH calculation.

EUDH is the equivalent unplanned derated hours. An Unplanned Derating (Forced Derating) occurs when the BESS experiences a derating that requires a reduction in availability before the end of the nearest following weekend. Unplanned Deratings include those due to Subscriber Organization-Attributable Non-Generation effecting BESS availability, but which occur during Inverter System Reserve Shutdown Hours. Each individual Unplanned Derating is transformed into equivalent full outage hour(s) by multiplying the actual duration of the derating (hours) by (i) the size of the reduction (MW) divided by (ii) the Maximum Rated Output. These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods. If the Inverter System is experiencing an Unplanned Derating as set forth in Attachment C (Required Performance Metrics; Liquidated Damages), Section 1.A. (Calculation of Inverter System Equivalent Availability Factor) any BESS Unplanned Derating during the Inverter System Unplanned Derating is excluded from the BESS EUDH calculation.

The effect of Force Majeure is taken into account in calculating the BESS Annual Equivalent Availability Factor over a 12 calendar month period as follows: When such 12 month period contains any hours in a month during which the BESS or a portion of the BESS is unavailable due to Force Majeure, then such month shall be excluded from the 12 month period and the calculation period shall be extended back in time to include the data used to calculate the BESS EAF from the next previous month during which there was no such unavailability of the BESS or a portion thereof due to Force Majeure. This means the BESS Annual Equivalent Availability Factor would not change from that determined in the month directly preceding a month containing Force Majeure.

The following examples are provided as illustrative examples only:

Example A: The BESS was continuously available, with no Planned or Unplanned (Forced) Deratings during the applicable BESS Measurement Period and in the immediately preceding three (3) full BESS Measurement Periods. In this case AH = 8760, EPDH and EUDH = 0 hours

$$\text{BESS EAF} = 100\% \times \frac{8,760-0}{8,760} = 100\%$$

Example B: During the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods. The BESS was online and charging from the PV System or discharging electric energy to the Company System for 8,400 hours and was available but not discharging electric energy due to lack of stored energy (i.e., not Subscriber Organization-Attributable Non-Generation) for 226 hours. The BESS experienced a Planned Derating of 7.2 MWs for 100 hours for maintenance that was scheduled a month in advance. The BESS also experienced an Unplanned Derating of 6.2 MWs for 100 hours as the derating could not be deferred to beyond the nearest following weekend. The Inverter System experienced a 4 MW Unplanned Derating for 35 hours not during RSH (i.e., an Inverter System Derating, as set forth in Section 1.A. of Attachment C (Required Performance Metrics; Liquidated Damages) to the Contract. The BESS Maximum Rated Output is 10 MW.

$$\text{Inverter System Derating} = (35 \text{ hours} \times 4\text{MW}/10\text{MW}) = 14 \text{ hours}$$

$$\text{PH} = 8,760 \text{ hours in 12 calendar months}$$

$$\text{SH} = 8,400 \text{ hours}$$

$$\text{RSH} = 226 \text{ hours} + 14 \text{ hours}$$

$$\text{AH} = \text{SH} + \text{RSH} = 8,400 \text{ hours} + 226 \text{ hours} = 8,640 \text{ hours}$$

$$\text{EPDH} = 100 \text{ hours} \times 7.2\text{MW}/10\text{MW} = 72 \text{ hours}$$

$$\text{EUDH} = 100 \text{ hours} \times 6.2\text{MW}/10\text{MW} = 62 \text{ hours (Unplanned Derating (Forced Derating))}$$

$$\text{BESS EAF} = 100\% \times \frac{8,640 - 72 - 62}{8,760} = 97.1\%$$

EXHIBIT 20

Redline of Draft Mid-Tier SFC for RDG (Wind+BESS)
for Maui and Hawaii Island



**Maui
Electric**



**Hawai'i
Electric
Light**

MID-TIER STANDARD FORM CONTRACT

for

Renewable Dispatchable Generation

(Wind + BESS)

October-9December 1, 2020 Version

(Maui and Hawaii Islands)

This contract assumes that the proposed generation facility will be paired with a battery energy storage system ("BESS"), and therefore contains terms and conditions with respect to the BESS. If a generation only proposal is selected for the CBRE Mid-Tier Project RFP's final award group, the BESS specific provisions will be removed from this Contract for such project proposal.

Attachment A	Schedule Of Defined Terms
Attachment B	Company Payments for Energy, Dispatchability and Availability of BESS
Attachment C	Required Performance Metrics; Liquidated Damages
Attachment D	Calculation and Adjustment of Net Energy Potential
Attachment E	Monthly Reporting and Dispute Resolution by Independent AF Evaluator
Attachment F	Facility Owned by Subscriber Organization
Exhibit F-1	Description of Generation and Battery Storage Facilities
Exhibit F-2	Consultants List
Exhibit F-3	Modeling Requirements
Exhibit F-4	Generator and Energy Storage Capability Curve(s)
Exhibit F-5	Single-Line Drawing and Interface Block Diagram
Exhibit F-6	Relay List and Trip Scheme
Exhibit F-7	Control System Acceptance Test Criteria
Exhibit F-8	Acceptance Test General Criteria
Attachment G	Company-Owned Interconnection Facilities
Exhibit G-1	Form of Letter of Credit
Attachment H	BESS Requirements
Section 1	BESS Test
Section 2	BESS Annual Equivalent Availability Factor
Section 3	BESS Annual Equivalent Forced Outage Factor
Attachment I	Facility's CBRE Program
Attachment J	Calculation of Certain Metrics

**MID-TIER STANDARD FORM CONTRACT
FOR
RENEWABLE DISPATCHABLE GENERATION**

THIS MID-TIER STANDARD FORM CONTRACT FOR RENEWABLE DISPATCHABLE GENERATION (“Contract”) is entered into as of _____, 20__ (the “Effective Date”), by [Maui Electric Company, Ltd., Hawai‘i Electric Light Company, Inc.], a Hawai‘i corporation (“Company”) and _____ (“Subscriber Organization”). Together, the Company and Subscriber Organization are the “Parties” and may singularly each be referred to as a “Party”.

RECITALS

WHEREAS, Company is an operating electric public utility engaged in the generation, transmission, distribution, storage, regulation, or physical control of electricity (“Company System”) on the Island of [Hawai‘i, Maui], subject to the Hawai‘i Public Utilities Law (Hawai‘i Revised Statutes, Chapter 269) and the rules and regulations of the Hawai‘i Public Utilities Commission (“PUC” or the “Commission”); and

WHEREAS, the Company System is operated as an independent power grid and must both maximize system reliability for its customers by ensuring that sufficient generation is available that meets the Company’s requirements for voltage stability, frequency stability, and reliability standards; and

WHEREAS, Company desires to minimize fluctuations in its purchased energy costs by acquiring renewable dispatchable generation at a fixed Unit Price; and

WHEREAS, Subscriber Organization understands the need to use all commercially reasonable efforts to maximize the overall reliability of the Company System; and

WHEREAS, Subscriber Organization is an approved “Subscriber Organization,” for Phase 2 the State of Hawai‘i Community-Based Renewable Energy (“CBRE”) Program, and desires ~~to~~ construct and operate a dispatchable generation renewable energy system (“CBRE Facility” or “Facility”) that is classified as an eligible resource under Hawai‘i’s Renewable Portfolio Standards Statute (codified as Hawai‘i Revised Statutes (“HRS”) 269-91 through 269-95) and qualifies for the CBRE Program together with a safe, reliable and operationally flexible battery energy storage system (“BESS”) so as to provide the Company System with those benefits and services associated with renewable energy generation and energy storage services, as defined herein; and

WHEREAS, this Contract applies to CBRE Facilities which provide at least 250 kW ~~but less than~~ up to and including 2.5 MW- of renewable dispatchable generation and is entered into in accordance with the terms and conditions contained herein, the CBRE Tariff and Tariff Rule 14, Paragraph H (Interconnection of Distributed Generating Facilities Operating in Parallel With The Company’s Electric System) (“Rule 14H”); and

WHEREAS, the Parties agree to allow Subscriber Organization to interconnect and operate the CBRE Facility in parallel with the Company System so long as all applicable requirements and conditions of this Contract, the CBRE Tariff and Rule 14H have been satisfied; and

WHEREAS, the renewable wind power energy system to be developed by the Subscriber Organization will be a planned wind turbine generating system with a nameplate capacity of _____ kilowatts of alternating current (AC) (“WTG System”); and

WHEREAS, the BESS to be installed by the Subscriber Organization will be an electrical energy battery storage system with a nameplate capacity in kilowatts of _____ and in kilowatt-hours [kWh] of _____; and

WHEREAS, the CBRE Facility will be installed and operated on property located at _____, Island of _____, State of Hawai'i and more fully described in Attachment F (Facility Owned by Subscriber Organization), Exhibit F-1 (Description of Generation and Battery Storage Facilities) to the Contract; and

WHEREAS, Subscriber Organization desires to sell to Company, and Company agrees to purchase, subject to the terms and conditions set forth herein, (i) the Actual Output produced by the Facility and delivered to the Point of Interconnection; (ii) the availability of the BESS; and (iii) the availability of the Facility's Net Energy Potential for Company Dispatch in accordance with this Contract;

NOW, THEREFORE, in consideration of the premises and the respective promises herein, Company and Subscriber Organization hereby agree as follows:

AGREEMENT

1. **DEFINITIONS.** Capitalized terms in this Contract shall have the meanings set forth in the Schedule of Defined Terms in Attachment A hereto.
2. **PARALLEL OPERATION.** Company agrees to allow Subscriber Organization to interconnect and operate the Facility to provide renewable dispatchable generation and energy in parallel with the Company System; provided, however, that such interconnection and operation shall not: (i) adversely affect Company's property or the operations of its customers and customers' property; (ii) present safety hazards to the Company System, Company's property or employees or Company's customers or the customers' property or employees; or (iii) otherwise fail to comply with this Contract. Such parallel operation shall be contingent upon the satisfactory completion, as determined solely by Company, of the Acceptance Test and, to the extent applicable, the Control System Acceptance Test, in accordance with Good Engineering and Operating Practices.
3. **TERM.**
 - A. The Term of this Contract shall begin when signed by the Parties and end twenty (20) years after the Commercial Operations Date unless otherwise provided for in this Contract.
 - B. This Contract shall continue in full force and effect as set forth above, until the earliest date that one of the following events occurs:
 1. The Parties agree in writing to terminate the Contract; or
 2. The Contract is declared null and void pursuant to the terms of Section 3.E (Contract Null and Void). Upon receipt of such notice, the Parties shall take reasonable steps to minimize additional costs to the other Party, where reasonably possible; or
 3. The Contract is terminated under Section 10.I.4 (Project Completion) if Subscriber Organization fails to interconnect and operate the CBRE Facility pursuant to the terms of this Contract; or
 4. The Contract is terminated pursuant to an Event of Default under the Contract.
 - C. Interconnection Requirements Study. If this Contract is executed prior to completion of the Interconnection Requirements Study, then following the completion of the IRS:
 1. The Parties shall, no later than the IRS Amendment Deadline, execute a formal amendment to this Contract substituting new versions of appropriate attachments to this Contract, including but not limited to, Attachment F (Facility Owned by Subscriber Organization) and Exhibits attached thereto, Attachment G (Company-Owned Interconnection Facilities) (the "IRS Amendment") solely to reflect the results of the IRS. If the IRS Amendment is not executed by the IRS Amendment Deadline, either Party may, by written notice delivered to the other Party, declare this Contract null and void.
 2. If Subscriber Organization is dissatisfied with the results of the IRS, Subscriber Organization shall have the option, by written notice delivered to Company no later than the IRS Termination Deadline, to declare the Contract null and void.
 - D. Prior to IRS Amendment Deadline. Company may, by written notice delivered prior to the IRS Amendment Deadline, declare the Contract null and void if any one or more of the following conditions applies:
 1. Subscriber Organization implements a material change to the Facility without following the requirements of Section 5(g) of Exhibit -F-1 (Description of Generation and Battery Storage Facilities).

2. Subscriber Organization, subsequent to making any payment to Company required under Attachment G (Company-Owned Interconnection Facilities), or subsequent to making the payment to Company to pay for the IRS under the IRS Amendment(s), requests in writing that Company stop or otherwise delay the performance of the work for which Company received such payment.
 3. The IRS Letter Agreement(s) is/are terminated pursuant to the terms thereof prior to the completion of the IRS.
- E. Contract Null and Void. If the Contract is declared null and void pursuant to Section 3.C (Interconnection Requirements Study), Section 3.D (Prior to IRS Amendment Deadline), or Section 1(d) (NEP IE Estimate, Liquidated Damages and Subscriber Organization's Null and Void Right) of said Attachment D (Calculation and Adjustment of Net Energy Potential) (the "Null and Void Rights"), the Parties hereto shall thereafter be free of all obligations hereunder except as set forth in this Section 3.E (Contract Null and Void) and Section 11.F.2 (Return of Development Period Security), and shall pursue no further remedies against one another. A declaration that this Contract is null and void pursuant to the Null and Void Rights, shall not affect the following provisions, which shall remain in full force and effect: this Section 3.E (Contract Null and Void), Section 8.F.2 (Confidentiality), Section 17 (Dispute Resolution), Section 26.A (Disconnection and Survival of Obligations), Section 26.L (Survival), and such provisions of Section 26 (Miscellaneous) which, by their terms, should survive termination of this Contract, and Section 7 (Land Restoration) of Attachment G (Company-Owned Interconnection Facilities).
- F. Termination Rights. Notwithstanding any of the foregoing, the right of Company to terminate the Contract at any time upon the occurrence of any Event of Default described in Section 13 (Events of Default) shall remain in full force and effect.
- 4. BILLING AND PAYMENT PROVISIONS.**
- A. Purchase and Sale of Renewable Energy, Dispatchability of CBRE Facility and Availability of the BESS.
1. Subject to the other provisions of this Contract, Company shall, through a combination of Bill Credits allocated among CBRE Facility Subscribers and payments to Subscriber Organization, pay for: (i) the Actual Output produced by the CBRE Facility and delivered to the Point of Interconnection in response to Company Dispatch of the CBRE Facility; (ii) the availability of the CBRE Facility's Net Energy Potential for Company Dispatch in accordance with this Contract; and (iii) the availability of the BESS. Included in such purchase are all of the Environmental Credits associated with the renewable energy. Company will not reimburse Subscriber Organization for any taxes or fees imposed on Subscriber Organization including, but not limited to, State of Hawai'i general excise tax. **[Drafting Note: For Contract with energy payment, use the following in lieu of the above:** Subject to the other provisions of this Contract: (i) Company shall, by an Energy Payment, pay for the Actual Output produced by the Facility and delivered to the Point of Interconnection in response to Company Dispatch of the Facility; and (ii) Company shall, by a Lump Sum Payment, pay for the availability of the Facility's Net Energy Potential and the availability of the BESS to respond to Company Dispatch in accordance with this Contract. Included in such purchase and sale of renewable energy and such purchase and sale of dispatchability are all of the Environmental Credits associated with the renewable energy. Company will not reimburse Subscriber Organization for any taxes or fees imposed on Subscriber Organization including, but not limited to, State of Hawai'i general excise tax.]
 2. Payment for Electric Energy. Commencing on the Commercial Operations Date, in exchange for the electric energy delivered to the Point of Interconnection in response to Company Dispatch, Company shall make an Energy Payment on a monthly basis as provided in Section 1 (Price for Purchase of Renewable Energy) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. **[Drafting Note: If there is no Energy Payment, replace this paragraph with [RESERVEDReserved]]**
- B. Lump Sum Payment. Commencing on the Commercial Operations Date, Company shall pay a monthly lump sum payment ("Lump Sum Payment"), to be apportioned between Subscribed and Unsubscribed RDG, as provided in Section 2. (Lump Sum Payment for Purchase of Dispatchability) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. As more fully set forth in Section 3. (Calculation of Lump Sum Payment) of Attachment B, the monthly Lump Sum Payment shall be calculated and adjusted to reflect changes in the estimate of the CBRE Facility's Net Energy Potential as such estimate is revised from time to time as more fully set forth in Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract. For purposes of calculating the monthly Lump Sum Payment, the

monthly Lump Sum Payment shall be adjusted downward to account for the time that all or any portion of the CBRE Facility is not available for Company Dispatch because of a Force Majeure condition (i) at the CBRE Facility, whether the WTG(s), the BESS, or both, or (ii) that otherwise delays or prevents the Subscriber Organization from making all or any portion of the CBRE Facility available for Company Dispatch, as more fully set forth in Section 3.D (Lump Sum Payment Pro-Rata Adjustments) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.

- C. Assurance of Capability of CBRE Facility to Deliver Net Energy Potential and Availability of BESS. In order to provide Company with reasonable assurance that, subject to the Renewable Resource Variability, the CBRE Facility's Net Energy Potential will be available for Company Dispatch: (i) the Modified Pooled OMC Equipment Availability Factor Performance Metric shall be used to evaluate the availability of the WTGs for dispatch by Company; (ii) the Guaranteed Performance Index ("GPI") Performance Metric shall be used to evaluate the efficiency of the WTGs; ~~and~~ (iii) the BESS Capacity Performance Metric shall be used to confirm the capability of the BESS to discharge continuously for four (4) hours at Maximum Rated Output or to discharge continuously for a total energy (MWh) equal to the BESS Contract Capacity if the test is conducted at less than Maximum Rated Output; (iv) the BESS EAF Performance Metric shall be used to determine whether the BESS is meeting its expected availability; (v) the BESS EFOF Performance Metric shall be used to evaluate whether the BESS is experiencing excessive unplanned outages; and (vi) the RTE Performance Metric shall be used to evaluate the storage efficiency of the BESS. Whenever the WTGs potential output is in excess of the Company Dispatch, the excess energy from the WTGs shall be used to maximize the BESS State of Charge so long as this does not conflict with the operating parameters of the BESS set forth in Section 9.(d) (Battery Energy Storage System) of Attachment F (Facility Owned by Subscriber Organization) to this Contract. Subscriber Organization shall design, operate and maintain the CBRE Facility in a manner consistent with the standard of care reasonably expected of an experienced owner/operator with the desire and financial resources necessary to design, operate and maintain the CBRE Facility to achieve the Performance Metrics. The foregoing is without limitation to Subscriber Organization's other obligations under this Contract, including the obligation to operate the CBRE Facility in accordance with Good Engineering and Operating Practices. The Performance Metrics are set forth in Attachment C (Required Performance Metrics; Liquidated Damages) of this Contract and shall be interpreted consistent with the North American Electric Reliability Corporation Generating Availability Data System ("NERC GADS") Data Reporting Instructions. In the event of a conflict between NERC GADS and the terms of this Contract, the terms of this Contract will control.
- D. No Payments Prior to Commercial Operations Date. CBRE Facilities shall be subject to an Acceptance Test and a Control System Acceptance Test prior to initial parallel operation. Company may accept test energy delivered by Subscriber Organization as provided in Section 6. (Test Energy) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. The procedures for such tests will be provided to Subscriber Organization by the Company prior to executing this Contract. Company shall not compensate Subscriber Organization for such test energy.
- E. Sale of Energy to Third Parties. Subscriber Organization shall not sell the renewable energy produced, stored, or associated with the CBRE Facility, to any person or entity other than the Company during the Term of this Contract.
- F. Subscriber Organization's Preparation of the Monthly Invoice. By the tenth (10th) Business Day of each calendar month, Subscriber Organization shall submit to Company an invoice that separately states the following for the preceding calendar month: (i) the Actual Output during the preceding calendar month; (ii) the monthly Lump Sum Payment for the preceding calendar month; (iii) a computation, based on the updated Monthly Subscriber Information for such preceding calendar month as provided pursuant to Section 4. (Updating Monthly Subscriber Information Used to Calculate Bill Credits and Other Matters) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract, of each Subscriber's Subscriber Allocation for the preceding month stated as a percentage of Contract Capacity; (iv) the Unsubscribed RDG for the preceding calendar month stated as a percentage of Contract Capacity; (v) a computation, based on each Subscriber's Subscriber Allocation, of the dollar amount of the Bill Credit to which each Subscriber is entitled for the monthly Lump Sum Payment for the preceding calendar month; (vi) the dollar amount owing to Subscriber Organization for its share of the monthly Lump Sum Payment for the preceding calendar month; and (vii) as a credit against the amount owing to the Subscriber Organization, the amounts payable by Subscriber Organization under Section 8.D (Subscriber Organization Fees) of this Contract. The dollar amount payable to the Subscriber Organization shall be subject to adjustment as provided in Section 5.

(~~Adjusting~~ Payment to Subscriber Organization; ~~Payment Reductions~~-Liquidated Damages for Failure to Achieve CBRE Subscriber Thresholds) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. **[Drafting Note: For Contracts with an Energy Payment, use the following in lieu of the above: Subscriber Organization's Preparation of the Monthly Invoice.** By the tenth (10th) Business Day of each calendar month, Subscriber Organization shall submit to Company an invoice that separately states the following for the preceding calendar month: (i) the Actual Output during the preceding calendar month; (ii) the Energy Payment for electric energy purchased by Company during the preceding calendar month, as set forth in Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) of this Contract (iii) the monthly Lump Sum Payment for the preceding calendar month; (iv.) a computation, based on the updated Monthly Subscriber Information for such preceding calendar month as provided pursuant to Section 4, (Updating Monthly Subscriber Information Used to Calculate Bill Credits and Unsubscribed Portion) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract, of each Subscriber's Subscriber Allocation for the preceding month stated as a percentage of Contract Capacity; (iv) the Unsubscribed RDG for the preceding calendar month stated as a percentage of Contract Capacity; (v) a computation, based on each Subscriber's Subscriber Allocation, of the dollar amount of the Bill Credit to which Subscriber is entitled for the monthly Energy Payment for the preceding calendar month; (vi) a computation, based on each Subscriber's Subscriber Allocation, of the dollar amount of the Bill Credit to which each Subscriber is entitled for the monthly Lump Sum Payment for the preceding calendar month; (vii) the total dollar amount of the Bill Credit to which each Subscriber is entitled for the preceding calendar month; (viii) the dollar amount owing to Subscriber Organization for the Unsubscribed Energy for the preceding calendar month; (ix) the dollar amount owing to Subscriber Organization for the Unsubscribed RDG for the preceding calendar month; (x) the total dollar amount owing Subscriber Organization for the preceding calendar month for the Baseline SO Payment; and (xi) as a credit against the amount owing to the Subscriber Organization, the amounts payable by Subscriber Organization under Section 8.D (Subscriber Organization Fees) of this Contract. The dollar amount payable to the Subscriber Organization shall be subject to adjustment as provided in Section 5, (~~Payment to Subscriber Organization; Payment Reductions~~-Liquidated Damages for Failure to Achieve CBRE Subscriber Thresholds) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.]

G. Payment Procedures.

1. Payments to Subscriber Organization.

a. By the twentieth (20th) Business Day of each calendar month following the month during which the invoice was submitted (i.e., by the twentieth (20th) Business Day of the second calendar month following the calendar month covered by the invoice in question), and not later than the last Business Day of that month if there are less than twenty (20) Business Days in that month, Company shall, make payment to Subscriber Organization of the amount payable for the ~~the Unsubscribed Energy and Unsubscribed RDG~~Baseline SO Payment shown on such invoice, or provide to Subscriber Organization an itemized statement of its objections to all or any portion of such invoice and pay Subscriber Organization its share of any undisputed amount. Any such payment to the Subscriber Organization shall be subject to Company's right to set-off ~~payment reductions~~-liquidated damages and/or to draw liquidated damages from Operating Period Security as provided in Section 5 (~~Payment To Subscriber Organization; Payment Reductions~~-Liquidated Damages for Failure to Achieve CBRE Subscriber Thresholds) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. The foregoing is without limitation to Company's rights under Section 9, (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract. **[Drafting note: If Contract has Energy Payment, include language in bold text].**

2. Time Extensions. Notwithstanding the foregoing, the Day by which the Company shall make payment to Subscriber Organization hereunder shall be increased by one (1) Day for each Day that Subscriber Organization is delinquent in providing to the Company either: (i) the Monthly Report for the calendar month in question pursuant to Section 1, (Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract; or (ii) the information required under Section 4.F (Subscriber Organization's Preparation of the Monthly Invoice) of this Contract. **[Drafting Note: If Contract has an energy payment**Energy Payment**, add the following:** "However, if Company is not timely in providing data required in Section 4.N, (Company's Obligation to Provide Certain Data) and this

directly causes Subscriber Organization to be unable to deliver its invoice in accordance with the time frame set forth in Section 4.F. (Subscriber Organization's Preparation of the Monthly Invoice), then Company shall still meet the payment date of the twentieth (20th) Business Day of the month following the month during which the invoice was submitted. If Subscriber Organization is unable to provide a complete invoice for the reasons set forth in the preceding sentence, an estimated payment, subject to reconciliation with the complete invoice, may be made by Company as an interim provision until a complete invoice can be prepared by Subscriber Organization and received by Company."]

H. Bill Credits.

1. The sole means of payment for each Subscriber Allocation for the calendar month covered by the invoice shall be by a Bill Credit on such Subscriber's retail electric bill. The Bill Credit shall be calculated on the undisputed amount of Subscriber Organization's invoice as set forth in Section 4.F. (Subscriber Organization's Preparation of the Monthly Invoice) of this Contract. Because not all of Company's customers have the same billing cycle, the timing of the appearance of the Bill Credit will vary with the Subscriber's billing cycle, but Company shall cause the Bill Credit to appear on each Subscriber's retail electric bill no later than the next billing cycle for such Subscriber following the due date for Company's payment to Subscriber Organization for the Unsubscribed RDG on the corresponding invoice. The calendar month upon which the Bill Credit is based shall not necessarily match the billing period for the retail electric service bill in which the Bill Credit is applied.
2. For purposes of applying the Bill Credit to each Subscriber's retail electric bill, the Company shall be entitled to rely exclusively on the Monthly Subscription Information as timely entered by the Subscriber Organization via the CBRE Online Portal as set forth in Section 4. (Updating Monthly Subscriber Information Used to Calculate Bill Credits and Other Matters) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.
3. If there is a breach, error or changed circumstances resulting in some portion of the **[monthly Energy Payment]** or monthly Lump Sum Payment being assigned to a Subscriber in excess of such Subscriber's allowable Subscriber Allocation under the CBRE Tariff, then the Company may treat this excess as an "overpayment" of the Subscriber Allocation and reduce the Bill Credit(s) to such Subscriber for the following calendar month for overpayment in proportion to the excess allocation received in error. Payment to the Subscriber Organization for such **[Unsubscribed Energy and/or]** Unsubscribed RDG shall only occur if no corresponding Bill Credit is made to a Subscriber, or if already allocated, if such allocation is corrected and withdrawn from such Subscriber. The intent of the Parties herein is to ensure that no portion of the [Energy Payment and/or] Lump Sum Payment from the CBRE Facility is double-counted to any Subscriber and/or Subscriber Organization. [Drafting note: For Contracts with an Energy Payment, include language in bold text.]

- I. Late Payments. Notwithstanding all or any portion of such invoice in dispute, and subject to the provisions of Section 9. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damage) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract (to the extent applicable), interest shall accrue on any invoiced amount that remains unpaid following the twentieth (20th) Business Day of each calendar month (or the last Business Day of that month if there are less than twenty Business Days in that month), or following the due date for such payment if extended pursuant to Section 4.G.2. (Time Extensions) to this Contract, at the average daily Prime Rate for the period commencing on the Day following the Day such payment is due until the invoiced amounts (or amounts due to Subscriber Organization if determined to be less than the invoiced amounts) are paid in full. Partial payments shall be applied first to outstanding interest and then to outstanding invoice amounts.

- J. Adjustments to Invoices After Payment. In the event adjustments are required to correct inaccuracies in an invoice after payment, the Party requesting adjustment shall recompute and include in the Party's request the principal amounts due during the period of the inaccuracy together with the amount of interest from the date that such invoice was payable until the date that such recomputed amount is paid at the average daily Prime Rate for the period. The difference between the amount paid and that recomputed for the invoice, along with the allowable amount of interest, shall either be (i) paid to Subscriber Organization or set-off by Company, as appropriate, in the next invoice payment to Subscriber Organization, or (ii) objected to by the Party responsible for such payment within thirty (30) Days following its receipt of such request. If the Party responsible for such payment objects to the request, then the Parties shall work together in good faith to resolve the objection. If the Parties are unable to resolve the objection, the matter shall be resolved pursuant to Section 17. (Dispute

Resolution) of the Contract. All claims for adjustments shall be waived for any amounts that were paid or should have been payable more than thirty-six (36) months preceding the date of receipt of any such request.

- K. Limitations Period. All Subscriber Organization claims for adjustments shall be submitted to the Company within three years of the end of the calendar month covered by the invoice on which the adjustment amount in question was invoiced or should have been invoiced. Claims not submitted to the Company by the end of such three-year period shall be deemed to have been waived.
- L. Company's Billing Records. Subscriber Organization, after giving reasonable advance written notice to Company, shall have the right during Company's normal working hours on Business Days to review all billing, metering and related records necessary to verify the accuracy of the data provided by Company regarding payments and credits. **[Drafting Note: If Contract has an energy payment Energy Payment, replace this section with the following:** Company's Billing Records. Subscriber Organization, after giving reasonable advance written notice to Company, shall have the right to review all billing, metering and related records necessary to verify the accuracy of the data provided by Company pursuant to Section 4.N. (Company's Obligation to Provide Certain Data) and payments relating to the Facility during Company's normal working hours on Business Days. Company shall maintain such records for a period of not less than thirty-six (36) months.]
- M. Subscriber Organization Responsibility for Billing Inaccuracies. The correction of any allocation of previously-applied Bill Credits among Subscribers or payments to the Subscriber Organization for Unsubscribed RDG, pertaining to a particular month due to any inaccuracy reflected in such Monthly Subscription Information with regard to a Subscriber's subscription in the CBRE Facility and the beneficial share of (RDG / NEP) exported by the CBRE Facility, or the share of Unsubscribed RDG, shall be the full responsibility of the Subscriber Organization, unless such inaccuracies are shown to have been caused by the Company.
- N. [RESERVEDReserved] **[Drafting Note: Use following section if Contract has energy payment an Energy Payment:** Company's Obligation to Provide Certain Data. By the fifth (5th) Business Day of each calendar month, Company shall provide Subscriber Organization or its designated agent with the appropriate data for Subscriber Organization to compute the amount to be paid for the electric energy purchased by Company in the preceding calendar month as determined in accordance with this Contract.]

5. COMPANY DISPATCH.

- A. General. Company shall have the right to dispatch all available real and reactive power delivered from the CBRE Facility to the Company System and to start up and shut down Subscriber Organization's Facility, in whole or in part, as it deems appropriate in its reasonable discretion, subject only to Company Dispatch and Subscriber Organization's operations and maintenance schedule determined in accordance with Section 4. (Maintenance of Subscriber Organization-Owned Interconnection Facilities) ~~and Section 10. (Operations Committee and Operating Procedures) to Attachment F (Facility Owned by Subscriber Organization) to this Contract.~~ to this Contract. Because the CBRE Facility must be available to respond to Company Dispatch, the Facility may not consume any energy generated by the Facility. Company shall not pay for reactive power.
- B. Company Dispatch. Dispatch will either be by Subscriber Organization's manual control under the direction of the Company System Operator or by remote computerized control by the EMS provided in Section 1.(g) (Active Power Control Interface) of Attachment F (Facility Owned by Subscriber Organization) to this Contract, in each case at Company's reasonable discretion.
- C. Company Rights of Dispatch. Company may require deration or outage in response to the CBRE Facility's failure to comply with Company Dispatch or to any conditions of Subscriber Organization-Attributable Non-Generation. A deration or outage required by Company pursuant to the preceding sentence shall be considered Subscriber Organization-Attributable Non-Generation and, until the conditions that led to the derating or outage are resolved by Subscriber Organization and Subscriber Organization notifies Company of the same, any such derating or outage shall "count against" Subscriber Organization for purposes of calculating the Performance Index and any such derating or outage shall "count against" Subscriber Organization for the purpose of calculating the Modified Pooled OMC Equipment Availability Factor. If, after such notification, Company attempts to dispatch the CBRE Facility and determines that such conditions that led to the deration or outage are not resolved, all time from the notice of resolution to actual resolution shall be revised as continuance of the derating or outage until the conditions that led to such outage or derating are resolved by Subscriber Organization to Company's reasonable satisfaction. If Subscriber Organization requests confirmation from Company that Subscriber Organization's actions to resolve such conditions that led to the derating or outage

were successfully completed, then Company shall use reasonable efforts to respond to such request within three (3) Business Days in writing (with email being acceptable) to allow Subscriber Organization the opportunity to take further appropriate corrective actions if needed. Nothing in this Section 5.C.(Company Rights of Dispatch) shall relieve Subscriber Organization of its obligation under the terms of this Contract to make available the full capability of the CBRE Facility for Company Dispatch.

D. Monthly Report. Commencing with the month during which the Commercial Operations Date is achieved, and for each calendar month thereafter during the Term, Subscriber Organization shall prepare and provide to Company a Monthly Report by the tenth (10th) Business Day of the following month in accordance with Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract. Beginning with the Monthly Report for the last calendar month of the initial Contract Year, Subscriber Organization shall include calculations of, as applicable, (a) the Modified Pooled OMC Equipment Availability Factor for the LD Period, (b) the Performance Index for the PI Assessment Period, (c) any of the BESS Capacity Ratio, the BESS Annual Equivalent Availability Factor, the BESS Equivalent Forced Outage Factor or the RTE Performance Metric for the BESS Measurement Period (if any), as well as (d) any liquidated damages to be assessed, as set forth in the form of Monthly Report included in Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator). All rights and obligations of the Parties with respect to each Monthly Report and any disagreements arising out of any Monthly Report are fully set forth in Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

6. **HOUSE POWER.** The Company will sell House Power to the CBRE Facility under the rate schedule in force for the class of customer to which the Subscriber Organization belongs. A separate meter to record energy delivered to the CBRE Facility may be installed by the Company. The Subscriber Organization shall be solely responsible for arranging retail electric service exclusively from the Company in accordance with the Company's Electric Rate Book. The Subscriber Organization shall obtain House Power solely through separately metered retail service and shall not obtain House Power through any other means and waives any regulatory or other legal claim or right to the contrary. Because the Subscriber Organization must make all energy produced by the CBRE Facility available to the Company, the CBRE Facility may not use the energy it generates to be consumed by it. It may not net-out or use energy it generates for House Power. The Parties acknowledge and agree that the performance of their respective obligations with respect to House Power shall be separate from this Contract and shall be interpreted independently of the Parties' respective obligations under this Contract. Notwithstanding any other provision in this Contract, nothing with respect to the arrangements for House Power shall alter or modify the Subscriber Organization's or the Company's rights, duties, and obligations under this Contract. This Contract shall not be construed to create any rights between the Subscriber Organization and the Company with respect to the arrangements for House Power.

7. **METERING REQUIREMENTS, CHARGES AND TESTING.**

- A. Company shall install, operate and maintain for the benefit of the CBRE Facility, one or more revenue metering package(s) suitable for measuring the export of renewable energy (AC) produced by the CBRE Facility in kilowatts and kilowatt-hours on a time-of-day basis and reactive power flow in kilovars and true root mean square kilovar-hours (the "Revenue Meter"). The metering point for the Revenue Meter shall be as close as possible to the Point of Interconnection as allowed by Company.
- B. Subscriber Organization, subject to Company review and approval, shall purchase, install, and maintain the infrastructure and other related equipment ("Meter Infrastructure") including meter housing, socket replacement and rewiring as required to install the Revenue Meter and any additional service meter(s), including, but not limited to, such meters for measuring House Power. Subscriber Organization shall install the Meter Infrastructure in adherence with requirements set forth in the latest edition of the Company's Electric Service Installation Manual (ESIM). Company shall test the Production Meter prior to installation and at the request and expense of the Subscriber Organization.
- C. Subscriber Organization shall reimburse Company for the costs reasonably incurred for the purchase and installation of the Revenue Meter. Subscriber Organization shall be responsible for the ongoing costs incurred by Company to operate, maintain (including maintenance replacements) and test the Revenue Meter during the Term.
- D. Metering Charge per Month: \$25.00. Subscriber Organization shall be charged each month during the Term an administrative metering fee of a \$25.00 for the Revenue Meter. The administrative metering fee is addition

to the costs associated with the purchase, installation, maintenance and testing of the Revenue Meter and Meter Infrastructure.

- E. **Meter Testing.** Company shall provide at least forty-eight (48) hours' notice to Subscriber Organization prior to any test it may perform on the Revenue Meter or metering equipment. Subscriber Organization may request tests in addition to the every fifth-year test and Subscriber Organization shall pay the cost of such tests. Company may perform tests in addition to the fifth-year test. If any of the revenue meters or metering equipment is found to be inaccurate at any time, as determined by testing in accordance with this section, Company shall promptly cause such equipment to be made accurate, and the period of inaccuracy, as well as an estimate for correct meter readings, shall be determined as provided in Company's Tariff Rule No.11 (Billing Error, Meter Tests and Adjustment for Meter Errors).

8. CBRE TARIFF REQUIREMENTS.

- A. **CBRE Framework and CBRE Tariff.** The Subscriber Organization shall comply with and assure that the requirements of the CBRE Framework and CBRE Tariff applicable to the CBRE Facility are met.
- B. **Subscriber Agreement.** Subscriber Organization shall require all prospective Subscribers to execute a Subscriber Agreement as a precondition to enrollment as a Subscriber in the CBRE Facility. The Subscriber Agreement must satisfy the requirements of the CBRE Tariff, the CBRE Framework, this Contract, and any additional guidance from the PUC. Without limitation to the generality of the preceding sentence, the Subscriber Agreement must include the right for the Subscriber to sell the subscription, either a portion or the entirety thereof, back to Subscriber Organization. The Subscriber Agreement shall require that the Subscriber Organization must buy back the interest in accordance with the preset repurchase/resale price schedule outlined in the Subscriber Agreement within thirty (30) Days of the Subscriber's request. Prior to executing the Subscriber Agreement, the Subscriber Organization shall make to the Subscriber the disclosures required under the Disclosure Checklist (attached as an Appendix to the CBRE Tariff). A copy of the Disclosure Checklist signed by both the Subscriber Organization and the Subscriber shall be attached to the executed Subscriber Agreement. The Subscriber Organization shall also disclose to the Subscriber that a failure to pay such Subscriber's monthly retail electric bill that results in Company issuance of a disconnection notice will result in forfeiture of Bill Credits for the duration of such disconnection. For each Subscriber, there must be a completed and fully executed Subscriber Agency Agreement and Consent Form (attached as an Appendix to the CBRE Tariff), which is delivered to the Company prior to the Commercial Operations Date, or prior to adding each Subscriber. The Subscriber Organization shall provide to each Subscriber a copy of the Subscriber's Bill of Rights (attached as an Appendix to the CBRE Tariff).
- C. **Funds Received From Subscribers Prior to the Commercial Operations Date.** Any payments made to Subscriber Organization by Subscribers prior to the Commercial Operations Date shall be deposited into an escrow account or other alternative proposed by Subscriber Organization and approved by the Company or CBRE IO ("Pre-COD Escrow"), to hold or segregate any pre-development enrollment fees or deposits from Subscribers (with appropriate mechanisms to refund such fees/deposits to Subscribers should the Subscriber Organization not complete its Facility), which shall be released to Subscriber Organization upon commercial operation of the Facility. These funds may not be withdrawn from the Pre-COD Escrow by the Subscriber Organization until the Commercial Operations Date. The Pre-COD Escrow must conform to the CBRE Tariff, the CBRE Framework, applicable Laws, and any additional guidance from the PUC or the CBRE IO.
- D. **Subscriber Organization Fees.**
1. ~~Subscriber Organization shall pay to Company the following Subscriber Organization fees:~~
 - ~~• \$250 Application Fee (once);~~
 - ~~• All applicable late fees for failure to meet Commercial Operations Date;~~
 - ~~• \$5/kW AC Program Administration Fee (annually), from the Commercial Operations Date;~~
 - ~~• \$25.00 (monthly) Revenue Meter Administration Fee;~~
 - 2.1. ~~Such other fees as the PUC may establish for required under the CBRE Program Tariff.~~
 - 3.2. ~~If Company does not received prior payment of such fees, Company may set off the amount of these fees unpaid amounts against Company payments to Subscriber Organization for Unsubscribed Energy, Company may the Baseline SO Payment, draw from the Security Funds, or, in its sole discretion, obtain payment from Security Funds, or Company shall invoice Subscriber Organization for payment to Company~~

of the foregoing fees. Subscriber Organization shall make payment to Company within ~~fifteen~~ (15) Days of Subscriber Organization's receipt of such invoice.

E. Facility Compliance.

1. The Subscriber Organization shall be responsible for ensuring that the equipment installed at the CBRE Facility meets all applicable codes, standards, and regulatory requirements at the time of installation and throughout its operation.
2. Subscriber Organization shall comply with all of the rules stated in the Company's applicable electric tariff rules related to the CBRE Program, as the same may be revised from time to time, and this Contract, as may be amended from time to time, as allowed by an amendment to this Contract approved, or deemed approved, by the PUC. In the event of any conflict between the terms of this Contract and Company's electric tariff rules related to the CBRE Program, the provisions of the tariff shall control.

F. Financial Compliance.

1. If Company reasonably believes the provisions of this Section 8.F apply to the CBRE Facility, Company shall notify Subscriber Organization in writing and Subscriber Organization shall provide or cause to be provided to Company on a timely basis, all information, including but not limited to information that may be obtained in any audit referred to below (the "Financial Compliance Information"), reasonably requested by Company for purposes of permitting Company and its parent company, Hawaiian Electric Industries, Inc. ("HEI") to comply with the requirements (initial and on-going) of (i) the accounting principles of Financial Accounting Standards Board ("FASB") Accounting Standards Codification 810, Consolidation ("FASB ASC 810"), (ii) FASB ASV 842 Leases ("FASB ASC 842"), (iii) Section 404 of the Sarbanes-Oxley Act of 2002 ("SOX 404") and (iv) all clarifications, interpretations and revisions of and regulations implementing FASB ASC 810, FASB ASC 842, and SOX 404 issued by the FASB, Securities and Exchange Commission, the Public Company Accounting Oversight Board, Emerging Issues Task Force or other Governmental Authorities. In addition, if required by Company in order to meet its compliance obligations, Subscriber Organization shall allow Company or its independent auditor to audit, to the extent reasonably required, Subscriber Organization's financial records, including its system of internal controls over financial reporting; provided, however, that Company shall be responsible for all costs associated with the foregoing, including but not limited to Subscriber Organization's reasonable internal costs. Company shall limit access to such Financial Compliance Information to Company and HEI personnel involved with such compliance matters and restrict any Company or HEI personnel involved in Company's monitoring, dispatch or scheduling of the Subscriber Organization and/or the CBRE Facility, the administration of this Contract, or in developing potential CBRE projects, from having access to such Financial Compliance Information (unless approved in writing in advance by Subscriber Organization).
2. Confidentiality. As a condition to obtaining the Financial Compliance Information, Company shall, and shall cause HEI to, maintain the confidentiality of said Financial Compliance Information pursuant to a mutually agreed to confidentiality and non-disclosure agreement to be executed among Company, HEI and Subscriber Organization.
3. Consolidation. Company does not want to be subject to consolidation as set forth in FASB ASC 810, as issued and amended from time to time by FASB. Company represents that, as of the Effective Date, it is not required to consolidate Subscriber Organization into its financial statements in accordance with FASB ASC 810. If for any reason, at any time during the Term, Company determines, in its sole but good faith discretion, that it is required to consolidate Subscriber Organization into its financial statements in accordance with FASB ASC 810, then Subscriber Organization shall immediately provide audited financial statements (including footnotes) in accordance with U.S. generally accepted accounting principles (and as of the reporting periods Company is required to report thereafter) in order for Company to consolidate and file its financial statements within the reporting deadlines of the Securities and Exchange Commission. Notwithstanding the foregoing requirement that Subscriber Organization provide audited financial statements to Company, the Parties will take all commercially reasonable steps, which may include modification of this Contract to eliminate the consolidation treatment, while preserving the economic "benefit of the bargain" to both Parties.

- G. Audits. The Company reserves the right to inspect the CBRE Facility as necessary to assure the safety and reliability of the system at any time during the Term, and for an additional period of one (1) year thereafter.

9. **REQUIREMENTS APPLICABLE TO SUBSCRIBER ORGANIZATION'S RELATIONSHIP WITH ITS SUBSCRIBERS.** The Subscriber Organization must comply with all of the following:
- A. **Subscriber Information.** The Subscriber Organization shall issue subscriptions in the CBRE Facility only to eligible retail electric service customers of the Company and provide to the Company the name, account number and service address attributable to each subscription and the Subscriber Allocation for each Subscriber's subscription. The Subscriber Organization shall take care to preserve the privacy expectations of the Subscribers, such as not publicly providing a Subscriber's Confidential Account Information, Subscriber Energy Usage Data, or Bill Credits. The Subscriber Organization will not disclose or share such information except as permitted by the Subscriber Agency Agreement and Consent Form executed by Subscriber in connection with Subscriber's acquisition of its subscription in the CBRE Facility or otherwise unless the Subscriber has provided explicit informed consent or if such disclosure is compelled by Law.
 - B. **Subscriber Exit or Transfer of Interest in CBRE Facility.** The transfer, cancellation, termination and/or exit of a Subscriber's interest in the CBRE Facility shall be completed in full accordance with applicable CBRE Framework or CBRE Tariff rules, in addition to any other terms, conditions or requirements imposed by the Subscriber Organization in the Subscriber Agreement, which Subscriber Organization shall ensure is also consistent with and in compliance with applicable CBRE Framework or CBRE Tariff rules. The CBRE Framework and/or CBRE Tariff requirements shall take precedence over any inconsistent or conflicting provisions found in the Subscriber Agreement.
 - C. **Updating Subscriber Information.** The Subscriber Organization shall provide to the Company the Monthly Subscriber Information together with any and all updates to the Monthly Subscription Information as provided in [Section 4](#). (Updating Monthly Subscriber Information Used to Calculate Bill Credits and Other Matters) to [Attachment B](#) (Company Payments for Energy, Dispatchability and Availability of Bess) to this Contract.
 - D. **Responsibility for Verification.**
 - 1. **Subscriber Verification.** If not already qualified by the CBRE Online Portal, the Subscriber Organization shall verify that each Subscriber is eligible to be a Subscriber in the CBRE Facility and that the CBRE Tariff requirements are met.
 - 2. **LMI Subscriber Verification.** For CBRE LMI Projects (as defined in the CBRE Tariff) or for CBRE Mid-Tier Projects or CBRE Large Projects (as defined in the CBRE Tariff) which commit to a certain percentage of LMI Subscribers, in addition to the requirements of [Section 9.D.1.](#), Subscriber Organization must comply with CBRE Tariff provisions to verify the LMI status of each LMI Subscriber:
 - E. **Disclosure of Production Information.** The Subscriber Organization acknowledges and agrees that, in order for the Company to carry out its responsibilities in applying Bill Credits to each Subscriber's retail electric bills, the Company may be required and shall be permitted to provide access or otherwise disclose and release to any Subscriber any and all production data related to the WTG System and BESS in its possession and information regarding the total Bill Credits applied by the Company with respect to the CBRE Facility and any information pertaining to a Subscriber's subscription. Any additional detailed information requested by a Subscriber shall be provided only upon the Subscriber Organization's consent in writing or email to the Company, or unless the Commission or the CBRE IO requests that the Company provide such information to the Subscriber, or as otherwise required by law.
 - F. **Disclosure of CBRE Facility Information.** The Subscriber Organization acknowledges and agrees that the Company may publicly disclose the CBRE Facility location, Subscriber Organization, nameplate capacity and production data of the CBRE Facility. Additionally, the Company will periodically provide a bill message to Subscribers clarifying that questions or concerns related to their subscription should be directed to the Subscriber Organization, including a statement that the Subscriber Organization is solely responsible for resolving any disputes with the Company or the Subscriber about the accuracy of the CBRE Facility data and that the Company is solely responsible for resolving any disputes with the Subscriber about the applicable rate used to determine the amount of the Bill Credit.
 - G. **Certain Tax and Securities Law Issues.** The Company makes no warranty or representation concerning the taxable consequences, if any, to Subscriber Organization or its Subscribers with respect to its Bill Credits to the Subscribers for participation in the CBRE [Facility-Facility's CBRE Program](#). Additionally, the Company makes no warranty or representation concerning the implication of any federal or state securities laws on how subscriptions to the CBRE [FacilityProgram](#) are handled.
 - H. **Full Cooperation with the PUC.** The Parties agree to fully cooperate with any request for information from the PUC or the CBRE IO pertaining in any way to the CBRE Facility and will provide such information upon

request in a timely manner. To the extent to which any request calls for producing a specific Subscriber's Confidential Account Information, Subscriber Energy Usage Data or Bill Credits, such information shall be provided and marked as Confidential Information.

- I. New Energy Generating Systems. The WTG System must not be built or previously interconnected at the time of application to the CBRE Program.
- J. Fair Disclosure; Disclosure Checklist. Prior to the time when any person or entity becomes a Subscriber, the Subscriber Organization will fairly disclose the future costs and benefits of the subscription and all other matters specified in the Disclosure Checklist and provide to the potential Subscriber a copy of this Contract. The Subscriber Organization shall comply with all other requirements of the PUC and applicable Laws with respect to communications with Subscribers.

10. GENERAL PROVISIONS FOR CBRE FACILITY DESIGN, CONSTRUCTION AND OPERATION.

- A. The following provisions generally set forth the minimum requirements of Subscriber Organization in designing, constructing and operating the CBRE Facility and are more fully described in Attachment F (Facility Owned by Subscriber Organization) and including without limitation the exhibits to Attachment F, Exhibits F-1 through F-6. In the event of any inconsistency or conflict between the terms and provisions of this Section 10, the terms and provisions of Attachment F and Exhibits F1-F6 shall control.
- B. Permits and Licenses. Subscriber Organization shall be responsible for the design, installation, operation, and maintenance of the CBRE Facility and shall obtain at its expense and maintain any required governmental authorizations and/or permits for the construction and operation of the CBRE Facility.
- C. Control and Protection of Equipment. Design, installation, operation and maintenance of the CBRE Facility shall include control and protection equipment as specified by the Company, including but not limited to the Telemetry and Control interface identified in Section 10.H (Telemetry and Control) below, and an automatic load-break device such as a circuit breaker or inverter and a manual disconnect that has a visible break or breaker with rack-out capability to isolate the CBRE Facility from the Company System. The manual disconnect device must be accessible by the Company and be capable of being locked by the Company in the open position, to establish working clearance for maintenance and repair work in accordance with the Company's safety rules and practices. The disconnect devices shall be furnished and installed by the Subscriber Organization and are to be connected between the CBRE Facility and the Company system. The disconnect devices shall be located in the immediate vicinity of the electric meter serving the Subscriber Organization. The manual disconnect device shall be, at a minimum, clearly labeled "Subscriber Organization System Disconnect." With permission of the Company, the disconnect devices may be located at an alternate location which is readily and safely accessible to the Company on a 24-hour basis. Such alternate location shall be clearly identified with signage placed in the immediate vicinity of the electric meter serving the Subscriber Organization.
- D. Access. The Subscriber Organization grants access to the Company to utilize the disconnect device, if needed. Subscriber Organization shall obtain the authorization from the owner and/or occupants of the premises where the CBRE Facility is located that allows the Company to access the CBRE Facility for the purpose specified in this Contract. Company may enter premises where the CBRE Facility is located, as permitted by law or tariff, for the following purposes: (1) to inspect CBRE Facility's protective devices and read or test meter(s); and (2) to disconnect the CBRE Facility and/or service to Subscriber Organization, whenever in Company's sole opinion, a hazardous condition exists and such immediate action is necessary to protect persons, Company's facilities, or property of others from damage or interference caused by the CBRE Facility, or the absence or failure of properly operating protective device.
- E. Prior Written Approval. Under no circumstances shall a Subscriber Organization interconnect and operate the CBRE Facility in parallel with the Company's electric system without prior written approval by the Company.
- F. Equipment Modifications. Once the CBRE Facility is interconnected to the Company's system, the Company reserves the right to require the installation of, or modifications to, equipment determined by the utility to be necessary to facilitate the delivery of reliable electric service to its customers, subject to the requirement that such installation or modification be consistent with the terms of this Contract and applicable interconnection standards (e.g., Rule 14H). If interconnection standards outside of this Contract conflict with the terms of this Contract, the provisions in this Contract shall apply. The Company shall provide a written explanation of the need for such installation or modification. Any disputes related to this provision shall be resolved according to the dispute resolution process set forth in Section 17. (Dispute Resolution) of this Contract.
- G. [~~RESERVED~~Reserved]

- H. Telemetry and Control Interface. The CBRE Facility must comply with the communications and controllability requirements set forth in Section 1(b) (Certain Specifications for the Facility), Sub-section (iii).e. of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
- I. Project Completion.
1. The Subscriber Organization shall achieve the Commercial Operations Date for the CBRE Facility within eighteen (18) months from the execution date of this Contract, as the same may be extended as provided herein or in the CBRE Tariff (the "Commercial Operations Date Deadline"). The Commercial Operations Date Deadline shall be extended day-for-day for a CBRE Facility that, in the Company's determination, has suffered a Force Majeure event as set forth in Section 27. (Force Majeure) of this Contract prior to the Commercial Operations Date, or for any delay caused by Company.
 2. Notwithstanding the foregoing, a local-government moratorium to issuing a permit may extend the 18-month Project Completion period for no more than an additional six (6) months. Failure to seek a permit, delay in seeking a permit, or permit-processing time not subject to a moratorium is not included in this 6-month extension.
 3. If Substantial Progress, as defined herein, has been achieved, but the Commercial Operations Date has not been achieved by the Commercial Operations Date Deadline, and Subscriber Organization still intends to complete its CBRE Facility, then the Subscriber Organization shall pay a "late fee" to Company of \$200/day/MW nameplate capacity of the WTG System until the CBRE Facility achieves the Commercial Operations Date. For example, if the CBRE Facility a nameplate capacity of 500 kW, and it achieves the Commercial Operations Date thirty (30) Days late, the "late fee" would be \$3,000. The "late fee" shall be paid to Company before the Commercial Operations Date. However, if Company fails to collect in full such amount by this date, such unpaid amount may be set off against any refund that may be due to Subscriber Organization for Total Estimated Interconnection Costs paid by Subscriber Organization that exceeds the Actual Interconnection Costs. All "late fee" payments received by Company will be credited back through the appropriate regulatory mechanism to offset the costs to Company ratepayers for the CBRE Program. A prerequisite to showing that Substantial Progress has been achieved in a timely manner is that before the Commercial Operations Date Deadline the Subscriber Organization must submit a signed letter to Company attesting to the fact that Substantial Progress as defined in this Contract has been made, and attach photographs to that letter demonstrating this.
 4. If: (i) Substantial Progress has not been achieved by the Commercial Operations Date Deadline, or (ii) Subscriber Organization does not wish to complete its CBRE Facility upon the Commercial Operations Date Deadline, or (iii) the Commercial Operations Date that is extended due to a permit issuance moratorium is not achieved within six (6) months from the originally required Commercial Operations Date Deadline, then the application for the CBRE Facility and this Contract will be terminated by Company without further notice. No additional concurrence from the CBRE IO shall be necessary for such termination. The Application Fee and any other deposits paid by the Subscriber Organization shall be forfeited.
 5. After termination, the Subscriber Organization, if it still intends to proceed with the CBRE Facility, must submit a new application and pay any applicable deposit and/or fees which will be subject to the then current CBRE Tariff, Bill Credit Rate and other applicable CBRE requirements for new projects, including CBRE Program capacity availability.

11. INTERCONNECTION REQUIREMENTS.

- A. Rule 14H Compliance. The Subscriber Organization must comply with the terms of this contract, and all of the terms, conditions, and requirements of Rule 14H (Interconnection of Distributed Generating Facilities Operating in Parallel With The Company's Electric System), including without limitation Appendix I (Distributed Generation Facility Interconnection Standards Technical Requirements). In the event of any inconsistency or conflict between the terms and provisions of this Contract and Rule 14H, the terms and provisions of Rule 14H this Contract shall control.
- B. Distribution Interconnection. Subject to Section 11.A (Rule 14H Compliance) above, if the CBRE Facility is a facility interconnecting at the Distribution level, the CBRE Facility shall follow the applicable Rule No. 14H interconnection process at the time of interconnection. If the CBRE Facility is a facility interconnecting at the Sub-Transmission and Transmission levels, the CBRE Facility shall follow the interconnection process applicable to such CBRE Facility at the time of interconnection.
- C. Subscriber Organization-Owned Interconnection Facilities.

1. The Subscriber Organization shall furnish, install, operate and maintain, at its cost, the interconnection facilities (such as circuit breakers, relays, switches, synchronizing equipment, monitoring equipment, and control and protective devices and schemes identified in Exhibit F-1 (Description of Generation and Battery Storage Facilities) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 2. The point of interconnection is shown on the single-line diagram and three-line diagram (provided by the Subscriber Organization and reviewed by the Company) which are appended to Attachment F, herein. Pursuant to Rule 14H, Appendix I (Distributed Generation Facility Interconnection Standards Technical Requirements), Section 6.c (Review of Design Drawings), the Company must review and approve Subscriber Organization's single-line and three-line diagrams prior to Subscriber Organization constructing of the CBRE Facility interconnection.
 3. The Subscriber Organization shall not operate equipment that superimposes a voltage or current upon the Company's system that interferes with the Company's operations, service to the Company's customers, or the Company's communication facilities. Such interference shall include, but not be limited to, overcurrent, voltage imbalance, and abnormal waveforms. If such interference occurs, the Subscriber Organization must diligently pursue and take corrective action at its own expense after being given notice and reasonable time to do so by the Company. If the Subscriber Organization does not take timely corrective action or continues to operate the equipment causing interference without restriction or limit, the Company may, without liability, disconnect the Subscriber Organization's equipment from the Company's system. ~~Pursuant to Rule 14H, Appendix I (Distributed Generation Facility Interconnection Standards Technical Requirements), Section 6.c (Review of Design Drawings), the Company must review and approve Subscriber Organization's single line and three line diagrams prior to Subscriber Organization constructing of the CBRE Facility interconnection.~~
 4. The Subscriber Organization agrees to test the CBRE Facility, to maintain operating records, and to follow such operating procedures, as may be specified by the Company to protect the Company's system from damages resulting from the parallel operation of the CBRE Facility, including such testing, records and operating procedures as more fully described Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 5. The Company may inspect the CBRE Facility and Subscriber Organization's interconnection facilities.
- D. System Capacity. The CBRE Facility must have a nameplate capacity, in the aggregate, of no more than _____ (_____) kW/MW to assure that the CBRE Facility has a nameplate capacity of ~~lessno more~~ than _____ 2.5MW.
- E. Company-Owned Interconnection Facilities.
1. The Company agrees to furnish, install, operate and maintain such interconnection facilities on its side of the point of interconnection with the CBRE Facility as required for the parallel operation with the CBRE Facility and more fully described in Attachment G (Company- Owned Interconnection Facilities) to this Contract.
 2. All Company-Owned Interconnection Facilities shall be the property of the Company. Where portions of the Company-Owned Interconnection Facilities are located on the Subscriber Organization's premises, the Subscriber Organization shall provide, at no expense to the Company, a suitable location for and access to all such equipment. If a 120/240 Volt power source or sources are required, the Subscriber Organization shall provide these at no expense to the Company.
 3. Subscriber Organization agrees to pay to the Company a non-refundable initial payment as contribution for the Company's investment in development of the Company-Owned Interconnection Facilities and to pay for all other interconnection costs (the "Total Estimated Interconnection Costs"), as more fully described in Attachment G (Company-Owned Interconnection Facilities). The Total Estimated Interconnection Costs shall not include the cost of an initial technical screening (under Rule 14H) of the impact of the CBRE Facility on the Company's system.
 4. Governmental Approvals for Company-Owned Interconnection Facilities. Subscriber Organization shall obtain at its sole cost and expense all Governmental Approvals necessary to the construction, ownership, operation and maintenance of the Company-Owned Interconnection Facilities. Subscriber Organization shall provide all Governmental Approvals necessary for the construction of such Company-Owned Interconnection Facilities prior to the commencement of construction by Company.
- F. Credit Assurance and Security. Subscriber Organization is required to post and maintain Development Security and Operating Security based on the requirements of this Section 11.F (Credit Assurance and Security).

1. Development Security. To guarantee undertaking the performance of Subscriber Organization's obligations under the Contract for the period prior to the Commercial Operations Date (including but not limited to Subscriber Organization's obligation to meet the Commercial Operations Date Deadline), Subscriber Organization shall post and maintain development period security ("Development Security") in an amount not less than twenty-five percent (25%) of the Total Estimated Interconnection Costs for the Company-Owned Interconnection Facilities within thirty (30) Days of Execution Date of the Contract.
2. Return of Development Security. The Development Security shall be returned to Subscriber Organization, subject to Company's right to draw from the Development Security as set forth in Section 11.F.6 (Company's Right to Draw from Security Funds), in the following circumstances: (i) this Contract is declared null and void under Section 3.E (Contract Null and Void) or this Contract is terminated prior to the Commercial Operations Date but in each case, only after all amounts which may be due and owing to Company upon such termination are paid in full by Subscriber Organization, including by draw upon such Development Security or (ii) following Company's receipt of Operating Security pursuant to Section F.3 (Operating Security).
3. Operating Security. To guarantee the performance of Subscriber Organization's obligations under this Contract for the period starting from the Commercial Operations Date to the expiration or termination of this Contract, Subscriber Organization shall provide satisfactory operating period security to Company in the amount of \$75/kW based on the Contract Capacity (the "Operating Security"). Subscriber Organization shall provide such Operating Security to Company within five (5) Business Days after the Commercial Operations Date, provided that, at all times, some form of Security Funds shall be in place and available to Company, whether Development Security or Operating Security
4. Form of Security. Subscriber Organization shall supply the Development Security and Operating Security required in the form of an irrevocable standby letter of credit with no documentation requirement substantially in the form attached to this Contract as Attachment G-1 (Form of Letter of Credit) from a bank chartered in the United States with a credit rating (as measured by Standard & Poor's) of "A-" or better. If the rating of the bank issuing the standby letter of credit falls below A-, Company may require Subscriber Organization to replace, within thirty (30) Days' notice by Company, the standby letter of credit with a standby letter of credit from another bank chartered in the United States with a credit rating of "A-" or better. Such letter of credit shall be issued for a minimum term of one (1) year and shall be automatically renewed for at least an additional one (1) year term so that at the time of such renewal, the remaining term of any such security shall not be less than one (1) year. The reasonable costs and expenses of establishing, renewing, substituting, canceling, increasing, reducing, or otherwise administering the letter of credit shall be borne by Subscriber Organization
5. Security Funds. The Development Security and Operating Security, including L/C Proceeds therefrom (collectively referred to as the "Security Funds") established, funded, and maintained by Subscriber Organization pursuant to the provisions of this Section 11.F (Credit Assurance and Security) shall provide security for the performance of Subscriber Organization's obligations under this Contract and shall be available to be drawn on by Company as provided in Section 11.F.6 (Company's Right to Draw from Security Funds). Subscriber Organization shall maintain the Security Funds at the contractually-required level throughout the Term of this Contract. Subscriber Organization shall replenish the Security Funds to such required level within fifteen (15) Business Days after any draw on the Security Funds by Company or any reduction in the value of Security Funds below the required level for any other reason. Notwithstanding the foregoing, Subscriber Organization's obligation to replenish the Development Security shall not exceed in total four (4) times the original amount of the Development Security required under Section 11.F.1 (Development Period Security) of this Contract.
6. Company's Right to Draw from Security Funds. In addition to any other remedy available to it, Company may, before or after termination of this Contract, draw from the Security Funds such amounts as are necessary to recover amounts Company is owed pursuant to this Contract, any accompanying letter agreements associated with the Contract for other work, such as the IRS, to be paid by Subscriber Organization, including, without limitation, any damages due Company, any interconnection costs owed pursuant to Attachment G (Company-Owned Interconnection Facilities) and any amounts for which Company is entitled to indemnification under this Contract. Company may, in its sole discretion, draw all or any part of such amounts due Company from any of the Security Funds to the extent available pursuant

to this Section 11.F (Credit Assurance and Security), and from all such forms, and in any sequence Company may select. Any failure to draw upon the Security Funds or other security for any damages or other amounts due Company shall not prejudice Company's rights to recover such damages or amounts in any other manner.

7. Failure to Renew or Extend Letter of Credit. If the letter of credit is not renewed or extended at least thirty (30) Days prior to its expiration or earlier termination, Company shall have the right to draw immediately upon the full amount of the letter of credit and, at Company's sole option, to place the proceeds of such draw (the "L/C Proceeds"), at Subscriber Organization's cost, in an escrow account until and unless Subscriber Organization provides a substitute letter of credit meeting the requirements of this Section 11.F (Credit Assurance and Security). If Company elects, the L/C Proceeds shall be deposited with a reputable escrow agent acceptable to Company ("Escrow Agent"). Without limitation to the generality of the foregoing, a federally-insured bank shall be deemed to be a "reputable escrow agent." Company shall have the right to apply the L/C Proceeds as necessary to recover amounts Company is owed as specified in Section 11.F.6 (Company's Right to Draw from Security Funds). The documentation governing such escrow account shall be in form and content satisfactory to Company and shall give Company the sole authority to draw from the escrow account. Subscriber Organization shall not be a party to such documentation and shall have no rights to the L/C Proceeds. If an adequate substitute letter of credit is obtained and provided to Company, the net L/C Proceeds remaining as of the date that such substitute letter of credit is provided, shall be returned to Subscriber Organization, or as Subscriber Organization directs in writing.
8. Release of Security Funds. Upon the end of the Term and the complete performance of all of Subscriber Organization's obligations under this Contract, including but not limited to the obligation to pay any and all amounts owed by Subscriber Organization to Company under this Contract, Company shall release the Security Funds to Subscriber Organization.

12. PERSONNEL AND SYSTEM SAFETY. Notwithstanding any other provisions of this Contract, if at any time Company determines that the Facility may endanger Company's personnel, and/or the continued operation of the Facility may endanger the integrity of the Company System or have an adverse effect on Company's other customers' electric service, Company shall have the right to disconnect the Facility from the Company System, as determined in the sole discretion of the Company System Operator. The Facility shall immediately comply with the dispatch instruction, which may be initiated through remote control, and shall remain disconnected (and in Subscriber Organization-Attributable Non-Generation status if so determined), until such time as Company is satisfied that the condition(s) referred to above have been corrected. If Company disconnects the Facility from the Company System for personnel or system safety reasons, it shall as soon as practicable notify Subscriber Organization by telephone, and thereafter make reasonable efforts to confirm, in writing (with email being acceptable), within three (3) Days of the disconnection, the reasons for the disconnection. If the reason for the disconnection constitutes Subscriber Organization-Attributable Non-Generation, Company will notify Subscriber Organization (i) whether the conditions resulting in such disconnection have been resolved (in which case no additional time after such confirmation shall count as Subscriber Organization-Attributable Non-Generation); or (ii) that conditions resulting in such disconnection have not been resolved so that Subscriber Organization can take such appropriate corrective actions. Subscriber Organization shall notify Company in writing when such corrective action has been completed; provided, however, that Subscriber Organization shall remain in Subscriber Organization-Attributable Non-Generation until Company is satisfied that the condition resulting in the disconnection has been corrected. Company shall use reasonable efforts to inspect such corrective measures (if necessary) and confirm the resolution of such condition within three (3) Business Days after Subscriber Organization's notification.

13. EVENTS OF DEFAULT BY SUBSCRIBER ORGANIZATION.

- A. The occurrence of any of the following shall constitute an "Event of Default" by Subscriber Organization:
 1. If at any time during the Term, Subscriber Organization delivers or attempts to deliver to the Point of Interconnection for sale under this Contract renewable energy that was not produced by the CBRE Facility and Subscriber Organization fails to cease such delivery or attempt to deliver such renewable energy within ten (10) Days after Company's written notice of such delivery or attempt.
 2. If at any time subsequent to the Commercial Operations Date, the WTG System Equivalent Availability Factor is less than **84%** for each of three consecutive Contract Years.
 3. If at any time subsequent to the Commercial Operations Date, the Measured Performance Ratio for each of three consecutive Contract Years falls below the Tier 2 Bandwidth for such Contract Year.

4. If at any time subsequent to the Commercial Operations Date, the Subscriber Organization fails to demonstrate satisfaction of the BESS Capacity Performance Metric prior to the expiration of the BESS Capacity Cure Period.
5. If at any time subsequent to the Commercial Operations Date, the Subscriber Organization fails to achieve a BESS Annual Equivalent Availability Factor of not less than **75%** for each of six (6) consecutive BESS Measurement Periods as provided in Section 4.B (BESS Annual Equivalent Availability Factor; Liquidated Damages; Termination Rights) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract.
6. If at any time subsequent to the Commercial Operations Date, Subscriber Organization fails to demonstrate satisfaction of the RTE Performance Metric prior to the expiration of the RTE Cure Period.
7. If at any time subsequent to the Commercial Operations Date, the Facility is unavailable to provide electric energy in response to dispatch by Company for a period of three hundred sixty-five (365) or more consecutive Days.
8. If at any time during the Term, Subscriber Organization fails to satisfy the requirements of Section 11.F (Credit Assurance and Security) of this Contract.
9. If at any time subsequent to the Commercial Operations Date, Subscriber Organization fails to take all corrective actions specified by the Company's written notice that the CBRE Facility is out of compliance with the terms of this Contract, within the timeframe set forth in such notice.
10. If at any time subsequent to the Commercial Operations Date, Subscriber Organization fails to install, operate, maintain, or repair the Facility in accordance with Good Engineering and Operating Practices if such failure is not cured within thirty (30) Days after written notice of such failure from Company unless such failure cannot be cured within said thirty (30) Day period and Subscriber Organization is making commercially reasonable efforts to cure such failure, in which case Subscriber Organization shall have a cure period of three hundred sixty-five (365) Days after Company's written notice of such failure.
11. The failure to make any payment required pursuant to this Contract when due if such failure is not cured within ten (10) Business Days after written notice is received by Subscriber Agreement.
12. If any representation or warranty made to Company by Subscriber Organization herein is false and misleading in any material respect when made.
13. Subscriber Organization becomes insolvent, or makes an assignment for the benefit of creditors; or shall have an order for relief in an involuntary case under the bankruptcy Laws as now or hereafter constituted entered against it, or shall commence a voluntary case under the bankruptcy Laws as now or hereafter constituted, or shall file any petition or answer seeking for itself any arrangement, composition, adjustment, liquidation, dissolution or similar relief to which it may be entitled under any present or future Law; or seeks or consents to or acquiesces in the appointment of or taking possession by, any custodian, trustee, receiver or liquidator of it or of all or a substantial part of its properties or assets; or takes action looking to its dissolution or liquidation, and Subscriber Organization is unable to remedy such actions within one hundred eighty (180) Days of the occurrence of such breach or default.
14. Subscriber Organization fails to comply with the applicable term, conditions and minimum requirements specified in the CBRE Tariff governing Subscriber Organization's CBRE Facility, if such failure is not cured within thirty (30) Days after written notice of such failure from Company.
15. Subscriber Organization fails to comply with a decision under Section 17 (Dispute Resolution) within thirty (30) Days after such decision or, if such decision cannot be complied with within thirty (30) Days, Subscriber Organization fails to have commenced commercially reasonable efforts designed to achieve compliance within such thirty (30) Days and diligently continue such commercially reasonable efforts until compliance is attained, but no longer than one hundred twenty (120) Days;
16. Other than the events of default specified in this Section 13.A.1 through Section A.15, should Subscriber Organization, by act or omission, materially breach or default on any other material covenant, condition or other provision of this Contract, and if such breach or default is not cured within thirty (30) Days after written notice of such breach or default from Company, such failure to cure shall constitute an Event of Default; provided, however, that if it is objectively impossible to cure such breach or default within said thirty (30) Day period, then, for so long as Subscriber Organization is making the same effort to cure such breach or default as would be expected of an experienced independent power producer willing and able to exert commercially reasonable efforts to achieve such cure, Subscriber Organization shall have a cure period equal to three hundred sixty-five (365) Days beginning on the date of Company's written notice of such breach or

default; provided, further, that if the material breach in question involves Subscriber Organization's failure to meet the operational and performance standards set forth in Attachment F (Facility Owned by Subscriber Organization), the provisions of Section 1(j) (Demonstration of Facility) of Attachment F (Facility Owned by Subscriber Organization) for consultant's study and Subscriber Organization implementation of such study's recommendation shall apply in lieu of the extended cure period provided under the preceding proviso.

14. TERMINATION FOR CAUSE.

A. Upon an Event of Default by the Subscriber Organization:

1. Company shall provide written notice to the Subscriber Organization to remedy the Event of Default within the applicable cure period specified for such Event of Default, if any.
 2. If after the cure period, if any, provided for in the Company's notice Subscriber Organization is still not in compliance with this Contract, then the Company shall have the right to terminate the Contract, as follows:
 - a. Company shall issue a written a Notice of Intent to Terminate the Contact for just cause;
 - b. Subscriber Organization shall have five (5) Business Days in which to provide evidentiary documentation reasonably establishing that Company's decision to terminate the Contract is in error.
 - c. If the Subscriber Organization fails to provide such proof or if the Company reasonably determines that such proof is insufficient to reverse the Company's decision to terminate, Company may proceed to terminate the Contract by providing a written Notice of Termination to Subscriber Organization. A copy of such notice shall be provided to all Subscribers of the CBRE Facility, the PUC, and the CBRE IO, if applicable.
 3. The termination date in the notice of termination shall not be earlier than thirty (30) Days from the date of such notice.
 4. Subscriber Organization acknowledges that Company is a public utility and is relying upon Subscriber Organization's performance of its obligations under this Contract, and that Company and/or its customers may suffer irreparable injury as a result of the failure of Subscriber Organization to perform any of such obligations, whether or not such failure constitutes an Event of Default or otherwise gives rise to a termination for cause of this Contract.. Accordingly, Company shall have right to seek specific performance injunctions or other available equitable remedies for Subscriber Organization's failure to perform any of its obligations under this Contract, irrespective of whether such failure constitutes an Event of Default.
 5. In the event of any breach of this Contract by Company, the Subscriber Organization shall provide Company with a written notice of the breach. Company shall have up to thirty (30) Days to cure the breach. If the breach is not cured within the thirty (30) Days, the Subscriber Organization may utilize the procedures set forth in Section 17. (Dispute Resolution) of this Contract. If the breach results in Bill Credits not being issued to one or more individual Subscribers, in the absence of a cure by Company within the allowed time following the notice, the Subscriber Organization may also seek a remedy on behalf of the affected Subscribers for any past due Bill Credits pursuant to the process set forth in Section 17. (Dispute Resolution) of this Contract.
- B. Following Termination, applicable provisions shall continue in effect after termination to the extent necessary to enforce and complete the duties, obligations or responsibilities of the Parties arising prior to termination and, as applicable, to provide for final billings and adjustments related to the period prior to termination, repayment of any money due and owing to either Party pursuant to this Contract.

15. DAMAGES IN THE EVENT OF TERMINATION BY COMPANY.

- A. Termination Due to an Event of Default. If the Contract is terminated by Company in accordance with this Contract due to an Event of Default, Company shall be entitled to Termination Damages calculated by multiplying the Contract Capacity by [\$75/kW].
- B. Termination Damages Appropriate. Subscriber Organization agrees and acknowledges that (i) the damages that Company would incur due to early termination of the Contract would be difficult or impossible to calculate with certainty, (ii) the Termination Damages are an appropriate approximation of such damages, and (iii) payment of Termination Damages does not relieve Subscriber Organization of liability for costs and balances incurred prior to the effective date of such termination. The Termination Damages are not intended to limit Company's rights or remedies, or Subscriber Organization's liabilities or duties, with respect to losses arising independent of the termination of this Contract for an Event of Default before the Commercial

Operations Date, including, without limitation, Company's right to recover under Section 16. (Limitation of Liability).

16. LIMITATION OF LIABILITY.

- A. Each Party shall at all times indemnify, defend, and save the other Party harmless from any and all damages, losses, claims, including claims and actions relating to injury or death of any person or damage to property, costs and expenses, reasonable attorneys' fees and court costs, arising out of or resulting from the Party's performance of its obligations under this Contract, except to the extent that such damages, losses or claims were caused by the negligence or intentional acts of the other Party.
- B. Each Party's liability to the other Party for failure to perform its obligations under this Contract shall be limited to the amount of direct damage actually incurred. In no event shall either Party be liable to the other Party for any punitive, incidental, indirect, special, or consequential damages of any kind whatsoever, including for loss of business opportunity or profits, regardless of whether such damages were foreseen.
- C. Notwithstanding any other provision of the Contract or this Section 16., with respect to the Company's duties or performance or lack of performance under this Contract, the Company's liability to the Subscriber Organization shall be limited as set forth in the Company's rate book and terms and conditions for electric service, which shall not be affected by the terms of this Contract. There are no third-party beneficiaries of any Company duty under this Contract other than the Company's duty to Subscribers to issue Bill Credits as set forth in this Contract.
- D. Indemnification of Company against Third Party Claims. Subscriber Organization shall indemnify, defend, and hold harmless Company, its successors, permitted assigns, affiliates, controlling persons, directors, officers, employees, agents, contractors, subcontractors and the employees of any of them (collectively referred to as an "Indemnified Company Party"), from and against any Losses suffered, incurred or sustained by any Indemnified Company Party due to any Claim (whether or not well founded, meritorious or unmeritorious) by a third party not controlled by, or under common ownership and/or control with, Company relating to (i) the Subscriber Agreement between Subscriber Organization and its Subscribers or (ii) Subscriber Organization's development, permitting, construction, ownership, operation and/or maintenance of the CBRE Facility.

17. DISPUTE RESOLUTION.

- A. Notwithstanding the provisions of this Contract allowing for early termination following an Event of Default, each Party agrees to attempt to resolve all disputes arising hereunder promptly, equitably and in a good faith manner.
- B. Before submitting any claims, controversies or disputes ("Dispute(s)") under this Contract to the Dispute Resolution Procedures set forth below in Section C., the presidents, vice presidents, or authorized delegates from both Subscriber Organization and Company having full authority to settle the Dispute(s), shall personally meet in Hawai'i and attempt in good faith to resolve the Dispute(s) (the "Management Meeting").
- C. Dispute Resolutions Procedures, Mediation. Any and all Dispute(s) arising out of or relating to this Contract, (i) which remain unresolved for a period of 20 Days after the Management Meeting takes place or (ii) for which the Parties fail to hold a Management Meeting within sixty (60) Days of the date that a Management Meeting was requested by a Party, may upon the agreement of the Parties, first be submitted to confidential mediation in Honolulu, Hawai'i pursuant to the administration by, and in accordance with the Mediation Rules, Procedures and Protocols of, Dispute Prevention & Resolution, Inc. (or its successor) or, in their absence, the American Arbitration Association ("DPR") then in effect. If the Parties agree to submit the dispute to confidential mediation, the parties shall each pay 50% of the cost of the mediation (i.e., the fees and expenses charged by the mediator and DPR) and shall otherwise each bear their own mediation costs and attorneys' fees. If the Parties do not submit the Dispute(s) to mediation, or if they do submit the Dispute(s) to mediation but settlement of the Dispute(s) is not reached within 60 Days after commencement of the mediation, either Party may initiate legal proceedings in a court of competent jurisdiction in the State of Hawai'i.

- 18. **ENVIRONMENTAL CREDITS.** Included in the purchase and sale of renewable energy are all of the Environmental Credits associated with the renewable energy. Company will not reimburse Subscriber Organization for any taxes or fees imposed on Subscriber Organization including, but not limited to, State of Hawai'i general excise tax. To the extent not prohibited by law, Company shall have the sole and exclusive right to use the renewable energy purchased hereunder to meet RPS and any Environmental Credit shall be the property of Company; provided,

however, that such Environmental Credits shall be to the benefit of Company's ratepayers in that the value must be credited "above the line." Subscriber Organization shall use all commercially reasonable efforts to ensure such Environmental Credits are vested in Company, and shall execute all documents, including, but not limited to, documents transferring such Environmental Credits, without further compensation; provided, however, that Company agrees to pay for all reasonable costs associated with such efforts and/or documentation.

19. REPRESENTATIONS AND WARRANTIES.

A. Company and Subscriber Organization represent and warrant, respectively, that:

1. Each respective Party has all necessary right, power, and authority to execute, deliver and perform this Contract.
2. The execution, delivery and performance of this Contract by each respective Party will not result in a violation of any Laws, or conflict with, or result in a breach of, or cause a default under, any agreement or instrument to which such Party is also a party or by which it is bound. No consent of any person or entity not a Party to this Contract, other than governmental agencies whose approval is necessary for construction of the CBRE Facility and interconnection facilities, is required for such execution, delivery, and performance by either Party.

B. Subscriber Organization represents, warrants, and covenants that:

1. Subscriber Organization has obtained all Land Rights necessary for the construction, ownership, operation and maintenance of the CBRE Facility during the Term, and Subscriber Organization shall maintain such Land Rights in effect throughout the Term.
2. As of the commencement of construction, Subscriber Organization shall have obtained all permits or approvals from any applicable governmental agency necessary for the construction, ownership, operation and maintenance of the CBRE Facility and all interconnection facilities.
3. Subscriber Organization warrants that the CBRE Facility complies with all applicable federal and state Laws, including but not limited to (a) all applicable securities Laws and shall continue to be in compliance for the duration of the Term; (b) complies with all applicable Laws concerning the dissemination of personally identifiable information, and shall continue to be in compliance for the longer of (i) the Term and (ii) for as long as Subscriber Organization continues to hold or otherwise have access to any personally identifiable information of Subscribers or customers of Company; (c) complies with all applicable Laws concerning consumer protection, and shall continue to be in compliance for the duration of the Term; (d) complies with all applicable Laws and regulations concerning renewable energy grid interconnections, and shall continue to be in compliance for the duration of the Term.

20. SUBSCRIBER ORGANIZATION AND CBRE FACILITY INFORMATION. By signing this Contract, the Subscriber Organization expressly agrees and authorizes the Company to request and obtain from Subscriber Organization and its contractors, vendors, subcontractors, installers, suppliers or agents (collectively "Subscriber Organization Agents"), at no cost to Company, information related to the CBRE Facility, including but not limited to Watts, Vars, Watt Hours, current and voltage, status of the CBRE Facility, inverter settings, any and all recorded event or alarm logs recorded, (collectively "CBRE Facility Data") that Company reasonably determines are needed to ensure the safe and reliable operation of the CBRE Facility or the Company's system. Subscriber Organization expressly agrees and irrevocably authorizes Subscriber Organization Agents to disclose such Subscriber Organization Data to Company upon request by Company.

21. ADDITIONAL INFORMATION. The Company reserves the right to request additional information from Subscriber Organization relating to the CBRE Facility, where reasonably necessary, to serve the Subscriber Organization under this Contract or to ensure reliability, safety of operation, and power quality of the Company's system.

22. NO MATERIAL CHANGES TO CBRE FACILITY. The Subscriber Organization agrees that no material changes or additions to the CBRE Facility shall be made without having obtained prior written consent from the Company, which consent shall not be unreasonably withheld. In no event may the Total Rated Capacity of the CBRE

Facility exceed _____ kW. If the CBRE Facility changes ownership, the Company may require the new Subscriber Organization to complete and execute an amended Contract or new Contract, as may be applicable.

23. CERTIFICATION BY LICENSED ELECTRICAL CONTRACTOR. The CBRE Facility and all interconnection systems must comply with all applicable safety and performance standards of the National Electrical Code (NEC), Institute of Electrical and Electronic Engineers (IEEE), and accredited testing laboratories such as the Underwriters Laboratories (UL), and where applicable, the rules of the Commission, or other applicable governmental laws and regulations, and the Company's interconnection requirements, in effect at the time of signing this Contract. This requirement shall include, but not be limited to, the interconnection standards and procedures of the Company's Rule 14H, as well as any other requirements as may be specified in this Contract, its Attachments, Exhibits, and as authorized by the Commission. Upon request by Company, Subscriber Organization shall cause a Licensed Electrical Contractor, as agent for Subscriber Organization, to certify that once approved by the Company, the proposed CBRE Facility will be installed to meet all preceding requirement(s).

24. GOOD ENGINEERING PRACTICE.

- A. Each Party agrees to install, operate and maintain its respective equipment and facilities and to perform all obligations required to be performed by such Party under this Contract in accordance with good engineering practice in the electric industry and with applicable laws, rules, orders and tariffs.
- B. Wherever in this Contract and its Attachments and Exhibits the Company has the right to give specifications, determinations or approvals, such specifications, determinations and/or approvals shall be given in accordance with the Company's standard practices, policies and procedures, which may include the Company's Electric Service Installation Manual, the Company's Engineering Standard Practice Manual and the IEEE Guides and Standards for Protective Relaying Systems.

25. INSURANCE. The following insurance provisions are only applicable to CBRE Facilities with a Total Rated Capacity 250 kW or greater but not exceeding 2.5 MW:

- A. The Subscriber Organization shall, at its own expense and during the term of the Contract and any other time that the CBRE Facility is interconnected with the Company's system, maintain in effect with a responsible insurance company authorized to do insurance business in Hawai'i and with a rating by A.M. Best Company, Inc. of "A-VII" or better, the following insurance or its equivalent at Company's discretion that will protect the Subscriber Organization and the Company with respect to the CBRE Facility, the CBRE Facility's operations, and the CBRE Facility's interconnection with the Company's system:
 - 1. A Commercial General Liability policy covering bodily injury and property damage with combined single limit of liability of at least the following amounts based on the Total Rated Capacity of the generator (for solar systems—Total Rated Capacity of the generator or inverter, whichever is lower, can be used with appropriate technical documentation on inverter, if not higher Total Rated Capacity will be used), for any occurrence. The limits below may be satisfied through the use of umbrella or excess liability insurance sufficient to meet these requirements:

COMMERCIAL GENERAL LIABILITY COVERAGE AMOUNT	TOTAL RATED CAPACITY OF THE CBRE FACILITY
\$5,000,000	Greater than 1 MW and less than or equal to 5 MW
\$2,000,000	250 kW and less than or equal to 1 MW

- 2. Said insurance by endorsement to the policy or policies shall: name the Company, its directors, officers, agents, and employees as additional insured; include contractual liability coverage for written agreements; include provisions stating that the insurance will respond to claims or suits by additional insureds against the Subscriber Organization or any other insured thereunder; provide that the insurance is primary with respect to the Subscriber Organization and the Company; and provide that the insurance company waives all rights of subrogation which Subscriber Organization or the insurance company may have against

Company, its directors, officers, agents, and employees. Any insurance carried by Company will be excess only and not contribute with this insurance.

- B. Said insurance by endorsement to the policy or policies shall provide written notice within thirty (30) Days to the Company should the required insurance be cancelled, limited in scope, or not renewed upon expiration. "Claims made" policies are not acceptable, unless the Subscriber Organization agrees to maintain coverage in full effect at all times during the term of this Contract and for three (3) years thereafter. The adequacy of the coverage afforded by the required insurance shall be subject to review by the Company from time to time, and if it appears in such review that risk exposures require an increase in the coverages and/or limits of this insurance, the Subscriber Organization shall make such increase to that extent and any increased costs shall be borne by the Subscriber Organization. The Subscriber Organization has the responsibility to determine if higher limits are desired and purchased. The Subscriber Organization shall provide certificates of insurance to the Company prior to executing the Contract and any parallel interconnection. Receipt of any certificate showing less coverage than required shall not operate as a waiver by the Company of the Subscriber Organization's obligation to fulfill the applicable requirements of this Section 25. The Subscriber Organization's indemnity and other obligations shall not be limited by the foregoing insurance requirements. Any deductible shall be the responsibility of the Subscriber Organization.
- C. Alternatively, where the Subscriber Organization is a governmental entity, Subscriber Organization may elect to be self-insured for the amounts set forth above in lieu of obtaining insurance coverage to those levels from an insurance company.

26. MISCELLANEOUS.

- A. Disconnection and Survival of Obligations. Upon termination of this Contract, the CBRE Facility shall be disconnected from the Company's system. The termination of this Contract shall not relieve the Parties of their respective liabilities and obligations, owed or continuing at the time of termination.
- B. Governing Law and Regulatory Authority. This Contract was executed in the State of Hawai'i and must in all respects be interpreted, governed, and construed under the laws of the State of Hawai'i. This Contract is subject to, and the Parties' obligations hereunder include, operating in full compliance with all valid, applicable federal, state, and local laws or ordinances, and all applicable rules, regulations, orders of, and tariffs approved by, duly constituted regulatory authorities having jurisdiction.
- C. Amendment, Modifications, or Waiver. This Contract may not be altered or modified by either of the Parties, except by an instrument in writing executed by each of them. None of the provisions of this Contract shall be considered waived by a Party unless such waiver is given in writing. The failure of a Party to insist in any one or more instances upon strict performance of any of the provisions of this Contract or to take advantage of any of its rights hereunder shall not be construed as a waiver of any such provisions or the relinquishment of any such rights for the future, but the same shall continue and remain in full force and effect. This Contract contains the entire agreement and understanding between the Parties, their agents, and employees as to the subject matter of this Contract. Each Party also represents that in entering into this Contract, it has not relied on any promise, inducement, representation, warranty, agreement or other statement not set forth in this Contract.
- D. Notices. Any notice required under this Contract shall be in writing and mailed at any United States Post Office with postage prepaid and addressed to the Party, or personally delivered to the Party at the address identified on the last page of the Contract. Changes in such designation may be made by notice similarly given. Notice sent by mail shall be deemed to have been given on the date of actual delivery or at the expiration of the fifth day after the date of mailing, whichever is earlier.
- E. Assignment. This Contract may not be assigned by either Party without the prior written consent of the other Party. Such consent shall not be unreasonably withheld. In the event of an assignment for financing, to the extent necessary, Company shall, if requested by Subscriber Organization and if its costs (including reasonable attorneys' fees of outside counsel) in responding to such request are paid by Subscriber Organization execute such Hawai'i-law-governed documents as may be reasonably requested by a lender in connection with CBRE Facility debt and reasonably acceptable to Company, to acknowledge an assignment of such debt and/or pledge/mortgage.
- F. Binding Effect. This Contract shall be binding upon and inure to the benefit of the Parties hereto and their respective successors, legal representatives, and permitted assigns.
- G. Relationship of Parties. Nothing in this Contract shall be deemed to constitute any Party hereto as partner, agent or representative of the other Party or to create any fiduciary relationship between the Parties.

- H. Limitations. Nothing in this Contract shall limit the Company's ability to exercise its rights or expand or diminish its liability with respect to the provision of electrical service pursuant to the Company's tariffs as filed with the Commission, or the Commission's Standards for Electric Utility Service in the State of Hawai'i, which currently are included in the Commission's General Order Number 7, as either may be amended from time to time.
- I. Non-Warranty. Neither by inspection, if any, or non-rejection, nor in any other way, does the Company give any warranty, express or implied, as to the adequacy, safety, or other characteristics of any structures, equipment, wires, appliances or devices owned, installed or maintained by the Subscriber Organization or leased by the Subscriber Organization from third parties, including without limitation the CBRE Facility and any structures, equipment, wires, appliances or devices appurtenant thereto.
- J. Hawai'i General Excise Tax. Subscriber Organization shall, when making payments to Company under this Contract, pay such additional amount as may be necessary to reimburse Company for the Hawai'i general excise tax on gross income and all other similar taxes imposed on Company by any Governmental Authority with respect to payments in the nature of gross receipts tax, sales tax, privilege tax or the like, but excluding federal or state net income taxes. By way of example and not limitation, as of the Execution Date, all payments subject to the Hawai'i general excise tax, (i) on the islands of on Maui, Moloka'i and Lana'i (totaling 4.0% as of the Execution Date) would include an additional 4.166% so that the underlying payment will be net of such tax liability; and (ii) all payments subject to general excise tax plus surcharge on Hawai'i island (totaling 4.5% as of the Execution Date) would include an additional 4.7120% so the underlying payment will be net of such tax liability.
- K. Execution of Contract; Multiple Counterparts. The Parties agree that this Contract, including amendments, may be executed and delivered by exchange of electronic signatures, which may be transmitted by facsimile, e-mail, or other acceptable means. A party's electronic signature shall be considered an "original" signature which is binding and effective for all purposes. This Contract may be executed in counterparts, each of which shall be deemed an original, and all of which shall together constitute one and the same instrument binding all Parties.
- L. Survival. The rights and obligations of the Parties in this Contract which, by its express terms or nature and context is intended to survive termination or expiration of this Contract, will survive any such termination or expiration.

27. FORCE MAJEURE

- A. Definition of Force Majeure. The term "Force Majeure", as used in this Contract, means any occurrence that:
 - 1. In whole or in part delays or prevents a Party's performance under this Contract;
 - 2. Is not the direct or indirect result of the fault or negligence of that Party;
 - 3. Is not within the control of that Party notwithstanding such Party having taken all reasonable precautions and measures in order to prevent or avoid such event; and
 - 4. The Party has been unable to overcome by the exercise of due diligence.
- B. Events That Could Qualify as Force Majeure. Subject to the foregoing, events that could qualify as Force Majeure include, but are not limited to, the following: acts of God, flooding, lightning, landslide, earthquake, fire, drought, explosion, epidemic, quarantine, storm, hurricane, tornado, volcano, other natural disaster or unusual or extreme adverse weather-related events; war (declared or undeclared), riot or similar civil disturbance, acts of the public enemy (including acts of terrorism), sabotage, blockade, insurrection, revolution, expropriation or confiscation; or strikes, work stoppage or other labor disputes (in which case the affected Party shall have no obligation to settle the strike or labor dispute on terms it deems unreasonable).
- C. Exclusions from Force Majeure. Force Majeure does not include:
 - 1. any acts or omissions of any Third Party, including, without limitation, any vendor, materialman, customer, or supplier of Subscriber Organization, unless such acts or omissions are themselves excused by reason of Force Majeure;
 - 2. any full or partial reduction in the electric output of Facility that is caused by or arises from (i) a mechanical or equipment breakdown or (ii) other mishap or events or conditions attributable to normal wear and tear or defects, unless such mishap is caused by Force Majeure;
 - 3. changes in market conditions that affect the cost of Subscriber Organization's supplies, or that affect demand or price for any of Subscriber Organization's products, or that otherwise render this Contract uneconomic or unprofitable for Subscriber Organization;

4. Subject to Section 10.I. of this Contract, Subscriber Organization's inability to obtain Governmental Approvals or Land Rights for the construction, ownership, operation and maintenance of Facility and the Company-Owned Interconnection Facilities, or Subscriber Organization's loss of any such Governmental Approvals or Land Rights once obtained;
 5. the lack of wind, sun or any other resource of an inherently intermittent nature;
 6. Subscriber Organization's inability to obtain sufficient fuel, power or materials to operate its Facility, except if Subscriber Organization's inability to obtain sufficient fuel, power or materials is caused solely by an event of Force Majeure;
 7. Subscriber Organization's failure to obtain additional funds, including funds authorized by a state or the federal government or agencies thereof, to supplement the payments made by Company pursuant to this Contract;
 8. a Forced Outage except where such Forced Outage is caused by an event of Force Majeure;
 9. litigation or administrative or judicial action pertaining to the Contract, the Site, the Facility, the Land Rights, the acquisition, maintenance or renewal of financing or any Governmental Approvals, or the design, construction, ownership, operation or maintenance of the Facility, the Company-Owned Interconnection Facilities or the Company System;
 10. a strike, work stoppage or labor dispute limited only to any one or more of the Indemnified Subscriber Organization Parties or any other third party employed by Subscriber Organization to work on the Project; or
 11. any full or partial reduction in the availability of the Facility to produce and deliver to the Point of Interconnection electric energy in response to Company Dispatch which is caused by any Third Party including, without limitation, any vendor or supplier of Subscriber Organization or Company, except to the extent due to Force Majeure.
- D. Satisfaction of Certain Conditions. This Contract defer or limit certain liabilities of a Party for delay and/or failure in performance to the extent such delay or failure is the result of conditions or events of Force Majeure; provided, however, that a Non-performing Party is only entitled to such limitations or deferrals of liabilities as and to the extent the following conditions are satisfied:
1. the Non-performing Party gives the other Party, within five (5) Days after the Non-performing Party becomes aware or should have become aware of the Force Majeure condition or event, but in any event no later than thirty (30) Days after the Force Majeure condition or event begins, written notice (the "Force Majeure Notice") stating that the Non-performing Party considers such condition or event to constitute Force Majeure and describing the particulars of such Force Majeure condition or event, including the date the Force Majeure commenced;
 2. the Non-performing Party gives the other Party, within fourteen (14) Days after the Force Majeure Notice was or should have been provided, a written explanation of the Force Majeure condition or event and its effect on the Non-performing Party's performance, which explanation shall include evidence reasonably sufficient to establish that the occurrence constitutes Force Majeure;
 3. the suspension of performance is of no greater scope and of no longer duration than is required by the condition or event of Force Majeure;
 4. the Non-performing Party exercises commercially reasonable efforts to remedy its inability to perform and provides written weekly progress reports to the other Party describing actions taken to end the Force Majeure; and
 5. When the condition or event of Force Majeure ends and the Non-performing Party is able to resume performance of its obligations under this Contract, that Party shall give the other Party written notice to that effect.
- E. Termination for Force Majeure. If Force Majeure delays or prevents a Party's performance for more than three hundred sixty-five (365) Days from the occurrence or inception of the Force Majeure, as stated in the Force Majeure Notice, and such delay or failure of performance would have otherwise constituted an Event of Default under Section 13. (Event of Default), the other Party shall have the right to terminate this Contract by written notice. Such notice shall designate the date such termination is to be effective, which date shall be no later than thirty (30) Days after such notice is deemed to be received by the Party whose performance has been delayed or prevented. In the event of termination pursuant to this Section 27.E (Termination for Force Majeure), neither Party shall be liable for any damages nor have any obligations to the other, except as provided in Section 26.L (Survival).

- F. Effect of Force Majeure. Other than as provided in Section 27.E. (Termination for Force Majeure), neither Party shall be responsible or liable for any delays or failures in its performance under this Contract as and to the extent (i) such delays or failures are substantially caused by conditions or events of Force Majeure, and (ii) the conditions of Section D. (Satisfaction of Certain Conditions) are satisfied.
- G. No Relief of Other Obligations. Except as otherwise expressly provided for in this Contract, the existence of a condition or event of Force Majeure shall not relieve the Parties of their obligations under this Contract (including, but not limited to, payment obligations) to the extent that performance of such obligations is not precluded by the condition or event of Force Majeure.
- H. No Extension of the Term. In no event will any delay or failure of performance caused by any conditions or events of Force Majeure extend this Contract beyond its stated Term.

28. **COMMUNITY OUTREACH.**

- A. The Parties acknowledge that, prior to the Execution Date, Subscriber Organization provided to Company a comprehensive community outreach and communications plan to work with and inform neighboring communities and stakeholders to gain their support for the Project ("Community Outreach and Engagement Plan"). Subscriber Organization agrees to work with neighboring communities and stakeholders and provide them timely information during all phases of the Project, including but not limited to the following information: Project description, Project stakeholders, community concerns and Subscriber Organization's efforts to address such concerns, Project benefits, government approvals, Project schedule, and a Community Outreach and Engagement Plan. Subscriber Organization's Community Outreach and Engagement Plan is a public document and shall remain available to members of the community on the Subscriber Organization's website for the Term of this Contract and upon request. Subscriber Organization shall also provide Company with links to its Project website and Community Outreach and Engagement Plan.
- B. Public Meeting; Public Comment Period. The Parties also acknowledge that, prior to the Execution Date, Subscriber Organization provided reasonable advance notice and hosted a public meeting for community and neighborhood groups in and around the vicinity of the Project site that provided neighboring community, stakeholders, and the general public with: (i) a reasonable opportunity to learn about the proposed Project; (ii) an opportunity to engage in a dialogue about concerns, mitigation measures, and potential community benefits of the proposed Project; and (iii) information concerning the process and/or intent for the public's input and engagement, including advising attendees that they will have thirty (30) Days from the date of said public meeting to submit written comments to Company and/or Subscriber Organization. Subscriber Organization shall collect all public comments, and then provide Company copies of all comments received in their original, unedited form. Subscriber Organization agrees that it will post all comments with personal information redacted on its website for public review. Comments should remain on the Subscriber Organization's website for at least two years after the Commercial Operations Date.
- C. Subscriber Organization acknowledges and agrees that any written comments from the public regarding the CBRE Project it receives after the 30-day public comment period will be submitted to Company in their original, unedited form. Subscriber Organization further agrees to post these subsequent public comments, with personal information redacted, on its website for public review for at least two years after the Commercial Operations Date.
- D. The Parties acknowledge and agree that Subscriber Organization is responsible for community outreach and engagement for the Project, and that the public meeting and comment solicitation process described in this Section 28 (Community Outreach) do not represent the only community outreach and engagement activities that can or should be performed by Subscriber Organization. Without limitation to the generality of the preceding sentence, Subscriber Organization agrees to take into account the Project's potential impacts on historical and cultural resources and, at a minimum, Subscriber Organization shall describe: (i) any valued cultural, historical, or natural resources in the area in question, including the extent to which traditional and customary native Hawaiian rights are exercised in the area; (ii) the extent to which those resources – including traditional and customary native Hawaiian rights – will be affected or impaired by the Project; and (iii) the feasible action, if any, to be taken to reasonably protect native Hawaiian rights if they are found to exist. Subscriber Organization shall determine and implement such additional means as may be reasonably necessary to share information with and involve the community and neighborhood groups in and around the vicinity of the Facility during the Project

planning and development process through the Term of this Contract, and shall timely inform Company of its plans and activities in this regard.

- E. Upon the Execution Date and at all times during the Term of this Contract, Subscriber Organization shall designate an individual as the "Subscriber Organization's Community Representative." The Subscriber Organization's Community Representative shall be the primary contact between the community and the Subscriber Organization and shall be available during the Term of this Contract to receive and answer questions from the community. As of the Execution Date, the Subscriber Organization's Community Representative shall be:

- Name: [name of Subscriber Organization's Community Representative]
- Contact Information: [email address]
- Subscriber Organization shall notify Company in writing upon designation of any new Subscriber Organization's Community Representative.

29. GENERATOR/EQUIPMENT CERTIFICATION.

CBRE Facilities that utilize inverter technology must be compliant with Institute of Electrical and Electronics Engineers IEEE Std 1547-2018, Underwriters Laboratories UL 1741 and the Company's Source Requirement Document Version 2.0 (though not preferred, Company will accept compliance with the Company's Source Requirement Document Version 1.1 for CBRE Projects executed prior to or on June 30, 2021) as well as the Company's Rule 14H and any additional requirements contained herein that apply to CBRE Facilities. CBRE Facilities that use a rotating machine must be compliant with applicable National Electrical Code, Underwriters Laboratories, and Institute of Electrical and Electronics Engineers standards and rules and orders of the Commission in effect at the time this Contract is executed. By signing below, the Applicant certifies that the installed generating equipment will meet the appropriate preceding requirement(s) and can supply documentation that confirms compliance, including a certification of the same from the Installing Electrical Contractor upon request by the Company. Notwithstanding the above, the CBRE Facility must still comply with the Performance Standards required in this Contract.

30. NOTICE AND DISCLAIMER REGARDING FUTURE TARIFF MODIFICATIONS.

- A. This Contract shall, at all times, be subject to modification by the Commission as said Commission may, from time to time, direct in the exercise of its jurisdiction. Without limiting the foregoing, Subscriber Organization expressly acknowledges the following:
1. The CBRE Tariff is subject to modification by the Commission.
 2. The CBRE Facility shall be subject to any future modifications ordered by the Commission. Subscriber Organization agrees to abide by and comply with and to pay for any costs related to such Commission-ordered modifications for the term of the Contract.
- B. **BY SIGNING BELOW, SUBSCRIBER ORGANIZATION ACKNOWLEDGES IT HAS READ, UNDERSTANDS AND AGREES TO ABIDE BY THE ABOVE SECTION 30. NOTICE AND DISCLAIMER.**

IN WITNESS WHEREOF, the Parties hereto have caused this Contract to be executed by their duly authorized representatives. This Contract is effective as of the Effective Date set forth above.

[Subscriber Organization]		[Hawai'i Electric Light Company, Inc. Maui Electric Company, Limited], a Hawai'i corporation
By: _____ Name: _____ Date: _____		By: _____ Name: _____ Date: _____

By: _____
Name: _____
Date: _____

MAILING ADDRESS [select as appropriate]

[Maui Electric Company, Ltd.
Attn: Renewable Energy Projects Division
P.O. Box 398
Kahului, HI 96733-6898]

[Hawai'i Electric Light Company, Inc

Hilo:
Hawai'i Electric Light Engineering
Attn: DER Program
54 Halekauila Street
Hilo, HI 96720

Kona:
Hawai'i Electric Light Engineering
Attn: DER Program
74-5519 Kaiwi Street
Kailua Kona, HI 96740]

ATTACHMENT A

SCHEDULE OF DEFINED TERMS

For the purposes of this Contract, the following capitalized terms shall have the meanings set forth below:

"**Acceptance Test**": A test conducted by Subscriber Organization and witnessed by Company, within thirty (30) Days of completion of all Interconnection Facilities and in accordance with criteria and test procedures determined by Company to determine conformance with Attachment F (Facility Owned by Subscriber Organization) and in accordance with Good Engineering and Operating Practices. Exhibit F-8 (Acceptance Test General Criteria) provides general criteria to be included in the written protocol for the Acceptance Test. Successful completion of the Acceptance Test shall be a condition precedent for the performance of the Control System Acceptance Test and the Commercial Operations Date.

"**Account Holder**": The primary account holder for each physical residence or business address on the island serviced by the Company, as identified in Company's records. An Account Holder is not a Subscriber until such Account Holder has been successfully enrolled in Facility's CBRE Program.

"**Active Power Control Interface**": Shall have the meaning set forth in Section 1(g) (Active Power Control Interface) of Attachment F (Facility Owned by Subscriber Organization) of this Contract.

"**Active Turbine Hours (ACTH)**": Shall have the meaning set forth in Attachment J (Calculation of Certain Metrics) of this Contract.

"**Actual Output**": The total quantity of electric energy (measured in kilowatt hours) produced by the CBRE Facility over a given time period and delivered to the Point of Interconnection, as measured by the Revenue Meter. "Actual Output" is the equivalent of "Net Energy."

"**Allowed Capacity**": Shall have the meaning set forth in Section 5(f) of Exhibit F-1 (Description of Generation and Battery Storage Facilities) to this Contract.

"**Applicable Period Lump Sum Payment**": For each applicable period, the total amount of Lump Sum Payment payable during such period, as such amount may be calculated and adjusted from time to time as set forth in Section 4.B (Lump Sum Payment) of this Contract and/or Section 3 (Calculation of Lump Sum Payment) of Attachment B to this Contract.

"**Applicable NEP Verification Date**": For the Initial OEPR, the Initial NEP Verification Date. For any Subsequent OEPR, the first Day of the calendar month following the calendar month during which there occurs the second anniversary of the event (e.g., completion of equipment replacement) which occasioned the preparation of such Subsequent OEPR.

"**Baseline SO Payment**": For each calendar month, the balance of **[the ~~monthly Energy Payment and~~ the monthly Lump Sum Payment remaining after subtracting the Bill Credits payable for such month. **[Drafting note: If Contract has ~~energy payment~~an Energy Payment, include language in bold text.]****

"**Battery Energy Storage System**" or "**BESS**": The battery energy storage system as described in Attachment F (Facility Owned by Subscriber Organization) to the Contract, together with all other equipment, devices, and associated appurtenances owned, controlled, operated and managed by Subscriber Organization in connections, with or to facilitate, the storage, transmission, delivery or furnishing by Subscriber Organization to Company of the electric energy stored in the BESS.

"**BESS Allocated Portion of the Lump Sum Payment**": For each BESS Measurement Period and for any other applicable period, an amount equal to fifty percent (50%) of the total of the three monthly Lump Sum Payments for such period without taking into account any set-offs against such monthly Lump Sum Payments.

"BESS Annual Equivalent Availability Factor": Shall be as described in Attachment C, Section 4. (BESS Annual Equivalent Availability Factor) to this Contract.

"BESS Capacity Performance Metric": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) to this Contract.

"BESS Capacity Cure Period": Shall have the meaning set forth in Attachment C, Section 3. (BESS Capacity Test; Liquidated Damages; Termination Rights).

"BESS Capacity Ratio": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) to this Contract.

"BESS Capacity Test": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) to this Contract.

"BESS Contract Capacity": The storage capacity, in MWh, of the BESS, or ___ MWh.

"BESS EAF Performance Metric": Shall have the meaning set forth in Attachment C Section 4. (BESS Annual Equivalent Availability Factor and Liquidated Damages).

"BESS EFOF Performance Metric": Shall have the meaning set forth in Attachment C Section 4. (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages).

"BESS Measurement Period": Shall mean, in any Contract Year, the following periods of three calendar months each: (i) the period beginning on the first day of the first calendar month of such Contract Year and extending through the last day of the third calendar month of such Contract Year; (ii) the period beginning on the first day of the fourth calendar month of such Contract Year and extending through the last day of the sixth calendar month of such Contract Year; (iii) the period beginning on the first day of the seventh calendar month of such Contract Year and extending through the last day of the ninth calendar month of such Contract Year; and (iv) the period beginning on the first day of the tenth calendar month of such Contract Year and extending through the last day of the twelfth calendar month of such Contract Year.

"BESS Measurement Period Report": For each BESS Measurement Period, the report of the data necessary for calculation of the Performance Metrics for such BESS Measurement Period to be provided by Subscriber Organization to Company in the form set forth in Section 1 (Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract or such other form as the Company may approve in writing.

"Bill Credit" shall mean the dollar amount payable by means of a credit by the Company to each Subscriber on the Subscriber's retail electric service bill, which represents the Subscriber's beneficial share of the Contract Capacity by which renewable energy is produced by the Facility and exported to the Company, and offsetting Subscriber's current renewable energy usage on such service bill. For each calendar month for which a Subscriber earns a Bill Credit, such dollar amount shall equal such Subscriber's Subscriber Allocation of [**the monthly Energy Payment for the month in question and**] the monthly Lump Sum Payment for the month in question. [**Drafting note: For Contract with Energy Payment, include language in bold text.**]

"Bill Credit Rate": shall mean the then current applicable "Credit Rate" as determined by the CBRE Tariff. The CBRE Tariff prescribes a specific Credit Rate in the event that CBRE Small Project Phase 2 Capacity (as defined in the CBRE Tariff) is not filled for any island and a competitive credit rate procurement ("CCRP") mechanism to set the Credit Rate if there are more applications for CBRE Small Project Phase 2 Capacity than is available for any island.

"Bill of Material": A list of equipment to be installed at the Facility including, but not necessarily limited to, items such as relays, breakers, and switches.

"BOP": The "balance of the plant", i.e., the infrastructural components of the Facility (excluding the WTG(s)) which support transfer of energy between the WTG(s) and the Point of Interconnection. The infrastructure normally consists of the site electrical facilities, SCADA and the civil plant (such as foundations and roads), which support the operation and maintenance of the WTG(s).

"BOP Benchmark Metric" The standard against which the BOP Efficiency Ratio is to be evaluated to determine if the BOP is achieving satisfactory standards of efficiency, : "BOP Efficiency Ratio": For each Contract Year, the estimated efficiency of the Facility during such Contract Year in delivering to the Point of Interconnection the electric energy produced by the WTG(s).

"Business Day": Any calendar day that is not a Saturday, a Sunday, or a federal or Hawai'i state holiday.

"CBRE Facility": Subscriber Organization's renewable electric energy facility that is the subject of this Contract, including the WTG System, the BESS, all Subscriber Organization-Owned Interconnection Facilities and all other equipment, devices, associated appurtenances owned, controlled, operated and managed by Subscriber Organization in connection with, or to facilitate, the production, generation, storage, transmission, delivery or furnishing of electric energy by Subscriber Organization to Company and required to interconnect with the Company System.

"CBRE Framework": means the CBRE Framework (Phase 1), as amended and supplemented by the CBRE Framework (Phase 2).

"CBRE Framework (Phase 1)": means that certain "Community-Based Renewable Energy – A Program Framework" issued by the PUC and attached as Attachment A to that certain Decision and Order No. 35137, filed December 22, 2017, in Docket No. 2015-0389, portions of which are applicable to Phase 2 of the CBRE Program as specified in the CBRE Tariff.

"CBRE Framework (Phase 2)": means ~~the framework established by the Commission pursuant to that certain~~ Order No. 37070, ~~issued~~ April 9, 2020, in Docket No, 2015-0389. The ~~Phase 2~~ CBRE Framework (Phase 2) provides the basis and framework for Phase 2 of the CBRE Program and is implemented by the CBRE Tariff.

"CBRE IO": means the Independent Observer contracted with the Company but answering to the PUC to carry out the responsibilities assigned to the Independent Observer under the Phase 2 CBRE Framework.

"CBRE Online Portal": is the interactive, internet website-based interface maintained by or on behalf of the Company through which the Subscriber Organization may establish qualifications, provide information and complete documents necessary for acceptance in the CBRE Program, and may enter or change the Monthly Subscription Information reflecting updated information for each Subscriber, including any changes to any Subscriber's name, account number, address, and Subscriber Allocation. For Phase One of the CBRE Program, the CBRE Online Portal will be a manually administered application form-based process managed by Company until the CBRE Online Portal is online and ready for commercial operation. The CBRE Online Portal should be completed in time for the commencement of Phase Two of the CBRE Program.

~~"CBRE Project": A community-based renewable energy project subject to the CBRE Tariff.~~

"CBRE Program": The program established under the CBRE Tariff to allow developers of renewable energy projects to provide Account Holders with an opportunity to avail themselves of the benefits of the CBRE Tariff.

~~"CBRE Project": A community-based renewable energy project subject to the CBRE Tariff.~~

"CBRE Subscriber Thresholds": Each of the following is a CBRE Subscriber Threshold: (i) the requirement that Unsubscribed RDG not exceed 15% of Contract Capacity; (ii) the requirement that the Facility's CBRE Program have a minimum of four individual Subscribers; (iii) the requirement that the total Subscriber Allocations for all Residential Subscribers be not less than 40% of Contract Capacity; (iv) the requirement that, if Seller's Subscriber Organization's Response to RFP included an Enhanced Residential Threshold, the total Subscriber Allocations for all Residential Subscribers be not less than the Enhanced Residential Threshold; and (v) if Seller's Subscriber Organization's Response to RFP included an LMI Minimum Threshold, the total Subscriber Allocations for all LMI Subscribers be not less than the LMI Minimum Threshold.

"CBRE Tariff": The rules for Phase 2 of the CBRE Program approved by the PUC as Tariff Rule 29 based on the CBRE Framework (Phase 2).

"Commercial Operations": Upon satisfaction of the following conditions, the Facility shall be considered to have achieved Commercial Operations on the Day specified in Subscriber Organization's written notice described below: (i) the Acceptance Test has been passed, (ii) all generating units have passed Control System Acceptance Tests, (iii) the Transfer Date has occurred, (iv) Subscriber Organization has (1) provided to Company the Required Models (as defined in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of Attachment F (Facility Owned by Subscriber Organization)) in the form of Source Code, (2) placed the current version of the Source Code for the Required Models with the Source Code Escrow Agent as required in Section 6(b)(i)(A) (Establishment of Source Code Escrow) of Attachment F (Facility Owned by Subscriber Organization), or (3) if Subscriber Organization is unable to arrange for the placement of the appropriate Source Code into the Source Code Escrow account, placed the required funds with the Monetary Escrow Agent as required in Section 6(b)(ii)(A) (Establishment of Monetary Escrow) of Attachment F (Facility Owned by Subscriber Organization), and (v) Subscriber Organization provides Company with written notice that (aa) Subscriber Organization is ready to declare the Commercial Operations Date and (bb) the Commercial Operations Date will occur within 24 hours (i.e., the next Day).

"Commercial Operations Date" or "COD": The date on which Facility first achieves Commercial Operations.

"Commercial Operations Date Deadline": Shall have the meaning set forth in Section 10.I.1 of this Contract.

~~"Commercial Operations Date" or "COD": The date on which Facility first achieves Commercial Operations.~~

"Company": Shall have the meaning set forth in the preamble to this Contract.

"Company-Designated NEP Estimate": The estimated Net Energy Potential of the CBRE Facility as designated by Company pursuant to Section 1.C. (NEP IE Estimate and Company-Designated NEP Estimate) of Attachment D (Calculation and Adjustment of Net Energy Potential) this Contract.

"Company Dispatch": Company's right, through supervisory equipment or otherwise, to direct or control both the capacity and the energy output of the CBRE Facility from its minimum output rating to its maximum output rating consistent with this Contract (including, without limitation, Good Engineering and Operating Practices, which dispatch shall include real power, reactive power, voltage, frequency, the determination to ~~eyele a unit off line~~take generating or ~~to restart a unit, the~~storage equipment offline or online, frequency droop ~~control~~ setting, the ramp rate setting, and other characteristics of such electric energy output whose parameters are normally controlled or accounted for in a utility dispatching system.

"Company-Owned Interconnection Facilities": Shall have the meaning set forth in of Attachment G (Company-Owned Interconnection Facilities).

"Company System": The electric system owned and operated by Company (to include any non-utility owned facilities) consisting of power plants, transmission and distribution lines, and related equipment for the production and delivery of electric power to the public.

"Company System Operator": The authorized representative of Company who is responsible for carrying out Company dispatch and curtailment of electric energy generation interconnected to the Company System.

"Company's Recommendations": Shall have the meaning set forth in Section 4(c) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Competitive Bidding Framework": The Framework for Competitive Bidding contained in Decision and Order No. 23121 issued by the Public Utilities Commission on December 8, 2006, and any subsequent orders providing for modifications from those set forth in Order No. 23121 issued December 8, 2006.

"Consultants List": Shall have the meaning set forth in Exhibit F-2 (Consultants List) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Contract Capacity": Shall have the meaning set forth in Attachment F - Exhibit F-1 (Description of Generation and Battery Storage Facilities) to this Contract.

"Contract Year": A twelve (12) calendar month period commencing on either: (i) the Commercial Operations Date (if the Commercial Operations Date occurs on the first Day of a calendar month) and thereafter on each anniversary of the Commercial Operations Date; or (ii) the first Day of the calendar month following the month during which the Commercial Operations Date occurs, and thereafter on each anniversary of the first Day of such month; provided, however, that, in the latter case, the initial Contract Year shall also include the Days from the Commercial Operations Date to the first Day of the succeeding calendar month.

"Control System Acceptance Test(s)" or "CSAT": A test or tests performed on the centralized and collective control systems and Active Power Control Interface of the CBRE Facility, which includes successful completion of the Control System Telemetry and Control List, in accordance with procedures set forth in Exhibit F-7 (Control System Acceptance Test Criteria) to Attachment F (Facility Owned by Subscriber Organization) of the Contract.

"Control System Telemetry and Control List": The Control System Telemetry and Control List includes, but is not limited to, all of the Facility's equipment and generation performance/quality parameters that will be monitored, alarmed and/or controlled by Company's Energy Management System (EMS) throughout the Term of this Contract.

Examples of the Control System Telemetry and Control List include:

Subscriber Organization's substation/equipment status – breaker open/closed status, equipment normal/alarm operating status, etc.

Subscriber Organization's ~~generation~~generating [and storage] data (analog values) – number of ~~generators~~inverters available/online, voltage, current, MW, MVAR, etc. [Storage state of charge]

~~Subscriber Organization's generation performance (status and/or analog values) – ramp rate, generator frequency, etc.~~

Active Power control interface – dispatch MW setpoint, etc.

Voltage control interface – voltage kV setpoint, etc.

Power factor control interface – power factor setpoint, etc.

"Day": A calendar day.

"Density-Adjusted Wind Speed": For each 10-minute increment for each WTG, the 10-minute averaged wind speed measurement from a calibrated anemometer on top of the nacelle for such turbine as adjusted for temperature and pressure as provided in Section 3 (Calculation of Density-Adjusted Wind Speed) of Attachment J (Calculation of Certain Metrics) to this Contract.

"Disconnection Event": Shall have the meaning set forth in Section 4(a) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Dispute": Shall have the meaning set forth in Section 17. of this Contract.

"DPR": Shall have the meaning set forth in Section 17. of this Contract.

"EMS" or "Energy Management System": The real-time, computer-based control system, or any successor thereto, used by Company to manage the supply and delivery of electric energy to its consumers. It provides the Company System Operator with an integrated set of manual and automatic functions necessary for the operation of the Company System under both normal and emergency conditions. The EMS provides the interfaces for the Company System Operator to perform real-time monitoring and control of the Company System, including but not limited to monitoring and control

of the Facility for system balancing, supplemental frequency control and economic dispatch as prescribed in this Contract.

"Energy Payment": The amount that Company will pay Subscriber Organization for electric energy delivered to Company in accordance with the terms and conditions of this Agreement Contract on a monthly basis as set forth in Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. . **[Drafting note: Delete if Contract does not include an Energy Payment.]** "Enhanced Residential Threshold": A specific percentage of Contract Capacity in excess of 40% committed to by Subscriber Organization in its proposal as the percentage to be represented by Subscriber Allocations for Residential Subscribers. The Enhanced Residential Threshold for this Contract is __%. **[Drafting note: If there is no Enhanced Residential Threshold enter "N/A" in the blank.]**

"Environment": Shall have the meaning set forth in Section 1(b) (iii) (G) (iii) (Malware) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Environmental Credits": Any environmental credit, offset, or other benefit allocated, assigned or otherwise awarded by any Governmental Authority, international agency, or non-governmental renewable energy certificate accounting and verification organization to Company or Subscriber Organization based in whole or in part on the fact that the CBRE Facility is a non-fossil fuel facility. Such Environmental Credits shall include, without limitation, the non-energy attributes of renewable energy including, but not limited to, any avoided emissions of pollutants to the air, soil, or water such as sulfur dioxide, nitrogen oxides, carbon monoxide, particulate matter, and hazardous air pollutants; any other pollutant that is now or may in the future be regulated under the pollution control laws of the United States; and avoided emissions of carbon dioxide and any other greenhouse gas, along with the renewable energy certificate reporting rights to these avoided emissions, but in all cases shall not mean tax credits.

"Equivalent Forced Derated Turbine Hours (EFDTH)": Shall have the meaning set forth in Attachment J (Calculation of Certain Metrics) to this Contract.

"Equivalent Maintenance Turbine Hours (EMDTH)": Shall have the meaning set forth in Attachment J (Calculation of Certain Metrics) to this Contract.

"Equivalent Planned Turbine Hours (EDPTH)": Shall have the meaning set forth in Attachment J (Calculation of Certain Metrics) to this Contract.

"Event of Default": Shall have the meaning set forth in Section 13. (Events of Default By Subscriber Organization) of this Contract.

"Excess Energy Conditions": An operating condition on the Company System that may occur when Company has more energy available than is required to meet the load on the Company System at any point in time and the generating assets interconnected with the Company System are operating at or near their minimum levels, taking into consideration factors such as the need to maintain system reliability and stability under changing system conditions and configurations, the need for downward regulating reserves, the terms and conditions of power purchase Contracts for base-loaded firm capacity or scheduled energy, and the normal minimum loading levels of such units.

"Execution Date": The date designated as such on the first page of this Contract or, if no date is so designated, the date the Parties exchanged executed signature pages to this Contract.

"Facility's CBRE Program": The program offered by Subscriber Organization whereby Subscribers are afforded the opportunity to obtain benefits of the CBRE Tariff by acquiring a beneficial interest in the Contract Capacity by which renewable energy is produced by the Facility and exported to Company. The Facility's CBRE Program includes the entire process of marketing and sales of, or subscriptions to, the Subscriber Allocations, enrolling Subscribers, providing Company with the information necessary to afford each Subscriber the Bill Credit to which such Subscriber is entitled, responding to Subscriber inquiries, facilitating the transfer of Subscriber interests and buying back Subscriber interests. The Facility's CBRE Program shall have a duration of 20 years commencing on the Commercial Operations Date.

"Federal Non-Refundable Tax Credit": Shall mean any U.S. federal tax credit for which the federal government is not required to refund any tax credit which exceeds the tax payments due to the federal government by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"Federal Refundable Tax Credit": Shall mean any U.S. federal tax credit for which the federal government is required to refund any tax credit which exceeds the tax payments due to the federal government by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"First Benchmark Period": The period commencing on the Commercial Operations Date and ending on the last Day of the calendar month during which an OEPR Evaluator issues the Initial OEPR. During the First Benchmark Period, the First NEP Benchmark shall be the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment as provided in Section 3.A. (Lump Sum Payment During First Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.

"First NEP Benchmark": The estimate of Net Energy Potential that is used to calculate the Lump Sum Payment during the First Benchmark Period as provided in Section 3.A. (Lump Sum Payment During First Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. The "First NEP Benchmark" shall consist of whichever of the following is applicable as of the Commercial Operation Date, as more fully provided in Section 1.C. (NEP IE Estimate and Company-Designated NEP Estimate) and Section 1.D. (NEP IE Estimate, Liquidated Damages and Subscriber Organization's Null and Void Right) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract: (i) NEP RFP Projection, (ii) NEP IE Estimate, (iii) Company-Designated NEP Estimate or (iv) such other amount as the Parties may agree in writing.

"First OEPR": Shall have the meaning set forth in Section 2.F. (Timeline and Fees) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Force Majeure": An event that satisfies the requirements of Section 27.A. (Definition of Force Majeure), Section 27.B. (Events That Could Qualify as Force Majeure) and Section 27.C. (Exclusions From Force Majeure).

"Forced Turbine Hours (FTH)": Shall have the meaning set forth in Attachment J to this Contract.

"Forced Outage": A start failure or unplanned outage reported consistently with the principles in the NERC GADS REPORTING INSTRUCTIONS for SF, U1, U2 and U2 events. This may be a startup failure, a condition resulting in immediate shutdown or trip, or an outage which requires removal from the in-service state before the end of the next weekend (Sunday at 2400 or before Sunday turns into Monday). This type of outage can only occur while the resource is in service.

"Full Dispatch": A time period during which all inverters are available and there are no technical restrictions or limitations affecting generation imposed to meet Company Dispatch.

"Good Engineering and Operating Practices": The practices, methods and acts engaged in or approved by a significant portion of the electric utility industry for similarly situated U.S. facilities, considering Company's isolated island setting, that at a particular time, in the exercise of reasonable judgment in light of the facts known or that reasonably should be known at the time a decision is made, would be expected to accomplish the desired result in a manner consistent with law, regulation, reliability for an island system, safety, environmental protection, economy and expedition. With respect to the CBRE Facility, Good Engineering and Operating Practices include, but are not limited to, taking reasonable steps to ensure that:

Adequate materials, resources and supplies, are available to meet the CBRE Facility's needs under normal conditions and reasonably foreseeable abnormal conditions.

Sufficient operating personnel are available and are adequately experienced and trained to operate the CBRE Facility properly, efficiently and within manufacturer's guidelines and specifications and are capable of responding to emergency conditions.

Preventive, routine and non-routine maintenance and repairs are performed on a basis that ensures reliable long-term and safe operation, and are performed by knowledgeable, trained and experienced personnel utilizing proper equipment, tools, and procedures.

Appropriate monitoring and testing is done to ensure equipment is functioning as designed and to provide assurance that equipment will function properly under both normal and reasonably foreseeable abnormal conditions.

Equipment is operated in a manner safe to workers, the general public and the environment and in accordance with equipment manufacturer's specifications, including, without limitation, defined limitations such as temperature, current, frequency, polarity, synchronization, control system limits, etc.

"Governmental Approvals": All permits, licenses, approvals, certificates, entitlements and other authorizations issued by Governmental Authorities, as well as any agreements with Governmental Authorities, required for the construction, ownership, operation and maintenance of the CBRE Facility and the Company-Owned Interconnection Facilities, and all amendments, modifications, supplements, general conditions and addenda thereto.

"Governmental Authority": Any federal, state, local or municipal governmental body; any governmental, quasi-governmental, regulatory or administrative agency, commission, body or other authority exercising or entitled to exercise any administrative, executive, judicial, legislative, policy, regulatory or taxing authority or power; or any court or governmental tribunal.

"GPI": Shall have the meaning set forth in Section 3.C. (Assurance of Capability of CBRE Facility to Deliver Net Energy Potential and Availability of BESS) of this Contract.

"GPI Metric": Shall be as determined under Section 2 (b). (GPI Metric and Liquidated Damages) of Attachment C to this Contract.

"Hawai'i Investment Tax Credit": Shall mean a credit against Hawai'i source income for which Subscriber Organization is eligible on the Commercial Operations Date or thereafter because of investment in renewable energy technologies incorporated into the CBRE Facility.

"Hawai'i Non-Refundable Tax Credit": Shall mean any Hawai'i Investment Tax Credit for which the State of Hawai'i is not required to refund any tax credit which exceeds the tax payments due to the State of Hawai'i by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"Hawai'i Production Tax Credit": Shall mean a credit against Hawai'i source income for which Subscriber Organization is eligible on the Commercial Operations Date or thereafter because of the energy produced by the CBRE Facility.

"Hawai'i Refundable Tax Credit": Shall mean any Hawai'i Investment Tax Credit for which the State of Hawai'i is required to refund any tax credit which exceeds the tax payments due to the State of Hawai'i by the Claiming Entity or to provide a cash rebate in lieu of such credit to the Claiming Entity.

"Hawai'i Renewable Energy Tax Credit": The Hawai'i Investment Tax Credit and the Hawai'i Production Tax Credit.

"HERA": The Hawai'i Electricity Reliability Administrator.

"HERA Law": Act 166 (Haw. Leg. 2012), which was passed by the 27th Hawai'i Legislature in the form of S.B. No. 2787, S.D. 2, H.D.2, C.D.1 on May 2, 2012 and signed by the Governor on June 27, 2012. The effective date for the law is July 1, 2012. The HERA Law authorizes (i) the PUC to develop, adopt, and enforce reliability standards and interconnection requirements, (ii) the PUC to contract for the performance of related duties with a party that will serve as the HERA, and (iii) the collection of a Hawai'i electricity reliability surcharge to be collected by Hawai'i's electric utilities and used by the HERA. Reliability standards and interconnection requirements adopted by the PUC pursuant to the HERA Law will apply to any electric utility and any user, owner, or operator of the Hawai'i electric system. The PUC also is provided with the authority to monitor and compel the production of data, files, maps, reports, or any other

information concerning any electric utility, any user, owner or operator of the Hawai'i electric system, or other person, business, or entity, considered by the eCommission to be necessary for exercising jurisdiction over interconnection to the Hawai'i electric system, or for administering the process for interconnection to the Hawai'i electric system.

"House Power": shall mean the electricity needed to assist in the operation of the CBRE Facility including system performance monitoring and associated communications, except for energy directly required for the local control and safe operation of the WTG System and BESS. It also means other electricity used by the CBRE Facility, such as for perimeter lighting, a visitor's center or any other structures or facilities at the CBRE Facility site.

"Independent AF Evaluator": A person empowered, pursuant to Section 2(e) (Appointment of Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to resolve disagreements due to failure of the Parties to resolve a Monthly Report Disagreement.

"Initial NEP OEPR Estimate": The NEP OEPR Estimate set forth in or derived from the Initial OEPR, as more fully set forth in Section 2.E (Terms of Engagement) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Initial NEP Verification Date": The first Day of the calendar month following the calendar month during which there occurs the second anniversary of the Commercial Operations Date.

"Initial OEPR": The OEPR to be prepared pursuant in Section 1.E. (Initial OEPR) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Interconnection Facilities": The equipment and devices required to permit the CBRE Facility to operate in parallel with, and deliver electric energy to, the Company System and provide reliable and safe operation of, and power quality on, the Company System (in accordance with applicable provisions of the PUC's General Order No. 7, Company tariffs, operational practices, interconnection requirements studies, and planning criteria), such as, but not limited to, transmission and distribution lines, transformers, switches, and circuit breakers.

"Interconnection Requirements Study" or "IRS": A study, consisting of a system impact study and a Facility study, performed in accordance with the terms of the IRS Letter Agreement to determine, among other things, (a) the system requirements and equipment requirements to interconnect the CBRE Facility with the Company System, (b) the Performance Standards for the CBRE Facility, and (c) an estimate of interconnection costs and project schedule for interconnection of the CBRE Facility.

"IRS Amendment": Shall have the meaning ascribed to such term in Section 3.C.1 (Interconnection Requirements Study).

"IRS Amendment Deadline": The 75th Day following the date the completed IRS is provided to Subscriber Organization, or such later date as Company and Subscriber Organization may agree to by written agreement

"IRS Letter Agreement" or "IRS Letter Agreements": The system impact study and Facility study letter agreements (which may be combined into one letter agreement) and any written, signed amendments thereto, between Company and Subscriber Organization that collectively describe the scope, schedule, and payment arrangements for the Interconnection Requirements Study.

"IRS Termination Deadline": The 30th Day following the date the completed IRS is provided to Subscriber Organization, or such later date as Company and Subscriber Organization may agree to by a written agreement

"Interface Block Diagram": The visual representation of the signals between Subscriber Organization and Company, including but not limited to, Telemetry and Control points, digital fault recorder settings, telecommunications and protection signals.

"kV": Kilovolt.

"kW": Kilowatt. Unless expressly provided otherwise, all kW values stated in this Contract are alternating current values and not direct current values.

"kWh": Kilowatt-hour.

"Land Rights": All easements, rights of way, licenses, leases, surface use agreements and other interests or rights in real estate.

"Laws": All federal, state and local laws, rules, regulations, orders, ordinances, permit conditions and other governmental actions.

"LD Assessment Date": For the last month of each LD Period, the Day following the expiration of the 10-Business Day period provided for Company to submit a Notice of Disagreement pursuant to Section 2(a) (Notice of Disagreement With Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"LDT": Shall have the meaning set forth in Attachment C, Section 7 (a) (RTE Test and Liquidated Damages).

"LMI Minimum Threshold": A specific percentage of Contract Capacity committed to by Subscriber Organization in its proposal as the percentage to be represented by Subscriber Allocations for LMI Subscribers. The Minimum LMI Threshold for this Contract is __%. **[Drafting note: The percentage shall be taken from Subscriber Organization's proposal if that proposal included a LMI Minimum Threshold. If there is no LMI Minimum Threshold enter "N/A" in the blank. For dedicated LMI projects, the LMI Minimum Threshold is 100%.]**

"LMI Subscriber": A Subscriber who satisfies the LMI requirements set forth in the CBRE Tariff.

"LD Period": A rolling period of twelve (12) calendar months each. At the end of each calendar month, the LD Period rolls forward to include the next calendar month. The initial "LD Period" shall consist of the 12 full calendar months of the initial Contract Year.

"Losses": Any and all direct, indirect or consequential damages, fines, penalties, deficiencies, losses, liabilities (including settlements and judgments), costs, expenses (including reasonable attorneys' fees and court costs) and disbursements.

"Lowest BESS Capacity Bandwidth": Shall have the meaning set forth in Attachment C Section 4. (BESS Capacity Test; Liquidated Damages; Termination Rights).

"Lump Sum Payment": The monthly lump sum as provided in Section 2. (Lump Sum Payment for Purchase of Dispatchability) of Attachment B to this Contract (Company Payments for Energy, Dispatchability and Availability of BESS. **[Drafting note: If Contract has an energy paymentEnergy Payment, replace first sentence above with the following:** The payment to be made by Company in exchange for (i) the availability of the Facility's Net Energy Potential for Company Dispatch in accordance with this Contract and (ii) the availability of the BESS.]

"Maintenance Turbine Hours (MTH)": Shall have the meaning set forth in Attachment J to this Contract.

"Malware": means computer software, code or instructions that: (a) intentionally, and with malice intent by a third party, adversely affect the operation, security or integrity of a computing, telecommunications or other digital operating or processing system or environment, including without limitation, other programs, data, databases, computer libraries and computer and communications equipment, by altering, destroying, disrupting or inhibiting such operation, security or integrity; (b) without functional purpose, self-replicate without manual intervention; (c) purport to perform a useful function but which actually performs either a destructive or harmful function, or perform no useful function other than utilize substantial computer, telecommunications or memory resources with the intent of causing harm; or (d) without authorization collect and/or transmit to third parties any information or data; including such software, code or instructions commonly known as viruses, Trojans, logic bombs, worms, adware and spyware.

"Management Meeting": Shall have the meaning set forth in Section 17.B. (Dispute Resolution).

"Maximum Rated Output": Net maximum output of the BESS in MW, which shall not exceed the Allowed Capacity.

"Measured Performance Ratio" or "PI": Shall have the meaning set forth in Attachment J (Calculation of Certain Metrics) of this Contract.

"Measured Power Curve": For each WTG, the measured power curve for such turbine for the initial Contract Year as (i) calculated as set forth in Section 4 (Determination of Measured Power Curve) of Attachment J (Calculation of Certain Metrics) to this Contract, (ii) agreed by the Parties as set forth in Section 3(b) (Submission of MPC Disagreement to Independent AF Evaluator) or (iii) decided by the Independent AF Evaluator as set forth in Section 4(d) (Written Decision of Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"Measured Wind Speed": For each WTG, the arithmetic mean, over any given period of time, of the wind speed readings from such turbine's nacelle anemometer, taken or sampled every two (2) seconds by the Facility's Monitoring and Communication Equipment, in miles per hour (mph). For calculations under this Contract based on Measured Wind Speed in m/s, the conversion factor shall be 1 mph = 0.447 m/s.

"MMT": Meteorological monitoring tower.

"Modified Pooled OMC Equipment Availability Factor Performance Metric": Shall have the meaning set forth in Section 1 of Attachment J (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages).

"Monthly Progress Report": Shall have the meaning set forth in Attachment E (Monthly Progress Report).

"Monthly Report": The report of the data (for the calendar month and the LD Period, the PI Assessment Period and the BESS Measurement Period ending with such calendar month) necessary for the calculation of the Performance Metrics to be provided by Subscriber Organization to Company as set forth in Section 1. (Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract. Without limitation to the generality of the preceding sentence, references to the Monthly Report for a month that constitutes the last month of a BESS Measurement Period shall be deemed to include the BESS Measurement Period Report for such BESS Measurement Period.

"Monthly Report Disagreement": Any disagreement arising out of the same Monthly Report.

"Monthly Subscription Information": shall mean the information stored within the CBRE Online Portal, as timely entered or changed by the Subscriber Organization via the CBRE Online Portal, setting forth the name, account number and service address each Subscriber holding subscriptions in the CBRE Facility, and the Subscriber Allocation applicable to each such Subscriber's subscription, reflecting each Subscriber's allocable portion of renewable energy produced by the CBRE Facility during a particular Production Month.

"Most Recent Prior NEP Benchmark": In the event a Subsequent OEPR is prepared for an OEPR Period of Record ending on or after the commencement of the fourth (4th) Contract Year, the "Most Recent Prior NEP Benchmark" shall be (i) for the first such Subsequent OEPR, the Second NEP Benchmark that was used to calculate the Lump Sum Payment for the last month of the Second Benchmark Period pursuant to Section 3.B. of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract and (ii) for all Subsequent OEPRs prepared after the aforementioned first Subsequent OEPR, the NEP OEPR Estimate obtained from the immediately preceding Subsequent OEPR.

"MPC Disagreement": Shall have the meaning set forth in Section 3(a) (Notice of Disagreement with Determination of Measured Power Curve) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator).

"MW": Megawatt. Unless expressly provided otherwise, all MW values stated in this Contract are alternating current values and not direct current values.

"MWh": Megawatt-hour.

"NEP IE Estimate": The estimated Net Energy Potential of the CBRE Facility to which the IE Energy Assessment Report assigns a P-Value of 95 for a ten-year period.

"NEP OEPR Estimate": For each OEPR, the estimated Net Energy Potential of the CBRE Facility to which such OEPR assigns a P-Value of 95 for a ten-year period.

"NEP RFP Projection": The Net Energy Potential of the CBRE Facility to which the Subscriber Organization in Subscriber Organization's RFP Proposal assigns a P-Value of 95 for a ten-year period.

"NERC GADS": Shall have the meaning set forth in Section 4.C, (Assurance of Capability of CBRE Facility to Deliver Net Energy Potential and Availability of BESS) of this Contract.

"Net Amount": Shall mean, with respect to any Hawai'i Renewable Tax Credit, the amount remaining after deducting any documented and reasonable financial, legal, administrative and other costs and expenses of applying for, pursuing, monetizing and receiving the applicable Hawai'i Renewable Tax Credit, and all payments to or reserves required by Subscriber Organization's lenders or other financing parties in connection with the application for or receipt of such Hawai'i Renewable Tax Credit.

"Net Energy": The total quantity of electric energy (measured in kilowatt hours) produced by the CBRE Facility over a given time period and delivered to the Point of Interconnection, as measured by the Revenue Meter. "Net Energy" the equivalent of "Actual Output."

"Net Energy Potential": The estimated single number with a P-Value of 95 for the annual Net Energy that could be produced by the CBRE Facility based on the estimated long-term monthly and annual total of such production over a ten-year period. The Net Energy Potential is subject to adjustment as provided in Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract, but in no circumstances shall the Net Energy Potential exceed the NEP RFP Projection.

"Notice of Disagreement": Shall have the meaning set forth in Section 2(a) (Notice of Disagreement with Monthly Report) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"Notice of MPC Disagreement": The written notice of MPC Disagreement submitted by SellerSubscriber Organization within the 30-Day period set forth in Section 3(a) (Notice of Disagreement with Measured Power Curve Determination) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"OEPR": An Operational Energy Production Report, including the Initial OEPR and each Subsequent OEPR.

"OEPR Conference": Shall have the meaning set forth in Section 2.G, (Review of the First OEPR Evaluator Report) of this Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"OEPR Consultants List": The engineering firms listed in Section 2.J, (Acceptable Persons and Entities) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract, as such list may be expanded or contracted by the Parties as provided in Section 2.B, (Eligibility for Appointment as OEPR Evaluator) of said Attachment D (Calculation and Adjustment of Net Energy Potential) or Section 2.(f) (Eligibility for Appointment as Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"OEPR Evaluator": Shall have the meaning set forth in Section 4(a) (Selection of OEPR Evaluator) of Attachment D (Calculation and Adjustment of Net Energy Potential) of this Contract.

"OEPR Period of Record": For each OEPR, the twelve-month period preceding the Applicable NEP Verification Date for such OEPR.

"OMC Equivalent Forced Derated Turbine Hours (oEFDTH)": Shall have the meaning set forth in Attachment J to this Contract.

"OMC Equivalent Maintenance Derated Turbine Hours (EMDTH)": Shall have the meaning set forth in Attachment J to this Contract.

"OMC Equivalent Planned Derated Turbine Hours (oEPDTH) (Optional)": Shall have the meaning set forth in Attachment J to this Contract.

"OMC Forced Turbine Hours (oFTH)": Shall have the meaning set forth in Attachment J to this Contract.

"OMC Maintenance Turbine Hours (oMTH)": Shall have the meaning set forth in Attachment J to this Contract.

"OMC Planned Turbine Hours (oPTH)": Shall have the meaning set forth in Attachment J to this Contract.

"Outside Management Control" or "OMC": Shall have the meaning set forth in Attachment J to this Contract.

"Parties": Subscriber Organization and Company, collectively.

"Party": Each of Subscriber Organization or Company.

"Performance Index" or "PI": Shall have the meaning set forth in Section 2 of Attachment J (Calculation of Performance Index).

"Performance Metrics": Each of the Modified Pooled OMC Equipment Availability Factor Performance Metric, the GPI Metric, , the BESS Capacity Performance Metric, the BESS EAF Performance Metric, and the BESS EFOF Performance Metric, and the RTE Performance Metric.

"Performance Metrics LDs": Shall have the meaning set forth in Attachment C Section 9. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damage).

"PI": Shall have the meaning set forth in Section 2 of Attachment J (Calculation of Performance Index).

"PI Assessment Period": Shall mean, for purposes of demonstrating a Performance Index, a rolling period of twelve (12) calendar months each. At the end of each calendar month, the PI Assessment Period rolls forward to include the next calendar month. The initial "PI Assessment Period" shall consist of the 12 full calendar months of the initial Contract Year.

"PI Assessment Period Lump Sum Payment": For each PI Assessment Period, the monthly Lump Sum Payment for the twelfth month of such PI Assessment Period after deducting the amounts (if any) payable as liquidated damages under Section 1(b) (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages) of Attachment C for the same calendar month in question.

"PI Test": Shall have the meaning set forth in Section 2(a) (iii) (PI Test) of Attachment C to this Contract.

"Planned Turbine Hours (PTH)": Shall have the meaning set forth in Attachment J to this Contract.

"Point of Interconnection": The point of delivery of electric energy and/or capacity supplied by Subscriber Organization to Company, where the CBRE Facility owned by the Subscriber Organization interconnects with the Company System. The Subscriber Organization shall own and maintain the facilities from the CBRE Facility to the Point of Interconnection, excluding any Company-Owned Interconnection Facilities located on the Site. The Company shall own and maintain the facilities from the Point of Interconnection to the Company's system. The Point of Interconnection will be identified in the IRS and set forth on the Single-Line Drawing and Interface Block Diagram in Attachment F, Exhibit F-5 (Single-Line Drawing and Interface Block Diagram).

"Power Curve": A table of wind speeds and MW at a reference density.

"Prime Rate" shall mean the current "U.S. Prime Rate" of interest, as published from time to time by The Wall Street Journal in the "Money Rates" section of its Western Edition Newspaper. The Prime Rate shall change without notice with each change in the U.S. Prime Rate reported by The Wall Street Journal, as of the date such change is reported.

"Project": The Facility as described in Attachment F (Facility Owned by Subscriber Organization).

"Project Documents": This Contract, any ground lease or other agreement or instrument in respect of the Site and/or the Land Rights, all construction contracts to which Subscriber Organization is or becomes a party thereto, operation and maintenance agreements, and all other agreements, documents and instruments to which Subscriber Organization is or becomes a party thereto in respect of the Facility, other than the Financing Documents, as the same may be modified or amended from time to time in accordance with the terms thereof.

"PUC" or "Commission": Shall have the meaning set forth in the Recitals.

"PUC's Standards": Standards for Small Power Production and Cogeneration in the State of Hawai'i, issued by the Public Utilities Commission of the State of Hawai'i, Chapter 74 of Title 6, Hawai'i Administrative Rules, currently in effect and as may be amended from time to time.

"Renewable Portfolio Standards" or "RPS": The Hawai'i law that mandates that Company and its subsidiaries generate or purchase certain amounts of their net electricity sales over time from qualified renewable resources. The RPS requirements in Hawai'i are currently codified as Hawai'i Revised Statutes (HRS) 269-91 through 269-95.

"Renewable Resource Baseline": The estimated renewable resource potential of the Site for a typical meteorological year. For avoidance of doubt, the purpose of this term is to provide a short-hand characterization of the nature of the renewable resource risk assumed by the Subscriber Organization under this Contract in making its Site selection.

"Renewable Resource Variability": The variations, above and below the Renewable Resource Baseline, of the renewable resource actually available at the Site on a moment-to-moment basis. For avoidance of doubt, the purpose of this term is to provide a short-hand characterization of the nature of the renewable resource risk assumed by the Company under this Contract in agreeing to make fixed payments in an amount calculated on the basis of the CBRE Facility's capability to deliver the Net Energy Potential regardless of whether or not sufficient renewable resource is in fact available at any particular moment.

"Required Model" or "Required Models": Shall have the meaning set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of Attachment F (Facility Owned by Subscriber Organization) of this Contract.

"Residential Subscriber": A subscriber served by Company under any of the following Company rate schedules: Schedule R, TOU-R, TOU-RI, TOU-EV or any other residential option.

"Revenue Meter": The revenue meter packaging, revenue metering PTs and CTs, and secondary wiring, which will record the renewable energy produced by the CBRE Facility and dispatched to the Company at the Point of Interconnection.

"RFP": Company's Request for Proposals issued on [_____], 202_.

"RFP Proposal": The documents and submissions comprising Subscriber Organization's proposal selected in response to the RFP.

"RTE Performance Metric": Shall have the meaning set forth in Attachment H, Section 1 (BESS Tests) and as referenced in Attachment C, Section 6. (Bess Round Trip Efficiency Test; Liquidated Damages; Termination Rights) to this Contract.

"RTE Ratio": Shall have the meaning set forth in in Section 1 (BESS Tests) of Attachment H to this Contract.

"SCADA" or "Supervisory Control and Data Acquisition": The Company system that provides remote control and monitoring of Company's transmission and sub-transmission systems and enables Company to perform real-time control of equipment in the field and to monitor the conditions and status of the Company System.

"Scheduled Maintenance": Time periods during which scheduled maintenance actions affecting the WTG in question are performed at the Facility.

"Second Benchmark Period": The period commencing on the first Day of the calendar month following the month during which an OEPR Evaluator issues the Initial OEPR and ending with the expiration of the fifth (5th) Contract Year. For avoidance of doubt, the effect of the foregoing definition is that the Second Benchmark Period will follow immediately upon the expiration of the First Benchmark Period.

"Second NEP Benchmark": For each calendar month during the Second Benchmark Period, the estimate of Net Energy Potential to be used during such calendar month to calculate the Lump Sum Payment pursuant to Section 3. (Calculation of Lump Sum Payment) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract. For avoidance of doubt, the Second NEP Benchmark may vary during the Second Benchmark Period as and to the extent provided in Section 3.B. of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to this Contract.

"Second OEPR": Shall have the meaning set forth in Section 2.G. (Review of the First OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Second OEPR Evaluator": Shall have the meaning set forth in Section 2.G. (Review of the First OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Site": The parcel of real property on which the CBRE Facility will be constructed and located, together with any Land Rights reasonably necessary for the construction, ownership, operation and maintenance of the CBRE Facility. The Site is identified in Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Source Code": Shall mean the human readable source code of the Required Models which: (i) will be narrated documentation related to the compilation, linking, packaging and platform requirements and any other materials or software sufficient to enable a reasonably skilled programmer to build, modify and use the code within a commercially reasonable period of time for the purposes of a Source Code Authorized Use; and (ii) can reasonably be compiled by a computer for execution.

"Source Code Authorized Use": Shall have the meaning set forth in Section 6(b) (i) (E) (Authorized Use) of Attachment F (Facility Owned by Subscriber Organization) of this Contract.

"Source Code Escrow": Shall mean the escrow established with the Source Code Escrow Agent under the terms of the Source Code Escrow Agreement under which Source Code shall be confidentially deposited by a Source Code Owner for safekeeping and, upon the satisfaction of certain conditions, release to the Company.

"Source Code Escrow Agent": Shall mean Iron Mountain Intellectual Property Management, Inc. or such other similar escrow agent approved by Company.

"Source Code Escrow Agreement": Shall mean a multi-party escrow agreement between Company, Source Code Escrow Agent and any and all Source Code Owners depositing Source Code into the Source Code Escrow which, among other matters, names Company as beneficiary thereunder, and is otherwise acceptable in form and substance to Company.

"Source Code Owner": Shall mean the developer and/or owner of the Required Models utilizing Source Code authorized to deposit the Source Code with the Source Code Escrow Agent upon the terms of the Source Code Escrow Agreement.

"SOX 404": Shall have the meaning set forth in Section 8.F. (Financial Compliance) of the Contract.

"State of Charge": Energy in the BESS stated as a percentage of BESS Contract Capacity.

"Submission Notice": Shall have the meaning set forth in Section 2(e) (Appointment of Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"Study": Shall have the meaning set forth in Section 4(e) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Submission Notice": Shall have the meaning set forth in Section 2(e) (Appointment of Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract.

"Subscriber" means a retail customer of the Company who owns one or more subscriptions of a CBRE Facility interconnected with the Company.

"Subscriber Agency Agreement and Consent Form": means the ~~agreement between Subscriber Organization and Subscriber, the form of which is included in the CBRE Tariff.~~

~~"Subscriber Agency Agreement and Consent Form": means the consent~~ agreement between Subscriber Organization and Subscriber that authorizes disclosure of certain ~~Account Information and Energy Usage Data~~account information and energy usage data, the form of which is included in the CBRE Tariff.

"Subscriber Agreement": means the written Agreement between Subscriber Organization and its Subscribers required to contain standard information and provisions to ensure transparency and proper consumer protection in accordance with the CBRE Tariff and applicable law.

"Subscriber Allocation": shall mean, for each Subscriber, such Subscriber's percentage interest in the total nameplate capacity of the WTG System, reflecting each Subscriber's allocable portion of renewable energy available for dispatch by the CBRE Facility in a particular calendar month.

"Subscriber's Confidential Account Information": consists of the Subscriber's name, account number, service address, telephone number, email address, web site URL, information on Subscriber participation in other distributed generation serving the premises of the Subscriber, and Subscriber specific Bill Credit(s).

"Subscriber Organization": Shall have the meaning set forth in the preamble to this Contract.

"Subscriber Organization Affiliate": Shall have the meaning set forth in Section 6(b) (ii) (A) (Establishment of Monetary Escrow) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.

"Subscriber Organization-Attributable Non-Generation": Time periods during which the inverter in question (or the CBRE Facility as a whole) is not dispatched or is derated or shutdown (or the CBRE Facility is disconnected) because of any of the following:

- (i) The CBRE Facility's failure to comply with any of the Performance Standards, Good Engineering and Operating Practices, Governmental Approvals, applicable Laws or Subscriber Organization's other obligations under this Contract;
- (ii) Subscriber Organization-Attributable System Conditions;
- (iii) Conditions at or on either side of the Point of Interconnection arising from the acts or omissions of Subscriber Organization or any of its affiliates, employees, agents, contractors, vendors, materialmen, independent contractors or suppliers of Subscriber Organization, acting in such capacity for the benefit of Subscriber Organization ("Subscriber Organization Representatives"), unless such acts or omissions are themselves excused by reasons of Force Majeure pursuant to Section 27. (Force Majeure) of the Contract;

- (iv) A disconnection initiated by the Company pursuant to Section 12. (Personnel and System Safety) of this Contract that is caused by Subscriber Organization or any Subscriber Organization Representatives;
- (v) The Company has reasonably decided that it is inadvisable for such WTGgenerating equipment, inverter, or BESS. (or the CBRE Facility as a whole) to continue normal operations without a further Control System Acceptance Test as provided in Attachment F to the Contract;
- (vi) The CBRE Facility is deemed to be in Subscriber Organization-Attributable Non-Generation status under any of the following sections of Attachment F: Section 1(g) (vi), Section 1(j) (Demonstration of Facility) or Section 4(e);
- (vii) The CBRE Facility is shutdown at the direction of Company, and such shutdown is caused by Subscriber Organization or any Subscriber Organization Representatives or the lack of reliable real time data; and
- (viii) The CBRE Facility fails to comply with Company Dispatch or other outage or duration as provided in Section 5.C. (Company Rights of Dispatch)

Each time period of Subscriber Organization-Attributable Non-Generation shall constitute an Outage or Deration, as applicable.

"Subscriber Organization-Attributable System Conditions": Conditions on the Company System:

- (i) that result from either (a) the CBRE Facility's generation and delivery of electric power to the Company System or (b) any condition arising from the acts or omissions of Subscriber Organization or any Subscriber Organization Representative, unless such acts or omissions are themselves excused by reasons of Force Majeure pursuant to Section 27. of the Contract; and
- (ii) caused by or attributable to the CBRE Facility or Subscriber Organization or any Subscriber Organization Representatives that Company reasonably determines to either (a) be inconsistent with Good Engineering and Operating Practices on the Company System or (b) jeopardize the safety, reliability or stability of the Company System.

For avoidance of doubt, the Company's inability to dispatch the CBRE Facility due to the existence of Excess Energy Conditions on the Company System shall not constitute Subscriber Organization-Attributable System Conditions.

"Subscriber Organization-Owned Interconnection Facilities": The Interconnection Facilities constructed and owned by Subscriber Organization.

"Subscriber's Confidential Account Information": consists of the Subscriber's name, account number, service address, telephone number, email address, web site URL, information on Subscriber participation in other distributed generation serving the premises of the Subscriber, and Subscriber specific Bill Credit(s).

"Subscriber's Usage Data": refers to data collected from the utility Subscriber meters that reflects the quantity, quality, or timing of electric usage or renewable energy production attributable to the Subscriber for the service address and account number identified for participation in the CBRE Facility.

~~"Subscriber Agreement"~~: ~~means the contract between a Subscriber and the Subscriber Organization.~~

"Subsequent NEP OEPR Estimate": For each Subsequent OEPR, the NEP OEPR Estimate derived from such Subsequent OEPR.

"Subsequent OEPR": Any OEPR prepared pursuant to Section 1.F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Subsequent NEP OEPR Estimate": For each Subsequent OEPR, the NEP OEPR Estimate derived from such Subsequent OEPR.

"Subsequent OEPR": Any OEPR prepared pursuant to Section 1.F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Substantial Progress": means that on or before the last Day of the 18-month period (including day-for-day extensions) to achieve the Commercial Operations Date, the Subscriber Organization has achieved all of the following: (1) installed one-hundred percent (100%) of the WTG System foundation (including pier, helical screw, ballasts, or similar) to enable mounting of the nameplate capacity as collectively set forth in Attachment F to this Contract; (2) built, or otherwise has in place, a permanent drivable (road) surface on the parcel or parcels of land associated with the CBRE Facility so that (i) Company on a 24 hour a day, seven days a week, basis can access its equipment, including but not limited to lines, poles, transformers, billing meters, underground facilities and other facilities, but excluding production meters; and (ii) the drivable road surface is reasonably sufficient to support operation and maintenance vehicles; and (3) built, or otherwise has in place, a permanent fence surrounding the entirety of the CBRE Facility location.

"Telemetry and Control": The interface between Company's EMS and the physical equipment at the Facility.

"Term": means the term of this Contract and shall begin when this Contract is signed by the Parties and end twenty (20) years after the Commercial Operations Date unless otherwise provided for in this Contract.

"Termination Damages": Liquidated damages calculated in accordance with Section 15. (Damages in the Event of Termination by Company) of this Contract.

"Third OEPR": Shall have the meaning set forth in Section 2.H. (Review of the Second OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Third OEPR Evaluator": Shall have the meaning set forth in Section 2.H. (Review of the Second OEPR Evaluator Report) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

"Third Party": Any person or entity other than Company or Subscriber Organization, and includes, but is not limited to, any subsidiary or affiliate of Subscriber Organization.

"Tier 1 Bandwidth": The Tier 1 bandwidth set forth in Attachment C, Section 2(b) (GPI Metric and Liquidated Damages) of this Contract.

"Tier 2 Bandwidth": The Tier 2 bandwidth set forth in Attachment C, Section 2(b) (GPI Metric and Liquidated Damages) of this Contract.

"Total Estimated Interconnection Costs": Shall have the meaning set forth in Section 11.E.3 of this Contract and as further described in Attachment G (Company-Owned Interconnection Facilities)

"Transfer Date": The date, prior to the Commercial Operations Date, upon which Subscriber Organization transfer to Company all right, title and interest in and to Company-Owned Interconnection Facilities to the extent, if any, that such facilities were constructed by Subscriber Organization and/or its contractors.

"Unit Price": \$ ___ per ___ MWh of Net Energy Potential annually. [TO BE CALCULATED FROM RESPONSE TO RFP.]

"Unsubscribed Energy": That portion of the Actual Output during a particular calendar month that is not associated with any Subscriber and is therefore not included in any Subscriber Allocation for such month. The Unsubscribed Energy for a particular calendar month is the balance of the Actual Output remaining after subtracting the Actual Output represented by the total of the Subscriber Allocations for such month. For purposes of allocating to Subscriber Organization a portion

of the monthly Energy Payment for a particular month: (i) the Unsubscribed Energy for such month is associated with the Subscriber Organization; and (ii) the portion of the monthly Energy Payment for such month that is payable to Subscriber Organization for such Unsubscribed Energy is the balance of such monthly Energy Payment remaining after subtracting that portion of the monthly Energy Payment that is payable in the form of Bill Credits. **[Drafting note: Delete if Contract does not include an ~~energy payment~~Energy Payment.]**

"Unsubscribed RDG": That portion of the Contract Capacity during a particular calendar month that is not associated with any Subscriber and is therefore not included in any Subscriber Allocation for such month. The Unsubscribed RDG for a particular calendar month is the balance of the Contract Capacity remaining after subtracting the Contract Capacity represented by the total of the Subscriber Allocations for such month. For purposes of allocating to Subscriber Organization a portion of the monthly Lump Sum Payment for a particular month: (i) the Unsubscribed RDG for such month is associated with the Subscriber Organization; and (ii) the portion of the monthly Lump Sum Payment for such month that is payable to Subscriber Organization for such Unsubscribed RDG is the balance of such monthly Lump Sum Payment remaining after subtracting that portion of the monthly Lump Sum Payment that is payable in the form of Bill Credits or any payment reduction attributable to Subscriber Organization's failure to meet any of the CBRE Subscriber Thresholds.

"WTG": Each wind turbine generating system and its internal components and subsystems, as installed at the Facility.

---END---

ATTACHMENT B

COMPANY PAYMENTS FOR ENERGY, DISPATCHABILITY AND AVAILABILITY OF BESS

1. **PRICE FOR PURCHASE OF RENEWABLE ENERGY.** Commencing on the Commercial Operations Date, Company shall pay Subscriber Organization for renewable energy produced by the Facility and delivered to the Point of Interconnection in response to Company Dispatch in accordance with this Contract at the rate of \$0.00/MWh. Company shall also not pay for renewable energy delivered to the Point of Interconnection from the BESS. **[Drafting note: If Contract has an Energy Payment, replace with the following:** Commencing on the Commercial Operations Date, Company shall pay Subscriber Organization for renewable energy produced by the Facility and delivered to the Point of Interconnection in response to Company Dispatch in accordance with this Contract at the rate of \$[_____] /MWh. Company shall not pay for renewable energy delivered to the Point of Interconnection from the BESS to the extent such energy was originally taken from the grid to charge the BESS. If the BESS is delivering renewable energy to the Point of Interconnection in response to Company Dispatch during a period in which a portion of the energy stored in the BESS is attributable to renewable energy that was originally taken from the grid, the renewable energy delivered to the Point of Interconnection from the BESS during such period shall be deemed to be produced by the Facility for purposes of the first sentence of this Section 1 (Price for Purchase of renewable Energy) until no portion of the energy stored in the BESS is attributable to the production of the Facility.
2. **LUMP SUM PAYMENT.** Commencing on the Commercial Operations Date, Company shall pay for (i) the Actual Output produced by the Facility and delivered to the Point of Interconnection in response to Company Dispatch of the Facility; (ii) the availability of the Facility's Net Energy Potential for Company Dispatch in accordance with this Contract and (iii) the availability of the BESS, a monthly Lump Sum Payment as calculated and adjusted as set forth in Section 3. (Calculation of Lump Sum Payment), below. The monthly Lump Sum Payment shall be calculated and adjusted to reflect changes in the estimate of the Facility's Net Energy Potential as such estimate is revised from time to time as more fully set forth in Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.
3. **CALCULATION OF LUMP SUM PAYMENT.** The monthly Lump Sum Payment shall be calculated and adjusted as follows:
 - A. **Lump Sum Payment During First Benchmark Period.** During the First Benchmark Period, the monthly Lump Sum Payment shall be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the First NEP Benchmark.
 - B. **Lump Sum Payment During Second Benchmark Period.**
 1. One purpose of the Second Benchmark Period is to provide the Subscriber Organization, in the event that the Initial NEP OEPR Estimate is less than NEP RFP Projection, with a limited period during which Subscriber Organization will have an opportunity, by having a Subsequent OEPR prepared pursuant to Section 1.F.2. (Voluntary Subsequent OEPR) of Attachment D (Calculation Adjustment of Net Energy Potential) to this Contract, to obtain an adjustment to the NEP OEPR Estimate used to calculate the Lump Sum Payment, subject to (i) the cap on any upward adjustment imposed by the limitation that the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment shall not exceed the NEP RFP Projection and (ii) the risk that any Subsequent OEPR might result in a downward adjustment to the NEP OEPR Estimate used to calculate the Lump Sum Payment. Accordingly, for each calendar month during the Second Benchmark Period, the monthly Lump Sum Payment shall be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the lesser of (w) the NEP RFP Projection or (x) the NEP OEPR Estimate of the OEPR that is most recent as of the first Day of such calendar month. For avoidance of doubt:
 - a. On the first Day of the Second Benchmark Period, the most recent OEPR will be the Initial OEPR;

- b. If no Subsequent OEPR is issued under Section 1.F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract for an OEPR Period of Record ending prior to the end of the third (3rd) Contract Year, the "most recent OEPR" during the entirety of the Second Benchmark Period will be the Initial OEPR;
- c. If any Subsequent OEPR is prepared for an OEPR Period of Record ending prior to the commencement of the fourth (4th) Contract Year, the monthly Lump Sum Payment shall, for the period commencing on the first Day of the calendar month following the month during which an OEPR Evaluator issues such Subsequent OEPR, be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the lesser of (w) the NEP OEPR Estimate obtained from such Subsequent OEPR or (x) the NEP RFP Projection. The monthly Lump Sum Payment calculated as aforesaid shall remain in effect through the first to occur of (y) the end of the Term or (z) the end of the calendar month during which an OEPR Evaluator issues the next Subsequent OEPR (if any) that is required or permitted under Section 2. (Preparation of OEPR) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract.

C. Lump Sum Payment Following Second Benchmark Period.

1. As of the first Day of the fourth (4th) Contract Year, the estimate of Net Energy Potential that was used to calculate the Lump Sum Payment for the last calendar month of the Second Benchmark Period shall continue in effect as the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment until the end of the calendar month during which an OEPR Evaluator issues the first Subsequent OEPR for an OEPR Period of Record ending on or after the commencement of the fourth (4th) Contract Year and, effective at the end of such calendar month, the Second NEP Benchmark that was in effect immediately prior to the issuance of such Subsequent OEPR shall constitute the "Most Recent Prior NEP Benchmark" under clause (i) of the definition of that term set forth in this Contract. For avoidance of doubt, if no Subsequent OEPR is issued for an OEPR Period of Record ending on or after the commencement of the fourth (4th) Contract Year, the Second NEP Benchmark that was used to calculate the Lump Sum Payment for the last calendar month of the Second Benchmark Period shall continue in effect for the balance of the Term as the estimate of Net Energy Potential that is used to calculate the Lump Sum Payment.
2. In order to facilitate planning for the Company System, no increase in Net Energy Potential (and hence in the monthly Lump Sum Payment) shall be permitted under this Contract as a consequence of any Subsequent OEPR that is prepared for an OEPR Period of Record ending on or after the expiration of the Second Benchmark Period. Accordingly, if any such Subsequent OEPR is prepared, the monthly Lump Sum Payment shall, for the period commencing on the first Day of the calendar month following the month during which an OEPR Evaluator issues such Subsequent OEPR, be equal to one-twelfth (1/12th) of the product (rounded to the nearest cent) obtained by multiplying the Unit Price by the lesser of (w) the NEP OEPR Estimate obtained from such Subsequent OEPR or (x) the Most Recent Prior NEP Benchmark. The monthly Lump Sum Payment calculated as aforesaid shall remain in effect through the first to occur of (y) the end of the Term or (z) the end of the calendar month during which an OEPR Evaluator issues the next following Subsequent OEPR (if any) that is required or permitted under Section 1.F. (Subsequent OEPRs) of Attachment D (Calculation and Adjustment of Net Energy Potential) to this Contract. If any such next following Subsequent OEPR is issued, the monthly Lump Sum Payment shall, for the period commencing on the first Day of the calendar month following the calendar month during which an OEPR Evaluator issues such Subsequent OEPR, be re-calculated and adjusted as provided in this and shall continue in effect for the period provided in the preceding sentence.

D. Lump Sum Pro-Rata Adjustments.

1. Under the Company's previous forms of as-available power purchase agreements for renewable energy, the independent power producer was compensated for the production and delivery of electrical energy and assumed the risk of non-payment for events such as Force Majeure that prevented such production and delivery. Although under this Contract most or all of Subscriber Organization's compensation will be in the form of a Lump Sum

Payment rather than for the production and delivery of electrical energy, it is not the intent of the Parties that Subscriber Organization should be entitled to unrestricted compensation in circumstances in which an independent power producer would not have been able to earn compensation under the Company's prior form of power purchase agreements (i.e., if the Facility or any portion thereof is unable to produce and deliver electric energy). Although the liquidated damages that are payable if the Modified Pooled OMC Equipment Availability Factor fails to satisfy the Modified Pooled OMC Equipment Availability Factor Performance Metric address this issue in certain of the circumstances when some or all of the WTGs are unable to generate electric energy, the Modified Pooled OMC Equipment Availability Factor does not account for events of Force Majeure because months containing such events are OMC under Section 1 (Modified Pooled OMC) of Attachment J (Calculation of Certain Metrics) this Contract. Similarly, in the case of the BESS, although the liquidated damages that are payable if the BESS Annual Equivalent Availability Factor fails to satisfy the BESS EAF Performance Metric addresses this issue in certain of the circumstances when the BESS or a portion thereof is unable to respond to Company Dispatch, the BESS Annual Equivalent Availability Factor does not account for events of Force Majeure because months containing such events are excluded from the calculation under Section 2 of Attachment H (BESS Annual Equivalent Availability) of this Contract.

2. Accordingly, and without limitation to the generality of the foregoing provisions of this Section 3 (Calculation of Lump Sum Payment) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), the monthly Lump Sum Payment shall be adjusted downward pro rata for each hour or portion thereof during the calendar month in question that the CBRE Facility or portion thereof was not available to respond to Company Dispatch because of a Force Majeure condition (i) affecting the Facility or any portion thereof or (ii) that otherwise delays or prevents the Subscriber Organization from making the CBRE Facility or any portion thereof generate energy or be available for Company Dispatch.
3. In the case of a BESS Force Majeure, such downward adjustment in the Lump Sum Payment shall be limited to the BESS Allocated Portion of the Lump Sum Payment. Further, during any periods in which there is a Force Majeure affecting both the WTG(s) and the BESS, the Lump Sum Payment shall only be adjusted for the effect of the Force Majeure on the WTG(s).
4. The hours the Facility is affected by a Force Majeure are converted to equivalent full outage hours by multiplying the actual duration of the event (hours) by (i) the size of the reduction in MWs or number of devices, divided by (ii) the Contract Capacity if the size of the reduction is in MWs or the total number of WTG(s) in the affected system if the size of the reduction is a WTG(s) count. These equivalent hour(s) are then summed. The summation of equivalent full outage hours is then divided by the months total period hours (number of days in the month x 24hrs/day) to determine the pro-rated factor the Lump Sum Payment will be adjusted by.

Example 1: if a Facility has ten WTG(s) and, during the month of May (which has 31 calendar days or 744 period hours), one WTG is not available to respond to Company Dispatch for a period of 360 hours due to a Force Majeure condition as aforesaid, the monetary amount of the resulting downward adjustment to the monthly Lump Sum Payment for the month of May would be calculated as follows:

$$\text{Monetary Amount of Downward Adjustment} = \text{MLSP} \times (1/10) \times (360/744)$$

where:

MLSP = The monthly Lump Sum Payment that would be payable for such month but for the downward adjustment.

Example 2: if a Facility BESS System has forty inverters and, during the month of June (which has 720 period hours), one BESS module is not available to respond to Company Dispatch for a period of 240 hours due to a Force Majeure condition as aforesaid, the monetary amount of the resulting downward adjustment to the monthly Lump Sum Payment for the month of June would be calculated as follows:

$$\text{Monetary Amount of Downward Adjustment} = (\text{BLSP} \times (1/40) \times 2(40/720)$$

where:

BLSP = The BESS Allocated Portion of the Lump Sum Payment that would be payable for such month but for the downward adjustment.

Note: the foregoing monetary amount of downward adjustments, shall be rounded to the nearest cent.

4. UPDATING MONTHLY SUBSCRIBER INFORMATION USED TO CALCULATE BILL CREDITS AND OTHER MATTERS.

- A. No later than the last Day of each calendar month, the Subscriber Organization shall provide to the Company any and all changes to the Monthly Subscription Information to be used for such calendar month by entering new or updating previously-entered data through the CBRE Online Portal. Such data to be entered or changed by the Subscriber Organization shall include additions, deletions or changes to the listing of Subscribers, including any changes occurring by said last Day of such calendar month to the Subscriber's account number and service address attributable to each subscription and the Subscriber Allocation for each subscription.
- B. For each calendar month, the purchase or transfer of all or any portion of a Subscriber's Allocation occurring on or before the 20th Day of such calendar month of which the Company is notified, as provided for in the preceding paragraph, shall have retroactive effect as of the first Day of such calendar month; the purchase or transfer of all or any portion of a Subscriber's Allocation occurring on or after the 21st Day of such calendar month, but prior to the first Day of the following calendar month, shall have effect as of the first Day of such following calendar month. The following shall be recalculated as of the last Day of each calendar month to account for the effectiveness of such purchases and transfers as aforesaid: (i) Unsubscribed RDG; (ii) the percentage of the Contract Capacity represented by the Subscriber Allocations for all Residential Subscribers; (iii) the number of individual Subscribers; and (iv) the percentage of Contract Capacity represented by all LMI Subscribers.

5. PAYMENT TO SUBSCRIBER ORGANIZATION; ~~PAYMENT REDUCTIONS-LIQUIDATED DAMAGES FOR FAILURE TO ACHIEVE CBRE SUBSCRIBER THRESHOLDS.~~

The dollar amount payable to Subscriber Organization for the ~~[Unsubscribed Energy and]~~ Unsubscribed RDG for a particular calendar month shall be: ~~[Drafting note: If Contract has energy payment, include the language in bold text]~~ as follows:

- A. The balance of the monthly Lump Sum Payment remaining after deducting the total dollar value of the Bill Credits for that month.
- B. Beginning with the seventh calendar month following the Commercial Operations Date, the Subscriber Organization shall pay, and Company shall accept, payment reductions (from Subscriber Organization's payment for Unsubscribed RDG) or liquidated damages for failure of the Subscriber Organization to achieve, during the calendar month in question, any one or more of the applicable CBRE Subscriber Thresholds. The amount of such ~~payment reductions-~~liquidated damages shall be determined as set forth in the CBRE Tariff. For purposes of this Section 5 (Payment to Subscriber Organization; ~~Payment Reductions-Liquidated Damages for Failure to Achieve CBRE Subscriber Thresholds)~~ of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), a provision in CBRE Tariff that provides for a reduction in the amount to be paid to the Subscriber Organization for ~~[Unsubscribed Energy and]~~ Unsubscribed RDG shall be deemed to provide for liquidated damages in the event that Subscriber Organization's payment for Unsubscribed RDG is insufficient to cover such payment reduction, which liquidated damages shall be in the amount of such ~~reduction~~insufficiency. The Company shall have the right to set-off liquidated damages for failure to achieve one or more of the

CBRE Subscriber Thresholds from the amounts to be paid to the Subscriber Organization or to draw such liquidated damages from the Operating Period Security.

6. **TEST ENERGY.** Company shall use reasonable efforts to accept test energy that is delivered as part of the normal testing for generators (such as energy delivered to Company during the Control System Acceptance Test but not during the Acceptance Test), provided Subscriber Organization shall use reasonable efforts to coordinate such normal testing with Company so as to minimize adverse impacts on the Company System and operations. Company shall not compensate Subscribers or Subscriber Organization for test energy.
7. **TAX CREDIT PASS THROUGH.** Company acknowledges and agrees that the Federal Refundable Tax Credit and Federal Non-Refundable Tax Credit shall inure to the benefit of the Claiming Entity; provided, however, that Subscriber Organization acknowledges and expressly agrees that the Federal Refundable Tax Credit and Federal Non-Refundable Tax Credit, with regard to Subscriber Organization's Facility, have been calculated into the Contract Pricing based on the maximization of such credits. In the event that Subscriber Organization's Facility does not gain the benefit of the Federal Refundable Tax Credit and/or the Federal Non-Refundable Tax Credit, Subscriber Organization expressly acknowledges and agrees that it shall not seek to amend the Contract Pricing.
 - A. Because the Hawai'i tax treatment that will apply to renewable energy technologies on the Commercial Operations Date is uncertain, the parties acknowledge that the Contract Pricing was set assuming Subscriber Organization will not be eligible for any Hawai'i Renewable Energy Tax Credit. The intent of this Section 7. (Tax Credit Pass Through) is to entitle Company, for the benefit of its customers, to a payment equal to 100% of the maximum Hawai'i Renewable Energy Tax Credit for which Subscriber Organization is eligible with respect to the Facility and receives during the Term, as more fully set forth in this Section 7. (Tax Credit Pass Through).
 - B. If, as of the Commercial Operations Date, or, if not available at the Commercial Operations Date, at any subsequent time during the Term, a Hawai'i Refundable Tax Credit is reasonably available to Subscriber Organization or its Affiliates with respect to the Facility, the following shall apply:
 - (i) Subscriber Organization or Subscriber Organization's Affiliate will apply for such Hawai'i Refundable Tax Credit, it being understood and agreed that if Subscriber Organization applies for a Hawai'i Refundable Tax Credit as of the Commercial Operations Date, it shall have fulfilled its obligations hereunder to apply for the Hawai'i Refundable Tax Credit;
 - (ii) Subscriber Organization shall make a payment to Company in an amount equal to one hundred percent (100%) of the Net Amount of such Hawai'i Refundable Tax Credit within thirty (30) Days after funds are received from the Hawai'i Department of Taxation;
 - (iii) Upon application for the Hawai'i Refundable Tax Credit, an officer of Subscriber Organization will deliver to Company a notice (A) describing Subscriber Organization's efforts to apply for and obtain the Hawai'i Refundable Tax Credit, (B) confirming that Subscriber Organization has applied for the Hawai'i Refundable Tax Credit, and (C) certifying that Subscriber Organization has used commercially reasonable efforts to apply for and obtain the maximum reasonably available Hawai'i Refundable Tax Credit as provided in this Section 7. (Tax Credit Pass Through);
 - (iv) Upon receipt of any funds from the Hawai'i Department of Taxation for the Hawai'i Refundable Tax Credit, an officer of Subscriber Organization or an Affiliate of Subscriber Organization, if applicable, will deliver a notice to Company certifying (A) the amount of funds received, (B) and the amount of payment that will be made to Company, net of any documented and reasonable financial, legal, administrative, and other costs required to claim and transfer such funds to Subscriber Organization, as supported by the officer's certificate as to the amount of such costs and the reasonableness thereof.

- C. If, as of the Commercial Operations Date, a Hawai'i Refundable Tax Credit is unavailable, but a Hawai'i Non-Refundable Tax Credit is available to Subscriber Organization or its Affiliates with respect to the Facility, or at any subsequent time during the Term, a Hawai'i Non-Refundable Tax Credit becomes available to Subscriber Organization or its Affiliates with respect to the Facility, notwithstanding that Subscriber Organization may have applied for a Hawai'i Refundable Tax Credit, and in either case Subscriber Organization can claim, or enable its investors to claim, such Hawai'i Non-Refundable Tax Credit, the following shall apply:
- (i) Subscriber Organization or an Affiliate of Subscriber Organization will apply for any available Hawai'i Non-Refundable Tax Credit, it being understood and agreed that if Subscriber Organization applies for a Hawai'i Non-Refundable Tax Credit as of the Commercial Operations Date, it shall have fulfilled its obligations hereunder to apply for the Hawai'i Non-Refundable Tax Credit;
 - (ii) Subscriber Organization shall make a payment to Company in an amount equal to one hundred percent (100%) of the Net Amount of such Hawai'i Non-Refundable Tax Credit that Subscriber Organization can claim in the tax year in question within sixty (60) Days after the filing date of the applicable tax return for the tax year in which such Hawai'i Non-Refundable Tax Credit is utilized;
 - (iii) Upon the filing of the applicable tax return(s), an officer of Subscriber Organization or an Affiliate of Subscriber Organization, if applicable, will deliver a notice to Company (A) describing Subscriber Organization's efforts to apply for and obtain the Hawai'i Non-Refundable Tax Credit, (B) confirming that Subscriber Organization has applied for the Hawai'i Non-Refundable Tax Credit, and (C) certifying that Subscriber Organization has used commercially reasonable efforts to apply for and obtain the maximum reasonably available Hawai'i Non-Refundable Tax Credit as provided in this Section 7. (Tax Credit Pass Through);
 - (iv) Upon receipt of any funds for the Hawai'i Non-Refundable Tax Credit, an officer of Subscriber Organization or an Affiliate of Subscriber Organization, if applicable, will deliver a notice to Company certifying (A) the amount of funds received, (B) and the amount of payment that will be made to Company, net of any documented and reasonable financial, legal, administrative, and other costs required to claim, monetize and transfer such funds to Subscriber Organization, as supported by the officer's certificate as to the amount of such costs and the reasonableness thereof.
- D. Subscriber Organization shall use commercially reasonable efforts to apply for and obtain the maximum reasonably available Hawai'i Refundable and/or Non-Refundable Tax Credit as provided in this Section 7 (Tax Credit Pass Through). If Subscriber Organization fails to apply for and to use commercially reasonable efforts to obtain such Hawai'i Renewable Energy Tax Credit as described above, then Company shall be entitled to liquidated damages in an amount equal **[\$150,000 per MW of Contract Capacity]**. Subscriber Organization and Company agree and acknowledge that (i) the failure to use commercially reasonable efforts as provided in the preceding sentence would result in damages to Company in the form of reduction or loss of a benefit for Company's customers that would be difficult or impossible to calculate with certainty and (ii) **[Note - Insert Amount That Equals \$150,000 Per Mw Of Contract Capacity]** is an appropriate approximation of such damages. Company's right to collect liquidated damages as described in this Section 7.D. shall constitute Company's exclusive remedy and fulfillment of all Subscriber Organization's liability with respect to its obligations to maximize the amount of Hawai'i Renewable Energy Tax Credit. Such liquidated damages shall be provided to Company in the form of a lump sum payment by Subscriber Organization or as a credit against any amounts due by Company to Subscriber Organization under this Contract, as Company reasonably determines.
- E. If, prior to the application in Section 7.B. or filing in Section 7.C. of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), as applicable, a change in tax law occurs to introduce a Hawai'i Production Tax Credit or an alternative renewable tax credit, Subscriber Organization will use commercially reasonable efforts to determine which tax strategy is likely to result in the larger Net Amount (based on net present value for tax credits earned over time) of claimable tax credits. If, based on such

efforts, Subscriber Organization determines that either Section 7.B. or Section 7.C. would result in a larger Net Amount of usable tax credits, an officer of Subscriber Organization will deliver a notice to Company certifying that Subscriber Organization has reasonably determined that the selected form of Hawai'i Renewable Energy Tax Credit is likely to result in the larger Net Amount (based on net present value for tax credits earned over time) of claimable tax credits and explaining the rationale for such determination. If, however, Subscriber Organization reasonably determines that such Hawai'i Production Tax Credit is likely to result in the larger Net Amount (based on net present value for tax credits earned over time) of claimable tax credits and that it reasonably can obtain such Hawai'i Production Tax Credit, Subscriber Organization shall promptly notify Company in writing and explain the rationale for such determination, and Subscriber Organization and Company shall negotiate in good faith and use commercially reasonable efforts to agree upon lump sum payments and/or credits or adjustments to the Contract Pricing and other terms of this Contract as may be required to best benefit Company's customers with 100% of the Net Amount of such tax benefits and preserve the intended economic benefits to the Parties arising from this Contract.

- F. Company reserves the right to have Subscriber Organization's application for the Hawai'i Renewable Energy Tax Credit in Section 7.B. or Section 7.C., or the Hawai'i Production Tax Credit or alternative tax credit under Section 7.E. of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) reviewed by an Independent Tax Expert to determine if such application is expected to maximize available tax credits to best benefit Company's customers, in which case, the provisions of this Section 7.E. shall apply. Company shall deliver to Subscriber Organization a written notice (the "Nomination Notice") of: (i) the names of three persons qualified and willing to accept appointment as an Independent Tax Expert; (ii) a description provided by each nominee of his or her qualifications to serve as an Independent Tax Expert; (iii) a written undertaking by each nominee to review Subscriber Organization's tax credit strategy and application, and (iv) each nominee's fee proposal. Subscriber Organization and Company shall agree on a mutually acceptable person to serve as the Independent Tax Expert within ten (10) Business Days of Subscriber Organization's receipt of Company's written notice. If the Parties fail to agree upon a mutually acceptable Independent Tax Expert within the aforesaid ten Business Day period, such disagreement shall be resolved pursuant to Section 7.G. of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS). Company shall pay the fees and expenses of the Independent Tax Expert and Subscriber Organization shall promptly reimburse Company for one-half of such fees and expenses.
- G. Any dispute arising under this Section 7. (Tax Credit Pass Through) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) shall constitute a "Dispute" within the meaning of Section 17. (Dispute Resolution) of the Contract and shall be resolved as provided in said Section 17. (Dispute Resolution).
- H. For purposes of this Section 7. (Tax Credit Pass Through) of this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), an Affiliate of Subscriber Organization is a company that directly or indirectly controls, is controlled by, or is under common control with Subscriber Organization, and Subscriber Organization may perform its obligations under this Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) directly or through one or more Affiliates.

---END---

ATTACHMENT C

REQUIRED PERFORMANCE METRICS; LIQUIDATED DAMAGES

1. MODIFIED POOLED OMC EQUIPMENT AVAILABILITY FACTOR; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

- (a) Calculation of the Modified Pooled OMC Equipment Availability Factor. Following the end of each LD Period, the Modified Pooled OMC Equipment Availability Factor shall be calculated for such LD Period as set forth in Section 1 (Modified Pooled OMC Equipment Availability Factor (“MPXEEAF”)) of Attachment J (Calculation of Certain Metrics) to the Contract.
- (b) Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages. For each LD Period, a Modified Pooled OMC Equipment Availability Factor shall be calculated as provided in accordance with Section 1 (Modified Pooled OMC Equipment Availability Factor (“MPXEEAF”)) of Attachment J (Calculation of Certain Metrics) to the Contract. In the event the Modified Pooled OMC Equipment Availability Factor is less than **97%** (the "Modified Pooled OMC Equipment Availability Factor Performance Metric") for any LD Period, Subscriber Organization shall be subject to liquidated damages as set forth in this Section 1(b) (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages). For avoidance of doubt, because the Modified Pooled OMC Equipment Availability Factor is calculated over an LD Period of 12 calendar months, the first month for which liquidated damages would be calculated under this Section 1(b) (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages) would be the last calendar month of the initial Contract Year. If the Modified Pooled OMC Equipment Availability Factor for a LD Period is less than the Modified Pooled OMC Equipment Availability Factor Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C Section 9. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for Subscriber Organization's failure to achieve the Modified Pooled OMC Equipment Availability Factor Performance Metric for such LD Period, an amount calculated in accordance with the following formula:

Modified Pooled
OMC Equipment
Availability Factor

Amount of Liquidated Damages Per Calendar Month

96.9% and below

For each one-tenth of one percent (0.001) by which the Modified Pooled OMC Equipment Availability Factor for such LD Period falls below the Modified Pooled OMC Equipment Availability Factor Performance Metric, an amount equal to 0.001 of the Applicable Period Lump Sum Payment for the last calendar month of such LD Period.

For purposes of determining liquidated damages under the preceding formula, the amount by which the Modified Pooled OMC Equipment Availability Factor for the LD Period in question falls below the applicable threshold shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the Modified Pooled OMC Equipment Availability Factor Performance Metric for a LD Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

- (c) Modified Pooled OMC Equipment Availability Factor Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 1(b) (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages) is to compensate Company for the damages that Company would incur if the Subscriber Organization fails to achieve the Modified Pooled OMC Equipment Availability Factor Performance Metric for a LD Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the Facility is likely to continue to substantially underperform the Modified Pooled OMC Equipment Availability Factor Performance Metric. Accordingly, and without limitation to Company's rights under said Section 1(b) (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages) for those LD Periods during which the Subscriber Organization failed to achieve the Modified Pooled OMC Equipment Availability Factor Performance Metric, the failure of the Facility to achieve a Modified Pooled OMC Equipment Availability Factor of not less than **84%** for each of three consecutive Contract Years shall constitute an Event of Default under Section 13 of this Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 14 (Termination for Cause) and Section 15 (Damages in the Event of Termination by Company) of the Contract.

2. PERFORMANCE INDEX; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

- (a) Calculation of Performance Index.
- (i) The Performance Index represents the efficiency of the WTG's conversion of the wind resource to electricity by comparing the calculated Expected Generation at the WTGs to the measured Actual Generation at the WTGs during Contact Hours excluding periods where the operational state is categorized as ERSDTH, oEFDTH, oEMPTH, oEPDTH or Environmental Derate.
- (ii) Following the end of each PI Assessment Period, the Performance Index shall be calculated for such PI Assessment Period (using the previous 12 months of data) as set forth in Section 2 (Performance Index) of Attachment J (Calculation of Certain Performance Metrics) to the Contract.
- (iii) PI Test. In the event that the set of operational data points under Attachment J (Calculation of Certain Performance Metrics) that is available for any month to calculate the PI cannot be validated to Company's reasonable satisfaction or in the event there were not at least 16 such data points during such month that could be used to calculate the PI, the Company shall have the right to perform a test ("PI Test") to collect the data points for such month to be used to calculate the PI in lieu of the use of operational data for such month. The Company shall retain sole discretion as to when to conduct the PI Test, and the PI Test may be conducted at any point during the month following the month for which Company was either unable to validate the set of operational data points for such month or there were not at least 24 data points available during such month. The PI Test shall have a minimum duration of four (4) hours and shall run until at least 16 data points are collected that meet the criteria set forth in Attachment J (Calculation of Certain Performance Metrics). During a PI Test, the PI shall be calculated from the data points collected during said PI Test using the formula set forth in Attachment J. To the extent possible, the Company shall schedule the PI Test for a period where all WTGs are available and weather conditions are expected to be optimum allowing the WTG System to generate at near full capacity for the duration of the PI Test (if possible). The result of the calculation based on the PI Test shall be the PI for the PI Assessment Period in question.
- (iv) For each PI Assessment Period that includes one or more months for which a PI Test was performed, the data points collected during said PI Test for such month(s) shall be used together with the data points for months for which a PI Test was not conducted to calculate the PI for the PI Assessment Period in question using the formula set forth in Section 2. (a)(iii) above. The

result of the calculation based on the PI Test shall be the PI for the PI Assessment period in question.

- (b) GPI Metric and Liquidated Damages. For each PI Assessment Period, a Performance Index shall be calculated as provided in Section 2 (Performance Index) of Attachment J (Calculation of Certain Metrics) to the Contract. In the event the PI is less than 97% (the "GPI Metric"), Subscriber Organization shall pay, in accordance with Attachment C Section 9., (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for Subscriber Organization's failure to achieve the GPI Metric for such PI Assessment Period, an amount calculated in accordance with the following formula:

<u>Tier</u>	<u>Facility PI</u>	<u>Amount of Liquidated Damages Per Calendar Month</u>
Tier 1	97.0%>PI> or equal to 90.0%	For each one-tenth of one percent (0.001) by which the Performance Index for such PI Assessment Period falls below 97% and is above 89.9%, an amount equal to one-tenth of one percent (0.001) of the PI Assessment Period Lump Sum Payment; plus
Tier 2	90.0%>PI> or equal to 80.0%	For each one-tenth of one percent (0.001) by which the Performance Index for such PI Assessment Period falls below 90.0% and is above 79.9%, an amount equal to two-tenths of one percent (0.002) of the PI Assessment Period Lump Sum Payment; plus
Tier 3	Below 80.0%	For each one-tenth of one percent (0.001) by which the Performance Index for such PI Assessment Period falls below 80.0%, an amount equal to four-tenths of one percent (0.004) of the PI Assessment Period Lump Sum Payment.

- (c) PI Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 2(b) (GPI Metric and Liquidated Damages) is to compensate Company for the damages that Company would incur if the Subscriber Organization fails to achieve the GPI Metric for a PI Assessment Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the Facility is likely to continue to substantially underperform the GPI Metric. Accordingly, and without limitation to Company's rights under said Section 2(b) (GPI Metric and Liquidated Damages) for those PI Assessment Periods during which the Subscriber Organization failed to achieve the GPI Metric, the failure of the Facility to achieve, for each of three consecutive Contract Years, a Performance Index of not less than the Tier 2 Bandwidth for such Contract Year shall constitute an Event of Default under Section 13 of the Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 14 (Termination for Cause) and Section 15 (Damages in the Event of Termination by Company) of the Contract.

3. **[RESERVED]**

4. **BESS CAPACITY TEST; LIQUIDATED DAMAGES; TERMINATION RIGHTS.**

- (a) BESS Capacity Test and Liquidated Damages. For each BESS Measurement Period following the Commercial Operations Date, the BESS shall be required to complete a BESS Capacity Test, as more

fully set forth in Section 1 (BESS Tests) of Attachment H (BESS Requirements) to the Contract. For each BESS Measurement Period for which the BESS fails to demonstrate that it satisfies the BESS Capacity Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C Section 9. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for such shortfall, the amount set forth in the following table (on a progressive basis) upon proper demand at the end the BESS Measurement Period in question:

BESS Capacity Ratio	Liquidated Damage Amount
Tier 1 95.0% - 99.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 100% and is above 94.9%, an amount equal to one-tenth of one percent (0.001) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 2 85.0% - 94.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 95% and is above 84.9%, an amount equal to one and a half-tenths of one percent (0.0015) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 3 75.0% - 84.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 85% and is above 74.9%, an amount equal to two-tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 4 60.0% - 74.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 75% and is above 59.9%, an amount equal to two and a half-tenths of one percent (0.0025) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 5 50.0% - 59.9%	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 60% and is above 49.9%, an amount equal to three-tenths of one percent (0.003) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 6 49.9% and below ("Lowest BESS Capacity Bandwidth")	For each one-tenth of one percent (0.001) that the BESS Capacity Ratio is below 50%, an amount equal to three and a half-tenths of one percent (0.0035) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question.

For purposes of determining liquidated damages under this Section 4(a) (BESS Capacity Test and Liquidated Damages), the starting and end points for the duration of the period that the BESS discharges shall be rounded to the nearest MWh. Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the BESS Capacity Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

EXAMPLE: The following is an example calculation of liquidated damages for the BESS Capacity Performance Metric and is included for illustrative purposes only. Assume the following:

The Maximum Rated Output for the BESS is 25 MW.

A BESS Capacity Test was conducted, and the BESS was measured to have discharged 65 MWh

BESS Contract Capacity = 25 MW x 4 hours = 100 MWh
 BESS Capacity Ratio = MWh Discharged/BESS Contract Capacity = 65 MWh/100 MWh = 0.65

LD = $[(1 - 0.950) \times 1] + [(0.950 - 0.850) \times 1.5] + [(0.850 - 0.750) \times 2] + [(0.750 - 0.65) \times 2.5]$ x BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question
 = 0.65 x BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question

- (b) **BESS Capacity Test Termination Rights.** The Parties acknowledge that, although the intent of the liquidated damages payable under Section 4(a) (BESS Capacity Test and Liquidated Damages) is to compensate Company for the damages that Company would incur if the BESS fails to demonstrate satisfaction of the BESS Capacity Performance Metric during a BESS Measurement Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the BESS is likely to continue to substantially underperform the Company's expectations. Accordingly, and without limitation to Company's rights under said Section 4(a) (BESS Capacity Test and Liquidated Damages) for those BESS Measurement Periods during which the BESS fails to demonstrate satisfaction of the BESS Capacity Performance Metric, substantial underperformance shall give rise to a termination right as set forth in this Section 4(b) (BESS Capacity Test Termination Rights). If the BESS is in the Lowest BESS Capacity Bandwidth for any two BESS Measurement Periods during a 12-month period, an **18-month** cure period (the "BESS Capacity Cure Period") will commence on the Day following the close of the second such BESS Measurement Period. For each BESS Measurement Period during such BESS Capacity Cure Period, BESS Capacity Tests shall continue to be conducted as set forth in Attachment H (BESS Requirements) and liquidated damages paid and accepted as set forth in Section 4 (a) (BESS Capacity Test and Liquidated Damages); provided, however, that if the Subscriber Organization fails to demonstrate satisfaction of the BESS Capacity Performance Metric prior to the expiration of the BESS Capacity Cure Period, such failure shall constitute an Event of Default under Section 13 of the Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 14 (Termination for Cause) and Section 15 (Damages in the Event of Termination by Company).

5. BESS ANNUAL EQUIVALENT AVAILABILITY FACTOR; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

- (a) **BESS Annual Equivalent Availability Factor and Liquidated Damages.** For each BESS Measurement Period following the Commercial Operations Date, a BESS Annual Equivalent Availability Factor shall be calculated as set forth in Section 2 (BESS Annual Equivalent Availability Factor) of Attachment H (BESS Requirements) to the Contract. If the BESS Annual Equivalent Availability Factor for such BESS Measurement Period is less than **97%** (the "BESS EAF Performance Metric"), Subscriber Organization shall pay, in accordance with Attachment C Section 9. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for such shortfall, the amount set forth in the following table (on a progressive basis) upon proper demand at the end the current BESS Measurement Period:

BESS Annual Equivalent Availability Factor	Liquidated Damage Amount
Tier 1 85.0% - 96.9%	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 97% but equal to or above 85%, an amount equal to one-tenth of one percent (0.001) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 2	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 85% but equal to or above 80%, an amount equal to two-

80.0% - 84.9%	tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 3 75.0% - 79.9%	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 80% but equal to or above 75%, an amount equal to three-tenths of one percent (0.003) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
Tier 4 Below 75.0%	For each one-tenth of one percent (0.001) by which the BESS Annual Equivalent Availability Factor falls below 75%, an amount equal to four-tenths of one percent (0.004) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question.

For purposes of determining liquidated damages under this Section 5(a) (BESS Annual Equivalent Availability Factor and Liquidated Damages), the BESS Annual Equivalent Availability Factor for the BESS Measurement Period in question shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the BESS EAF Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

EXAMPLE: The following is an example calculation of liquidated damages for the BESS Annual Equivalent Availability Factor Performance Metric and is included for illustrative purposes only. Assume the following:

The monthly Lump Sum Payment is \$1,000,000

The BESS Annual Equivalent Availability Factor Performance Metric was calculated to be 72.9%.

BESS Allocated Portion of the Lump Sum Payment = 50% x 3 calendar months x \$1,000,000 = \$1,500,000

LD = $[(0.970-0.850) \times 1] + [(0.850-0.800) \times 2] + [(0.800-0.750) \times 3] + [(0.750-0.729) \times 4]$ x \$1,500,000

= $[0.120 + 0.100 + 0.150 + 0.084]$ x \$1,500,000 = \$681,000

- (b) BESS Annual Equivalent Availability Factor Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 5(a) (BESS Annual Equivalent Availability Factor and Liquidated Damages) is to compensate Company for the damages that Company would incur if the Subscriber Organization fails to achieve the BESS EAF Performance Metric for a BESS Measurement Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the BESS is likely to continue to substantially underperform the BESS EAF Performance Metric. Accordingly, and without limitation to Company's rights under said Section 5(a) (BESS Annual Equivalent Availability Factor and Liquidated Damages) for those BESS Measurement Periods during which the Subscriber Organization failed to achieve the BESS EAF Performance Metric, the failure of the Subscriber Organization to achieve, for each of six consecutive BESS Measurement Periods, a BESS Annual Equivalent Availability Factor of not less than **75%** shall constitute an Event of Default under Section 13 of the Contract for which Company shall have the rights including but not limited to the termination rights set forth in Section 14 (Termination for Cause) and Section 15 (Damages in the Event of Termination by Company) of the Contract; provided, however, that if a BESS Measurement Period for which the aforementioned **75%** threshold is not achieved falls within a BESS

Capacity Cure Period, such BESS Measurement Period shall be excluded from the calculation of the aforementioned "six consecutive BESS Measurement Periods" if the failure to achieve the aforementioned 75% threshold was the result of unavailability caused by the process of carrying out the repairs to or replacements of the BESS necessary to remedy the failure of the BESS to achieve the BESS Capacity Performance Metric.

6. BESS ANNUAL EQUIVALENT FORCED OUTAGE FACTOR; LIQUIDATED DAMAGES.

For each BESS Measurement Period following the Commercial Operations Date, the BESS shall maintain a BESS Annual Equivalent Forced Outage Factor of not more than 4% (the "BESS EFOF Performance Metric") as calculated as set forth in Section 3 (BESS Annual Equivalent Forced Outage Factor) of Attachment H (BESS Requirements) to the Contract. If the BESS Annual Equivalent Forced Outage Factor for such BESS Measurement Period exceeds the BESS EFOF Performance Metric, Subscriber Organization shall pay, in accordance with Attachment C Section 9. (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), and Company shall accept, as liquidated damages for exceeding the BESS EFOF Performance Metric, the amount set forth in the following table (on a progressive basis) upon proper demand by the Company at the end of the BESS Measurement Period in question.

BESS Annual Equivalent Forced Outage Factor	Liquidated Damage Amount
0.0% - 4.0%	-0-
4.1% - 6.9%	For each one-tenth of one percent (0.001) that the BESS Annual Equivalent Forced Outage Factor is above 4.0% but less than 7.0%, an amount equal to two-tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question; plus
7.0% and above	For each one-tenth of one percent (0.001) that the BESS Annual Equivalent Forced Outage Factor is above 6.9%, an amount equal to four-tenths of one percent (0.004) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question

For purposes of determining liquidated damages under this Attachment C Section 6 (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages), the BESS Annual Equivalent Forced Outage Factor for the BESS Measurement Period in question shall be rounded to the nearest one-tenth of one percent (0.001). Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the BESS EFOF Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

For example, if the BESS Equivalent Annual Forced Outage Factor was 4.1% as calculated in the example in Attachment H (BESS Annual Equivalent Forced Outage Factor) attached hereto and the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question is \$1,000,000, the liquidated damages would be \$2,000, calculated as follows:

$$\begin{aligned}
 4.1\% - 4.0\% &= 0.1\% \\
 0.1\%/0.1 &= 1 \\
 \$1,000,000 \times .002 &= \$2,000 \\
 \$2,000 \times 1 &= \$2,000
 \end{aligned}$$

7. BESS ROUND TRIP EFFICIENCY TEST; LIQUIDATED DAMAGES; TERMINATION RIGHTS.

- (a) RTE Test and Liquidated Damages. For each BESS Measurement Period following the Commercial Operations Date, the BESS shall be required to complete a RTE Test or otherwise demonstrate satisfaction of the RTE Performance Metric, as more fully set forth in Section 1 (BESS Tests) of Attachment H (BESS Requirements) to the Contract. For each BESS Measurement Period for which the BESS fails to demonstrate that it satisfies the RTE Performance Metric, Subscriber Organization shall pay, and Company shall accept, in accordance with Attachment C Section 9, (Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damages), as liquidated damages for such shortfall, in the amount to be calculated as provided in this Section 7(a) (RTE Test and Liquidated Damages), upon proper demand at the end the BESS Measurement Period in question.

The RTE Performance Metric is %. The RTE Performance Metric represents the lowest acceptable efficiency of the BESS for a full charge and discharge cycle if all energy to achieve the full cycle was taken from and delivered to the Point of Interconnection. **[DRAFTING NOTE: PERCENTAGE TO BE TAKEN FROM RESPONSE TO RFP. The metric will remain a “theoretical” POI to POI worse and represents the worst acceptable performance, even though the intake energy measurement used in the RTE test will move electrically closer to the BESS. This is in the Subscriber Organization's favor, as it can expect to gain efficiency (less losses) by moving the intake energy measurement point closer to the BESS as set forth in Attachment H.]**

The liquidated damages threshold ("LDT") is equal to the RTE Performance Metric minus 2 percentage points.

The Selected RTE Test is the RTE Test most recently completed during the BESS Measurement Period in question.

Subscriber Organization shall be liable for liquidated damages if:

$$(PM - RTE Ratio) > 2\%$$

Where:

PM = RTE Performance Metric stated as percentage

RTE Ratio = RTE Ratio from Selected RTE Test stated as percentage

For each percentage point by which the RTE Ratio is below the LDT, Subscriber Organization shall pay, and Company shall accept, liquidated damages in an amount equal to two-tenths of one percent (0.002) of the BESS Allocated Portion of the Lump Sum Payment for the BESS Measurement Period in question, in accordance with Section 9.(Payment of Liquidated Damages for Failure to Achieve Performance Metrics; Limitation on Liquidated Damage).

Each Party agrees and acknowledges that (i) the damages that Company would incur if the Subscriber Organization fails to achieve the RTE Performance Metric for a BESS Measurement Period would be difficult or impossible to calculate with certainty and (ii) the aforesaid liquidated damages are an appropriate approximation of such damages.

- (b) RTE Test Termination Rights. The Parties acknowledge that, although the intent of the liquidated damages payable under Section 7 (a) (RTE Test and Liquidated Damages) is to compensate Company for the damages that Company would incur if the BESS fails to demonstrate satisfaction of the RTE Performance Metric during a BESS Measurement Period, such liquidated damages are not intended to compensate Company for the damages that Company would incur if a pattern of underperformance establishes a reasonable expectation that the BESS is likely to continue to substantially underperform

the Company's expectations. Accordingly, and without limitation to Company's rights under said Section 7(a) (RTE Test and Liquidated Damages) for those BESS Measurement Periods during which the BESS fails to demonstrate satisfaction of the RTE Performance Metric, substantial underperformance shall give rise to a termination right as set forth in this Section 7(b) (RTE Test Termination Rights). If the RTE Ratio for the Selected RTE Test for the BESS Measurement Period in question is more than 15 percentage points below the RTE Performance Metric for any two BESS Measurement Periods during a 12-month period, an **18-month** cure period (the "RTE Cure Period") will commence on the Day following the close of the second such BESS Measurement Period. For each BESS Measurement Period during such RTE Cure Period, RTE Tests shall continue to be conducted as set forth in Section 1 of Attachment H (BESS Requirements) and liquidated damages paid and accepted as set forth in Section 2(a) (RTE Test and Liquidated Damages); provided, however, that if the Subscriber Organization fails to demonstrate satisfaction of the RTE Performance Metric prior to the expiration of the RTE Cure Period, such failure shall constitute an Event of Default under Section 13 of the Contract for which Company shall have the rights (including but not limited to the termination rights) set forth in Section 14 (Termination for Cause) and Section 15 (Damages in the Event of Termination by Company) of the Contract.

8. **[RESERVED]**

9. **PAYMENT OF LIQUIDATED DAMAGES FOR FAILURE TO ACHIEVE PERFORMANCE METRICS; LIMITATION ON LIQUIDATED DAMAGE.**

(a) Payment of Performance Metrics LDs by Subscriber Organization.

With respect to the liquidated damages payable under Section 1(b) (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages), Section 2 (b) (GPI Metric and Liquidated Damages), Section 4(a) (BESS Capacity Test and Liquidated Damages), Section 5(a) (BESS Annual Equivalent Availability Factor and Liquidated Damages), Section 6 (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages) and Section 7 (BESS Round Trip Efficiency Test; Liquidated Damages; Termination Rights) (collectively, the "Performance Metrics LDs"), Company shall have the right, at any time on or after the LD Assessment Date for the liquidated damages in question, at Company's option, to set-off such liquidated damages from the amounts to be paid to Subscriber Organization for the Baseline SO Payment or, to draw such liquidated damages from the Operating Period Security, as follows:

~~(i) if the BESS fails to achieve the BESS Capacity Performance Metric for a BESS Measurement Period, the Company shall have the right to set-off or draw the amount owed for such failure as calculated as provided in Section 4(a) (BESS Capacity Test and Liquidated Damages); and~~

~~(i) [Reserved]~~

(ii) if the Monthly Report for the calendar month, PI Assessment Period, or BESS Measurement Period in question, as applicable, shows a failure to achieve one or more of the Performance Metrics required for the LD Period in question, the PI Measurement Period in question, or the BESS Measurement Period in question, as applicable, and Company does not submit a Notice of Disagreement with respect to such Monthly Report, the Company shall have the right to set-off or draw the amount of liquidated damages owed for such failure as calculated as provided in Section 1(b) (Modified Pooled OMC Equipment Availability Factor Performance Metric and Liquidated Damages), Section 2(b) (GPI Metric and Liquidated Damages), Section 4. (BESS Capacity Test and Liquidated Damages), Section 5(a) (BESS Annual Equivalent Availability Factor and Liquidated Damages), Section 6 (BESS Annual Equivalent Forced Outage Factor; Liquidated Damages) and Section 7 (BESS Round Trip Efficiency Test; Liquidated Damages; Termination Rights), as applicable;

- (iii) in all cases in which Company submits a Notice of Disagreement for a given Monthly Report, Company shall have the right to set-off or draw all or any portion of the amount of liquidated damages for the calendar month in question, PI Assessment Period in question or BESS Measurement Period in question, as applicable, as calculated on the basis of the shortfall(s) in the achievement of the Performance Metric(s) in question, as shown in such Notice of Disagreement; and
- (iv) in the event of any disagreement as to the liquidated damages owed under clause 9(a)(i) and 9(a)(iii) above:
 - (aa) if the amount set-off or drawn by the Company exceeds the amount of liquidated damages for such calendar month, BESS Measurement Period or PI Assessment Period that are eventually found to be payable for the LD Period in question as determined under Section 2 (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to this Contract, Company shall promptly (and in no event more than forty-five (45) Business Days from the date of such determination) repay such excess to Subscriber Organization together with, unless the Parties otherwise agree in writing, interest from the date of Company's set-off or draw until the date that such excess is repaid to Subscriber Organization at the average Prime Rate for such period; and
 - (bb) if Company does not exercise its rights to set-off or draw liquidated damages for such calendar month, BESS Measurement Period or PI Assessment Period, or does not set-off or draw the full amount of the liquidated damages for such calendar month, BESS Measurement Period or PI Assessment Period that are eventually found to be payable for the LD Period, the BESS Measurement Period or PI Assessment Period in question as determined under Section 2 (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to the Contract, Subscriber Organization shall promptly, upon such determination as aforesaid, pay to Company the amount of liquidated damages that are found to be owing together with, unless otherwise agreed by the Parties in writing, interest on the amount of such liquidated damages that went unpaid from the applicable LD Assessment Date for such liquidated damages until the date such liquidated damages are paid to Company in full at the average Prime Rate for such period, and Company shall have the right, at its option, to set-off such interest from the amounts to be paid to Subscriber Organization for the Baseline SO Payment or to draw from the Operating Period Security.
 - (cc) Any delay by Company in exercising its rights to set-off liquidated damages and/or interest from the amounts to be paid to Subscriber Organization for the Baseline SO Payment or to draw such liquidated damages and/or interest from the Operating Period Security shall not constitute a waiver by Company of its right to do so.
- (b) Limitation on Liquidated Damages. Notwithstanding any other provision of this Attachment C or the Contract to the contrary, the aggregate liquidated damages paid by Subscriber Organization during each Contract Year for the Performance Metrics LDs, such payments by Subscriber Organization to include but not be limited to any set-offs or draws made by Company during such Contract Year pursuant to Section 9(a) (Payment of Liquidated Damages Performance Metrics LDs by Subscriber Organization) of this Attachment C, shall not exceed the total of the twelve (12) monthly ~~Lump Sum~~ Baseline SO Payments payable during such Contract Year pursuant to Section 4.A.2 (Payment for Electric Energy), Section 4.B (Lump Sum Payment), Section 4.B, (Subscriber Organization's Preparation of the Monthly Invoice) and Section 4.G (Payment Procedures) of the Contract. For avoidance of doubt: A monthly Lump Sum Payment that is invoiced by Subscriber Organization to Company pursuant to Contract Section 4.F (Subscriber Organization's Preparation of the Monthly Invoice) for, e.g., the twelfth (12th) calendar month of Contract Year N but is paid during Contract Year N+1 as provided in Contract Section 4.G (Payment Procedures) shall, for purposes of determining the limitation on Performance Metrics LDs

under this Section 9(b) (Limitation on Liquidated Damages), be included in the total of the twelve (12) monthly Lump Sum Payments payable during Contract Year N+1. As a result of the foregoing, the total of the monthly Lump Sum Payments used to establish the limitation on Performance Metrics LDs for the initial Contract Year under this Section 9(b) (Limitation on Liquidated Damages) will be less than twelve (12). The Parties acknowledge that, because the monthly Lump Sum Payment is subject to adjustment (including downward adjustment) as provided in Section 2.3 (Lump Sum Payment), it is possible that a downward adjustment in some or all of the monthly Lump Sum Payments payable during a Contract Year might cause the Performance Metrics LDs paid by Subscriber Organization during the course of such Contract Year to exceed the limitation on the Performance Metrics LDs for such Contract Year established at the close of such Contract Year pursuant to the first sentence of this Section 9(b) (Limitation on Liquidated Damages). In such case, Company shall promptly upon the determination that the Performance Metrics LDs paid during the course of such Contract Year exceeded the limitation on Performance Metrics LDs for such Contract Year (and in no event more than forty-five (45) Business Days from the end of such Contract Year) repay such excess amount to Subscriber Organization without interest. **[Drafting Note: If Contract has an Energy Payment, include language in bold text.]**

(c) Payment of Shortfall Performance Metrics LDs by Reduction of Bill Credits.

- (i) If Performance Metrics LDs remain unpaid after Company has exercised its rights under Section 9(a) (Payment of Performance Metrics LDs by Subscriber Organization) of the Contract to set off such liquidated damages from the amounts to be paid to Subscriber Organization and to draw such liquidated damages from the Operating Period Security, the Company shall have the right to pay such unpaid Performance Metrics LDs ("Shortfall Performance Metrics LDs") by reducing Bill Credits in the aggregate amount of such unpaid Shortfall Performance Metrics LDs. The reduction in Bill Credits shall be proportionate so that the burden of paying the Shortfall Performance Metrics LDs is shared equitably among the Subscribers.
- (ii) In the event of any disagreement under Section 9(a) (Payment of Performance Metrics LDs by Subscriber Organization) of the Contract as to the amount of liquidated damages owing:
 - (aa) upon the resolution of such disagreement pursuant to Section 2 (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to the Contract, if such resolution has the effect of reducing the Shortfall Performance Metrics LDs, and if such reduction in the Shortfall Performance Metrics LDs has the effect of causing the reduction in Bill Credits previously implemented by Company under Section 9(c)(i) to exceed the actual amount of the Shortfall Performance Metrics LDs (the amount of such excess being referred to herein on the "Excess Reduction in Bill Credits"), Company shall promptly (and in no event later than the second billing cycle for each Subscriber following the date of the resolution of such disagreement as aforesaid) afford to such Subscriber a Bill Credit (referred to herein as a "Compensatory Bill Credit") in an amount equivalent to the total of (i) such Subscriber's proportionate share of the Excess Reduction in Bill Credits and (ii), unless the Company and Subscriber Organization otherwise agree in writing as provided in Section 2.12(a)(iv)(aa), interest on the amount of the Excess Reduction in Bill Credits from the date Company implemented such Excess Reduction in Bill Credits with respect to such Subscriber until the date that Company applies the Compensatory Bill Credit against such Subscriber's retail electric service bill, at the average Prime Rate for such period; and
 - (bb) upon the resolution of such disagreement pursuant to Section 2 (Monthly Report Disagreements) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to the Contract, if Company has not previously exercised its rights to set-off or draw liquidated damages pursuant to Section 9(a) (Payment of Performance Metrics LDs by Subscriber Organization), or has not previously set-off or drawn from the Performance Security the full amount of the liquidated damages that are eventually found to be payable as

a result of the resolution of such disagreement, Company shall have the right to reduce Subscriber Bill Credits in an amount equal to the total of Subscribers' share of pay such Shortfall Performance Metrics LDs.

ATTACHMENT D

CALCULATION AND ADJUSTMENT OF NET ENERGY POTENTIAL

1. NET ENERGY POTENTIAL.

A. Net Energy Potential and the Intent of the Parties. The essence of this Attachment D is that Company is paying to Subscriber Organization a Lump Sum Payment in exchange for Company's right to dispatch, subject to Renewable Resource Variability, the Facility's Net Energy Potential. Under this Attachment D, "Net Energy Potential": (i) constitutes an estimated single number with a P-Value of 95 for annual Net Energy that could be produced by the Facility based on the estimated long-term monthly and annual total of such production over a period of ten years excluding losses due to availability and Company Dispatch; (ii) is subject to adjustment from time to time as provided in this Attachment D (Calculation and Adjustment of Net Energy Potential); and (iii) as so adjusted, provides a basis for calculating and adjusting the Lump Sum Payment, as provided in Section 3. (Calculation of Lump Sum Payment) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to the Contract. The Net Energy Potential shall be calculated using, but not limited to, long-term resource data correlated with on-site measurements (if available), the most current construction design and equipment specifications, and industry-accepted energy simulation models. Loss factors and uncertainty analysis are to be determined using industry best practices and standard assumptions. Loss factors shall include, but not be limited to, electrical losses. Loss factors will exclude losses due to availability and Company Dispatch. In the case of the Initial OEPR and any Subsequent OEPR evaluation, the Net Energy Potential shall also consider historical operational data further described in this Attachment D Section 2.E). It is the intent of the Parties that the estimate of Net Energy Potential, as calculated and adjusted as foresaid, should reflect the following risk allocation between the Parties under the Contract:

1. Subscriber Organization has assumed the risk of downward adjustment to the Net Energy Potential (and hence the Lump Sum Payment) to account for any of the following circumstances:
 - a. if the Renewable Resource Baseline (as estimated on the basis of the typical meteorological year as derived from the Site's measured meteorological data) is lower than Subscriber Organization had assumed when it submitted its RFP Proposal;
 - b. if the as-built design and construction of the Facility is not as efficient in generating electrical energy and delivering such electric energy to the Point of Interconnection as Subscriber Organization had assumed when it submitted its RFP Proposal; and
 - c. if the Facility's level of operational efficiency is below the standard of comparable facilities;
 - d. Company has assumed the risk of the following (i.e., the following are to be disregarded for purposes of estimating Net Energy Potential (and hence the Lump Sum Payment)):
 - e. Renewable Resource Variability; and
 - f. the possibility that, at any given moment, Company does not need to dispatch any or all of the electric energy that the Facility is then capable of generating and delivering to the Point of Interconnection.
2. The foregoing is not intended as an exhaustive list of the risks assumed by either Party under this Attachment D or as a limitation on the circumstances that an OEPR Evaluator, in its professional judgment, may decide to take into account in preparing its OEPR under Section 2.E. (Terms of Engagement) of this Attachment D (Calculation and Adjustment of Net Energy Potential).

B. NEP RFP Projection. In its RFP Proposal, the Subscriber Organization projected that the Facility would have a Net Energy Potential (as defined in this Attachment D) of [REDACTED] MWh [**NOTE – INSERT NEP FROM RFP PROPOSAL**], and Company relied on Subscriber Organization's NEP RFP Projection in deciding to contract with Subscriber Organization in lieu of other developers. Among the fundamentals of the bargain evidenced in this Attachment D is that there will be consequences to Subscriber Organization if (i) the IE Energy Assessment does not support the NEP RFP Projection and/or (ii) the operational performance of the Facility indicates a Net Energy Potential that is below the applicable thresholds set forth in this Attachment D (Calculation and Adjustment of Net Energy Potential).

- C. NEP IE Estimate and Company-Designated NEP Estimate. Prior to the closing of the construction financing for the Facility but in no event later than the Commercial Operations Date, the Subscriber Organization shall provide Company with a copy of the IE Energy Assessment Report. In addition, Subscriber Organization shall obtain from the administrative agent of the Facility Lender and provide to Company, at financial close of the construction debt financing, a confirmation letter confirming to Company that the IE Energy Assessment Report provided by Subscriber Organization to Company is the final energy assessment prepared for the Facility Lender as part of the Facility Lender's due diligence leading up to the Facility Lender's legally binding commitment (subject to certain conditions precedent) to provide a specific amount of financing for the Project as evidenced by the Facility Lender's execution of the Financing Documents. If the IE Energy Assessment Report fails to provide a NEP IE Estimate that is consistent with the requirements of this Attachment D in all material respects, or if the confirmation letter is not provided, Company shall have the option, exercisable by written notice to Subscriber Organization issued no later than 30 Days, or such longer period as the Parties may agree in writing, following the first to occur of Company's receipt of (i) the IE Energy Assessment Report or (ii) notice that Company will not be provided with a copy of the IE Energy Assessment Report and the data on plane of array of irradiance, ambient temperature, wind speed and corresponding power output used in arriving at the NEP IE Estimate, to designate such Company-Designated NEP Estimate as Company, in its sole discretion, determines to be reasonable in light of the information then available to Company. In connection with Company's decision as to whether to designate a Company-Designated NEP Estimate, Company shall have the right to require Subscriber Organization to pay for an energy assessment to be performed by an independent engineer selected by Company. In such case, the aforesaid 30-Day period for Company's decision to designate a Company-Designated NEP Estimate shall be tolled for the time necessary to prepare such assessment. If Company fails, within the aforesaid 30-Day period as such period may be tolled as provided in the preceding sentence, to designate a Company-Designated NEP Estimate, the NEP RFP Projection shall constitute the First NEP Benchmark, unless the Parties agree in writing on a lower First NEP Benchmark.
- D. NEP IE Estimate, Liquidated Damages and Subscriber Organization's Null and Void Right. If the NEP IE Estimate is higher than the NEP RFP Projection, the NEP RFP Projection shall constitute the First NEP Benchmark. In any other case, Subscriber Organization shall have the option to declare the Contract null and void by written notice to Company as follows:
1. if (aa) the NEP IE Estimate is lower than the NEP RFP Projection and (bb) Subscriber Organization issues its null and void notice to Company not later than 30 Days after issuance of the IE Energy Assessment Report; or
 2. if (aa) Company exercises its right to designate a Company-Designated NEP Estimate under Section 1.C. (NEP IE Estimate and Company-Designated NEP Estimate) of this Attachment D (Calculation and Adjustment of Net Energy Potential), (bb) such Company-Designated NEP Estimate is lower than the NEP RFP Projection, and (cc) Subscriber Organization issues its null and void notice to Company not later than 30 Days after Company's notice of the Company-Designated NEP Estimate.
 3. If Subscriber Organization fails to declare this Attachment D null and void under the conditions set forth in either clause (i) or clause (ii) above, then: (x) the NEP IE Estimate or the Company-Designated NEP Estimate, as applicable, shall thereafter constitute the First NEP Benchmark and (y) Subscriber Organization shall, within five (5) Business Days following the expiration of the applicable 30-Day period for the issuance of Subscriber Organization's null and void notice, pay liquidated damages equal to \$10 for every MWh by which the NEP RFP Projection exceeds the First NEP Benchmark for the initial Contract Year.
- E. Initial OEPR. Following the Initial NEP Verification Date, the Initial OEPR shall be prepared pursuant to the process set forth in Section 2. (Preparation of OEPR) of this Attachment D (Calculation and Adjustment of Net Energy Potential) and the Initial NEP OEPR Estimate shall be as set forth in or derived from the Initial OEPR, as more fully set forth in Section 2.E. (Terms of Engagement) of this Attachment D (Calculation and Adjustment of Net Energy Potential). If the Initial NEP OEPR Estimate differs from the First NEP Benchmark, the Lump Sum Payment shall be recalculated and adjusted as provided in Section 3.B. (Lump Sum Payment during Second Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to the Contract.
- F. Subsequent OEPRS.

1. Required Subsequent OEPR. If Subscriber Organization makes any changes to the Facility that involve (i) replacing any step-up transformer(s) or (ii) making any other changes (e.g., changing the characteristics of the Facility equipment or the specifications used in the IRS) that Company reasonably determines require an updated IRS, then Subscriber Organization shall also be required to have a subsequent OEPR prepared as of the first Day of the calendar month following the second anniversary of the date such change to the Facility was completed.
 2. Voluntary Subsequent OEPR. Without limitation to the generality of Section F.1. (Required Subsequent OEPR) of this Attachment D (Calculation and Adjustment of Net Energy Potential), if the Subscriber Organization makes any changes to the Facility (e.g., replacing original equipment) that does not trigger a required Subsequent OEPR but which changes Subscriber Organization has reasonable grounds to believe will improve the Facility's Net Energy Potential, Subscriber Organization shall have a one-time option, exercisable by written notice to Company issued not less than 120 Days prior to the Applicable NEP Verification Date, of having a subsequent OEPR prepared as of a date no sooner than 24 months following completion of the then most recent OEPR.
 3. Subsequent OEPR and Adjustment to Lump Sum Payment. If the Subsequent NEP OEPR Estimate differs from ~~the 1.F.Most~~ the Most Recent Prior NEP Benchmark, the Lump Sum Payment shall be recalculated and adjusted as provided in Section 3.B. (Lump Sum Payment Following Second Benchmark Period) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS) to the Contract.
2. PREPARATION OF OEPR. The following provisions apply to the Initial OEPR and any Subsequent OEPR:
- A. Selection of OEPR Evaluator. No later than 90 Days prior to the Applicable NEP Verification Date, Company and Subscriber Organization shall select, in accordance with the terms of this Section 2.A. (Selection of OEPR Evaluator), an independent engineering firm from the firms listed on the OEPR Consultants List (the "OEPR Evaluator") to prepare an operational energy production report ("OEPR"). Each party shall select the names of two (2) firms from the OEPR Consultants List. If there is mutual agreement on one or both of the named firms, then the Subscriber Organization shall select one of the named firms to serve as the OEPR Evaluator. If there is no agreement on any of the named firms, then Subscriber Organization shall select one of the firms named by the Company.
 - B. Eligibility for Appointment as OEPR Evaluator. Both Parties agree that the engineering firms listed in Section 2.J. of this Attachment D (Calculation and Adjustment of Net Energy Potential) are fully qualified to prepare the OEPR. By mutual agreement between the Parties in writing, both Parties acting reasonably, a name or names may be added to or removed from the OEPR Consultants List at any time. In no event shall there be less than three (3) names on the OEPR Consultants List.
 - C. OEPR Period of Record. It is the intent of the Parties that the OEPR shall be prepared using measured meteorological and production data from the OEPR Period of Record. However, although the OEPR Period of Record is a twelve-month period, the Parties acknowledge that, in certain circumstances (e.g., Force Majeure), there may not be twelve months of data available for the OEPR Period of Record. In such case, (i) it is the intent of the Parties that the OEPR be prepared using such measured meteorological and production data that is available from the OEPR Period of Record and (ii) Parties may, by written agreement, direct the OEPR Evaluator to use such additional data outside of the OEPR Period of Record as the Parties may agree. The preceding sentence does not constitute a limitation on the professional judgment of the OEPR Evaluator as to the appropriateness of using measured meteorological and/or production from outside of the OEPR Period of Record.
 - D. Participation of Parties. Promptly following the Applicable NEP Verification Date, Subscriber Organization and Company shall provide the OEPR Evaluator with such data from the OEPR Period of Record as they consider to be material to the preparation of the OEPR. Subscriber Organization and Company shall also provide such additional data and information as the OEPR Evaluator may reasonably request. The Parties shall assist the OEPR Evaluator throughout the process of preparing the OEPR, including making key personnel and records available to the OEPR Evaluator, but neither Party shall be entitled to participate in any meetings with personnel

of the other Party or review of the other Party's records. However, the OEPR Evaluator will have the right to conduct meetings, hearings or oral arguments in which both Parties are represented. Subscriber Organization and Company shall have forty-five (45) Days from issuance of the draft OEPR Report to review and provide feedback to the OEPR Evaluator on such report.

- E. Terms of Engagement. Upon selection of the OEPR Evaluator, as set forth in this Attachment D (Calculation and Adjustment of Net Energy Potential), the Subscriber Organization shall retain and contract with the OEPR Evaluator in accordance with the terms of this Attachment D (Calculation and Adjustment of Net Energy Potential). The OEPR Evaluator's scope of work and expected deliverables for all OEPRs must be acceptable to Company and shall, among other things, require the OEPR Evaluator to provide (i) an estimated single number with a P-Value of 95 for annual Net Energy that could be produced by the Facility based on the estimated long-term monthly and annual total of such production over a period of ten years; (ii) a BOP Benchmark Metric for purposes of allowing the Parties to evaluate the BOP Efficiency Ratio as provided for under this Contract; and (iii) any additional information that may be reasonably required by a Party with respect to the methodology used by the OEPR Evaluator to reach its conclusion. The provisions of this Attachment D (Calculation and Adjustment of Net Energy Potential) do not impose a limit on the OEPR Evaluator's professional judgment as to what other estimates (if any) to include in the OEPR. Without limiting the professional judgment of the OEPR Evaluator in estimating the Net Energy Potential and the BOP Benchmark Metric, the following is a general description of how the Parties anticipate that the OEPR Evaluator will proceed:
1. The purpose of an OEPR is to implement the intent of the Parties as set forth in Section 1.A. (Net Energy Potential and the Intent of the Parties) of this Attachment D (Calculation and Adjustment of Net Energy Potential) by evaluating (i) whether, when the Renewable Resource Baseline (as estimated by the OEPR Evaluator on the basis of the typical meteorological year as derived from the Site's measured meteorological data) is present and the Facility is in Full Dispatch, the Facility is capable of doing what the Parties expected the Facility to do: i.e., generating and delivering to the Point of Interconnection electric energy in an amount consistent with the then applicable Net Energy Potential of the Facility (i.e., the estimate of Net Energy Potential then being used to calculate the monthly Lump Sum Payment pursuant to Section 3. (Calculation of Lump Sum Payment) of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS to the Contract); and (ii) if the Facility is not doing what the parties expected in this regard, identifying a new estimated single number with a P-Value of 95 for annual Net Energy that could be generated and delivered by the Facility based on the estimated long-term monthly and annual total of such production over a period of the next ten years.
 2. At a high level, the analysis relies on reported Actual Output (i.e., energy delivered to the Point of Interconnection) during the OEPR Period of Record and the total reported Actual Generation and the WTGs (i.e., energy production measured at the WTGs) during the OEPR Period of Record to estimate Facility performance over a future evaluation period of ten years. The data from the OEPR Period of Record are first quality screened and evaluated. One-time events are assessed and removed from the record where appropriate. Values for potential energy are then calculated from the reported Actual Generation and the WTGs by adjusting for 100% availability and undischarged energy. Suitable long-term reference data sets are then identified by analyzing the reference for Density-Adjusted Wind Speeds and the normalized values for potential energy production of the WTGs over the OEPR Period of Record. Relationships between selected long-term reference wind speed data sets and normalized values for potential energy production of the WTGs are used to calculate long-term values for such on a monthly and annual basis. Finally, estimates of future Facility availability (taking into account anticipated maintenance) and losses (such as system degradation and BOP losses) are applied in order to calculate the Net Energy Potential. For this purpose, no reductions are made for future estimates of energy that Company may choose not to dispatch. If a copy of the IE Energy Assessment Report is available to the OEPR Evaluator, the OEPR Evaluator should review such Report before commencing preparation of the OEPR and evaluate whether it is appropriate for the OEPR Evaluator to take into account any of the work reflected in the IE Energy Assessment Report.

- F. Timeline and Fees.** The terms of engagement with the OEPR Evaluator shall require the OEPR Evaluator to provide, for Party review, a draft OEPR that shall include a NEP OEPR Estimate and a BOP Benchmark Metric within 30 Days following the NEP Applicable Verification Date ("First OEPR"). The OEPR Evaluator shall be required to provide its completed OEPR within 30 Days following the end of the Parties' 45-Day review period under Section 2.D. (Participation of the Parties) of this Attachment D (Calculation and Adjustment of Net Energy Potential). The Parties shall each pay fifty percent (50%) of the fees and expenses charged by the OEPR Evaluator in connection with the Initial OEPR. For the Initial OEPR, the OEPR Evaluator's fees and costs must be acceptable to Company. Subscriber Organization shall pay all of the fees and expenses charged by the OEPR Evaluator in connection with any Subsequent OEPR. Subscriber Organization shall also pay for any reasonable internal fees and costs incurred by the Company as a result of its participation in the process set forth in Section 2.D. (Participation of Parties) of this Attachment D (Calculation and Adjustment of Net Energy Potential).
- G. Review of the First OEPR or and Subsequent OEPR Report.** In the event Company or Subscriber Organization does not agree with the NEP OEPR Estimate or BOP Benchmark Metric determined by the First OEPR Evaluator, Subscriber Organization or Company may, within 30 Days of issuance of the First OEPR, engage, at its own cost, a different expert evaluator from the OEPR Consultants List (the "Second OEPR Evaluator") to prepare a second OEPR that shall include a NEP OEPR Estimate or BOP Benchmark Metric, as applicable ("Second OEPR"). The terms of engagement with the Second OEPR Evaluator shall require the Second OEPR Evaluator to issue the Second OEPR within 60 Days following the date of its appointment. In the event the NEP OEPR Estimates or BOP Benchmark Metric, as applicable, provided by the First OEPR Evaluator and the Second OEPR Evaluator are different then, within ten (10) Days of the issuance of the Second OEPR, the Parties shall, with the two evaluators, confer in an attempt to mutually agree upon a NEP OEPR Estimate or BOP Benchmark Metric, as applicable ("OEPR Conference").
- H. Review of the Second OEPR Evaluator Report.** If the Parties are unable to agree upon an NEP OEPR Estimate or BOP Benchmark Metric, as applicable, within 30 Days of the OEPR Conference, then within ten (10) Days thereafter the First OEPR Evaluator and Second OEPR Evaluator shall, by mutual agreement, select a third firm from the OEPR Consultants List to act as an independent OEPR Evaluator ("Third OEPR Evaluator"). The Third OEPR Evaluator shall not be a person from the same entity as the First OEPR Evaluator or the Second OEPR Evaluator. The Parties shall direct the Third OEPR Evaluator to review the First OEPR and Second OEPR and select one as the final and binding NEP OEPR Estimate and/or BOP Benchmark Metric, as applicable ("Third OEPR"). The Third OEPR Evaluator shall complete its review and selection of the NEP OEPR Estimate within thirty (30) Days following his or her retention. If the Third OEPR Evaluator selects the First OEPR, then the Party requesting the Second OEPR shall pay for the cost of the Third OEPR. If the Third OEPR Evaluator selects the Second OEPR, then the Parties shall each pay fifty percent (50%) of the fees and expenses charged by the Third OEPR Evaluator in connection with the Third OEPR.
- I. Final, Binding and Conclusive.** The Parties acknowledge the inherent uncertainty in estimating the Net Energy Potential and BOP Benchmark Metric and hereby assume the risk of such uncertainty and waive any right to dispute any of the qualification of the person or entity appointed as the OEPR Evaluator pursuant to Section 2.A. (Selection of OEPR Evaluator) and Section 2.B. (Eligibility for Appointment as OEPR Evaluator) of this Attachment D (Calculation and Adjustment of Net Energy Potential), the appropriateness of the methodology used by OEPR Evaluator in preparing the OEPRs, the NEP OEPR Estimate and/or the BOP Benchmark Metric. Without limitation to the generality of the preceding sentence, the determination of the NEP OEPR Estimate and BOP Benchmark Metric in the First OEPR, Second OEPR (if applicable), or final decision of the Third OEPR Evaluator (if applicable) shall be final, conclusive and binding upon Company and Subscriber Organization and shall not be subject to further dispute under Section 17. (Dispute Resolution) of the Contract; provided that, nothing in this Section 2.I. (Final, Binding and Conclusive) of this Attachment D (Calculation and Adjustment of Net Energy Potential) shall preclude Subscriber Organization from engaging an OEPR Evaluator to issue a Subsequent OEPR as allowed pursuant to Section 1.F. (Subsequent OEPRs) of this Attachment D (Calculation and Adjustment of Net Energy Potential).

J. Acceptable Persons and Entities. The OEPR Evaluator and Second OEPR Evaluator shall be selected from the following engineering firms listed below, subject to such additions or deletions effectuated by the Parties as provided in Section 2.(f) (Eligibility for Appointment as Independent AF Evaluator) of Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) to the Contract and Section 2. B. (Eligibility for Appointment as OEPR Evaluator) of this Attachment D (Calculation and Adjustment of Net Energy Potential):

- DNV GL
- UL
- Black & Veatch
- Leidos Engineering

ATTACHMENT E

**MONTHLY REPORTING AND DISPUTE
RESOLUTION BY INDEPENDENT AF EVALUATOR**

1. MONTHLY REPORT.

Commencing with the month during which the Commercial Operations Date is achieved, and for each calendar month thereafter during the Term, Subscriber Organization shall provide to Company a Monthly Report in Excel, Lotus or such other format as Company may require ("Monthly Report"), which Monthly Report shall include (i) the data for the calendar month in question populated into the form of Monthly Report below, (ii) the data for the BESS Measurement Period ending with the calendar month in question populated into the form of "BESS Measurement Period Report" below, and (iii) Subscriber Organization's calculations of the performance metrics and any liquidated damages assessments for the LD Period ending with such calendar month as set forth below. Subscriber Organization shall deliver such Monthly Report to Company by the tenth (10th) Business Day following the close of the calendar month in question. Subscriber Organization shall deliver the Monthly Report electronically to the address provided by the Company. Company shall have the right to verify all data set forth in the Monthly Report by inspecting measurement instruments and reviewing Facility operating records. Upon Company's request, Subscriber Organization shall promptly provide to Company any additional data and supporting documentation necessary for Company to audit and verify any matters in the Monthly Report.

MONTHLY REPORT

NAME OF IPP FACILITY: [Facility Name]

MONTHLY REPORT PERIOD: [Month Day, Year] to [Month Day, Year]

Enter the total number of hours for each WTG and state during the reporting period
(to 2 decimal places).

TID	ACTH	FTH	MTH	PTH	OFTH	OMTH	OPTH
Turbine1							
Turbine2							
Turbine3							
...							

Enter the Actual Generation (MWh) for each WTG and state during the reporting period
(to 2 decimal places).

TID	CTH	ERSDTH	OEFDTH	OEMPTH	OEPDTH	Env. Derate
Turbine1						
Turbine2						
Turbine3						
...						

Enter the Expected Generation (MWh) for each WTG and state during the reporting period
(to 2 decimal places)

TID	CTH	ERSDTH	OEFDTH	OEMPTH	OEPDTH	Env. Derate
Turbine1						
Turbine2						
Turbine3						
...						

Calculated Pooled OMC Equipment Equivalent Availability Factor for the reporting period:	
--	--

Calculated Performance Index for the reporting period:	
--	--

BESS MEASUREMENT PERIOD REPORT

NAME OF IPP FACILITY: [Facility Name]

BESS MEASUREMENT PERIOD: [Month Day, Year] to [Month Day, Year]

Enter the applicable information from operational data collected during the most recently completed BESS Capacity Test to demonstrate satisfaction of the BESS Capacity Performance Metric during the reporting period. This can either be from the most recent BESS Capacity Test performed during the period or taken from operating data reflecting the net output of the BESS

Date/Time Start	Date/Time End	Total MWh delivered to the POI (A)	BESS Contract Capacity (MWh) (B)	BESS Capacity Ratio 100% x (A/B)

Enter the applicable information ~~from operational data collected during the most recently completed BESS RTE Test~~ to demonstrate satisfaction of the BESS Round Trip Efficiency Performance Metric during the reporting period. This can either be from the most recent BESS RTE Test performed during the period or taken from operational data reflecting the charging/discharging of the BESS.

Date/Time Start	Date/Time End	Total MWh delivered to the POI (A)	Charging Energy (MWh) (B)	BESS RTE Ratio 100% x (A ÷ B)

Please provide the following BESS availability information even for months containing Force Majeure even though it is OMC for purposes of Attachment J (Calculation of Certain Metrics).

Enter the information for each Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (B-A)

Calendar hours in the reporting period: _____

Total Outage hours for the reporting period (from above): _____

Available Hours (AH) in the reporting period: _____

AH from the last three (3) reporting periods: _____

AH for the last four (4) reporting periods: _____

Enter the information for each BESS Planned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E

Total equivalent planned derated hours (EPDH) for the reporting period: _____

EPDH from the last three (3) reporting periods: _____

EPDH for the last four (4) reporting periods: _____

Enter the information for each BESS Unplanned Derating event during the reporting period. Dates and times should be entered to the nearest minute. Duration, size of reduction, maximum rated output, and equivalent hours should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (C) = (B-A)	Size of Reduction (MW) (D)	Maximum Rated Output (MW) (E)	Equivalent Hours (hrs) (C x D)/E

Total equivalent unplanned derated hours (EUDH) for the reporting period: _____

EUDH for the last three (3) reporting periods: _____

EUDH for the last four (4) reporting periods: _____

Period Hours (PH) is: (8760 hours if no 29th day in February in the last month twelve months; otherwise 8784 hours; also can be adjusted appropriately depending on any month(s) containing Force Majeure in the last 12 reporting periods.)

Enter the Available Hours, EPDH and EUDH for the last four (4) reporting periods as calculated above.

AH (A)	EPDH (B)	EUDH (C)	PH (D)	BESS Annual Equivalent Availability Factor $100\% \times (A - B - C)/D$

Enter the information for each Unplanned (Forced) Outage during the reporting period. Dates and times should be entered to the nearest minute. Duration should be rounded to 1 decimal place.

Date/Time Start (A)	Date/Time End (B)	Duration (hrs) (B-A)

Total Forced Outage Hours (FOH) for the reporting period (from above): _____

FOH from the last three (3) reporting periods: _____

FOH for the last four (4) reporting periods: _____

Enter the FOH and EUDH for the last four (4) reporting periods as calculated above.

FOH (A)	EUDH (B)	BESS Annual Equivalent Forced Outage Factor $100\% \times (A + B)/8760$

If the BESS Measurement Period for which this report has been prepared contains a month with a BESS Force Majeure event, please indicate the proper 12-month period used to calculate the BESS Annual Equivalent Availability Factor for this report.

2. MONTHLY REPORT DISAGREEMENTS.

- (a) Notice of Disagreement with Monthly Report. Within ten (10) Business Days following the close of the calendar month in question, Subscriber Organization shall provide to Company the Monthly Report for such calendar month and the LD Period, the PI Assessment Period and the BESS Measurement Period (if any) ending with such calendar month, as provided in Section 1 (Monthly Report) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator). Within ten (10) Business Days after Company's receipt of a Monthly Report, Company shall provide written notice to Subscriber Organization of any Monthly Report Disagreement, including with respect to the data for the calendar month covered by such Monthly Report and Subscriber Organization's calculation of, as applicable, (i) the Modified Pooled OMC Equipment Availability Factor for the LD Period ending with such calendar month, (ii) the PI Assessment Period ending with such Performance Index calendar month, or (iii) any of the BESS Capacity Ratio, the BESS Annual Equivalent Availability Factor or the BESS Equivalent Forced Outage Factor for the BESS Measurement Period (if any) ending with such calendar month ("Notice of Disagreement"). Together with any such Notice of Disagreement, the Company shall include its own calculations and other support for its position. If Company fails to provide a Notice of

Disagreement within said 10-Business Day period, the Monthly Report provided by Subscriber Organization shall be deemed to be accepted by Company and shall no longer be subject to dispute by Company or Subscriber Organization.

(b) [Reserved-]

(c) Submission of Monthly Report Disagreement to Independent AF Evaluator. Upon issuance of a Notice of Disagreement, the Parties shall review the contents of the Monthly Report(s) together with such Notice of Disagreement and attempt to resolve such Monthly Report Disagreement. If the Parties are able to agree on a resolution of any Monthly Report Disagreement, the resulting corrected Monthly Report(s) in question shall be set forth in a writing executed by both Parties, following which (i) such corrected Monthly Reports shall no longer be subject to dispute by either Party and (ii) to the extent such resolution of such Monthly Report Disagreement affects future Monthly Reports, such future Monthly Reports shall be prepared, and the Modified Pooled OMC Equipment Availability Factor, the Performance Index, the BESS Annual Equivalent Factor and the BESS Annual Equivalent Forced Outage Factor in such future Monthly Reports shall be calculated, in a manner consistent with such resolution. If the Parties are unable to resolve such Monthly Report Disagreement within ten (10) Business Days after Company's issuance of such Notice of Monthly Report Disagreement, either Party may, within five (5) Business Days after the end of such 10-Business Day period, submit the unresolved Monthly Report Disagreement to an Independent AF Evaluator for resolution. Notwithstanding anything to the contrary in this Section 2(c) (Submission of Monthly Report Disagreement to Independent AF Evaluator), once the Measured Power Curve has been (i) deemed to be accepted by Company pursuant to Section 3 (Measured Power Curve Disagreement) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator), (ii) resolved pursuant to Section 3(b) (Submission of MPC Disagreement to Independent AF Evaluator), or (iii) resolved pursuant to Section 4(d) (Written Decision of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator), the issue of the Measured Power Curve may not be reopened by either Party in the guise of a Monthly Report Disagreement.

(d) [Reserved-]

3. MEASURED POWER CURVE DISAGREEMENTS.

(a) Notice of Disagreement with Determination of Measured Power Curve. Within ten (10) Business Days after the first day of the second Contract Year, Subscriber Organization shall provide written notice to Company of the Measured Power Curve for each WTG as provided in Section 4 (Determination of Measured Power Curve) of Attachment J (Calculation of Certain Metrics). Within thirty (30) Days after Company's receipt of Subscriber Organization's written notice of the Measured Power Curve for each WTG, Company shall provide written notice to Subscriber Organization of any disagreement with any such determination ("MPC Disagreement"). Together with any such notice of disagreement ("Notice of MPC Disagreement"), the Company shall include its own calculations and other support of its position. If Company fails to provide a Notice of MPC Disagreement within said 30-Day period, the Measured Power Curve for each WTG as calculated by the Subscriber Organization pursuant to the aforesaid Section 4 (Determination of Measured Power Curve) of Attachment J (Calculation of Certain Metrics) shall be deemed to be accepted by Company and shall no longer be subject to dispute by Company or Subscriber Organization.

(b) Submission of MPC Disagreement to Independent AF Evaluator. Upon issuance of a Notice of MPC Disagreement, the Parties shall review the Measured Power Curve(s) in question together with such Notice of MPC Disagreement and attempt to resolve such MPC Disagreement. If the Parties are able to agree on a resolution of such MPC Disagreement, the resulting Measured Power Curve for each WTG shall be set forth in a writing executed by both Parties, following which such Measured Power Curve for such WTG shall be deemed to be the Measured Power Curve for such WTG under this Contract and

shall no longer be subject to dispute by either Party. If the Parties are unable to agree on a written resolution of such MPC Disagreement within thirty (30) Days after Company's issuance of such notice of disagreement, either Party may submit the unresolved MPC Disagreement to an Independent AF Evaluator for resolution. If, within five (5) Business Days following the expiration of said 30-Day period, neither Party has submitted such MPC Disagreement to an Independent AF Evaluator, the Measured Power Curve for each WTG as calculated by Subscriber Organization pursuant to Section 4 (Determination of Measured Power Curve) of Attachment J (Calculation of Certain Metrics) shall be deemed to be accepted by Company and shall no longer be subject to dispute by Company or Subscriber Organization.

4. INDEPENDENT AF EVALUATOR PROCESS.

- (a) Appointment of Independent AF Evaluator. If either Party decides to submit an unresolved MPC Disagreement, unresolved Monthly Report Disagreement to an Independent AF Evaluator, it shall provide written notice to that effect (the "Submission Notice") to the other Party, which notice shall designate which of the engineering firms on the OEPR Consultants List is to act as the Independent AF Evaluator for purposes of resolving such dispute; provided, however, for purposes of facilitating consistency in the resolution of Monthly Report Disagreements, all Monthly Report Disagreements concerning the same Performance Metric arising out of any one or more of the twelve (12) Monthly Reports issued for a given Contract Year shall be submitted to the same Independent AF Evaluator unless such Independent AF Evaluator declines to accept any such submission(s). A Submission Notice must be provided within the 5-Business Day period provided in Section 2(c) (Submission of Monthly Report Disagreement to Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator). A Submission Notice must be provided within whichever of the following time periods is applicable:
- (i) For any MPC Disagreement, within the 5-Business Day period provided in Section 3(b) (Submission of MPC Disagreement to Independent AF Evaluator); and
 - (ii) For any Monthly Report Disagreement, within the 5-Business Day period provided in Section 2(c) (Submission of Monthly Report Disagreement to Independent AF Evaluator).

The Parties shall each pay fifty percent (50%) of the fees and expenses charged by the Independent AF Evaluator.

- (b) Eligibility for Appointment as Independent AF Evaluator. Both Parties agree that the engineering firms listed in Section 4(j) (Acceptable Persons and Entities) of Attachment D (Calculation and Adjustment of Net Energy Potential) are fully qualified to serve as Independent AF Evaluator. By mutual agreement between the Parties in writing, a name or names may be added to or removed from the OEPR Consultants List at any time. In no event shall there be less than three (3) names on the OEPR Consultants List.
- (c) Participation of Parties. Promptly following the issuance of a Submission Notice as provided in Section 4(a) (Appointment of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator), Subscriber Organization and Company shall provide the Independent AF Evaluator which such data as they consider to be material to the resolution of the disputed issue(s). Subscriber Organization and Company shall also provide such additional data and information as the Independent AF Evaluator may reasonably request. The Parties shall assist the Independent AF Evaluator throughout the process of resolving such dispute, including making key personnel and records available to the Independent AF Evaluator, but neither Party shall be entitled to participate in any meetings with personnel of the other Party or review of the other Party's records. However, the Independent AF Evaluator will have the right to conduct meetings, hearing or oral arguments in which both Parties are represented.

- (d) Written Decision of Independent AF Evaluator. The terms of engagement with the Independent AF Evaluator shall require the Independent AF Evaluator to issue its written decision resolving the disputed issues submitted to it within the applicable time period set forth below, which time periods are subject to any tolling that may be applicable pursuant to Section 4(e) (Sequence to Resolving Interrelated Disagreements) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator): (a) 30 Days as measured from the issuance of the Submission Notice; or (b) such other time period as the Parties may agree in writing. Unless otherwise agreed by the Parties in writing:
- (i) for a MPC Disagreement, the written decision of the Independent AF Evaluator shall set forth the Measured Power Curve for the WTG in question;
 - (ii) for a Performance Metric Disagreement concerning the Modified Pooled OMC Equipment Availability Factor, the written decision of the Independent AF Evaluator shall set forth (aa) for the calendar month in question, the correct values for equation used in calculations under Section 1 (Modified Pooled OMC Equipment Availability Factor) of Attachment J (Calculation of Certain Metrics) of this Contract as determined by such Independent AF Evaluator if any such values were in dispute and (bb) for the LD Period ending with the calendar month in question, the Modified Pooled OMC Equipment Availability Factor for such LD Period as determined by such Independent AF Evaluator if such Modified Pooled OMC Equipment Availability Factor was in dispute;
 - (iii) for a Performance Metric Disagreement concerning the Performance Factor, the written decision of the Independent AF Evaluator shall set forth (aa) the correct values of the equation to be used in the calculation under Section 2 (Performance Index) of Attachment J (Calculation of Certain Metrics) that include such calendar month if any such values were in dispute, (bb) if a PI Test was conducted during the month in question, the correct data points from such PI Test to be used in the calculation of PI under Section 2(a) (Calculation of Performance Index) of Attachment C to this Contract for the PI Assessment Periods that include the month preceding the month covered by the Monthly Report in question if any such data points were in dispute, and (cc) for the PI Assessment Period ending with the calendar month in question, the Performance Index if such Performance Index was in dispute;
 - (iv) for a Performance Metric Disagreement concerning the BESS Capacity Ratio or the RTE Ratio, the written decision of the Independent AF Evaluator shall set forth the BESS Capacity Ratio and/or the RTE Ratio (as applicable) for the BESS Measurement Period ending with the calendar month in question;
 - (v) for a Performance Metric Disagreement concerning the BESS Annual Equivalent Availability Factor, the written decision of the Independent AF Evaluator shall set forth (aa) the correct values to be used for AH, EPDH, EUDH and PH under Section 2 (BESS Annual Equivalent Availability Factor) of Attachment H (BESS Requirements) to the Contract for the calendar month in question if any such values were in dispute and (bb) the BESS Annual Equivalent Availability Factor for the BESS Measurement Period ending with the calendar month in question if such BESS Annual Equivalent Availability Factor was in dispute; and
 - (vi) for a Performance Metric Disagreement concerning the BESS Annual Equivalent Forced Outage Factor, the written decision of the Independent AF Evaluator shall set forth (aa) the correct values for FOH and EUDH under Section 3 (BESS Annual Equivalent Forced Outage

Factor) of Attachment H (BESS Requirements) for the calendar month in question if any such values were in dispute and (bb) the BESS Annual Equivalent Forced Outage Factor for the BESS Measurement Period ending with the calendar month in question if such BESS Annual Equivalent Forced Outage Factor was in dispute; ~~and.~~

~~(vii) — for a BOP Benchmark Disagreement, the written decision shall: (aa) confirm that the BOP Benchmark derived by the Company was reasonably derived and state that such percentage constitutes the BOP Benchmark; or (bb) confirm the Company's conclusion that it is unable to reasonably derive a BOP Benchmark and state that 97% is the BOP Benchmark; or (cc) disagree with the Company's conclusion that it is unable to reasonably derive a BOP Benchmark, state the percentage that is the best-supported BOP Benchmark, and state that such percentage constitutes the BOP Benchmark.~~

(e) Sequence for Resolving Interrelated Disagreements.

(i) If an MPC Disagreement is unresolved at the time a Monthly Report Disagreement is submitted to an Independent AF Evaluator pursuant to Section 4(a) (Appointment of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator), and the resolution of such MPC Disagreement is necessary to the resolution of such Monthly Report Disagreement, the time period for an Independent AF Evaluator to issue its written decision resolving such Monthly Report Disagreement shall be tolled until the resolution of such MPC Disagreement pursuant to either Section 3(b) (Submission of MPC Disagreement to Independent AF Evaluator) or Section 4(d) (Written Decision of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator).

(ii) If at the time a Performance Metric Disagreement is submitted to an Independent AF Evaluator pursuant to Section 4(a) (Appointment of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) there are one or more other unresolved Performance Metric Disagreements concerning the same Performance Metric and the same LD Period that are pending before a different Independent AF Evaluator, and the resolution of such other Performance Metric Disagreement(s) is necessary to the resolution of the Performance Metric Disagreement that has been newly submitted to a new Independent AF Evaluator as aforesaid, the time period for such new Independent AF Evaluator to issue its written decision resolving such newly submitted Performance Metric Disagreement shall be tolled until such pending Performance Metric Disagreement(s) have been resolved. For avoidance of doubt, it is the intent of the Parties that disagreements over performance ratio data and calculations for a given calendar month or a given BESS Measurement Period shall (i) not be subject to resolution twice and (ii) once resolved, shall not be reopened.

(f) Final, Conclusive and Binding. The Parties acknowledge the inherent uncertainty in calculating the Performance Metrics, and hereby assume the risk of such uncertainty and waive any right to dispute the qualification of the person or entity appointed as the Independent AF Evaluator pursuant to Section 4(a) (Appointment of Independent AF Evaluator) of this Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator) and/or the appropriateness of the methodology used by Independent AF Evaluator in resolving such Performance Metric Disagreements. Without limitation to the generality of the preceding sentence, the decision of the Independent AF Evaluator as to each Performance Metric Disagreement submitted to an Independent AF Evaluator shall be final, conclusive

and binding upon Company and Subscriber Organization and shall not be subject to further dispute under Article 28 (Dispute Resolution) of the Contract.

5. **PERIODIC REVIEW OF METHOD OF CALCULATING AND REPORTING PERFORMANCE METRIC.** At least once per Contract Year, Company shall review the method of calculating and reporting Performance Metric under this Contract to determine if other variables should be incorporated into such calculations. Any revisions to the Performance Metric calculations in this Contract shall be mutually agreed to by both Subscriber Organization and Company.

6. **FUTURE CHANGES IN REPORTING REQUIREMENTS.** Subscriber Organization shall reasonably cooperate with any Company requested revisions to the Monthly Report to include additional data that may be necessary from time to time to enable Company to comply with any new reporting requirements directed by the PUC or otherwise imposed under applicable Laws.

ATTACHMENT F
FACILITY OWNED BY SUBSCRIBER ORGANIZATION

1. THE FACILITY.

(a) Drawings, Diagrams, Lists, Settings and As-Builts.

- (i) Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme. A preliminary single-line drawing (including notes), Interface Block Diagram, relay list, relay settings, and trip scheme of the Facility shall, after Subscriber Organization has obtained prior written consent from Company, be attached to this Contract on the Execution Date as Exhibit F-5 (Single-Line Drawing and Interface Block Diagram) and Exhibit F-6 (Relay List and Trip Scheme). A final single-line drawing (including notes), Interface Block Diagram, relay list and trip scheme of the Facility shall, after having obtained prior written consent from Company, be labeled the "Final" Single-Line Drawing, the "Final" Interface Block Diagram and the "Final" Relay List and Trip Scheme and shall supersede Exhibit F-5 (Single-Line Drawing and Interface Block Diagram) and Exhibit F-6 (Relay List and Trip Scheme) to this Contract and shall be made a part hereof on the Commercial Operations Date. After the Commercial Operations Date, no changes shall be made to the "Final" Single-Line Drawing, the "Final" Interface Block Diagram and the "Final" Relay List and Trip Scheme without the prior written consent of Subscriber Organization and Company. The single-line drawing shall expressly identify the Point of Interconnection of Facility to Company System.
- (ii) As-Builts. Subscriber Organization shall provide final as-built drawings of the Subscriber Organization-Owned Interconnection Facilities within 30 Days of the successful completion of the Acceptance Test.
- (iii) Modeling. Subscriber Organization shall provide the models as set forth in Exhibit F-4.
- (iv) No Material Changes. Subscriber Organization agrees that no material changes or additions to the Facility as reflected in the "Final" Single-Line Drawing (including notes), the "Final" Interface Block Diagram and the "Final" Relay List and Trip Scheme, shall be made without Subscriber Organization first having obtained prior written consent from Company. The foregoing are subject to changes and additions as part of any Performance Standards Modifications. If Company directs any changes in or additions to the Facility, records and operating procedures that are not part of any Performance Standards Modifications, Company shall specify such changes or additions to Subscriber Organization in writing, and, except in the case of an emergency, Subscriber Organization shall have the opportunity to review and comment upon any such changes or additions in advance.

(b) Certain Specifications for the Facility.

- (i) Subscriber Organization shall furnish, install, operate and maintain the Facility including breakers, relays, switches, synchronizing equipment, monitoring equipment and control and protective devices approved by Company as suitable for parallel operation of the Facility with Company System. The Facility shall be accessible at all times to authorized Company personnel.
- (ii) The Facility shall include:

[LIST OF THE FACILITY

Examples may include, but are not limited to:

- **Subscriber Organization-Owned Interconnection Facilities**
- **Substation**
- **Control and monitoring facilities**
- **Transformers**
- **Generating and ~~BESS~~/or Battery Energy Storage System (“BESS”) equipment (as described in Exhibit F-1)**
- **"Lockable" cabinets or housings suitable for the installation of the Company-Owned Interconnection Facilities located on the Site**
- **Relays and other protective devices**
- **Leased telephone line and/or equipment to facilitate microwave communication]**

(iii) The Facility shall comply with the following [~~includes excerpts of language that some requirements may be requested removed~~ by Company following completion of the Technical Review or IRS]:

- A. Subscriber Organization shall install a ____ kV gang operated, load breaking, lockable disconnect switch and all other items for its switching station (relaying, control power transformers, high voltage circuit breaker). Bus connection shall be made to a manually and automatically (via protective relays) operated high-voltage circuit breaker. The high-voltage circuit breaker shall be fitted with bushing style current transformers for metering and relaying. Downstream of the high-voltage circuit breaker, a structure shall be provided for metering transformers. From the high-voltage circuit breaker, another bus connection shall be made to another pole mounted disconnect switch, with surge protection.
- B. Subscriber Organization shall provide within the Subscriber Organization-Owned Interconnection Facilities a separate, fenced area with separate access for Company. Subscriber Organization shall provide all conduits, structures and accessories necessary for Company to install the Revenue Metering Package. Subscriber Organization shall also provide within such area, space for Company to install its communications, supervisory control and data acquisition ("SCADA") equipment (remote terminal unit or equivalent) and certain relaying if necessary for the interconnection. Subscriber Organization shall also provide AC and DC source lines as specified by Company. Subscriber Organization shall provide a telephone line for Company-owned meters. Subscriber Organization shall work with Company to determine an acceptable location and size of the fenced-in area. Subscriber Organization shall provide an acceptable demarcation cabinet on its side of the fence where Subscriber Organization and Company wiring will connect/interface.
- C. Subscriber Organization shall ensure that the Subscriber Organization-Owned Interconnection Facilities have a lockable cabinet for switching station relaying equipment. Subscriber Organization shall select and install relaying equipment acceptable to Company. At a minimum, the relaying equipment will provide over and under frequency (81) negative phase sequence (46), under voltage (27), over voltage (59), ground over voltage (59G), over current functions (50/51) and direct transfer trip (if required). The settings shall be consistent with the requirements for over/under

frequency and voltage ride-through. Subscriber Organization shall install protective relays that operate a lockout relay (86), which in turn will trip the main circuit breaker and not allow it to be reclosed without reset.

D. [~~RESERVED~~Reserved]

E. Subscriber Organization's equipment also shall provide at a minimum:

- (i) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide telemetry of electrical quantities such as total Facility net MW, MVar, power factor, voltages, currents, and other quantities as identified by the Company;
- (ii) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide status for circuit breakers, reactive devices, switches, and other equipment as identified by the Company;
- (iii) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide control to incrementally raise and lower the voltage target at the point of regulation operating in automatic voltage regulation control;
- (iv) Interface with Company's Telemetry and Control, or designated communications and control interface, to provide the active power control requirements of this Contract. More than one interface may be required if Facility energy components, such as a BESS and variable generation resource are controlled separately by the Company (as in grid-charging BESS);
- (v) Interface with Company's Telemetry and Control, or designated communications and control interface, for the Company to specify control system modes of operation and parameters, for remotely configurable parameters and operating states required under this Contract;
- (vi) For Variable Energy Facilities: Interface with Company's Telemetry and Control, or designated communications and control interface, to provide telemetry of equipment availability and meteorological and production data required under Section 8 (Data and Forecasting) of this Attachment F (Facility Owned by Subscriber Organization) and the Facility's Power Possible-; and
- (vii) Provision for Loss of Telemetry and Control: If Company's Telemetry and Control, or designated communications and control interface, is unavailable, due to loss of communication link, Telemetry and Control failure, or other event resulting in loss of the remote control by Company, provision must be made for Subscriber Organization to be able to institute via local controls, within 5 minutes (or such other period as Company accepts in writing) of the verbal directive by the Company System Operator, such change in voltage regulation target and real power export or import as directed by the Company System Operator. If all local and remote active power controls become unavailable or fail, the Facility may be required disconnect from the Company's System [to be based upon the size of the system]
- (viii) If the direct transfer trip is required and is unavailable due to loss of communication link, Telemetry and Control failure, or other event resulting in the loss of the remote control by the Company, provision must be made for the Subscriber Organization to shutdown Facility and open and lockout the main circuit breaker.

- F. If Subscriber Organization adds, deletes and/or changes any of its equipment, or changes its design in a manner that would change the characteristics of the equipment and specifications used in the IRS, Subscriber Organization shall be required to obtain Company's prior written approval. If an analysis to revise parts of the IRS is required, Subscriber Organization shall be responsible for the cost of revising those parts of the IRS, and modifying and paying for the cost of the modifications to the Facility and/or the Company-Owned Interconnection Facilities based on the revisions to the IRS.
- G. Cybersecurity and Critical Infrastructure Protection.

[DRAFTING NOTE: COMPANY RETAINS SOLE DISCRETION TO CONSIDER THE LESS STRINGENT REQUIREMENTS (WHICH ARE INCLUDED IN THE FIRST SET OF ALTERNATIVE CYBER-SECURITY PROVISIONS UNDER G. (i) THROUGH (iv)) FOR PROJECTS THAT DO NOT EXCEED 1 MW.]

- (i) Safety and Security Procedures. The Subscriber Organization shall maintain and enforce safety and security procedures to safeguard: all data provided by Company to Subscriber Organization pursuant to this Contract or in any way connected with the CBRE Program and the administration of the CBRE Program including but not limited to Subscriber names, Subscriber account numbers and information on such accounts, Subscriber addresses, Subscriber rate schedules and Subscriber CBRE bill credit information (“Company CBRE Data”); and all information regarding Company’s customers, customer lists, any of the data and testing results produced under this Contract and any information identified by Company as confidential (“Company Customer Data” and together with Company CBRE Data, collectively referred to as “Company Confidential Information”); all generation and telemetry data provided by the Subscriber Organization to the Company (“SO Data”); in Subscriber Organization’s possession, including Company Confidential Information that Subscriber Organization provides to any contractors, consultants, and other third parties retained by Subscriber Organization to assist Subscriber Organization to perform under this Contract in the course of Subscriber Organization’s performance pursuant to this Contract. Subscriber Organization warrants that it shall (A) use the National Institute of Standards and Technology (“NIST”) industry best practices for physical and systems security measures to prevent destruction, loss, alteration or unauthorized access to, use of, or tampering with, the CBRE Facility, Subscriber Organization software, and Company Confidential Information, including to protect the confidentiality and integrity of any of Company Confidential Information, operation of Company’s systems, and to prevent viruses and similar destructive code from being placed in any software or data provided to Company, on Subscriber Organization’s or Company’s website, or in Subscriber Organization’s or Company’s programming; and (B) use NIST industry best practices physical security and precautionary measures to prevent unauthorized access or damage to the CBRE Facility, including to protect the confidentiality and integrity of any of Company’s Confidential Information as well as the operation of Company’s systems. Subscriber Organization shall, at a minimum, protect Company’s Confidential Information and provide the standard of care required by NIST cybersecurity requirements, and the same measures it uses to protect its own confidential information.
- (ii) Exception to Certain NIST Requirements. Company, at its sole and absolute discretion, may waive the requirements concerning NIST industry best practices as set forth in subsection (i)(A) and (B) above provided that Subscriber

Organization implements alternate measures that Company deems acceptable and not inconsistent with Company's standards with respect to (A) physical and systems security measures to prevent destruction, loss, alteration or unauthorized access to, use of, or tampering with, the CBRE Facility, software and Company's Confidential Information, including to protect the confidentiality and integrity of any of Company's Confidential Information, operation of Company's systems, and to prevent viruses and similar destructive code from being placed in any software provided to Company, on Subscriber Organization's or Company's website, or in Subscriber Organization's or Company's programming; and (B) physical security and precautionary measures to prevent unauthorized access or damage to the CBRE Facility, including to protect the confidentiality and integrity of any of Company's Confidential Information as well as the operation of Company's systems.

(iii) Security Breach. In the event that Subscriber Organization discovers or is notified of a breach, potential breach of security, or security incident at the CBRE Facility or of Subscriber Organization's systems (a "Security Breach"), Subscriber Organization shall immediately (i) notify Company of such Security Breach, whether or not such breach has compromised any of Company Confidential information, (ii) investigate and remediate the effects of the Security Breach, (iii) cooperate with Company with respect to any such Security Breach and provide necessary information on the Security Breach as requested by Company; and (iv) comply with all applicable privacy and data protection laws, including any notification obligations. Any remediation of any Security Breach will be at Subscriber Organization's sole expense.

(iv) "Subscriber" means a retail customer of the Company who owns a subscription of Subscriber Organization's CBRE project interconnected with the Company.

**[ALTERNATIVE ENHANCED CYBER-SECURITY PROVISIONS-WAIVED
SOLELY AT DISCRETION OF COMPANY.]**

(i) Security Policies and Documentation. Subscriber Organization shall implement and document security policies and standards in accordance with industry best practices (e.g., aligned with the intent of NERC CIP-003-6 ~~R2~~R1) and consistent with Company's security policies and standards. Subscriber Organization shall submit documentation describing the approach, methodology, and design to provide physical and cyber security (i.e., aligned with the intent of NERC CIP-003-6 R2) with its submittal of the design drawings pursuant to Section 1(c) (Design Drawings, Bill of Materials, Relay Settings and Fuse Selection) of Attachment F (Facility Owned by Subscriber Organization) which shall be at least sixty (60) Days prior to the Acceptance Test.

(aa) The design shall meet industry standards and best practices, consistent with the National Institute of Standards and Technology ("NIST") guidelines as indicated in Special Publication 800-53 Rev. 4 "Security and Privacy Controls for Federal Information Systems and Organizations" and Special Publication 800-82 Rev. 2 "Guide to Industrial Control Systems (ICS) Security". The system shall be designed with the criteria to meet applicable compliance requirements and identify areas that are not consistent with NIST guidelines and recommendations.

(bb) The cybersecurity documentation shall include a block diagram of the control system with all external connections clearly described.

(cc) Subscriber Organization shall provide such additional information as Company may reasonably request as part of a security posture assessment.

~~• Company shall be notified in advance when there is any condition that would compromise physical or cyber security.~~

(dd) Subscriber Organization shall, at the request of Company or, in the absence of any request from Company, at least annually during the term of this Contract, provide Company with updated documentation and diagrams including a record of changes.

(ii) Network and Application Security. Subscriber Organization shall implement appropriate network and application security processes and practices commensurate with the level of risk as determined by periodic risk assessments (i.e., aligned with the intent of NERC CIP-005-5):

(aa) Segment and segregate networks and functions, including physical and logical separation between business networks and control system networks (i.e., aligned with the intent of NERC CIP-005-5 R1).

(bb) Limit unnecessary lateral communications (i.e., aligned with the intent of NERC CIP-005-5 R1).

(cc) Harden network devices (i.e., aligned with the intent of NERC CIP-007-6 R1).

(dd) Secure access to infrastructure devices (i.e., aligned with the intent of NERC CIP-004-6 R4).

(ee) Perform out-of-band (OoB) network management (i.e., aligned with the intent of NERC CIP-005-5 R2).

(ff) Validate integrity of hardware and software (i.e., aligned with the intent of NERC CIP-010-3 R1 and NERC CIP-006-6 R1 Part 10).

(iii) Endpoint and Server Security. Subscriber Organization shall implement appropriate endpoint and server security processes and practices commensurate with the level of risk as determined by periodic risk assessments:

(aa) Mechanisms to identify vulnerabilities and apply security patches in a timely manner (i.e., aligned with the intent of NERC CIP-007-6 R2).

(bb) Malware defense and anti-phishing capabilities (i.e., aligned with the intent of NERC CIP-007-6 R3).

(cc) Access Controls to enforce the least privilege principle and provide access to resources only for authorized users (i.e., aligned with the intent of NERC CIP-004-6 R4).

(dd) Secure authentication mechanisms including multi-factor authentication for systems with higher risk exposure (i.e., aligned with the intent of NERC CIP-007-6 R5 and NERC CIP-005-5 R2).

- (ee) Data confidentiality, protection, and encryption technologies for endpoints, servers, and mobile devices (i.e., aligned with the intent of NERC CIP-011-2 R1 and NERC CIP-005-5 R2).

Subscriber Organization shall (consistent with the following sentence) ensure that no malicious software ("Malware") or unauthorized code is introduced into any aspect of the Facility, Interconnection Facilities, the Company Systems interfacing with the Facility and Interconnection Facilities, and any of Subscriber Organization's critical control systems or processes used by Subscriber Organization to provide energy, including the information, data and other materials delivered by or on behalf of Subscriber Organization to Company, (collectively, the "Environment"). Subscriber Organization shall periodically review, analyze and implement improvements to and upgrades of its Malware prevention and detection programs and processes that are commercially reasonable and consistent with the then current technology industry's standards and, in any case, not less robust than the programs and processes implemented by Subscriber Organization with respect to its own information systems.

- (iv) Cybersecurity Program. Subscriber Organization shall establish and maintain a continuous cybersecurity program (i.e., aligned with the intent of NERC CIP-003-6) that enables the Subscriber Organization (or its designated third party) to:
 - (aa) Define the scope and boundaries, policies, and organizational structure of the cybersecurity program.
 - (bb) Conduct periodic risk assessments to identify the specific threats to and vulnerabilities of the Subscriber Organization's Organization consistent with guidance provided in NIST Special Publication 800-30 Rev. 1 "Guide for Conducting Risk Assessments".
 - (cc) Implement appropriate mitigating controls and training programs and manage resources.
 - (dd) Monitor and periodically test the cybersecurity program to ensure its effectiveness. Subscriber Organization shall review and adjust their cybersecurity program as appropriate for any assessed risks.
 - (ee) Applicability is extended to Cloud Service providers and other third-party services the Subscriber Organization may use.
- (v) Security Monitoring and Incident Response. Company and Subscriber Organization shall collaborate on security monitoring and incident response, define points of contact on both sides, establish monitoring and response procedures, set escalation thresholds, and conduct training (i.e., aligned with the intent of NERC CIP-008-5). Subscriber Organization shall, at the request of Company or, in the absence of any request from Company, at least quarterly, provide Company with a report of the incidents that it has identified and describe measures taken to resolve or mitigate.

In the event that Subscriber Organization discovers or is notified of a breach, potential breach of security, or security incident at Subscriber Organization's Facility or of Subscriber Organization's systems, Subscriber Organization shall immediately (aa) notify Company of such potential, suspected or actual

security breach, whether or not such breach has compromised any of Company's confidential information; (bb) investigate and promptly remediate the effects of the breach, whether or not the breach was caused by Subscriber Organization; (cc) cooperate with Company with respect to any such breach or unauthorized access or use; (dd) comply with all applicable privacy and data protection laws governing Company's or any other individual's or entity's data; and (ee) to the extent such breach was caused by Subscriber Organization, provide Company with reasonable assurances satisfactory to Company that such breach, potential breach, or security incident shall not recur. Subscriber Organization shall provide documentation to Company evidencing the length and impact of the breach. Any remediation of any such breach will be at Subscriber Organization's sole expense.

If malicious software or unauthorized code is found to have been introduced into the Environment, Subscriber Organization will promptly notify Company. Subscriber Organization shall take immediate action to eliminate and remediate the effects of the Malware, at Subscriber Organization's expense. Subscriber Organization shall not modify or otherwise take corrective action with respect to the Company Systems except at Company's request. Subscriber Organization shall promptly report to Company the nature and status of all efforts to isolate and eliminate malicious software or unauthorized code.

(vi) Monitoring and Audit. Subscriber Organization shall provide information on available audit logs and reports relating to cyber and physical and security (i.e., aligned with the intent of NERC CIP-007-6 R4). Company may audit Subscriber Organization's records to ensure Subscriber Organization's compliance with the terms of this Section 1(b) (iii) G (Cybersecurity and Critical Infrastructure Protection) of this Attachment F (Facility Owned by Subscriber Organization), provided that Company has provided reasonable notice to Subscriber Organization and any such records of Subscriber Organization's will be treated by Company as confidential.

(vii) Contingency Plans. Subscriber Organization shall implement and maintain a business continuity plan, a disaster recovery plan, and an incident response plan ("Contingency Plans" – i.e., aligned with the intent of NERC CIP-009-6) appropriate for the level of risk associated with the Work under this Contract based on the impact of Subscriber Organization's associated facilities, systems and equipment, which, if destroyed, degraded, misused, or otherwise rendered unavailable, would affect the reliable operation of the Company System. The Contingency Plans shall be provided to Company upon request. Such Contingency Plans shall be updated to reflect lessons learned from real recovery events.

H. Available Power Production.

(i) Variable Energy Systems. Subscriber Organization's available power production considering equipment and resource availability (Power Possible) will be determined at any given time using the best-available data and methods for an accurate representation of the amount of available active power at the Point of Interconnection.

(ii) Variable Energy Systems Paired with Storage Operated through a Single Active Power Control Interface. For variable energy systems paired with storage

operated through a single active power control interface (i.e., charging indirectly controlled through dispatch), Subscriber Organization's available power production considering equipment and resource availability and BESS state of charge (Power Possible) will be determined at any given time using the best-available data and methods for an accurate representation of the amount of active power at the Point of Interconnection. Telemetry will be provided to indicate state of charge, including available estimated duration at the current dispatch given state of charge and forecast production.

~~(iii) Storage Directly Controlled by the Company. Subscriber Organization's available power production considering state of charge (Power Possible) will be supplied as an accurate representation of the amount of maximum and minimum (negative) available active power at the Point of Interconnection and the duration available at the current dispatch. If the Facility allows for allocation of capacity to different modes of operation (i.e., reservation of capacity for regulation or contingency response), then the available capacity in each allocated region shall be reported individually and controlled separately through separately designated dispatch or active power control interface.~~

I. ~~I.~~ For variable resources where Power Possible is derived, in part or in whole, from a measured available variable energy source such as solar or wind: To the extent available, the Parties shall use Subscriber Organization's real time Power Possible communicated to Company through the SCADA ~~S~~system except to the extent that the Potential Energy does not accurately reflect the actual available active power at the Point of Interconnection (plus or minus 0.1 MW). During those periods of time when the SCADA derived Power Possible is unavailable or does not accurately represent the available power production considering equipment and resource availability and BESS State of Charge, the Parties shall use the best available data obtained through commercially reasonable methods to determine the Power Possible. Follow up actions to resolve the discrepancy will be as provided in Section 1(j) (Demonstration of Facility) of this Attachment F (Facility Owned by Subscriber Organization).

(i) If, at any time during the Term, there is a material discrepancy or pattern of discrepancies in the accuracy of Power Possible, the Parties shall review the method for determining Power Possible and develop modifications with the objective of avoiding future discrepancies. If the Parties are unable to resolve the issue, then (aa) the Parties shall promptly commission a study to be performed by one of the engineering firms then included on the Qualified Independent Third-Party Consultants List attached to the Agreement as Attachment D (Consultants List) to evaluate the cause of the Power Possible discrepancy and to make recommendations with the objective of avoiding future Power Possible discrepancies ("Study"); and (bb) if the Company decides that its ability to effectively optimize the benefits of its right of Company Dispatch to dispatch the Facility's Net Energy Potential is materially impaired by the lack of an accurate method to determine Power Possible, the Company shall have the right to derate the Facility and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status until the Study has been completed and the Study's recommendations have been implemented by Subscriber Organization to Company's reasonable satisfaction. Subscriber Organization shall pay for the cost of the Study. The Study shall be completed within ninety (90) days from the date the Study is commissioned, unless otherwise reasonably agreed to in writing by Subscriber Organization and Company. The Consultant shall send the Study to Company and Subscriber Organization. Subscriber Organization (and/or its Third-Party

consultants and contractors), at Subscriber Organization's expense, shall take such action as the Study shall recommend (e.g., modifications to the model, modifications and/or additions to the data inputs used in the model, modifications to the procedures for maintaining and/or recalibrating the Monitoring and Communication Equipment used to provide data inputs, replacement of such Monitoring and Communication Equipment, modifications of procedures for Facility operations) with the objective of avoiding future Power Possible discrepancies. Such recommendations shall be implemented by Subscriber Organization to Company's reasonable satisfaction no later than forty-five (45) Days from the Day the completed Study is issued by the consultant, or such other longer commercially reasonable timeframe otherwise agreed to in writing by Company.

- J. Subscriber Organization shall reserve space within the Site for possible future installation of Company-owned meteorological equipment (such as wind speed, direction and relative humidity monitors, SODAR and irradiance monitors) and AC and DC source lines for such equipment as may be required depending on the Facility resource type and location. In the event Company decides to install such meteorological equipment: (i) Subscriber Organization shall work with Company to determine an acceptable location for such equipment and any associated wiring, interface or other components; and (ii) Company shall pay for the needed equipment, and installation of such equipment, unless otherwise agreed to by the Parties. Company and Subscriber Organization shall use commercially reasonable efforts to facilitate installation and minimize interference with the operation of the Facility.
- K. The Facility shall, at a minimum, satisfy the wind load and seismic load requirements of the International Building Code and any more stringent requirements imposed under applicable Laws.
- (c) Design Drawings, Bill of Material, Relay Settings and Fuse Selection. Subscriber Organization shall provide to Company for its review the design drawings, Bill of Material, relay settings and fuse selection for the Facility, and Company shall have the right, but not the obligation, to specify the type of electrical equipment, the interconnection wiring, the type of protective relaying equipment, including, but not limited to, the control circuits connected to it and the disconnecting devices, and the settings that affect the reliability and safety of operation of Company's and Subscriber Organization's interconnected system. Subscriber Organization shall provide the relay settings and protection coordination study, including fuse selection and AC/DC Schematic Trip Scheme (part of design drawings), for the Facility to Company during the 60% design. Company, at its option, may, with reasonable frequency, witness Subscriber Organization's operation of control, synchronizing, and protection schemes and shall have the right to periodically re-specify the settings. Subscriber Organization shall utilize relay settings prescribed by Company, which may be changed over time as Company System requirements change.
- (d) Disconnect Device. Subscriber Organization shall provide a manually operated disconnect device which provides a visible break to separate Facility from Company System. Such disconnect device shall be lockable in the OPEN position and be readily accessible to Company personnel at all times.
- (e) Other Equipment. Subscriber Organization shall install, own and maintain the infrastructure associated with the Revenue Metering Package, including but not limited to all enclosures (meter cabinets, meter pedestals, meter sockets, pull boxes, and junction boxes, along with their grounding/bonding connections), CT/PT mounting structures, conduits and duct lines, enclosure support structures, ground buses, pads, test switches, terminal blocks, isolation relays, telephone surge suppressors, and analog phone lines (one per meter), subject to Company's review and approval.

- (f) Maintenance Plan. Subscriber Organization shall maintain Subscriber Organization-Owned Interconnection Facilities in accordance with Good Engineering and Operating Practices.
- (g) Active Power Control Interface. [COMPANY TO REVISE THIS SECTION BASED ON SPECIFICS OF THE PROJECT.]

- (i) Subscriber Organization shall provide and maintain in good working order all equipment, computers and software associated with the control system (the "Active Power Control Interface") necessary to interface the Facility active power controls with the Company System Operations Control Center for real power control of the Facility by the Company System Operator.

The detailed design will be tailored to the specific resource type and configuration to achieve the functional requirements of the Facility.

The Active Power Control Interface will be used to control the net real power export (or import, as applicable) from the Facility for load following, system balancing, energy arbitrage, and/or supplemental frequency control as required under this Attachment F (Facility Owned by Subscriber Organization).

For variable resources paired with storage: The implementation of the Active Power Control Interface will allow the Company System Operator to control the net real power export (or import, as applicable for facilities with grid charging storage) from the entire Facility, up to Power Possible, remotely from the Company System Operations Control Center through control signals from the Company System Operations Control Center. The Facility will maintain the power level specified by the Company through the variable resource and BESS available energy, subject to the availability of resource and BESS State of Charge.

For facilities with grid charging storage, the Active Power Control interface ~~may also direct the~~ will provide for a negative signal resulting in charging/~~discharging of energy from~~ the BESS.

The Facility real power output (or import, if storage charging is enabled) will automatically adjust to a change in frequency in accordance with the frequency response requirements provided in this Attachment F (Facility Owned by Subscriber Organization).

- (ii) Company shall review and provide prior written approval of the design for the Active Power Control Interface to ensure compatibility with Company's centralized control systems and use of Facility available energy and storage capabilities. To ensure such continued compatibility, Subscriber Organization shall not materially change the approved design without Company's prior review and written approval. This will include design description and parameters for the Subscriber Organization's control system(s), which determine provision of net real power from the variable resource System (i.e., wind or WTG) and/or the BESS storage, and charging of the BESS storage, in response to the Active Power Control signal or signals.
- (iii) The Active Power Control Interface shall include, but not be limited to, a demarcation cabinet, ancillary equipment and software necessary for Subscriber Organization to connect to Company's Telemetry and Control, located in Company's portion of the Facility switching station which shall provide the control signals to the Facility and send feedback status to the Company System Operations Control Center. The control type shall be analog output (set point) or raise/lower controls and will be established by the Company prior to final design approval.

- (iv) The Active Power Control Interface shall also include provision for feedback points from the Facility indicating when active power target in MW for the Active Power Control signal(s). The Facility shall provide the MW target feedback to the Company SCADA system immediately upon receiving the respective control signal from the Company.
- (v) Subscriber Organization shall provide to the telemetry interface analogs for the gross production of the energy resource(s) at the Facility (for example, DC or AC MW production of the variable resource generator(s), depending on design; gross DC MW of the BESS, etc.). Subscriber Organization shall also provide the total net AC MW production at the Point of Interconnection.
- (vi) The Active Power Control Interface shall provide for remote control of the real power output of the Facility by the Company at all times. If the Active Power Control Interface is unavailable or disabled, the Facility may not export electric energy to Company and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status, unless the Company, in its sole discretion, agrees on an alternate means of dispatch. The alternate means of dispatch, including but not limited to local controls, is to be the temporary dispatch mechanism until the Active Power Interface is returned to service and must be capable of changing the real power export or import as directed by the Company System Operator within 30 minutes (or such other period as Company accepts in writing) of the Subscriber Organization receiving the directive by the Company System Operator, verbal or otherwise permitted by such alternate means. If Subscriber Organization fails to provide such remote control capability (whether temporarily or throughout the Term), then, notwithstanding any other provision of this Attachment F (Facility Owned by Subscriber Organization), Company shall have the right to derate or disconnect the entire Facility during those periods that such control capability is not provided and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status for such periods.
- If all local and remote active power controls become unavailable or fail, the Facility shall immediately disconnect from the Company's System.
 - If the direct transfer trip is unavailable due to loss of communication link, Telemetry and Control failure, or other event resulting in the loss of the remote control by the Company, provision must be made for the Subscriber Organization to shutdown Facility and open and lockout the main circuit breaker.
- (vii) The rate at which the Facility changes net real power in response to the active power control shall not be less than the greater of 2 MW per minute or 10% of the Facility capacity per minute, and shall make available through agreed parameters, such faster ramp as the installed equipment can support. The Facility's Active Power Control Interface will be used by Company to control the rate at which electric energy is changed to achieve the active power limit for load-following and regulation. The Facility will respond to the active power control request immediately with an echo of the set point and measurable change within the 4 second control cycle.
- (viii) The Facility shall accept the following controls related to active power and frequency response to or from the Company centralized control system:
- Power Reference Setpoint from Company (based on the input to the Facility, from the Active Power Control Interface): The Facility output shall match this setting from the Variable Resource and/or BESS so long as it can be supported by the variable resource and/or BESS State of Charge (Power Possible does not change). This net output should be accurate within +/- 0.1 MW under normal

frequency conditions. This setpoint will be modified as appropriate in the controls by the appropriate frequency response consistent with Section 1(g)(xi) (Active Power – Frequency Response (DROOP)), Section 1(g)(xii) (Dynamic Active Power – Frequency Performance), and **[FOR FACILITIES WITH STORAGE]** Section 1(g)(xiii) (Alternate Active Power / Frequency Response Modes) of this Attachment F (Facility Owned by Subscriber Organization).

- For variable energy resources: The Facility shall include Variable Resource Enable/Disable control. When "Disable" is selected, the Facility shall ramp down, shutdown, and leave offline variable resource generators. When "Enable" is selected, the Facility variable resource generators can start up, ramp up, and remain in normal operations subject to Company active power dispatch.
- ~~From Company: Frequency Response Mode (DROOP, isochronous) state (where alternate modes of operation are required).~~
- From Subscriber Organization:
 - Power Possible (Available maximum capacity): See above, instantaneous limit for available energy, represents max level the Facility can produce under present resource, BESS State of Charge (if applicable) and equipment conditions. This is used as upper limit for Company Dispatch.
 - For variable energy resources, maximum level the variable generation resources can produce under present variable resource and equipment conditions.
 - Minimum Sustained Limit: Minimum output level the Facility can be reduced to continuously without delay (ecomn). For projects with BESS: If BESS charging from the grid is permitted, and charging capacity is available, this will be a negative value.
 - Minimum Transient Limit (for frequency response, regulation) (lfcmn). For projects with BESS: If BESS charging from the grid is permitted, and charging capacity is available, this will be a negative value.
 - Maximum Dispatchable Ramp Rate: Controlled ramp rate available for controlled changes in output.
 - For projects with a BESS, Subscriber Organization shall also provide the following:
 - BESS potential (BESS State of Charge and projected number of hours at present dispatch, minimum dispatch, and maximum dispatch).
 - ~~Frequency Response Mode (DROOP, isochronous) state.~~

- (ix) Subscriber Organization shall not override Company's active power controls without first obtaining specific approval to do so from the Company System Operator unless there is a system emergency. Disabling of the remote Active Power Control shall initiate telemetry notification to the Company.
- (x) The requirements of the Active Power Control Interface may be modified as mutually agreed upon in writing by the Parties.

Active Power Communications between Company and Subscriber Organization

Company will receive and send AGC Set-Point and related data through the communications interface in accordance with Company standards. The data points covered under this Contract, as described below, may overlap with data requirements described elsewhere.

AGC Data Points to be sent from Subscriber Organization to Company via SCADA

The following data points will be transmitted via SCADA from Subscriber Organization to Company and represent Facility level data [**Note: May be modified based on resource type and Facility requirements**]:

DESCRIPTION	UNITS
AGC Set-Point (echo)	MW
Power demand	MW
Actual power	MW
Power Possible	MW
Actual reactive power	Mvars
Average Voltage	Kv
Variable Generation potential	MW
[Wind only] Number of turbines online and running	Integer
BESS State of Charge	Pct
[PV only] Inverters online	Integer
Facility duration at current output	HRS
AGC Status	Remote/Local
[For facilities with alternate modes of frequency response] Indication of Frequency Response Mode	Integer Droop, ISOCH

Response times and limitations of Facility in regard to Active Power Control

The following protocols outline the expectations for responding to the AGC Set-Point.

Frequency of Changes. Company may send a new AGC Set-Point to the Facility at up to the AGC control cycle (present 4 seconds).

Range of AGC Set-Point. The range of set point values can be between 0% and 100% of Power Possible. For projects offering grid-charging storage, negative set-point values maywill be required.

Backup Communications

In the event of an AGC failure, Company and Subscriber Organization shall communicate via telephone, or other method mutually agreeable between the Parties, in order to correct the failure.

- (xi) Active Power - Frequency Response (DROOP).

The Facility shall provide a primary frequency response with a frequency droop characteristic reacting to system frequency at the Point of Interconnection in both the overfrequency and underfrequency directions except as limited by the minimum and maximum available capacity and energy potential at the time of the event including BESS state of charge. This response must be timely and sustained rather than injected for a short period and then withdrawn. For over-frequency events, response may include absorption through charging (as applicable under the terms of this Contract). Subscriber Organization shall provide minimum operational limits for each online resource and the Facility for primary frequency response.


Frequency will be calculated over a period of time (e.g., three to six cycles, or other period as specified by Company), and filtered to take control action on the fundamental frequency component of the calculated signal. Calculated frequency may not be susceptible to spikes caused by phase jumps on the Company system.

The active power-frequency control system, and overall response of the inverter-based resource (plant), must meet the following performance aspects (see figure below):

The active power-frequency control system shall have an adjustable proportional droop characteristic with a default value of [4%] percent. The droop setting shall permit a setting from 0.1% to 10%. This setting shall be changed upon Company's written request as necessary for grid droop response coordination. The droop setting shall be tunable and may be specified during commissioning. The droop shall be a permanent value based on Pmax (maximum nominal active power output of the plant) and Pmin (typically 0 for an inverter-based resource). This keeps the proportional droop constant across the full range of operation. The curve for an inverter-based BESS may include the negative active power quadrant of this curve. The droop response must include the capability to respond in both the upward (underfrequency) and downward (overfrequency) directions. Frequency droop will be based on the difference between maximum nameplate active power output (Pmax) and zero output (Pmin) such that the [4%] percent droop line is always constant for a resource.

Subscriber Organization shall make commercially reasonable efforts to provide frequency response without a deadband, but in any case, not to exceed +/- 0.0166 Hz. If the active power-frequency control system has a deadband, it shall be a nonstep deadband that is adjustable between 0 Hz and the full frequency range of the droop characteristic with a default value not to exceed ± 0.036 Hz. (Nonstep deadband is where the change in active power output starts from zero deviation on either side of the deadband.) (Frequency deadband is the range of frequencies in which the unit does not change active power output.)

Inverter-based resources may consider a small hysteresis characteristic where linear droop meets any deadband to reduce dithering of inverter output when operating near the edges of the deadband. The hysteresis range may not exceed ± 0.005 Hz on either side of the deadband. If measurement resolution is not sufficient to measure this frequency, hysteresis may not be used.

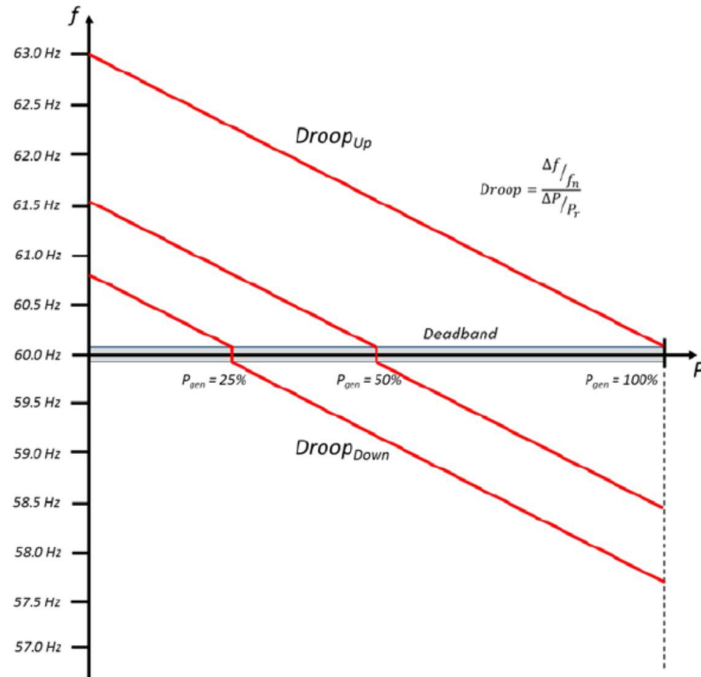

Active Power - Frequency Control Characteristic

Nominal System Frequency is 60.00 Hz.

The closed-loop dynamic response of the active power-frequency control system of the overall inverter-based resources, as measured at the POI must have the capability to meet or exceed the performance specified in below. Subscriber Organization shall ensure that the models and parameters for the resources and control equipment are consistent with those provided during the IRS process and that any updates have been provided to the Company reflecting currently implemented settings and configuration.

(xii) Dynamic Active Power-Frequency Performance.

For a step change in frequency at the point of measure of the inverter-based resource [NOTE - MAY BE ADJUSTED AS THE RESULT OF IRS]:

Reaction time: The time between a step change in frequency and the time when the resource active power output begins responding to the change shall be less than 500 ms or as otherwise specified by Company.¹

Rise time: The time when the resource has reached 90% of the new steady-state (target) active power output shall be less than 4 seconds, or as otherwise specified by Company.²

Settling Time: Time in which the resource has entered into, and remains within, the settling band of the new steady-state active power (target) output shall be less than 10 seconds, or as otherwise specified by Company.

¹ Time between step change in frequency and the time to 10 percent of new steady-state value can be used as a proxy for determining this time.

² Percentage based on final (expected) settling value.

Overshoot: Percentage of the rated active power output that the resource can exceed while reaching the settling band shall be less than 5% or as otherwise specified by Company.³

Settling Band: Percentage of rated active power output that the resource should settle to within the settling time shall be less than 2.5%.

When operating in parallel with the Company System, the Facility shall operate with its primary frequency response control in automatic operation and in accordance with Company directions. Notification of changes in the status of the frequency response controls and, where applicable, mode of operation must be provided to the Company System Operator immediately through SCADA telemetry indication.

The Facility frequency response control shall adjust, without intentional delay and without regard to the ramp rate limits in Section 3 (Performance Standards) of this Attachment F (Facility Owned by Subscriber Organization), the Facility's net real power export based on frequency deadband and frequency droop settings specified by the Company.

The Facility frequency response control shall increase the net real power export above the Power Reference Setpoint set under Section 1(g)(viii) of this Attachment F (Facility Owned by Subscriber Organization) or further decrease the net real power export from the Power Reference Limit in its operations in accordance with the frequency response settings.

The Facility frequency response control shall be in continuous operation unless directed otherwise by the Company.

~~(xiii) [FOR FACILITIES WITH STORAGE]. Alternate Active Power/ Frequency Response Modes. The Facility will provide the capability to supply an isochronous mode of operation, in addition to normal droop, which can be set remotely or locally. The control design shall allow for a bump less transfer between modes of operation.~~

~~A. Reserved.~~

~~B. Isochronous / Black Start: The Facility will be capable of operating in a zero droop (isochronous) mode of operation. When in this mode of operation, the frequency droop characteristic will be configured as needed to keep system frequency at a target. In a black start configuration, the target shall be 60 Hz. If isochronous is specified while in operation, the target shall be initialized to the grid frequency and the target increased or decreased from the Company System through the control interface.~~

~~(xiii) [Reserved]~~

(h) Control System Acceptance Test Procedures.

(i) Conditions Precedent. The following conditions precedent must be satisfied prior to conducting the Control System Acceptance Test:

- Successful completion of the Acceptance Test.
- Facility has been successfully energized.
- All of the Facility's generators (as applicable) have been fully commissioned.

³ Percentage based on final (expected) settling value.

- The control system computer has been programmed for normal operations.
 - All equipment that is relied upon for normal operations (including ancillary devices such as capacitors/inductors, energy storage device, statcom, etc.) shall have been commissioned and be operating within normal parameters.
- (ii) Facility Energy Equipment. In the event that all or any portion of the Facility's energy equipment is not available for the duration of the Control System Acceptance Test, the Control System Acceptance Test will have to be re-run from the beginning unless Subscriber Organization demonstrates to the satisfaction of the Company that the test results attained are consistent with the results that would have been attained if all of the equipment had been available for the duration of the test.
- (iii) Procedures. The Control System Acceptance Test will be conducted on Business Days during normal working hours on a mutually agreed upon schedule. No Control System Acceptance Test will be scheduled during the final 21 Days of a calendar year. No later than thirty (30) Days prior to conducting the Control System Acceptance Test, Company and Subscriber Organization shall agree on a written protocol setting out the detailed procedure and criteria for passing the Control System Acceptance Test. Exhibit F-7 (Control System Acceptance Test Criteria) provides general criteria to be included in the written protocol for the Control System Acceptance Test. Within fifteen (15) Business Days of completion of the Control System Acceptance Test, Company shall notify Subscriber Organization in writing whether the Control System Acceptance Test(s) has been passed and, if so, the date upon which such Control System Acceptance Test(s) was passed. If any changes have been made to the technical specifications of the Facility or the design of the Facility in accordance with Section 5(f) of Exhibit F-1 (Description of Generation and Battery Storage Facility), such changes shall be reflected in an amendment to this Contract, and the written protocol for the Control Systems Acceptance Test shall be based on the Facility as modified. Such amendment shall be executed prior to conducting the Control System Acceptance Test and Company shall have no obligation for any delay in performing the Control Systems Acceptance Test due to the need to complete and execute such amendment.
- (i) Facility Security and Maintenance. Subscriber Organization is responsible for securing the Facility. Subscriber Organization shall have personnel available to respond to all calls related to security incidents and shall take commercially reasonable efforts to prevent any security incidents. Subscriber Organization is also responsible for maintaining the Facility, including vegetation management, to prevent security breaches. Subscriber Organization shall comply with all commercially reasonable requests of Company to update security and/or maintenance if required to prevent security breaches.
- (j) Demonstration of Facility. Company shall have the right at any time, other than during maintenance or other special conditions, including Force Majeure, communicated by Subscriber Organization, to notify Subscriber Organization in writing of Subscriber Organization's failure, as observed by Company and set forth in such written notice, to meet the operational and performance requirements specified in Section 1(b)(iii)(I), Section 1(g) (Active Power Control Interface) and Section 3 (Performance Standards) of this Attachment F (Facility Owned by Subscriber Organization), and to require documentation or testing to verify compliance with such requirements. Upon receipt of such notice, Subscriber Organization shall promptly investigate the matter, implement corrective action and provide to Company, within thirty (30) Days of such notice or such longer time period agreed to in writing by Company, a written report of both the results of such investigation and the corrective action taken by Subscriber Organization; ~~provided, that, if thirty (30) Days is not a reasonable time period to investigate the matter, implement corrective action and provide such written report, Subscriber Organization shall complete the foregoing within such longer commercially reasonable period of time agreed to by the Parties in writing.~~ If the Subscriber Organization's report does not resolve the issue to Company's reasonable satisfaction, the Parties shall promptly commission a study to be performed by one of the

engineering firms then included on the Qualified Independent Third-Party Consultants List attached to the Contract as Exhibit F-2 (Consultants List) to evaluate the cause of the non-compliance and to make recommendations to remedy such non-compliance. Subscriber Organization shall pay for the cost of the study. The study shall be completed within ninety (90) Days, unless the selected consultant determines that such study cannot reasonably be completed within ninety (90) Days, in which case, such longer commercially reasonable period of time as it takes the ~~selected~~-consultant ~~determines is necessary~~-to complete ~~such study shall apply~~. The consultant shall send the study to Company and Subscriber Organization. Subscriber Organization (and/or its Third-Party consultants and contractors), at Subscriber Organization's expense, shall take such action as the study shall recommend with the objective of resolving the non-compliance. Such recommendations shall be implemented by Subscriber Organization to Company's reasonable satisfaction no later than forty-five (45) Days from the Day the completed study is issued by the consultant, unless the consultant determines that such recommendations cannot reasonably be implemented within forty-five (45) Days, in which case, ~~Subscriber Organization shall implement such recommendations within~~ such longer commercially reasonable period of time agreed to by the Parties in writing to implement such recommendation as determined by the consultant. Failure to implement such recommendations within this period shall constitute a material breach of this Contract. ~~Unless the aforementioned written report and study are being completed, and any recommendations are being implemented, solely to address Subscriber Organization's failure to satisfy the requirements of Section 3(w) (Round Trip Efficiency) of this Attachment F (Facility Owned by Subscriber Organization), the Company shall have the right to declare derate the Facility and the Facility derated and shall be deemed to be~~ in Subscriber Organization-Attributable Non-Generation status until the Subscriber Organization's aforementioned written report has been completed, any subsequent study commissioned by the Parties has been completed and any recommendations to resolve the non-compliance have been implemented to Company's reasonable satisfaction.

2. **OPERATING PROCEDURES. [NOTE: NUMERICAL SPECIFICATIONS IN THIS SECTION 2 MAY VARY DEPENDING ON THE SPECIFIC PROJECT AND THE RESULTS OF THE PROJECT-SPECIFIC INTERCONNECTION REQUIREMENT STUDY.]**

- (a) Reviews of the Facility. Company may require periodic reviews of the Facility, maintenance records, available operating procedures and policies, and relay settings, and Subscriber Organization shall implement changes Company deems necessary for parallel operation or to protect the Company System from damages resulting from the parallel operation of the Facility with the Company System.
- (b) Separation. Subscriber Organization must separate from Company System whenever requested to do so by the Company System Operator pursuant to Section 5. (Company Dispatch) and Section 12. (Personnel and System Safety) of the Contract.
- (c) Subscriber Organization Logs. Logs shall be kept by Subscriber Organization for information on unit availability including reasons for planned and forced outages, circuit breaker trip operations, relay operations, including target initiation, and other unusual events. Company shall have the right to review these logs, especially in analyzing system disturbances. Subscriber Organization shall maintain such records for a period of not less than six (6) years.
- (d) Reclosing and Return to Service. Under no circumstances shall Subscriber Organization, when separated from the Company System for any reason, including tripping during disturbances or due to equipment failure, reclose into the Company System without first obtaining specific approval to do so from the Company System Operator. Ramp rates, behavior and mode of operation upon return to service shall conform to verbal instructions from the System Operator or Active Power control from Company. Following "system black" conditions, the Facility shall not attempt to automatically reconnect to the grid (unless directed by the Company System Operator) so as to not interfere with blackstart system restoration procedures.

- (e) ~~[Reserved.]~~
- (f) ~~[Reserved.]~~
- (g) Critical Infrastructure Protection. Subscriber Organization shall comply with the critical infrastructure protection requirements set forth in Section 1(b) (iii) (G) of this Attachment F (Facility Owned by Subscriber Organization).
- (h) Allowed Operations. Facility shall be allowed to export energy to the Company System only when the [] circuit is in normal operating configuration served by breaker [] at [] Substation. **[TO BE DETERMINED BY COMPANY BASED ON THE RESULTS AND REQUIREMENTS OF THE IRS]**

3. **PERFORMANCE STANDARDS.** [NOTE: FACILITIES CONNECTING TO THE DISTRIBUTION SHALL FOLLOW THE PERFORMANCE STANDARDS FOR DISTRIBUTION SET FORTH BELOW.

PROVISIONS FOR DISTRIBUTION CONNECTION

(a) Rule 14H. The Facility shall follow the performance standards of Rule 14H Appendix I and the additional provisions set forth below in Section 3(b) (Voltage Ride-Through) through Section 3(g) (Unintentional Islanding). To the extent any of those additional provisions conflict with Rule 14H, the ~~additional~~ provisions of ~~Section 3(b) through Section 3(g)~~this Contract shall control.

~~(b) Voltage Undervoltage Ride-Through. Whenever the utility Distribution System:~~ The Facility, as a whole, will meet the following undervoltage ride-through requirements during low voltage affecting one or more of the three voltage phases ("V" is the voltage of any three voltage phases at the Point of Interconnection varies from and).

$V \geq 0.80$ pu The Facility remains outside the normal operating high and normal operating low region voltage for the predetermined parameters set forth connected to the Company's System in Table 4A-1.1. The Facility's protective functions shall cause the Facility's Advanced Inverter(s) to Cease continuous operation.

$0.70 \text{ pu} \leq V < 0.80 \text{ pu}$ The Facility remains connected to Energize the utility Distribution Company's System. Unless provided alternate settings by the Company, the Facility must comply with and in continuous operation for a minimum of twenty (20) seconds per event (while "V" remains in this range). The duration of the event is measured from the point at which the voltage ride-through and trip settings specified in Table 4A-1.1; drops below 0.80 pu and ends when the voltage is at or above 0.80 pu.

$0.50 \text{ pu} \leq V < 0.70 \text{ pu}$ The Facility shall stay remains connected to the utility Distribution Company's System and in continuous operation for a minimum of ten (10) seconds (while the grid remains "V" remains in this range); the duration of the event is measured from the point at which the voltage drops below 0.70 pu. and ends when the voltage is at or above 0.70 pu.

$0.00 \text{ pu} \leq V < 0.50 \text{ pu}$ The Facility remains connected to the Company's System and in continuous operation for a minimum of 600 milliseconds (while "V"

remains in this range); the duration of the event is measured from the point at which the voltage drops below 0.50 pu. and ends when the voltage is at or above 0.50 pu.

(c) Overvoltage Ride-Through: The overvoltage protection equipment at the Facility shall be set so that the Facility will meet the following overvoltage ride-through requirements during high voltage affecting one or more of the three voltage phases (as described below) ("V" is the voltage of any of the three voltage phases at the Point of Interconnection).

1.00 pu ≤ V < 1.10 pu The Facility remains connected to the Company's System and in continuous operation.

1.10 pu ≤ V < 1.15 pu The Facility remains connected to the Company's System and in continuous operation no less than thirty (30) seconds; the duration of the event is measured from the point at which the voltage increases at or above 1.10 pu and ends when voltage is at or below 1.10 pu.

1.15 pu ≤ V The Facility remains connected to the Company's System and in continuous operation for as long as possible as allowed by the equipment operational limitations

(d) Fault Ride Through. Ride- requires that the resource continues to inject current within the "Ride-Through Until" voltage time range and must operate in accordance with the "Operating Mode" specified for each "Operating Region"."No Trip" zone of the voltage and frequency ride-through requirements. Unless approved during the Interconnection Requirements Study analysis, resources should not use "momentary cessation" within the ride-through regions for any of the ride-through requirements.

1. In the Continuous Operation region, the Facility's Advanced Inverter shall reduce power output as a function of voltage, in accordance with section (iv) Volt-Watt of Rule 14H.

2. Different settings than those specified in Table 4A-1.1 may be specified by the Company

TABLE 4A-1.1: VOLTAGE RIDE-THROUGH TABLE

Operating Region	Voltage at Point of Interconnection (% of Nominal Voltage)	Operating Mode	Ride-Through Until (s)	Default Maximum Trip Time (s)
OV2	$V > 120$	Cease to Energize	N/A	0.16 (1)
OV1	$120 \geq V > 110$	Mandatory operation	.92	‡
CO	$110 \geq V > 100$	Continuous Operation (Volt-Watt)	N/A	N/A
CO	$100 > V \geq 88$	Continuous Operation	N/A	N/A
UV1	$88 > V \geq 70$	Mandatory Operation	20	24
UV2	$70 > V \geq 50$	Mandatory Operation	10-20	11-21(2)

UV3	50 → V	Momentary Cessation	N/A	2
-----	--------	---------------------	-----	---

~~(4) Must trip time under steady state condition. Inverters will also be required to meet the Company's Transient Overvoltage criterion (TrOV-2) or Limitation of overvoltage contribution requirement stated in IEEE 1547-2018 (or latest version), "IEEE Standard for Interconnection and Interoperability of Distributed Energy Resources with Associated Electric Power System Interfaces." Ride Through shall not inhibit TrOV-2 or limitation of overvoltage contribution of IEEE 1547-2018 requirements.~~

~~(2) May be adjusted within these ranges at manufacturer's discretion.~~

~~(e) Fault Ride Through. For fault related voltage dips at the Point of Interconnection that stay within the limits of the under voltage ride through requirements in Section 3(b) (Voltage Ride Through), upon clearing of the fault, Subscriber Organization shall within 1 second of restoration, provide at least 90% of the real power output at the point of interconnection immediately before the fault to the extent allowed by the availability of the solar resource. The fault ride through requirement does not apply if the Generating Facility is operating at less than five percent (5%) of the Generating Facility's nameplate capacity.~~

~~(d)(c) Grid Forming Capabilities. [NOTE APPLICABILITY BASED ON RESOURCE TYPE AND DESIGN, FOR PV INVERTER BASED RESOURCES PAIRED WITH STORAGE, TO BE DELETED IF SUBSCRIBER ORGANIZATION DOES NOT PROPOSE GRID FORMING] Subscriber Organization Facility ~~inverters shall~~ may be capable of operating in grid forming mode ~~supporting system operation under normal and emergency conditions without relying on if intended to serve load in the characteristics~~ absence of synchronous machines ~~the power system. Grid forming is required for facilities that provide black start capability.~~ This includes operation as a current independent AC voltage source during normal and transient conditions (as long as no limits are reached within the inverter) and the ability to synchronize to other voltage sources or operate autonomously if a grid reference is unavailable. The grid forming design and operation shall be reviewed and agreed upon by the Company to ensure compatibility with system operation under normal and restoration procedures.~~

~~(i) Subscriber Organization shall operate the Facility in grid forming mode only as directed by the Company System Operator, in its sole discretion. Such mode of operation shall be indicated to the Company System Operator through telemetry.~~

~~(ii) The Facility shall include safeguards to prevent the unintentional switching of the Facility into and out of grid forming mode. The safeguards shall be approved in writing by the Company and implemented by the Subscriber Organization prior to control system testing.~~

~~(e)(f) Black Start Capability. [NOTE - APPLICABILITY BASED ON RESOURCE TYPE AND DESIGN, FOR PV INVERTER BASED RESOURCES PAIRED WITH STORAGE, TO BE DELETED IF SUBSCRIBER ORGANIZATION DOES NOT PROPOSE BLACK START.] The BESS shall be capable of grid forming inverter capability so it can generate its own AC waveform rather than relying on a grid voltage to synchronize and maintain frequency. ~~Further, inverter based resources shall ensure they have sufficient energy storage to maintain power injection to the grid during system restoration (i.e., have power available when and if called upon). Inverter based facilities should be capable of support as a black start cranking path to start synchronous generators for restoration.~~~~

~~(f) (g) Frequency Response. Subscriber Organization shall comply with the requirements of Section 1(g) (xi) (Frequency Response (DROOP)), Section 1(g) (xii) (Dynamic Active Power – Frequency Performance), and ~~[FOR FACILITIES WITH STORAGE] Section 1(g) (xiii) (Alternate Active Power / Frequency Response Modes)~~ of this Attachment F (Facility Owned by Subscriber Organization).~~

- (gh) Unintentional Islanding. A Facility's inverters shall be certified to meet the unintentional islanding requirement stated in IEEE 1547-2018 (or latest version), "IEEE Standard for Interconnection and Interoperability of Distributed Energy Resources with Associated Electric Power System Interfaces." Ride through requirements specified herein shall not inhibit the islanding detection performance where a valid unintentional islanding condition exists.

4. MAINTENANCE OF SUBSCRIBER ORGANIZATION-OWNED INTERCONNECTION FACILITIES.

- (a) Subscriber Organization must address any Disconnection Event (as defined below) according to the requirements of this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities) of Attachment F (Facility Owned by Subscriber Organization). For the purposes of this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities), a "Disconnection Event" is the removal of 80% of or more from Company System and/or disconnection of the Facility from the Company's System (i) that is not the result of Company dispatch, frequency droop response, or isolation of the Facility resulting from designed protection fault clearing, and (ii) for which Company does not issue the written notice for failure to meet operational and performance requirements as set forth in Section 1(j) (Demonstration of Facility) of this Attachment F (Facility Owned by Subscriber Organization). Company's election to exercise its rights under Section 1(j) (Demonstration of Facility) shall not relieve Subscriber Organization of its obligation to comply with the requirements of this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities) for any future Disconnection Event during the pendency of such election or thereafter.
- (b) For every Disconnection Event ~~from the Company System~~, Subscriber Organization shall investigate the cause. Within three (3) Business Days of the Disconnection Event, Subscriber Organization shall provide, in writing to Company, an incident report that summarizes the sequence of events and probable cause.
- (c) Within forty-five (45) Days of a Disconnection Event, Subscriber Organization shall provide, in writing to Company, Subscriber Organization's findings, data relied upon for such findings, and proposed actions to prevent reoccurrence of a Disconnection Event ("Proposed Actions"). Company may assist Subscriber Organization in determining the causes of and recommendations to remedy or prevent a Disconnection Event ("Company's Recommendations"). Subscriber Organization shall implement such Proposed Actions (as modified to incorporate the Company's Recommendations, if any) and Company's Recommendations (if any) in accordance with the time period agreed to by the Parties.
- (d) In the event Subscriber Organization and Company disagree as to (i) whether a Disconnection Event occurred, (ii) the sequence of events and/or probable cause of the Disconnection Event, (iii) the Proposed Actions, (iv) Company's Recommendations, and/or (v) the time period to implement the Proposed Actions and/or Company's Recommendations, then the Parties shall follow the procedure set forth in Section 5 (Expedited Dispute Resolution) of this Attachment F (Facility Owned by Subscriber Organization).
- (e) Upon the fourth (4th) Disconnection Event (and each subsequent Disconnection Event) within any Contract Year, the Parties shall follow the procedures set forth in Section 4(a) and Section 4(d) of Attachment F (Facility Owned by Subscriber Organization), to the extent applicable. If after following the procedures set forth in this Section 4 (Maintenance of Subscriber Organization-Owned Interconnection Facilities) of Attachment F (Facility Owned by Subscriber Organization), Subscriber Organization and Company continue to have a disagreement as to (1) the probable cause of the Disconnection Event, (2) the Proposed Actions, (3) the Company's Recommendations, and/or (4) the time period to implement the Proposed Actions and/or the Company's Recommendations, then the Parties shall commission a study to be performed by a qualified independent Third-Party consultant ("Qualified Consultant") chosen from the Qualified Independent Third-Party Consultants List ("Consultants List") attached to the Contract as Exhibit F-2 (Consultants List). Such study shall review

the design of, review the operating and maintenance procedures dealing with, recommend modifications to, and determine the type of maintenance that should be performed on Subscriber Organization-Owned Interconnection Facilities ("Study"). Subscriber Organization and Company shall each pay for one-half of the total cost of the Study. The Study shall be completed within ninety (90) Days from such fourth Disconnection Event (and each subsequent Disconnection Event) within any Contract Year, unless ~~the Qualified Consultant determines the Study cannot otherwise~~ reasonably ~~be completed within ninety (90) Days, in which case, such longer period of time as the Qualified Consultant determines is necessary~~ agreed to complete the Study shall apply in writing by the Subscriber Organization and Company. The Qualified Consultant shall send the Study to Company and Subscriber Organization. Subscriber Organization (and/or its Third-Party consultants and contractors), at Subscriber Organization's expense, shall change the design of, change the operating and maintenance procedures dealing with, implement modifications to, and/or perform the maintenance on Subscriber Organization-Owned Interconnection Facilities recommended by the Study. Such design changes, operating and maintenance procedure changes, modifications, and/or maintenance shall be completed no later than forty-five (45) Days from the Day the completed Study is issued by the Qualified Consultant, unless such design changes, operating and maintenance procedure changes, modifications, and/or maintenance cannot reasonably be completed within forty-five (45) Days, in which case, Subscriber Organization shall complete the foregoing within such longer commercially reasonable period of time agreed to by the Parties in writing. Company shall have the right to derate the Facility to a level that maintains reliable operations in accordance with Good Engineering and Operating Practices, and the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status, until the study has been completed and the study's recommendations have been implemented by Subscriber Organization to Company's reasonable satisfaction. Nothing in this provision shall affect Company's right to dispatch the Facility as provided for in this Contract.

- (f) The Consultants List attached hereto as Exhibit F-2 (Consultants List) contains the names of engineering firms which both Parties agree are fully qualified to perform the Study. At any time, except when a Study is being conducted, either Party may remove a particular consultant from the Consultants List by giving written notice of such removal to the other Party. However, neither Party may remove a name or names from the Consultants List without approval of the other Party if such removal would leave the list without any names. Intended deletions shall be effective upon receipt of notice by the other Party, provided that such deletions do not leave the Consultants List without any names. Proposed additions to the Consultants List shall automatically become effective thirty (30) Days after notice is received by the other Party unless written objection is made by such other Party within said thirty (30) Day period. By mutual agreement between the Parties, a new name or names may be added to the Consultants List at any time.

5. EXPEDITED DISPUTE RESOLUTION.

If there is a disagreement between Company and Subscriber Organization regarding (i) whether a Disconnection Event occurred, (ii) the sequence of events and/or probable cause of the Disconnection Event, (iii) the Proposed Actions, (iv) the Company's Recommendations, and (v) the time period to implement the Proposed Actions and/or the Company's Recommendations, then authorized representatives from Company and Subscriber Organization, having full authority to settle the disagreement, shall meet in Hawai'i (or by telephone conference) and attempt in good faith to settle the disagreement. Unless otherwise agreed in writing by the Parties, the Parties shall devote no more than five (5) Business Days to settle the disagreement in good faith. In the event the Parties are unable to settle the disagreement after the expiration of the time period, then such disagreement shall constitute a Dispute for which either Party may pursue the dispute resolution procedure set forth in Section 17. (Dispute Resolution) of this Contract.

6. MODELING.

- (a) Subscriber Organization's Obligation to Provide Models. Within 30 Days of Company's written request, but no later than the Commercial Operations Date, Subscriber Organization shall provide

detailed data regarding the design and location of the Facility, in a form reasonably satisfactory to Company, to allow the modeling of the invertersWTGs and any other equipment within the Facility identified in the IRS which utilizes Source Code (such as energy storage system, STATCOM or DVAR equipment), including, but not limited to, integrated and validated power flow and transient stability models (such as PSS/E models), a short circuit model (such as an ASPEN model), and an electromagnetic transient model (such as a PSCAD model) of the invertersWTGs and any additional equipment identified in the IRS as set forth above, applied assumptions, and pertinent data sets (each a "Required Model" and collectively, the "Required Models"). Thereafter, during the Term, Subscriber Organization shall provide working updates of any Required Model within 30 Days of (i) Company's written request, or (ii) Subscriber Organization obtaining knowledge or notice that any Required Model has been modified, updated or superseded by the Source Code Owner.

(b) Escrow Establishment. If, pursuant to Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization), the Required Models are provided to the Company in a form other than Source Code, Subscriber Organization shall arrange for and ensure that the Source Code for the relevant Required Model is deposited into the Source Code Escrow as set forth below in Section 6(b)(i) (Source Code Escrow) of this Attachment F (Facility Owned by Subscriber Organization) no later than the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization) for delivery of the Required Models. Subscriber Organization shall be responsible for all costs associated with establishing and maintaining the Source Code Escrow. If, however, Subscriber Organization is unable to deposit the required Source Code into the Source Code Escrow within the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models), Subscriber Organization shall, no later than such time periods, instead establish a monetary escrow as set forth below in Section 6(b)(ii) (Monetary Escrow) of this Attachment F (Facility Owned by Subscriber Organization).

(i) Source Code Escrow.

(A) Establishment of Source Code Escrow. If the Required Models are not provided to the Company in the form of Source Code pursuant to Section 6(a) of this Attachment F (Facility Owned by Subscriber Organization), Subscriber Organization shall: (a) arrange for and ensure the deposit of a copy of the current version of the Source Code and relevant documentation for all Required Models with the Source Code Escrow Agent under the terms and conditions of the Source Code Escrow Agreement, and (b) arrange for and ensure the update of the deposited Source Code and relevant documentation for Major Releases and Minor Releases of the Required Models as soon as reasonably possible after they are made generally available.

(B) Release Conditions. Company shall have the right to obtain from the Source Code Escrow Agent one copy of the escrowed Source Code for the Required Models, under the following conditions upon Company's request:

(i) A receiver, trustee, or similar officer is appointed, pursuant to federal, state or applicable foreign law, for the Source Code Owner;

(ii) Any voluntary or involuntary petition or proceeding is instituted, under (x) U.S. bankruptcy laws or (y) any other bankruptcy, insolvency or similar proceeding outside of the United States, by or against the Source Code Owner; or

(iii) Failure of the Source Code Owner to function as a going concern or operate in the ordinary course; or

(iv) Subscriber Organization and the Source Code Owner fail to provide to Company the Required Models or updated Required Models, or, alternatively, fail to issue a Source Code LC,

within the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization), Company gives written notice of such failure to Subscriber Organization and the Source Code Owner, and Subscriber Organization and Source Code Owner fail to remedy such breach within five (5) Days following receipt of such notice.

(C) Remedies. If Company has the right to obtain from the Source Code Escrow Agent one copy of the escrowed Source Code for the Required Models pursuant to Section 6(b)(i)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization), and Company finds that Subscriber Organization failed to arrange for and ensure the update the Source Code Escrow with the modified and/or updated Source Code and relevant documentation for Major Releases and Minor Releases of the Required Models as provided in Section 6(b)(i) (Establishment of Source Code Escrow) of Attachment F (Facility Owned by Subscriber Organization) or that the Source Code for the Required Models is incomplete or otherwise unusable, Subscriber Organization shall be liable to Company for liquidated damages in the amount of \$500 per Day for each Day Subscriber Organization fails to provide such Source Code to Company or such update to the Source Code to Company from the date such Major Release or Minor Release was first made available by the Source Code Owner to customers of the Source Code Owner. Failure to provide the updated Source Code of the Required Models within 30 Days' notice from Company of a breach of Section 6(b)(i)(A) (Establishment of Source Code Escrow) of Attachment F (Facility Owned by Subscriber Organization); provided, that Subscriber Organization has also failed to provide a satisfactory Source Code LC as set forth in Section 6(b)(ii) (Source Code Security) of this Attachment F (Facility Owned by Subscriber Organization) shall constitute an Event of Default pursuant to Section 13. underof the Contract.

(D) Certification. The Source Code Escrow Agent shall release the Source Code of the Required Models to Company upon receipt of a signed statement by a representative of Company that reads substantially as follows:

For Maui Facilities: The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Maui Electric Company, Limited ("Maui Electric"), and (ii) Maui Electric is entitled to a copy of the Source Code of the Required Models Pursuant to Section 6(b)(i)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Maui Electric.

For Hawai'i Facilities: The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf Hawai'i Electric Light Company, Inc. ("Hawai'i Electric Light"), and (ii) Hawai'i Electric Light of is entitled to a copy of the Source Code of the Required Models Pursuant to Section 6(b)(i)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Hawai'i Electric Light.

(E) Authorized Use. If Company becomes entitled to a release of the Source Code of the Required Models from escrow, Company may thereafter correct, modify, update and enhance the Required Models for the sole purpose of providing itself the support and maintenance it otherwise would have been entitled to if it had been provided the Required Models by Subscriber Organization under Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned By Subscriber Organization) (the "Source Code Authorized Use").

(F) Confidentiality Obligations. Company shall keep the Source Code of the Required Models confidential pursuant to the confidentiality obligations of the Source Code Escrow Agreement. Company shall restrict access to the Source Code of the Required Models to those employees, independent contractors and consultants of Company who have agreed in writing to be bound by confidentiality and use obligations consistent with those specified in the Escrow Agreement, and who have a need to access the Source Code of the Required Models on behalf of Company to carry out their duties for the Source Code

Authorized Use. Promptly upon Subscriber Organization's request, Company shall provide Subscriber Organization with the names and contact information of all individuals who have accessed the Source Code of the Required Models, and shall take all reasonable actions required to recover any such Source Code in the event of loss or misappropriation, or to otherwise prevent their unauthorized disclosure or use.

(ii) Source Code Security.

(A) Establishment of Source Code Security. If the Required Models and their relevant Source Code are not provided to the Company in the form of Source Code pursuant to Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization) and if the Subscriber Organization is unable to arrange for and ensure the deposit of the Source Code into the Source Code Escrow established for the benefit of the Company pursuant to Section 6(b)(i) (Source Code Escrow) of this Attachment F (Facility Owned by Subscriber Organization) then, no later than the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization) for delivery of the Required Models and Source Code, Subscriber Organization shall provide an irrevocable standby letter of credit (the "Source Code LC") with no documentation requirement in the amount of Two Hundred Fifty Thousand Dollars (\$250,000) per Required Model (and its relevant Source Code) substantially in the form attached to this Contract as Exhibit G-1 (Form of Letter of Credit) from a bank chartered in the United States with a credit rating (as measured by Standard & Poor's) of "A-" or better ~~from Standard & Poor's~~ or A3 or better from Moody's. Such letter of credit shall be issued for a minimum term of one (1) year. Furthermore, at the end of each year the security shall be renewed for an additional one (1) year term so that at the time of such renewal, the remaining term of any such security shall not be less than one (1) year. The letter of credit shall include a provision for at least thirty (30) Days' advance notice to Company of any expiration or earlier termination of the letter of credit so as to allow Company sufficient time to exercise its rights under said security if Subscriber Organization fails to extend or replace the security. In all cases, the reasonable costs and expenses of establishing, renewing, substituting, canceling, increasing, reducing, or otherwise administering the letter of credit shall be borne by Subscriber Organization.

(B) Release Conditions. Company shall have the right to draw on the letter of credit the funds necessary to develop and recreate the Required Model or Required Models upon Company's request if Subscriber Organization fails to provide the Company the Required Models or updated Required Models within the time periods set forth in Section 6(a) (Subscriber Organization's Obligation to Provide Models) or Section 6(b)(i)(C) (Remedies) of this Attachment F (Facility Owned by Subscriber Organization), Company gives written notice of such failure to Subscriber Organization, and Subscriber Organization fails to remedy such breach within five (5) Days following receipt of such notice for a breach under Section 6(a) (Subscriber Organization's Obligation to Provide Models), or within thirty (30) Days following receipt of such notice for a breach under Section 6(b)(i)(C) (Remedies).

(C) Extend Letter of Credit. If the letter of credit is not renewed or extended no later than thirty (30) Days prior to its expiration or earlier termination, Company shall have the right to draw immediately upon the full amount of the letter of credit and to place the proceeds of such draw (the "Proceeds"), at Subscriber Organization's cost, in an escrow account in accordance with Section 6(b)(ii)(D) (Proceeds Escrow), until and unless Subscriber Organization provides a substitute form of letter of credit meeting the requirements of this Section 6(b)(ii) (Source Code Security) of this Attachment F (Facility Owned by Subscriber Organization).

(D) Proceeds Escrow. If Company draws on the letter of credit pursuant to Section 6(b)(ii)(C) (Extend Letter of Credit) of this Attachment F (Facility Owned by Subscriber Organization), Company shall, in order to avoid comingling the Proceeds, have the right but not the obligation to place the Proceeds in an escrow account as provided in this Section 6(b)(ii)(D) (Proceeds Escrow) of this Attachment F (Facility Owned by Subscriber Organization) with a reputable escrow agent acceptable to Company ("Proceeds Escrow Agent") subject to an escrow agreement acceptable to Company ("Proceeds Escrow Agreement"). Without limitation to the generality of the foregoing, a federally insured bank shall be deemed to be a "reputable

escrow agent." Company shall have the right to apply the Proceeds as necessary to recover amounts Company is owed pursuant to this Section 6 (Modeling) of this Attachment F (Facility Owned by Subscriber Organization). To that end, the Proceeds Escrow Agreement governing such escrow account shall give Company the sole authority to draw from the account. Subscriber Organization shall not be a party to such Proceeds Escrow Agreement and shall have no rights to the Proceeds. Upon full satisfaction of Subscriber Organization's obligations under Section 6 (Modeling) of this Attachment F (Facility Owned by Subscriber Organization), Company shall instruct the Proceeds Escrow Agent to remit to the bank that issued the letter of credit that was the source of the Proceeds the remaining balance (if any) of the Proceeds. If there is more than one escrow account with Proceeds, Company may, in its sole discretion, draw on such accounts in any sequence Company may select. Any failure to draw upon the Proceeds for any damages or other amounts due Company shall not prejudice Company's rights to recover such damages or amounts in any other manner.

(E) Subscriber Organization's Obligation. If the letter of credit is not sufficient to cover Company's associated consultant fees, costs and expenses to develop and recreate the Required Models, Subscriber Organization shall pay to Company the difference within ten (10) Days of Company's written notice to Subscriber Organization.

(F) Model Verification. Subscriber Organization shall work with the Company to validate the new Required Models developed by or on behalf of Company within sixty (60) Days of receiving such new Required Models. Subscriber Organization shall also arrange for and ensure that Company may obtain new Required Models directly from the Source Code Owner in the event that Subscriber Organization ceases to operate as a going concern or is subject to voluntary or involuntary bankruptcy and is unable or unwilling to obtain the new Required Models from the Source Code Owner.

(G) Certification. The terms of the letter of credit shall provide for a release of the funds, or in the event the funds have been placed into a Proceeds Escrow, the ~~Proceeds~~ Escrow Agent shall release the necessary funds to Company upon receipt of a signed statement by a representative of Company that reads substantially as follows:

For Maui Facilities The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Maui Electric Company, Limited ("Maui Electric"), and (ii) Maui Electric is entitled to \$ _____, pursuant to Section 6(b)(ii)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the CBRE Mid-Tier Standard Form Contract dated as of _____, between _____, and Maui Electric.

For Hawai'i Facilities: The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Hawai'i Electric Light Company, Inc. ("Hawai'i Electric Light" , and (ii) Hawai'i Electric Light is entitled to \$ _____, pursuant to Section 6(b)(ii)(B) (Release Conditions) of Attachment F (Facility Owned by Subscriber Organization) of the CBRE Mid-Tier Standard Form Contract dated as of _____, between _____, and Hawai'i Electric Light.

(H) Authorized Use. If Company becomes entitled to a draw of funds from the Source Code Security or a release of funds from the Proceeds Escrow, Company may thereafter use such funds to develop, recreate, correct, modify, update and enhance the Required Models for the sole purpose of providing itself the support and maintenance it otherwise would have been entitled to if it had been provided the Required Models by Subscriber Organization under Section 6(a) (Subscriber Organization's Obligation to Provide Models) of this Attachment F (Facility Owned by Subscriber Organization).

(iii) Supplementary Agreement. The parties stipulate and agree that the escrow provisions in this Section 6(b) (Escrow Establishment) of Attachment F (Facility Owned by Subscriber Organization) and the Source Code Escrow Agreement and Proceeds Escrow Agreement are "supplementary agreementsSupplementary Agreements" as contemplated in Section 365(n) ~~(1)-(B)~~ of the Code. In any voluntary or involuntary bankruptcy proceeding involving

Subscriber Organization, failure by Company to assert its rights to "retain its rights" to the intellectual property encompassed by the Source Code or the funds in the Proceeds Escrow, pursuant to Section 365(n)-(1)-(B) of the Code, under an executory contract rejected in a bankruptcy proceeding, shall not be construed as an election to terminate the ~~contract~~Agreement by Company under Section 365(n)-(1)-(A) of the Code.

7. **TESTING REQUIREMENTS.**

- (a) **Testing Requirements.** Once the Control System Acceptance Test has been successfully passed, Subscriber Organization shall not replace and/or change the configuration of the Facility Control, inverter control settings and/or ancillary device controls, without prior written notice to Company. In the event of any such replacement and/or change, the relevant test(s) of the Control System Acceptance Test shall be redone and must be successfully passed before the replacement or altered equipment is allowed to be placed in normal operations. In the event that Company reasonably determines that such replacement and/or change of controls makes it inadvisable for the Facility to continue in normal operations without a further Control Systems Acceptance Test, the Facility shall be deemed to be in Subscriber Organization-Attributable Non-Generation status until the new relevant tests of the Control System Acceptance Test have been successfully passed.
- (b) **Periodic Testing.** Subscriber Organization shall coordinate periodic testing of the Facility with Company to ensure that the Facility is meeting the performance standards specified under this Contract.

8. **DATA AND FORECASTING.**

Subscriber Organization shall provide Site, meteorological and production data in accordance with the following requirements:

- (i) **Physical Site Data:** Subscriber Organization shall provide Company with an accurate description of the physical Site, including but not limited to the following, as appropriate to Facility resource type(s) and use of storage which may not be changed during the Term without Company's prior written consent ~~—[Drafting Note: May be modified by Company as appropriate based on Facility equipment and resource type]~~:
- A. Location Facility Map showing the layout of the Facility (coverage area or footprint) and the coordinates (latitude and longitude) of generating equipment:
- Wind Generators: coordinates (latitude and longitude) and height above ground of each wind turbine hub.
- B. Location (latitude and longitude) and elevation (above ground) of each MMT ~~/MMS~~ and elevation (above ground) of each field measurement device for, e.g., air density, ambient air pressure and ambient air temperature, located at each MMT or each field measurement device located on such MMST.
- C. Wind generation technology employed at the Facility with representative power curve(s).
- D. BESS technology and related auxiliary equipment, location and type.
- (ii) **Meteorological and Production Data.**
- A. Subscriber Organization shall install and maintain a minimum of one MMST for facilities with a Contract Capacity of less than 5 MW and a coverage area of not more than one square kilometer.

- B. Subscriber Organization shall install and maintain a minimum of two MMST for facilities that have either (i) a DC rating of the Facility of 5 MW or greater or (ii) a coverage area greater than one square kilometer.
- C. Placement of each MMST should account for the microclimate of the area and Facility coverage area and shall be oriented with respect to the primary wind direction.
- D. Subscriber Organization shall provide to Company, via SCADA communication and protocol acceptable to Company to support operations and forecasting needs at a continuous scan, all meteorological and production data required under this Contract updated every 2 seconds.
- E. Subscriber Organization shall arrange for a dedicated distribution voltage line to provide separate service from Company, or for such other independent, backup power source as approved by Company in writing, to temporarily store and record the meteorological data from the field measuring devices at the MMSTs. Any such backup power source must be capable of providing power for the field measurement devices for a reasonable period of time until primary power is restored. The same backup power source can serve multiple MMSTs as needed by the Facility.

(iii) Units and Accuracy:

A. ~~[For PV] The Table below shows minimum required solar irradiance measurements for various types of solar generation technology. This value may not be derived.~~

Solar Technology	Direct Normal Irradiance	Global Irradiance (GHI)	Plane of Array Irradiance (POA)
Flat Plate (fixed horizontal, fixed angle, tracking, roof mounted)		X	X
Flat Panel Solar Thermal (fixed angle, roof mounted, tracking)	X		X
Concentrated PV (flat, trough, tracking)	X	X	X

B. ~~Units and accuracy of measured parameters to be provided to Company in real time shall be as shown in the Table below. These represent the minimum required accuracies.~~

~~Table of Units and Accuracy of Meteorological and Production Data (PV)~~

Parameter	Data Source	Unit	Range	Accuracy
Global Horizontal Irradiance at MMS	Pyranometer or equivalent	W/m²	0 to 1500 W/m²	Secondary standard per ISO 9060 or ≤ 3% from 100 W/m² to 1500 W/m² if using a PV Reference Cell

Parameter	Data Source	Unit	Range	Accuracy
Plane of Array Irradiance on same axis as array	Pyranometer or equivalent	W/m ²	0 to 1500 W/m ²	Secondary standard per ISO 9060 or $\leq 3\%$ from 100 W/m ² to 1500 W/m ² if using a PV Reference Cell
Back of Panel temperature at array height	Temperature probe	°C	-20 to +50 °C	± 1 °C
Ambient air temperature at MMS	Temperature probe	°C	-20 to +50 °C	± 1 °C
Wind speed at MMS	Anemometer, sonic device or equivalent	mph	0 to 134 mph	± 1 mph
Set point for each inverter	Reported by Subscriber Organization	MW	0 to inverter name plate	Not applicable
Power production of Facility	Measured at — POI	MW	Up to Capacity	± 0.1 MW
BESS Charging Power	Measured at BESS Charging Interface	MW	Up to Capacity	± 0.1 MW
Facility power production ratio	Ratio of Facility's power production (MW)/Allowed Capacity (MW)	%	0 to 100%	± 0.1 %
Inverters Available*	Subscriber Organization's system	digital	Up to the number installed inverters	
Facility Inverter Availability	Ratio of inverters online/number of inverters	%	0 to 100%	
Power Possible*	Subscriber Organization's Model	MW	0 to Allowed Capacity	± 0.1 MW

TABLE OF UNITS AND ACCURACY OF METEOROLOGICAL AND PRODUCTION DATA (WIND)				
Parameter	Data Source	Unit	Range	Accuracy
Wind speed at MMT (hub height)	Cup or sonic anemometer	Mph	0 to 134 mph	+/-1 mph
Wind direction at MMT (hub height)	Vane, sonic device or equivalent	Degrees (from True North)	360°	+/-5°
Ambient air temperature at MMT (hub height)	Temperature probe	°C	-20 to +50 °C	+/-1 °C
Ambient air pressure at MMT (hub height)	Piezoresistive transducer, barometer or equivalent	Mbar	150 to 1150 mbar	+/-60 mbar (0 to +50°C)
Power production of Facility	Measured at POI	MW		+/- 0.1 MW
Power Possible	Subscriber Organization's Model	MW	0 to 120% of Allowed Capacity	+/- 0.1 MW

(iv) Status of Generating Equipment:

For each inverter, or wind turbine, Subscriber Organization shall provide to Company, via SCADA communication and protocol acceptable to Company at a continuous scan updated not less frequently than every 2 seconds, a signal as to whether such inverter or wind turbine is available or unavailable, and on or offline.

(v) Data Collection.

[NOTE COMPANY TO UPDATE REQUIREMENTS; WILL BE SPECIFIC TO FACILITY EQUIPMENT AND RESOURCE TYPE]

High Resolution Data: Subscriber Organization shall install and make available to the Company time stamped and sequential data recordings for all inverter-based resources (and all generating resources) to perform event analysis and verify Facility performance during steady state and transient disturbance events. This will include a time-synchronized phasor measurement unit at the Facility, and access to multiple sources to provide sufficient clarity as to any abnormal response or behavior within the Facility, including Facility control settings and static values, SCADA data, sequence of events recording (SER) data, dynamic disturbance recorder (DDR) data, and inverter fault codes and inverter-level dynamic recordings. This data will be used to review the Facility response to system dynamics, such as the frequency response (normal droop), reactive response, etc.

Plant Data: [Note: specific requirements below are representative of variable energy resources and will be tailored to the Facility resource type(s) and geographic arrangement]

~~Subscriber Organization shall install at least three (3) meteorological tower(s), spaced so as to provide the data points set forth below for the entire Facility.~~ At least two months prior to the Commercial Operation Date, Subscriber Organization shall deliver to Company a report showing (i) manufacturer, model and year of all energy equipment (~~panels, inverters,~~ energy storage devices, turbine generators), and meteorological instrumentation, and (ii) the latitude and longitude of the center of the energy equipment (i.e., ~~solar panels for every inverter,~~ wind turbines) and every meteorological tower. Beginning upon COD, Subscriber Organization shall transmit and provide to Company the real-time data set forth below, refreshed as frequently as allowed by the SCADA system, not to exceed sixty (60) second intervals:

- Three (3) data points from each ~~inverter or~~ wind turbine:
 - Inverter/turbine generation (MW)
 - Inverter/turbine availability
 - Inverter/turbine on/offline status
- ~~Two (2) data points from each meteorological tower (solar resources):~~
 - ~~Global horizontal solar irradiance (instantaneous solar intensity, full sky)~~
 - ~~Plane of array solar irradiance (instantaneous solar intensity at the current angle of the PV array)~~
- Five data points from each Meteorological Tower (wind resources):
 - Wind Speed ** (mps)
 - Wind Direction** (degrees relative to true north)
 - Temperature (Celsius)
 - Pressure (mb)
 - Air Density (kg/m3)

In addition to the other requirements for data collection, if required by Company, a Facility with wind turbines shall install, maintain and operate at least one meteorological tower that is installed at hub height and is placed upstream of the prevailing wind path to provide meteorological data through a means agreed by the Company. The data stream from this meteorological tower to the Company's System must be reliable and include battery back-up at the meteorological tower and a local source of electricity to power the data collection and communication from the Facility to Company during transmission outages.

Subscriber Organization shall provide a map and key for each inverter or wind turbine sufficient to allow Company to correlate the data received through Company's data historian system to each individual resource.

9. TECHNOLOGY SPECIFIC REQUIREMENTS.

- (a) ~~[RESERVED]~~Reserved
- (b) ~~[RESERVED]~~Reserved
- (c) Inverter Systems.

- (i) Direct current generators and non-power (i.e., other than 60 Hertz) alternating current generators can only be installed in parallel with the Company System using a non-islanding synchronous inverter unless alternate designs are approved by the Company. The design shall comply with the requirements of IEEE Std 1547-2003 (or latest version), except as described in Section 3 (Performance Standards) of this Attachment F (Facility Owned by Subscriber Organization).
- (i) Self-commutated inverters of the Company-interactive type shall synchronize to the Company System. Line-commutated, thyristor-based inverters are not recommended and will require additional technical study to determine harmonic and reactive power requirements. All interconnected inverter systems shall comply with the harmonic current limits of IEEE Std 519-1992 (or latest version).
- (d) Battery Energy Storage System. The operating parameters of the BESS for facilities with paired storage shall be as follows:
 - (i) For facilities with variable energy and paired storage: The BESS shall directly charge storage from the variable resource when the Company Active Power Dispatch is for less than the available resource energy.
 - (ii) No more than [] % of the BESS energy capacity can be charged from the grid prior to the fifth (5th) anniversary of the Commercial Operations Date. Thereafter, 100% of the BESS energy capacity can be charged from the grid. **[DRAFTING NOTE ONE: 5-YEAR LIMITATION ON GRID CHARGING WILL BE DELETED IF ITC RECAPTURE IS NOT APPLICABLE TO THE BESS.] [DRAFTING NOTE TWO: IF THE BESS WILL NEVER CHARGE FROM THE GRID, REPLACE THIS ENTIRE SUBSECTION WITH THE FOLLOWING: "None of the BESS energy capacity may be charged from the grid during the Term of this Agreement."]**
 - (iii) The BESS will not be required to discharge more energy than available relative to the available state of charge.
 - (iv) For storage used primarily for energy shifting, the BESS shall be designed for an average annual use of 365 cycle(s) (a cycle is a discharge equal to the portion of the BESS Contract Capacity allocated for energy shifting, and sufficient charging to return the BESS to 100% State of Charge)
 - ~~(v) For contingency storage, the BESS storage technology shall be procured based on required charging/discharging duty for the provision of disturbance frequency response. This response will require fast response outside of a specified frequency deadband (settable between 0.1 and 0.5 Hz), in accordance with specified droop and time parameters. (Historical frequency data for 2-second data resolution samples will be provided to bidders.) (Assumptions and associated restrictions on charging/discharging duty to be supplied by bidders).~~

~~10. OPERATING COMMITTEE AND OPERATING PROCEDURES.~~

~~Company and Subscriber Organization shall each appoint one representative and one alternate representative to act as the operating committee in matters relating to the Parties' performance obligations under this Contract and to develop operating arrangements for the generation, delivery and receipt of renewable energy from the Facility.~~

~~The operating committee may develop mutually agreeable written operating procedures consistent with the requirements of this Contract, to address matters such as day to day communications; key personnel;~~

~~operations center interface; metering, telemetering, telecommunications, and data acquisition procedures; operations and maintenance scheduling and reporting; reports; operations log; testing procedures; and such other matters as may be mutually agreed upon by the operating committee.~~

~~The operating committee shall review the requirements for Active Power Control, the data collection and telemetry, and control system parameters from time to time after the date hereof and may agree on modifications thereto to the extent necessary or convenient for operation of the Facility in accordance with this Contract.~~

~~The operating committee shall have authority to act in all technical and day-to-day operational matters relating to performance of this Contract and to attempt to resolve potential disputes, provided, however, that except as explicitly provided herein, the operating committee shall have no authority to amend or waive any provision of this Contract.~~

EXHIBIT F-1
DESCRIPTION OF GENERATION AND BATTERY STORAGE FACILITIES

1. Name of Facility:

(a) Location: (TMK No.)

(b) Telephone number (for system emergencies):

(c) E-mail Address:

(d) Contact Information for notices pursuant to the Contract:

Mailing Address:

Address for Delivery by Hand or Overnight Delivery:

Email Address:

2. Owner (If different from Subscriber Organization):

If Subscriber Organization is not the owner, Subscriber Organization shall provide Company with a certified copy of a certificate warranting that the owner is a corporation, partnership or limited liability company in good standing with the Hawai'i Department of Commerce and Consumer Affairs which shall be attached hereto as Exhibit F-1-1 (Good Standing Certificates).

3. Operator:

4. Name of person to whom payments are to be made:

(a) Mailing address:

(b) Hawai'i Gross Excise Tax License number:

5. Equipment:

(a) Type of facility and conversion equipment:

[For example: Small power production facility designated as a Qualifying Facility that produces electric energy using _____.]

(b) Design and capacity

Total Facility Capacity ("Contract Capacity"): _____

_____ kW

Total Number of Generators: _____

[number and size of each generator, e.g., one (1) Brand X, 200 kW; one (1) Brand Y, 300 kW]

Description of Equipment:

[For example: Describe the type of energy conversion equipment, capacity, and any special features.]

Individual Unit: **[if more than one generator, list information for each generator]**

	kW	kVAR Consumed	kVAR Produced
<u>Full load</u>			
<u>Startup</u>			

Generator:

Type _____

Rated Power _____ kW

Voltage _____ V, _ phase

Frequency _____ Hz

Class of Protection _____

Number of Poles _____

Rated Speed _____ rpm

Rated Current _____ A

Rated Power Factor See Exhibit B-2

Batteries

Total Number of Energy Storage Units:

- (c) Single or 3 phase:
- (d) Name of manufacturer:
- (e) Description of Facility SCADA and control system(s)
- (f) The "Allowed Capacity" of this Contract shall be the lower of (i) Contract Capacity or (ii) the net nameplate capacity (net for export) of the Facility installed by the Commercial Operations Date.
- (g) Subscriber Organization may propose revisions to this Section 5 (Equipment) of Exhibit F-1 (Description of Generation Battery and Storage Facilities) ("Section 5") for Company's approval prior to commencement of construction, provided, however, that (i) no such revision to this

Section 5 shall change the type of Facility or conversion equipment deployed at the Facility from a solarwind energy conversion facility ~~using photovoltaic equipment~~; (ii) Subscriber Organization shall be in compliance with all other terms and conditions of this Contract; and (iii) such revision(s) shall not change the characteristics of the Facility equipment or the specifications used in the IRS. Any revision to this Section 5 complying with items (i) through (iii) above shall be subject to Company's prior approval, which approval shall not be unreasonably withheld. If Subscriber Organization's proposed revision(s) to this Section 5 otherwise satisfies items (i) and (ii) above but not item (iii) such that Company, in its reasonable discretion, determines that a re-study or revision to all or any part of the IRS is required to accommodate Subscriber Organization's proposed revision(s), Company may, in its sole and absolute discretion, conditionally approve such revision(s) subject to a satisfactory re-study or revision to the IRS and Subscriber Organization's payment and continued obligation to be liable and responsible for all costs and expenses of re-studying or revising such portions of the IRS and for modifying and paying for all costs and expenses of modification to the Facility, the Company-Owned Interconnection Facilities based on the results of the re-studies or revisions to the IRS. Any changes made to this Attachment F of the Contract as a result of this Section 5(f) of Exhibit F-1 (Description of Generation and Battery Storage Facilities) shall be reflected in a written amendment to the Contract.

Subscriber Organization understands and acknowledges that Company's review and approval of Subscriber Organization's proposed revisions to this Section 5 and any necessary re-studies or revisions to the IRS shall be subject to Company's then-existing time and personnel constraints. Company agrees to use commercially reasonable efforts, under such time and personnel constraints, to complete any necessary reviews, approvals and/or re-studies or revisions to the IRS.

Any delay in completing, or failure by Subscriber Organization to meet, any subsequent Subscriber Organization milestones under Article 13 (Guaranteed Project Milestones Including the Commercial Operations Date) as a result of any revisions pursuant to this Section 5 by Subscriber Organization (whether requiring a re-study or revision to the IRS or not) shall be borne entirely by Subscriber Organization and Company shall not be responsible or liable for any delay or failure to meet ~~the Commercial Operations Date~~ any such milestones by Subscriber Organization.

6. ~~(h)~~ Insurance carrier(s): **[SUBSCRIBER ORGANIZATION TO PROVIDE INFORMATION]**
7. If Subscriber Organization is not the operator, Subscriber Organization shall provide a copy of the agreement between Subscriber Organization and the operator which requires the operator to operate the Facility and which establishes the scope of operations by the operator and the respective rights of Subscriber Organization and the operator with respect to the sale of electric energy from Facility no later than the Commercial Operations Date. In addition, Subscriber Organization shall provide a certified copy of a certificate warranting that the operator is a corporation, partnership or limited liability company in good standing with the Hawai'i Department of Commerce and Consumer Affairs no later than the Commercial Operations Date.
8. Subscriber Organization shall provide a certified copy of a certificate warranting that Subscriber Organization is a corporation, partnership or limited liability company in good standing with the Hawai'i Department of Commerce and Consumer Affairs which shall be attached hereto as Exhibit F-1-1 (Good Standing Certificates).
9. Subscriber Organization, owner and operator shall provide Company a certificate and/or description of their ownership structures which shall be attached hereto as Exhibit F-1-2 (Ownership Structure).

10. In the event of a change in ownership or identity of Subscriber Organization, owner or operator, such entity shall provide within 30 Days thereof, a certified copy of a new certificate and a revised ownership structure.

**EXHIBIT F-2
CONSULTANTS LIST**

EXHIBIT F-3
MODELING REQUIREMENTS

1. Steady State and Dynamic Model Requirements and As-built Data to be provided by Subscriber Organization. The expected steady state power flow and dynamic models will be provided by the Subscriber Organization during the interconnection study process in the format compatible with the analytical tools used by Company. Depending upon Facility design, different representations may be required for steady state and dynamic simulations. Subscriber Organization will work with Company to derive a complex equivalent model if it is required to meet interconnection study needs. The as-built data and models will be provided by Subscriber Organization immediately upon commissioning with sufficient information to demonstrate that the as-built parameters match the model. Any changes to plant settings that affect its response and impact to the Company System are required to be studied prior to those changes taking effect. The modeling will include all necessary control settings such that the correct capabilities, flags, and settings can be represented in a base case. Where such parameters are settable according to this Contract, the initial models will be configured with parameters mutually agreed with Company for the interconnection study analysis. This includes, but is not limited to:
 - Plant Type: A description of the resource type (e.g., storage, solar PV or wind power resource) used as a flag to ensure that the inverter-based resource is accurately represented in the base case, where applicable.
 - Active and Reactive Capability: The overall plant "composite capability curve" shall be provided by Subscriber Organization for performance purposes. That same curve will be used for accurately modeling the P-Q capability in power flow studies.
 - Plant-Level Voltage Control Settings: Information on the plant voltage control mode to ensure correct voltage control flags and set points are set accordingly in the software tools.
 - The voltage control set point at the POI is provided by the Company. Subscriber Organization shall provide a description of the coordination of any plant-level shunt compensation (static or dynamic) to ensure it can be accurately represented in the power flow base case.The models provided by Subscriber Organization should accurately reflect the contractual requirements established under this Contract.
2. Positive Sequence Stability Modeling. Subscriber Organization shall provide a positive sequence stability model representation which provides sufficient detailed modeling for necessary reliability studies, as specified by Company. **[Note – language to be revised based on proposed Facility.]** For example, the following are typical requirements for plants with inverter equipment:
 - Inverter-Level Controller Model: This represents the overall control of the inverter as an energy or generating resource.
 - Electrical Control Model: This represents the detailed electrical controls of the resource, including large disturbance behavior.
 - Plant-Level Controller Model: This represents control of multiple individual inverters and/or generators within the plant.
3. Short Circuit Modeling. Subscriber Organization will provide appropriate and accurate models to Company to support short circuit studies. **[Company to specify requirements based on specific Facility]**
4. Electromagnetic Transient Modeling. Company will require an electromagnetic transient ("EMT") model for the Facility. Subscriber Organization shall provide Company with an EMT model for the IRS and an updated EMT model after the Facility has been commissioned. These models are in addition to the positive sequence stability models required for interconnection-wide modeling purposes. In addition, Subscriber Organization shall provide Company with evidence that the expected (and commissioned) EMT model reasonably matches the positive sequence dynamic models provided. This should include a benchmarking report provided by the inverter OEM.

EXHIBIT F-4
GENERATOR AND ENERGY STORAGE CAPABILITY CURVE(S)

EXHIBIT F-5
SINGLE-LINE DRAWING AND INTERFACE BLOCK DIAGRAM

(To be attached as per Section 1(a) of Attachment F)

EXHIBIT F-6
RELAY LIST AND TRIP SCHEME

(To be attached as per Section 1(a) of Attachment F.)

EXHIBIT F-7
CONTROL SYSTEM ACCEPTANCE TEST CRITERIA

[THIS ATTACHMENT WILL NEED TO BE MODIFIED BASED ON THE RESULTS OF THE IRS]

1. The Control System Acceptance Test for the Facility will be conducted, following installation of the Facility. The Control System Acceptance Test procedures will be in accordance with criteria set forth herein. The Control System Acceptance Test shall be performed in accordance with Good Engineering and Operating Practices and demonstrate to Company's satisfaction that the Facility and the interconnection portion of the Facility, including Company-Owned Interconnection Facilities, have met the provisions of Section 5. (Company Dispatch) of the Contract and Section 3 (Performance Standards) of Attachment F (Facility Owned by Subscriber Organization).
 - A. Control System Acceptance Test procedures will be developed by Company for the Subscriber Organization's review at least sixty (60) Days in advance of performing the tests based on the date provided by Company.
 - B. The procedures will include, but not be limited to, demonstration of the functional requirements of the Facility defined in Section 5. (Company Dispatch) of the Contract and Section 3. (Performance Standards) of Attachment F (Facility Owned by Subscriber Organization) such as, but not limited to:
 1. Interconnection equipment and communications to support remote monitoring of the Facility and control of Facility breakers
 2. Droop characteristic and change of frequency control / response modes (if applicable)
 3. Real power delivery under remote Company Dispatch, Active Power Dispatch. For facilities with directly controlled storage, the storage will be operated to perform at least two full charging/discharging cycles.
 4. Accurate provision of limits for Minimum and Maximum Dispatch (Power Possible, Minimum load capability)
 5. Ramp rates for controlled actions
 6. Control of Facility breakers
 7. Voltage regulation
 8. Grid forming and Black start (if applicable)
 9. BESS Capacity Test and demonstration of the round-trip efficiency of the BESS, each as described in Attachment H (BESS Requirements)
 - C. Testing of primary and redundant communications between Company System Operator and Facility Operator
 - D. The actual dynamic response of the Facility equipment will be confirmed to allow Company transient stability model to reflect the as-left conditions of the unit. During the commissioning, the following will be required:
 1. A final review by Company engineers of the equipment installed to control the operation and protect the plant will be needed upon installation and prior to the start of commercial operation.
 2. The review will include off-line tuning and testing results of the excitation and governor control and/or control system and the IEEE block diagram utilized for the PSS/E dynamics program.
 3. iii. During the commissioning of the actual Facility, equipment system testing will be conducted to ensure that similar, well damped, expected responses will be produced by the facility. The as-left parameters obtained from real and reactive local response tuning will be determined for use in the Company planning model. The Subscriber Organization will provide an estimate of the earliest date for the Control System Acceptance Test at least ninety (90) Days before the date.
 - E. The Control System Acceptance Test procedures for the Facility will be mutually agreed upon between Subscriber Organization and Company prior to conducting the test.
 - F. When the Facility is ready for the Control System Acceptance Test, Subscriber Organization shall notify Company at least seven (7) Days prior to the test and shall coordinate with Company. Subscriber Organization shall perform, and Company shall monitor such test no earlier than seven (7) Days from Company's receipt of such notice.
 - G. The Control System Control Acceptance Test is to be successfully completed prior to the Commercial Operation Date.

2. Examples of the type of tests conducted to meet the aforementioned objectives may include, but are not limited to the following:
- A. On-site Tests
 1. SCADA Test to verify the status and analog telemetry, and if the remote controls between the Company's EMS and the Facility are working properly end-to-end.
 2. Dispatch Test to verify if the Facility's active power limit controls and the Active Power Control Interface with the Company's EMS are working properly. The Test is generally conducted by setting different active power setpoints and limits and observing the proper dispatch at the appropriate ramp rate limiting of the Facility's real power output.
 - B. Control Test for Voltage Regulation to verify the Facility can properly perform automatic voltage regulation as defined in this Exhibit F-7 and pursuant to Attachment F and the Contract. Test is generally conducted by making small adjustments of the voltage setpoint and verifying by observation that the Facility regulates the voltage at the point of regulation to the setpoint by delivering/receiving reactive power to/from the Company System to maintain the applicable setpoint according to the reactive power control and the reactive amount requirements of ~~Sections 3(a) (Reactive Power Control) and Section 3(b) (Reactive Power Characteristics (Performance Standards))~~ of Attachment F (Facility Owned by Subscriber Organization) to the Contract. [**Note: Sub transmission Requirements**]
 - C. Frequency Response Test to verify the Facility provides a frequency droop response as defined in the Contract. Test is generally conducted by adjusting of the frequency reference setting and verifying by observation that the Facility responds per droop and deadband settings, and appropriately modifies the Company issued Dispatch Setpoint. If different modes of frequency response are provided, each mode is tested (i.e.; isochronous, fast frequency response, active power droop response).
 - D. Loss-of-Communication Test to verify the Facility will properly shutdown upon the failure of the direct-transfer-communication system. Test is generally conducted by simulating a communications failure and observing the proper shutdown of the Facility. [If DTT required for the Project]
 - E. Round trip efficiency test, as described in Attachment H (BESS Requirements) Section 1. (BESS Tests) to verify that the round-trip efficiency of the BESS is not less than [] percent ([]%). [**DRAFTING NOTE: The round-trip efficiency percentage will be taken from Subscriber Organization's response to the RFP.**]
 - F. BESS Capacity Test to verify the BESS Capacity Ratio.
 1. Monitoring Test:
 - a. The monitoring test requires the Facility to operate as it would in normal operations.
 - b. To ensure useful and valid test data is collected for variable facilities, the monitoring test shall end when one of the following criteria is met:
 - i. For variable energy resources, Facility's gross power production is greater than 85% of its Allowed Capacity, for at least four (4) hours in any continuous 24-hour CSAT period.
~~ii. For solar facilities, the recorded renewable energy resource at the Facility is above 600 W/m² for least eight (8) hours in any continuous 48-hour CSAT period.~~
 - ~~iii.~~ ii. For wind facilities, the recorded wind speed is sufficient for turbines to operate for at least 8 hours in any continuous 48-hour CSAT period
14 continuous Days from the start of the CSAT.
 - c. At the end of the test, an evaluation period is selected based on the criteria that triggered the end of the test.
 - G. The performance of the Facility during the period of the successfully completed monitoring test is evaluated for, e.g., voltage regulation, frequency response, dispatch control, operating limits and ramp rate performance, to verify the performance meets the requirements of this Exhibit F-7. according to the criteria set forth in the testing procedures. Certain requirements, such as disturbance ride-through requirements, cannot be adequately tested without actual grid disturbances. These requirements will be confirmed following a grid event based on operational data, which may be after the completion of the Control System Acceptance Test. The Parties understand and agree that a successful completion of the test does not constitute a waiver of any of the performance standards of Subscriber Organization, all of which are hereby reserved, and shall not alleviate Subscriber Organization from any of its obligations under the Contract, in particular, as required in Section 5.

(Company Dispatch) and the Performance Standards in Section 3. (Performance Standards) of Attachment F (Facility Owned by Subscriber Organization).

---END---

|

=

EXHIBIT F-8
ACCEPTANCE TEST GENERAL CRITERIA

**[THIS ATTACHMENT WILL NEED TO BE MODIFIED
BASED ON THE RESULTS OF THE IRS]**

Upon final completion of Company review of the Facility's drawings, final test criteria and procedures shall be agreed upon by Company and Subscriber Organization no later than thirty (30) Days prior to conducting the Acceptance Test in accordance with the Contract. The Acceptance Test shall include, but not be limited to, the following:

1. Interconnection.
 - (A) A visual inspection of all Interconnection equipment and verification of as-built drawings.
 - (B) Phase rotation testing to verify proper phase connections.
 - (C) Based on manufacturer's specification, test the local operation of the Facility's generator breaker(s) and inter-tie breaker(s), and other breaker(s) which connect the Facility equipment to Company System – must open and close locally using the local controls remotely from Company's EMS. Test and ensure that the status shown on the EMS is the same as the actual physical status in the field.
 - (D) Relay test engineers to connect equipment and simulate certain inputs to test and ensure that the protection schemes such as any under/over frequency and under/over voltage protection or the Direct Transfer Trip operate as designed. (For example, a fault condition may be simulated to confirm that the breaker opens to sufficiently clear the fault. Additional scenarios may be tested and would be outlined in the final test criteria and procedures.) Subscriber Organization to also test the synchronizing mechanisms to which the Facility would be synchronizing and closing into the Company System to ensure correct operation. Other relaying also to be tested as specified in the protection review of the IRS and on the single line diagram, Attachment E (Single-Line Drawing and Interface Block Diagram) for the Facility.
 - (E) All breaker disconnects and other high voltage switches will be inspected to ensure they are properly aligned and operated manually or automatically (if designed).
 - (F) Step-Up Transformer Enclosure(s) inspections – The Step-Up Transformer Enclosure(s) may be inspected to test and ensure that the equipment that Subscriber Organization has installed is installed and operating correctly based upon agreed to design. Wiring may be field verified on a sample basis against the wiring diagrams to ensure that the installed equipment is wired properly. The grounding mat at the Step-Up Transformer Enclosure(s) may be tested to make sure there is adequate grounding of equipment.
 - (G) Communication testing – Communication System testing to occur to ensure correct operation. Detailed scope of testing will be agreed by Company and Subscriber Organization to reflect installed systems and communication paths that tie the Facility to Company's communications system.

- (H) Various contingency scenarios to be tested to ensure adequate operation, including testing contingencies such as loss of communications, and fault simulations to ensure that the Facility's breakers, if any, open as they are designed to open. (Back up relay testing)
- (I) Metering section inspection; verification of metering PTs, CTs, and cabinet and the installation of the two Company meters.

2. Telephone Communication.

- (A) Test to confirm Company has a direct line to the Facility control room at all times and that it is programmed correctly.
- (B) Test to confirm that the Facility operators can sufficiently reach Company System Operator.
- (C) Verification of dial-up telephone connection for metering cabinet.

3. Drawings, Documentation and Equipment Warranties.

The items below are required components of the Acceptance Test and must be satisfied for successful completion of this Test.

- (A) Electronic and three (3) hard copies of all Switchyard construction drawings, specifications, calibrations, and settings including as-built drawings.
- (B) Equipment operating and maintenance manuals, spare parts lists, commissioning notes, as-built equipment settings, and other information related to the switchyard equipment.
- (C) Contractor construction warranties and equipment warranties.
- (D) Phase rotation testing to verify proper phase connections.
- (E) Switching Station inspections – The Switching Station may be inspected to test and ensure that the equipment that Subscriber Organization has installed is installed and operating correctly based upon agreed-to design. Wiring may be field verified on a sample basis against the wiring diagrams to ensure that the installed equipment is wired properly. The grounding mat at the Switching Station may be tested to make sure there is adequate grounding of equipment.
- (F) If agreed by the Parties in writing, some requirements may be postponed to the Control Systems Acceptance Test.

ATTACHMENT G

COMPANY-OWNED INTERCONNECTION FACILITIES

(To be filled out by Company)

1. DESCRIPTION OF COMPANY-OWNED INTERCONNECTION FACILITIES.

- (a) General. Company will, furnish or construct, own, operate and maintain all interconnection facilities required to interconnect the Company's system with the CBRE Facility at ___volts, up to the point of interconnection.
- (b) Site. Company will, furnish or construct, own, operate and maintain all interconnection facilities required to interconnect the Company's system with the CBRE Facility at ___volts, up to the point of interconnection.
- (c) IRS. If an IRS addressing Facility requirements was or will be completed for the Project in accordance with the IRS Letter Agreements, the results have been or will be incorporated in Attachment F (Facility Owned by Subscriber Organization) and this Attachment G (Company-Owned Interconnection Facilities) as appropriate(d) The Company-Owned Interconnection Facilities, for which the Subscriber Organization agrees to pay, include: **[Need to specify the interconnection facilities. If no interconnection facilities, state "None". DRAFTING NOTE: For LMI RFP Company will pay for all Company-Owned Interconnection Facilities and "NONE" will be inserted here in place of the below.]**
- (d) Responsibility of Subscriber Organization and Company. The general responsibilities of Subscriber Organization and Company for the design, procurement, installation, programming/testing, and maintenance/ownership of equipment at the Facility and the Company Owned Interconnection Facilities is specified in Matrix G-1 (Substation Responsibilities) and Matrix G-2 (Telecom Responsibilities). **[DRAFTING NOTE: MATRIXES WILL BE UPDATED FOLLOWING COMPLETION OF IRS.]**

2. CONSTRUCTION AND SUPPORT SERVICES BY SUBSCRIBER ORGANIZATION.

- (a) Construction and Support Services by Subscriber Organization.
 - (i) Subscriber Organization (and/or its third party consultants or contractors (collectively, "Contractors")) will design, engineer, construct, test and place in service, at Subscriber Organization's expense. The items identified in Matrix G-1 (Substation Responsibilities) and Matrix G-2 (Telecom Responsibilities) as being the responsibility of Subscriber Organization to construct; and

All design, engineering and construction performed by Subscriber Organization (and/or its Contractors) shall, without limitation, satisfy the wind load and seismic load requirements of the International Building Code and any more stringent requirements imposed under applicable Laws.
 - (ii) Subscriber Organization shall provide the necessary support for the Company's kV overhead line extension work, which may include, but not limited to:

- A. Furnish surveyed topographical drawing including contour lines of project areas and beyond as needed in State Plane coordinates with overlay of the Facility and Company pole line route(s) indicating pole locations and anchors in CADD format acceptable to Company.
 - B. Staking of Company proposed poles and anchors by surveyor.
 - C. Graded access roads including gravel if required by Company to provide sufficient vehicle access to Company poles and anchors by Company trucks and cranes.
 - D. Graded level pads to provide vehicle working areas around all Company poles and anchors.
 - E. Grading of the areas beneath the Company's overhead lines as needed to provide required ground clearance.
 - F. Grubbing and clearing of vegetation within Company's easement area or as required.
- (b) Coordination of Construction. Prior to Subscriber Organization engaging the Contractors, Subscriber Organization shall obtain Company's written approval, which approval shall not be unreasonably withheld. Prior to Subscriber Organization and/or its Contractors first starting to work on the construction plans for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization (and/or its Contractors), such as the civil, structural, and construction drawings, specifications to vendors, vendor approved final drawings and materials lists (collectively, the "Plans"), Subscriber Organization and/or its Contractors shall meet with Company to discuss the construction of such Company-Owned Interconnection Facilities, including but not limited to subjects concerning coordination of construction milestone dates, agreement on areas of interface design, and Company's design/drawing layout and symbols standards, equipment specifications and construction specifications and standards. Company will provide the equipment specifications and construction specifications and standards information so Subscriber Organization can incorporate such information in its bid documents.
- (c) Plans. Subscriber Organization shall provide Company its complete Plans at 30%, 60% and 90% completion. No later than sixty (60) Days before Subscriber Organization and/or its Contractors first start to order materials and equipment for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization and/or its Contractors, Subscriber Organization shall provide Company with the final Plans. The Plans for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization (and/or its Contractors) shall comply with (i) all applicable Laws; (ii) Company's design/drawing layout and symbol standards, equipment specifications, and construction specifications and standards; and (iii) Good Engineering and Operating Practices (collectively, the "Standards"). Subscriber Organization shall submit design drawings in MicroStation format per Company standards.
- (d) Company's Review of the Plans. Unless otherwise agreed to by the Parties, Company shall have thirty (30) Days following receipt of the complete Plans at each stage (30%, 60%, 90% and final) for it to review and comment on the Plans, and verify in writing to Subscriber Organization that the Plans comply with the Standards, which verification shall not be unreasonably withheld. If Company reasonably determines that the Plans are not in accordance with the Standards, then it may request in writing a response from Subscriber Organization to its comments and Subscriber Organization shall respond in writing within thirty (30) Days of such request by providing (i) its justification for why its Plans conform to the Standards or (ii) changes in the Plans responsive to Company's comments and in accordance with the Standards.

- (e) Company Inspection. Construction work will be subject to Company inspections to ensure that construction is done in accordance with the Standards. Company inspectors will be allowed access to the construction sites for inspections and to monitor construction work. The inspector shall have the authority to work with the appropriate construction supervisor to stop any work that does not meet the Standards. All equipment and materials used in Company-Owned Interconnection Facilities to be constructed by Subscriber Organization and/or its Contractors shall meet the Standards.
- (f) Acceptance Test Procedures.
- (i) Subscriber Organization acknowledges that: (aa) Company has multiple on-going projects with other developers as well as its own capital improvement projects; (bb) Company has limited resources to provide engineering oversight (such as review of plans) to such projects and to participate in the testing of such projects; (cc) in order for Company to accommodate such oversight and testing, it is necessary for Company to sequentially allocate its resources for each project a year or more in advance; (dd) the result is a queue of such projects that reflects the scheduling commitments of Company's resources to conduct such oversight and to participate in such testing; (ee) if a project is behind the schedule on which Company's resources have been scheduled for the oversight of such project, or if a project is not ready for testing at the time Company's resources have been scheduled for the testing of such project, or if a project does not complete testing within the period for which Company's resources have been scheduled for such testing, the progress of projects later in the queue may be adversely affected; and (ff) the Project will lose its place in the queue and will be assigned a new Acceptance Testing date for commencement of the Acceptance Test that will be behind the other projects then in the queue if (i) the Subscriber Organization fails to satisfy any of the conditions precedent set forth in Section 2(f)(ii) of this Attachment G (Company-Owned Interconnection Facilities) within the time period specified therein for the task in question, (ii) the Acceptance Test are not satisfactorily completed within the time allotted to complete such testing.
- (ii) The Conduct of the Acceptance Test is subject to the satisfaction of the following conditions precedent within the time period required by Company for the task in question:
- Final Single-Line Drawing, and notes, has received Company's written consent pursuant to Section 1(a)(i) (Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 - Final Relay List and Trip Scheme have received Company's written consent pursuant to Section 1(a)(i) (Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 - Final Interface Block Diagram has received Company consent pursuant to Section 1(a)(i) (Single-Line Drawing, Interface Block Diagram, Relay List, Relay Settings and Trip Scheme) of Attachment F (Facility Owned by Subscriber Organization) to this Contract.
 - Final Control System Telemetry and Control List has received Company consent.
 - Final phasor measurement unit (PMU) devices, if applicable, have received Company consent.
 - Control system design and tunable parameters reviewed and mutually agreed upon as needed to meet the Company requirements in accordance with Attachment F (Facility Owned by Subscriber Organization) Performance Standards.
 - Agreement on Active Power Control Interface.

- No later than 14 Days prior to commencement of the Acceptance Test:
 - Subscriber Organization shall have certified to Company that Subscriber Organization-Owned Interconnection Facilities have been installed and commissioned and such certification has not, prior to the commencement of the Acceptance Test, been subsequently challenged by Company on the basis of on-site observations made by the Company's representatives following the walk-through to be conducted pursuant to Section 2(f)(iii) of this Attachment G (Company-Owned Interconnection Facilities).
 - Subscriber Organization shall have certified to Company that any Company-Owned Interconnection Facilities built by Subscriber Organization (and/or its Contractors) have been installed and commissioned and such certification has not, prior to the commencement of the Acceptance Test, been subsequently challenged by Company on the basis of on-site observations made by the Company's representatives following the walk-through to be conducted pursuant to Section 2(f)(iii) of this Attachment G (Company-Owned Interconnection Facilities).
 - Any Company-Owned Interconnection Facilities not built by or on behalf of Subscriber Organization have been installed and commissioned.
 - No later than 7 Days prior to the commencement of the Acceptance Test, Subscriber Organization and Company shall have participated in walk-through of fully constructed Interconnection Facilities.
 - Redlined as-built drawings of the Subscriber Organization-Owned Interconnection Facilities and any of the Company-Owned Interconnection Facilities built by Subscriber Organization (and/or its Contractors) shall have been provided to Company.
 - Continuous power is being supplied to Company's protection and SCADA equipment.
 - Not less than four (4) weeks prior to the commencement of the Acceptance Test, the high speed communication lines required under this Contract have been commissioned and are ready for use.
 - Not less than two (2) weeks prior to the commencement of the Acceptance Test, Subscriber Organization and Company have participated in an on-Site Acceptance Test coordination meeting.
- (iii) Subscriber Organization shall provide Company with at least fourteen (14) Days advance written notice of the commencement of the Acceptance Test. The Acceptance Test will be conducted on Business Days during normal business hours and may take a minimum of 30 Days to complete. No electric energy will be delivered from Subscriber Organization to Company during the Acceptance Test. No later than thirty (30) Days prior to conducting the Acceptance Test, Company and Subscriber Organization shall agree on a written protocol setting out the detailed procedure and criteria for passing the Acceptance Test. At the time that Subscriber Organization provides its 14-Day notice of the Acceptance Test to Company, Subscriber Organization shall concurrently schedule a site walk-through of the Facility with Company to occur no later than seven (7) Days prior to the Acceptance Test. Subscriber Organization's 14-Day notice to Company of the Acceptance Test shall constitute its certification that (i) the completion of the installation and commissioning of the Subscriber Organization-Owned Interconnection Facilities and the Company-Owned Interconnection Facilities built by Subscriber Organization (and/or its Contractors) and (ii) a walk-through by Company shall demonstrate, to Company's reasonable satisfaction, Subscriber Organization's readiness to commence with the Acceptance Test. If, after the site walk-through, Company representatives reasonably determine that Subscriber Organization is not ready to commence with the Acceptance Test, the Project will lose its place in the queue and will be assigned a new Acceptance Testing date that will be behind the other projects then in the queue. In the

meantime, Subscriber Organization shall remediate the deficiencies identified by Company, and the process described in this Section 2(f) (Acceptance Test Procedures) of this Attachment G (Company-Owned Interconnection Facilities), shall commence again until Subscriber Organization's readiness for the Acceptance Test is demonstrated to Company's reasonable satisfaction. Successful completion of the Acceptance Test requires successful completion of each of the individual tests that comprise the Acceptance Test. Retesting of any individual test constitutes as restart of the Acceptance Test if such retesting is required because of a prior failure of such individual test or because of a prior test could not be completed because of a problem with the Facility. Within fifteen (15) Business Days of completion of the Acceptance Test and Company's receipt of the final report setting forth the results of the Acceptance Test, Company shall notify Subscriber Organization in writing whether the Acceptance Test has been passed and, if so, the date upon which the Acceptance Test was passed.

- (iv) Company will be present when the Acceptance Test is conducted, and Subscriber Organization shall promptly correct any deficiencies identified during the Acceptance Test. Subscriber Organization will be responsible for the cost of Company personnel (and/or Company contractors) performing the duties (such as reviewing the Plans and reviewing the construction) necessary for Company-Owned Interconnection Facilities to be constructed by Subscriber Organization (and/or its Contractors). If Company (i) does not make any inspection or test, (ii) does not discover defective workmanship, materials or equipment, or (iii) accepts Company-Owned Interconnection Facilities (that were constructed by Subscriber Organization and or its Contractors), such action or inaction shall not relieve Subscriber Organization from its obligation to do and complete the work in accordance with the Plans approved by Company.
- (g) As-Built Drawings. Within thirty (30) Days of the successful completion of the Acceptance Test, Subscriber Organization shall provide for Company review a set of the proposed as-built drawings for the Company-Owned Interconnection Facilities constructed by Subscriber Organization (and/or its Contractors). Within thirty (30) Days of Company's receipt of the proposed as-built drawings, Company shall provide Subscriber Organization with either (i) its comments on the proposed as-built drawings or (ii) notice of acceptance of the proposed as-built drawings as final as-built drawings. If Company provides comments on the proposed as-built drawings, Subscriber Organization shall incorporate such comments into a final set of as-built drawings and provide such final as-built drawings to Company within twenty (20) Days of Subscriber Organization's receipt of Company's comments

3. **SUBSCRIBER ORGANIZATION PAYMENT TO COMPANY FOR COMPANY-OWNED INTERCONNECTION FACILITIES, REVIEW OF GENERATING FACILITY, AND REVIEW OF VERIFICATION TESTING.**

- (a) The Subscriber Organization shall pay to the Company the total estimated interconnection costs to be incurred by the Company (Total Estimated Interconnection Costs), which is comprised of (i) the estimated cost of the Company-Owned Interconnection Facilities, (ii) the estimated engineering costs associated with a) developing the Company-Owned Interconnection Facilities and b) reviewing and specifying those portions of the CBRE Facility which allow interconnected operation, and (iii) witnessing and reviewing the verification testing, which shall include testing of the telemetry and control interface which allows the Company to remotely measure, monitor, evaluate and verify technical compliance, CBRE Facility performance, and power quality and, if necessary, control the Generating Facility. The following summarizes the Total Estimated Interconnection Costs:

Description	Estimated Cost (\$) [If no cost, state "None".]
Total Estimated Interconnection Costs (\$):	

- (b) The Total Estimated Interconnection Cost, which, except as otherwise provided herein, is non-refundable, shall be paid by the Subscriber Organization fourteen (14) days after receipt of an invoice from the Company, which shall be provided not less than thirty (30) days prior to start of procurement of the Company-Owned Interconnection Facilities.
- (c) Within thirty (30) days of receipt of an invoice, which shall be provided within fourteen (14) days of the final accounting, which shall take place within sixty (60) days of completion of construction of the Company-Owned Interconnection Facilities, the Subscriber Organization shall remit to the Company the difference between the Total Estimated Interconnection Costs paid to date and the total actual interconnection costs (Total Actual Interconnection Costs). The latter is comprised of (i) the total costs of the Company-Owned Interconnection Facilities, and (ii) the total engineering costs associated with (a) developing the Company-Owned Interconnection Facilities and (b) reviewing and specifying those portions of the Generating Facility which allow interconnected operations as such are described in Exhibit F-1, and (iii) reviewing the verification testing. If in fact the Total Actual Interconnection Costs is less than the payments received by the Company as the Total Estimated Interconnection Cost, the Company shall repay the difference to the Subscriber Organization within thirty (30) days of the final accounting. If the Contract is terminated prior to the Subscriber Organization's payment for the Total Actual Interconnection Costs (or the portion of this cost which has been incurred) or prior to the Company's repayment of the over collected amount of the Total Estimated Interconnection Costs (or the portion of this cost which has been paid), such payments shall be made by the Subscriber Organization or Company, as appropriate. If payment is due to the Company, the Subscriber Organization shall pay within thirty (30) days of receipt of an invoice, which shall be provided within fourteen (14) days of the final accounting, which shall take place within sixty (60) days of the date the Contract is terminated. If payment is due to the Subscriber Organization, the Company shall pay within thirty (30) days of the final accounting.
- (d) All Company-Owned Interconnection Facilities shall be the property of the Company.

4. OPERATION, MAINTENANCE AND TESTING COSTS

The Company will bill the Subscriber Organization monthly and the Subscriber Organization will, within 30 days after the billing date, reimburse the Company for any costs incurred in operating, maintaining or testing the Company-Owned Interconnection Facilities. The Company's costs will be determined on the basis of outside

service costs, direct labor costs, material costs, transportation costs, applicable overheads at time incurred and applicable taxes. Applicable overheads will include such costs as vacation, payroll taxes, non-productive wages, supervision, tools expense, employee benefits, engineering administration, corporate administration, and materials handling. Applicable taxes will include the Public Service Company Tax, and Public Utility Fee and Hawai'i general excise tax

5. RELOCATION OF COMPANY-OWNED INTERCONNECTION FACILITIES.

- (a) In the event that the Land Rights include a relocation clause and such clause is exercised or if Company-Owned Interconnection Facilities must be relocated for any other reason not caused by Company, Subscriber Organization shall bear the cost of such relocation. Prior to the relocation of the Company-Owned Interconnection Facilities Company shall invoice Subscriber Organization for the total estimated cost of relocating the Company-Owned Interconnection Facilities (the "Total Estimated Relocation Cost"). Subscriber Organization shall, within thirty (30) Days after the invoice date, pay to Company the Total Estimated Relocation Cost.
- (b) Once the relocation of the Company-Owned Interconnection Facilities is complete, Company shall conduct a final accounting of all costs related thereto. Within thirty (30) Days of the final accounting, which shall take place within one hundred and twenty (120) Days of completion of the relocation of Company-Owned Interconnection Facilities, Subscriber Organization shall remit to Company the difference between the Estimated Relocation Cost paid to date and the total actual relocation cost incurred by Company (the "Total Actual Relocation Cost"). If the Total Actual Relocation Cost is less than the payments received by Company as the Total Estimated Relocation Cost, Company shall repay the difference to Subscriber Organization within thirty (30) Days of the final accounting.

6. LAND RESTORATION.

- (a) Definition of "Land". For the purposes of this Attachment G (Company-Owned Interconnection Facilities), "Land" means any portion of the Site and any other real property where any Company-Owned Interconnection Facilities are located.
- (b) Removal of Interconnection Facilities. After termination of this Contract, if requested by Company, Subscriber Organization shall, at its sole cost and expense, remove (i) the Company-Owned Interconnection Facilities from the Land and (ii) the Subscriber Organization-Owned Interconnection Facilities from the Land, and, in conjunction with such removal, shall develop and implement a program to recycle, to the fullest extent possible, or to otherwise properly dispose of, all such removed infrastructure; provided, however, that, Company may elect to remove all or part of the Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities from the Land because of operational concerns over the removal of such Interconnection Facilities, in which case Subscriber Organization shall reimburse Company for its costs to remove such Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities. To the extent Subscriber Organization is obligated to remove Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities, Subscriber Organization shall complete such removal within ninety (90) Days of termination of this Contract, or as otherwise agreed to by both Parties in writing.
- (c) Restoration of the Land. After the termination of this Contract and removal of the Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities, as the case may be, Subscriber Organization shall, at its sole cost and expense, restore the Land to its condition prior to construction of such Company-Owned Interconnection Facilities and/or Subscriber Organization-Owned Interconnection Facilities, as applicable. Land restoration shall be completed within ninety (90) Days of termination of this Contract, or as otherwise agreed to by both Parties in writing.

7. **TRANSFER OF OWNERSHIP/TITLE.**

- (a) **Transfer of Ownership and Title.** On the Transfer Date, Subscriber Organization shall transfer to Company all right, title and interest in and to Company-Owned Interconnection Facilities to the extent such facilities were designed and constructed by Subscriber Organization and/or its Contractors together with (i) all applicable manufacturers' or Contractors' warranties which are assignable and (ii) all Land Rights necessary to own, operate and maintain Company-Owned Interconnection Facilities on and after the Transfer Date. Subscriber Organization shall provide a written list of the manufacturers' and Contractors' warranties which will be assigned to Company and the expiration dates of such warranties no later than thirty (30) Days before the Transfer Date.
- (b) **No Liens or Encumbrances.** Company's title to and ownership of Company-Owned Interconnection Facilities that were designed and constructed by Subscriber Organization and/or its Contractors shall be free and clear of liens and encumbrances.
- (c) **Form of Documents.** The transfers to be made to Company shall not require any further payment by Company. The form of the document to be used to convey title to the Company-Owned Interconnection Facilities that were designed and constructed by or on behalf of Subscriber Organization shall be in the form set forth by Company. The form of the document(s) to be used to assign leases shall be substantially in the form set forth by Company.

8. **GOVERNMENTAL APPROVALS FOR ANY COMPANY-OWNED INTERCONNECTION FACILITIES.**

For all other Governmental Approvals for Company-Owned Interconnection Facilities, Subscriber Organization shall provide these prior to the Transfer Date. On or before the Transfer Date, Subscriber Organization shall provide Company with (i) copies of all such Governmental Approvals obtained by Subscriber Organization regarding the construction, ownership, operation and maintenance of Company-Owned Interconnection Facilities that Subscriber Organization and/or its Contractors constructed and (ii) documentation regarding the satisfaction of any condition or requirement set forth in any Governmental Approvals for Company-Owned Interconnection Facilities (excluding ongoing reporting or monitoring requirements that may continue beyond the Transfer Date in accordance with such Governmental Approval) or that such Governmental Approvals have otherwise been closed with the issuing Governmental Authority.

9. **LAND RIGHTS.**

Subscriber Organization shall, prior to the commencement of construction of the Company-Owned Interconnection Facilities (whether to be built by Subscriber Organization or by Company) obtain at its sole cost and expense all Land Rights that are required to construct, own, operate and maintain the Company-Owned Interconnection Facilities. Without limitation to the preceding sentence, Subscriber Organization shall pay all surveying and mapping costs, appraisal fees, document preparation fees, recording fees or other costs. Subscriber Organization shall use commercially reasonable efforts to obtain on behalf of the Company perpetual Land Rights for the Company-Owned Interconnection Facilities. Such Land Rights shall contain terms and conditions which are acceptable to Company and the documents setting forth the Land Rights shall be provided in advance of execution to Company for its review and approval and shall be recorded if required by Company. Following the Execution Date, Subscriber Organization shall provide as part of the Monthly Progress Report the status of negotiations with landowner(s) regarding the Land Rights. Notwithstanding the foregoing, Company shall have the right in its sole discretion, at any time upon notice to Subscriber Organization, to communicate directly with the landowner(s) and/or participate in the negotiations with landowner(s) for the Land Rights. For so long as Subscriber Organization has the right under this Contract to sell the

availability of the Facility to Company, Subscriber Organization shall pay for any rents and other payments due under such Land Rights that are associated with Company-Owned Interconnection Facilities.

10. **CONTRACTS FOR COMPANY-OWNED INTERCONNECTION FACILITIES.**

For all contracts entered into by or on behalf of Subscriber Organization for Company-Owned Interconnection Facilities to be designed, engineered and constructed, in whole or in part, by or on behalf of Subscriber Organization, the following shall apply: (i) Company shall be made an intended third-party beneficiary of such contracts; and (ii) Company shall be provided with copies of such executed contracts, which may be redacted but only to the extent required to prevent disclosure of confidential or proprietary information of Subscriber Organization or the counterparty to such agreement; provided, however, that such redactions may not conceal information that is necessary for the Company to determine and exercise Company's rights under such contracts as a third-party beneficiary.

[MATRIX TO BE INSERTED]

EXHIBIT G-1

FORM OF LETTER OF CREDIT

Page 1 of 2

[Bank Letterhead]

[Date]

Beneficiary: [designate appropriate entity according to where Facility is located] **Maui Electric Company, Limited**
[or] **Hawai'i Electric Light Company, Inc.**

[Address]

[Bank's Name]

[Bank's Address]

Re: [Irrevocable Standby Letter of Credit Number]

Ladies and Gentlemen:

We hereby establish, in your favor, our irrevocable standby Letter of Credit Number _____ (this "Letter of Credit") for the account of [Applicant's Name] and [Applicant's Address] in the initial amount of \$ _____ [dollar value] and authorize you, Maui Electric Company, Limited [or] Hawai'i Electric Light Company, Inc. ("Beneficiary"), to draw at sight on [Bank's Name].

Subject to the terms and conditions hereof, this Letter of Credit secures [Project Entity Name]'s certain obligations to Beneficiary under the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____ between [Project Entity Name] and Beneficiary.

This Letter of Credit is issued with respect to the following obligations: _____.

This Letter of Credit may be drawn upon under the terms and conditions set forth herein, including any documentation that must be delivered with any drawing request.

Partial draws of this Letter of Credit are permitted. This Letter of Credit is not transferable. Drafts on us at sight shall be accompanied by a Beneficiary's signed statement signed by a representative of Beneficiary as follows:

The undersigned hereby certifies that (i) I am duly authorized to execute this document on behalf of Maui Electric Company, Limited [or] Hawai'i Electric Light Company, Inc. and [(ii) the amount of the draft accompanying this certification is due and owing to Maui Electric Company, Limited [or] Hawai'i Electric Light Company, Inc. under the terms of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation dated as of _____, between _____, and Maui Electric Company, Limited [or] Hawai'i Electric Light Company, Inc.][(ii) the Letter of Credit will expire in less than thirty (30) days, it has not been replaced or extended and collateral is still required under Section 11.G. 1 of the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation *].

Such drafts must bear the clause "Drawn under [Bank's Name and Letter of Credit Number _____ and date of Letter of Credit.]"

All demands for payment shall be made by presentation of originals or copies of documents, by facsimile transmission of documents to [Bank Fax Number] or other such number as specified from time to time by the bank, or by email

* For draw relating to lapse of Letter of Credit while credit support is still required pursuant to the Mid-Tier Standard Form Contract for Renewable Dispatchable Generation.

transmission of documents to **[Bank Email Address]** or other such email address as specified from time to time by the bank. If presentation is made by facsimile transmission or an email transmission, you may contact us at **[Bank Phone Number]** to confirm our receipt of the transmission. Your failure to seek such a telephone confirmation does not affect our obligation to honor such a presentation. If presented by facsimile or email, original documents are not required.

This letter of credit shall expire one year from the date hereof. Notwithstanding the foregoing, however, this letter of credit shall be automatically extended (without amendment of any other term and without the need for any action on the part of the undersigned or Beneficiary) for one year from the initial expiration date and each future expiration date unless we notify you and Applicant in writing at least thirty (30) days prior to any such expiration date that this letter of credit will not be so extended. Any such notice shall be delivered by registered or certified mail, or by FedEx, both to:

Beneficiary at:

and to

And copy to Applicant at:

We hereby agree with drawers that drafts and documents as specified above will be duly honored upon presentation to **[Bank's Name]** and **[Bank's Address]** if presented on or before the then-current expiration date hereof.

Payment of any amount under this Letter of Credit by **[Bank]** shall be made as the Beneficiary shall instruct on the next Business Day after the date the **[Bank]** receives all documentation required hereunder, in immediately available funds on such date. As used in this Letter of Credit, the term "Business Day" shall mean any day other than a Saturday or Sunday or any other day on which banks in the State of **[Note – insert State of bank's location]** are authorized or required by law to be closed.

Unless otherwise expressly stated herein, this irrevocable standby letter of credit is issued subject to the rules of the International Standby Practices, International Chamber of Commerce publication no. 590 ("ISP98")

[Bank's Name]:

By: _____

[Authorized Signature]

ATTACHMENT H
BESS REQUIREMENTS

SECTION 1 - BESS TESTS

Prior to achieving Commercial Operations, and in each BESS Measurement Period, unless waived by Company, Subscriber Organization shall demonstrate that the BESS satisfies the (1) BESS Capacity Performance Metric, and (2) the RTE Performance Metric, each as defined and further described below.

A. BESS Capacity Performance Metric.

- The BESS Capacity Performance Metric reflecting the net output of the BESS from the Point of Interconnection can be demonstrated either through (i) operational data or (ii) a scheduled formal BESS Capacity Test.
- The "BESS Capacity Performance Metric" shall be deemed to be satisfied where the BESS Capacity Ratio is not less than 100% for an applicable BESS Measurement Period. The "BESS Capacity Ratio" shall be the number, expressed as a percentage, equal to the total "Discharge Energy" (MWh discharge) delivered to the Point of Interconnection to bring the BESS from (i) its maximum State of Charge or (ii) 100% State of Charge to a 0% State of Charge, divided by the BESS Contract Capacity.
- A "BESS Capacity Test" is when the Company coordinates Company Dispatch to demonstrate the BESS maintains the power output required to follow the dispatch signal provided by the Company through a control set point, as measured at the Point of Interconnection, and is able to continuously discharge energy to the Point of Interconnection according to Company Dispatch to bring the BESS from (i) its maximum State of Charge or (ii) 100% State of Charge to a 0% State of Charge.
- The BESS Capacity Test can only be performed when the BESS is at the lower of: (i) its maximum State of Charge or (ii) 100% State of Charge prior to the start of the BESS Capacity Test and during the BESS Capacity Test the Company Dispatch allows for continuous discharge of the BESS to 0% State of Charge with energy delivered to the Point of Interconnection.

B. RTE Performance Metric.

- The "RTE Performance Metric" is set forth in Section 7 (a) (RTE Test and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract. The RTE Performance Metric reflecting the charging/discharging of the BESS can be demonstrated either through (i) operational data or (ii) a scheduled formal RTE Test.
- Demonstration of the RTE Performance Metric requires measurement of "Charging Energy" (MWh charge) at the BESS inverters' AC input to bring the BESS from a 0% State of Charge to a 100% State of Charge from the WTG(s) (or grid, [if grid charging is permitted](#)) according to Company Dispatch, followed by measurement at the Point of Interconnection of the "Discharge Energy" (MWh discharge) delivered to the grid to bring the BESS to a 0% State of Charge according to Company Dispatch. The exact equipment and point used for measurement of Charging Energy will be mutually agreed to by the Parties on the Facility's single-line diagram attached as Exhibit F-5 (Single-Line Drawing and Interface Block Diagram) to Attachment F (Facility Owned by Subscriber Organization) to this Contract. For the purposes of evaluating satisfaction of the RTE Performance Metric, the "RTE Ratio" shall be the number, expressed as a percentage, equal to the total

Discharge Energy delivered to the Point of Interconnection during the BESS Capacity Test, divided by the Charging Energy measured at the BESS inverters' AC input.

- The formula for the RTE Ratio is as follows: $\text{RTE Ratio} = 100\% \times (\text{MWh discharge})/(\text{MWh charge})$
- The RTE Performance Metric will be deemed to have been "passed" or "satisfied" to the extent the RTE Ratio is not less than the RTE Performance Metric set forth in Section 7 (a) (RTE Test and Liquidated Damages) of Attachment C (Required Performance Metrics; Liquidated Damages) to this Contract.
- An "RTE Test" is when the Company coordinates Company Dispatch to demonstrate the charging/discharging requisite to satisfy the RTE Performance Metric.
- The RTE Test may be conducted concurrently with a BESS Capacity Test.
- For purposes of the RTE Test, the charging cycle shall begin when the BESS is at a 0% State of Charge prior to a (i) 100% discharge cycle or (ii) BESS Capacity Test if being conducted concurrently and the Charging Energy is the amount of energy, as measured at the BESS inverters' AC input, that brings the BESS to a 100% State of Charge.

C. BESS Test Procedures.

- After Commercial Operations, Subscriber Organization shall demonstrate satisfaction of the BESS Capacity Performance Metric by reference to the operational data reflecting the net output of the BESS from the Point of Interconnection, or by conducting a scheduled formal BESS Capacity Test during such BESS Measurement Period. Once Subscriber Organization demonstrates satisfaction of the BESS Capacity Performance Metric through either operational data or a scheduled formal BESS Capacity Test (100% discharge cycle), the BESS shall be deemed to have met the BESS Capacity Performance Metric and satisfied ("passed") the BESS Capacity Test for the applicable BESS Measurement Period.
- After Commercial Operations, Subscriber Organization shall demonstrate satisfaction of the RTE Performance Metric by reference to the operational data reflecting the charging/discharging of the BESS, or by conducting a scheduled formal RTE Test during such BESS Measurement Period. Once Subscriber Organization demonstrates satisfaction of the RTE Performance Metric through either operational data or a scheduled formal RTE Test (100% charge/discharge cycle), the BESS shall be deemed to have met the RTE Performance Metric and satisfied ("passed") the RTE Test for the applicable BESS Measurement Period.
- Any BESS Capacity Test or RTE Test (each a "BESS Test" and collectively, the "BESS Tests") scheduled in lieu of being demonstrated by reference to operational data shall be performed at a time scheduled by the Company in its sole discretion.
- Subscriber Organization shall be permitted up to a total of three (3) BESS Tests (100% discharge cycles) within a BESS Measurement Period to demonstrate satisfaction of the BESS Capacity Performance Metric and RTE Performance Metric for such BESS Measurement Period, unless additional such tests are authorized by Company. If upon completion of the first BESS Test, Subscriber Organization does not "pass" either the BESS Capacity Test or the RTE Test, Company shall attempt to notice up to two (2) additional BESS Tests within a BESS Measurement Period, for Subscriber Organization to further demonstrate its performance. If a scheduled formal BESS Test is requested by Subscriber Organization, Company shall attempt to schedule a formal BESS Test and Company shall provide notice to Subscriber Organization no less than three (3) Business Days prior to conducting such scheduled formal BESS Test.

- If, during a BESS Measurement Period, Subscriber Organization fails to pass a BESS Capacity Test, the BESS shall nevertheless be deemed to have satisfied the BESS Capacity Performance Metric for the applicable BESS Measurement Period if (i) Company failed to notice up to three BESS Capacity Tests in order for Subscriber Organization to further demonstrate the BESS' performance during such BESS Measurement Period, or (ii) Subscriber Organization was unable to perform at least two (2) such noticed BESS Capacity Tests during such BESS Measurement Period due to (a) conditions on the Company System other than Subscriber Organization-Attributable Non-Generation or (b) an act or omission by Company. If Subscriber Organization-Attributable Non-Generation is cause for the inability to demonstrate the BESS Capacity Performance Metric, the BESS Capacity Ratio used to assess LDs shall be the highest demonstrated in operational data or the most recently completed test during the applicable BESS Measurement Period.
- If, during a BESS Measurement Period, Subscriber Organization does not demonstrate satisfaction of the BESS Capacity Performance Metric through operational data or a BESS Capacity Test, assessment of Liquidated Damages will be based on the last of the BESS Capacity Tests performed.
- If, during a BESS Measurement Period, Subscriber Organization both fails to pass a RTE Test noticed by Company and fails to demonstrate satisfaction of the RTE Performance Metric by reference to operational data for such BESS Measurement Period, the BESS shall nevertheless be deemed to have satisfied the RTE Performance Metric for the applicable BESS Measurement Period if (i) Company failed to notice up to three RTE Tests in order for Subscriber Organization to further demonstrate the BESS' performance during such BESS Measurement Period, or (ii) Subscriber Organization was unable to perform at least two (2) such noticed RTE Tests during such BESS Measurement Period due to (a) conditions on the Company System other than Subscriber Organization-Attributable Non-Generation or (b) an act or omission by Company. If Subscriber Organization-Attributable Non-Generation is cause for not adequately demonstrating the RTE Performance Metric, the RTE Ratio used to assess LDs shall be the highest demonstrated in operational data or the most recently completed test during the applicable BESS Measurement Period.
- If, during a BESS Measurement Period, Subscriber Organization does not demonstrate satisfaction of the RTE Performance Metric through operational data or RTE Tests, assessment of Liquidated Damages will be based on the last of the RTE Tests performed.
- Company will conduct any necessary BESS Test(s) through Company Dispatch. Company shall have the right to attend, observe and receive the results of all BESS Tests. Subscriber Organization shall provide to Company the results of each BESS Test (including time stamped graphs of system performance based in operational data or test data) no later than ten (10) Business Days after any BESS Test.

SECTION 2 – BESS ANNUAL EQUIVALENT AVAILABILITY FACTOR

- A. To the extent the Commercial Operations Date occurs on a date other than the first day of a BESS Measurement Period, the period between the Commercial Operations Date and the first day of the next BESS Measurement Period if any, shall be ignored for purposes of this BESS Availability Factor.
- B. For the purposes of calculating the BESS Annual Equivalent Availability Factor for the first three (3) full BESS Measurement Periods in the first Contract Year, the calculation will assume that the BESS is one hundred percent (100%) available for the remaining hours of the Contract Year.
- C. “BESS Annual Equivalent Availability Factor” shall be calculated as follows:

$$\frac{\text{BESS Annual Equivalent Availability Factor}}{100} = \frac{AH - ED}{PH}$$

Where:

PH is period hours (8760 hours; except leap year is 8784)

Available Hours (AH) is the number of hours that the BESS is not on Outage. It is sum of all Service Hours (SH) + Reserve Shutdown Hours (RSH).

A "BESS Outage" exists whenever the entire BESS is offline and unable to charge or discharge electric energy and is not in Reserve Shutdown state.

Service Hours (SH) is the number of hours during the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Period that the BESS is online and (i) charging from the WTGs or the Company System, or (ii) discharging electric energy to the Company System.

Reserve Shutdown Hours (RSH) is the number of hours the BESS is available but not charging or discharging electric energy or is offline at the Company's request for reasons other than Subscriber Organization-Attributable Non-Generation.

A "BESS Derating" exists when the BESS is available but at less than Maximum Rated Output, including deratings due to Subscriber Organization-Attributable Non-Generation or those by Company pursuant to Section 5 (Company Rights of Dispatch) of the Contract. For the avoidance of doubt, if there is a BESS Outage occurring, there cannot also be a BESS Derating.

Equivalent Derated Hours (EDH) is the sum of ESADH, EPDH, and EUDH. For deratings due to BESS inverter unavailability, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the number of inverters in the BESS unavailable and dividing by the total number of inverters in the BESS. For deratings that do not impact the availability of an entire BESS inverter or set of entire BESS inverters, the equivalent full outage hour(s) are calculated by multiplying the actual duration of the derating (hours) by the size of the derating (in MW) and dividing by the Maximum Rated Output.

Equivalent Subscriber Organization-Attributable Derated Hours (ESADH): A Subscriber Organization-Attributable Derating occurs when a derating exists due to Subscriber Organization-Attributable Non-Generation or deratings by Company pursuant to Section 8.3 (Company Rights of Dispatch). Each individual derating is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods.

EPDH is the equivalent planned derated hours, including Planned Derations (PD) and Maintenance Derations. A Planned Deration is when the BESS experiences a Deration scheduled well in advance and for a predetermined duration. A Maintenance Deration is a Deration that can be deferred beyond the end of the next weekend (Sunday at midnight or before Sunday turns into Monday) but requires a reduction in capacity before the next Planned Deration (PD). Each individual Deration is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods.

EUDH is the equivalent unplanned derated hours. An Unplanned Deration (Forced Derating) occurs when the BESS experiences a derating that requires a reduction in availability before the end of the nearest following weekend. Each individual Unplanned Deration is transformed into equivalent full outage hour(s). These equivalent hour(s) are then summed for the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods.

The effect of Force Majeure is taken into account in calculating the BESS Annual Equivalent Availability Factor over a 12 calendar month period as follows: When such 12 month period contains any hours in a month during which the BESS or a portion of the BESS is unavailable due to Force Majeure, then such month shall be excluded from the 12 month period and the calculation period shall be extended back in time to include the next previous month during which there was no such unavailability of the BESS or a portion thereof due to Force Majeure. This means the BESS Equivalent Availability Factor would not change from that determined in the month directly preceding a month containing Force Majeure.

The following examples are provided as illustrative examples only:

Example A: The BESS was continuously available, with no BESS Outages or BESS Deratings during the applicable BESS Measurement Period and in the immediately preceding three (3) full BESS Measurement Periods. In this case AH = 8760 hours, EDH = 0 hours as ESADH, EPDH, and EUDH each = 0 hours

$$\text{BESS EAF} = 100\% \times \frac{8,760}{8,760} = 100\%$$

Example B: During the applicable BESS Measurement Period and the immediately preceding three (3) full BESS Measurement Periods: (a) The BESS was online and charging from the PV system or discharging electric energy to the Company System for 8,400 hours and was available but not discharging electric energy due to lack of stored energy (i.e., not Subscriber Organization-Attributable Non-Generation) for 226 hours; (b) The BESS experienced a Planned Derating of 7.2 MWs for 100 hours for maintenance that was scheduled a month in advance; (c) The BESS also experienced an Unplanned Derating of 62 BESS inverters for 100 hours as the derating could not be deferred to beyond the nearest following weekend; (d) The BESS did not experience any outage or derating due to Subscriber Organization-Attributable Non-Generation during this period.

The BESS Maximum Rated Output is 10 MW and the BESS contains 100 total inverters.

PH = 8,760 hours in 12 calendar months

SH = 8,400 hours

RSH = 226 hours

AH = SH + RSH = 8,400 + 226 = 8,626 hours

ESADH = 0

EPDH = 100 hours x 7.2 MW/10 MW = 72 hours (Planned Maintenance)

EUDH = 100 hours x 62 inverters/ 100 inverters = 62 hours (Unplanned Deration (Forced Derating))

$$EDH = 72 \text{ hours} + 62 \text{ hours} = 134 \text{ hours}$$

$$BESS \text{ EAF} = 100\% \times \frac{8,626-1}{8,760} = 96.9\%$$

SECTION 3 - BESS ANNUAL EQUIVALENT FORCED OUTAGE FACTOR

$$EFOF = 100\% \times \frac{(FOH + EUDH)}{8760}$$

Where:

Equivalent Unplanned (Forced) Derated Hours (EUDH) is calculated in accordance with Attachment X (BESS Annual Equivalent Availability Factor) of this Contract.

Forced Outage Hours (FOH) = Sum of all hours the BESS experienced an Unplanned (Forced Outages) during the applicable BESS Measurement Period and the sum of all hours experienced during Unplanned (Forced) Outages during the immediately preceding three (3) full BESS Measurement Periods, in each case caused by Subscriber Organization-Attributable Non-Generation.

Unplanned (Forced) Derating: A Derating that requires a reduction in capacity of the BESS before the end of the nearest following weekend.

Unplanned (Forced) Outage: An outage that requires removal of the entire BESS from service before the end of the nearest following weekend that is not planned, including those caused by Subscriber Organization-Attributable Non-Generation or those imposed by Company pursuant to Section 5, (Company Rights of Dispatch) to the Contract.

EXAMPLE CALCULATION:

Assume a 50 MW BESS that for the BESS Measurement Period in question was completely out of service for 50 hours. For the BESS Measurement Period in question, it also had the following deratings:

Duration of Derating	MW Size Reduction
100 Hours	25 MW
20 Hours	20 MW
50 Hours	5 MW

During the three preceding BESS Measurement Periods, the BESS had a total of 150 Forced Outage Hours and a total of 100 Equivalent Forced Derated Hours.

$$FOH = 50 \text{ hours} + 150 \text{ hours} = 200 \text{ hours}$$

$$EUDH = ((100 \times 25) / 50) + ((20 \times 20) / 50) + ((50 \times 5) / 50) + 100 = 163 \text{ hours}$$

$$EFOF = 100\% \times \frac{(200 + 163)}{8760} = 4.1\%$$

ATTACHMENT I

FACILITY'S CBRE PROGRAM

1. **CBRE Program.** The purpose of the CBRE Program is to facilitate the continued expansion of renewable energy by allowing developers of renewable energy projects to provide Company's retail customers with the opportunity to avail themselves of the benefits of the CBRE Tariff by utilizing CBRE Credits to offset all or a portion of their on-going electricity usage. To this end, Subscriber Organization has established Facility's CBRE Project. Subscriber Organization acknowledges that it has been informed that Facility's CBRE Project must at all times comply with the requirements of the CBRE Program, the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and applicable Laws, including (i) the federal securities laws, including the registration requirements under the Securities Act of 1933 and the Securities and Exchange Act of 1934 and all rules and regulations promulgated thereunder (collectively, "Federal Securities Laws"); (ii) the State securities laws, including the registration requirements under the Hawai'i Uniform Securities Act and all rules and regulations promulgated thereunder (collectively, "State Securities Laws"); (iii) Laws concerning the dissemination of personally identifiable information; and (iv) Laws concerning consumer protection. The purpose of this Attachment I (Facility's CBRE Program) is to set forth certain requirements of the CBRE Program as of the Execution Date. Company reserves the right to modify the requirements of the CBRE Program upon PUC order and/or guidance from the CBRE IO where such modifications are necessary to comply with the CBRE Tariff, the CBRE Framework or applicable Laws, and Subscriber Organization shall comply with all such modifications. Without limitation to the generality of the foregoing, in the event of any conflict between the requirements of the CBRE Program, on the one hand, and any one or more of the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and/or applicable Laws, on the other hand, the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and applicable Laws, shall control and Subscriber Organization shall comply with the CBRE Tariff, the CBRE Framework, guidance from the PUC, guidance from the CBRE IO, and applicable Laws.
2. **Termination, Transfer and Buy-back of Subscriber Allocations.** Termination, transfer and buy-back of Subscriber Allocations shall be governed by the provisions of the CBRE Tariff contingent on whether the Facility's CBRE Program uses the Pay-As -You -Go or Pay-Up-Front model for Subscriber Allocations.
3. **Additional Representations of Subscriber Organization.** Subscriber Organization represents, warrants and covenants that:
 - (a) Subscriber Organization shall disclose to each Account Holder before enrolling such Account Holder as a Subscriber:
 - (1) Subscriber Organization's experience in developing and operating renewable energy projects similar to the Facility.
 - (2) The circumstances under which the Lump Sum Payment can be reduced through the OEPR process and the impact of such reduction on Bill Credits.
 - (3) The circumstances under which the Bill Credits can be reduced if Performance Metrics LDs are unpaid by Subscriber Organization.

- (b) Subscriber Organization shall not knowingly allow the transfer of any Subscriber Allocations at a price other than that set forth in the repurchase/resale price schedule attached to the Subscriber Agreement.
 - (c) Facility's CBRE Program:
 - (1) As of the Execution Date, complies with all applicable Federal Securities Laws, and shall continue to be in compliance for the duration of Facility's CBRE Program.
 - (2) As of the Execution Date, complies with all applicable State Securities Laws, and shall continue to be in compliance for the duration of Facility's CBRE Program.
 - (3) As of the Execution Date, complies with all applicable Laws concerning the dissemination of personally identifiable information, and shall continue to be in compliance for the longer of (i) the duration of Facility's CBRE Program and (ii) for as long as Subscriber Organization continues to hold or otherwise have access to any personally identifiable information of Account Holders or former customers of Company.
 - (4) As of the Execution Date, complies with all applicable Laws concerning consumer protection, and shall continue to be in compliance for the duration of Facility's CBRE Program.
 - (5) Shall achieve the various Subscriber thresholds ~~set forth in Section 5. of Attachment B (Company Payments for Energy, Dispatchability and Availability of BESS), applicable to the Facility's CBRE Program.~~
 - (6) As of the Execution Date, Subscriber Organization is and "approved Subscriber Organization" under the CBRE Tariff and committed to operating, maintaining and administering its CBRE Project in accordance with this Contract and the CBRE Framework for the Term.
5. **Marketing and Sales of the Subscriber Allocations.** Subscriber Organization represents, warrants, and covenants that Subscriber Organization's marketing and sale of the Subscriber Allocations, including but not limited to Subscriber Organization's marketing and sales materials, shall comply with all applicable Federal Securities Laws and State Securities Laws.
6. **CBRE Online Portal and CBRE Program Data.** Subscriber Organization shall utilize the CBRE Online Portal and provide Company with CBRE Program data as required under the CBRE Tariff and/or the CBRE Framework.
7. **Additional Responsibilities.** Subscriber Organization shall perform the responsibilities of "Subscriber Organizations" under the CBRE Framework and the CBRE Tariff, including but not limited to complying with the Subscriber Agreement requirements, complying with the consumer protection measures, unlocking the market for LMI Subscribers and data collection requirements. Subscriber Organization shall cooperate with the CBRE IO as and when requested by the CBRE IO to facilitate the performance of the CBRE IO's responsibilities under the CBRE Framework.
8. **LMI Subscribers.**
- (a) If Subscriber Organization's Facility has been awarded a project from one of Company's CBRE LMI RFP's, then Subscriber Organization has proposed, and hereby

agrees, that all Subscribers enrolled for subscriptions in the Facility CBRE Program for this Facility shall be LMI Subscribers.

- (b) If Subscriber Organization, in its bid in response to any other Company CBRE RFP, has pledged to recruit a certain percentage of LMI Subscribers for its Facility CBRE Program, then Subscriber Organization hereby agrees to recruit LMI Subscribers to meet this pledged commitment for LMI Subscribers into Subscriber Organization's Facility CBRE Program.
- (c) If Subscriber Organization has an LMI Subscriber commitment under either Section 8(a) or Section 8(b) of this Attachment I (Facility's CBRE Program), then Subscriber Organization shall comply with the requirements of Part III of the CBRE Tariff to (1) qualify LMI Subscribers, (2) provide verification of Subscriber Organization's confirmation efforts to verify such LMI Subscribers' qualifications upon Company's request, and (3) comply with the minimum applicable requirements for LMI Subscribers and report monthly Subscriber Organization's LMI Subscriber percentage status for Company's review. Subscriber Organization understands and agrees that failure to maintain the required percentages of LMI Subscribers in Subscriber Organization's Facility CBRE Program may subject Subscriber Organization to payment reductions and/or liquidated damages as specified in the CBRE Tariff.

ATTACHMENT J

CALCULATION OF CERTAIN METRICS

[DRAFTING NOTE: THE PERFORMANCE METRICS SET FORTH IN SECTIONS 1 AND 2 OF THIS ATTACHMENT ARE STILL UNDER COMPANY REVIEW AND ARE SUBJECT TO MODIFICATION.]

1. **Modified Pooled OMC Equipment Availability Factor ("MPXEEAF").**

NERC formula
$OutageHrs = (FTH + MTH + PTH)$
$DeratedHrs = (EFDTH + EMDTH + EPDTH)$
$OMCHrs = (oFTH + oMTH + oPTH)$
$DeratedOMCHrs = (oEFDTH + oEMDTH + oEPDTH)$
$PXEAF = \frac{\sum[ACTH - (OutageHrs + DerateHrs) + (OMCHrs + DeratedOMCHrs)]}{\sum ACTH} * 100$
Modified Pooled OMC Equipment Equivalent Availability Factor (MPXEEAF)
$MPXEEAF = \frac{[(ACTH - ExcludedTime) - (OutageHrs) + (OMCHrs)]}{ACTH - ExcludedTime} * 100$

- Modifications made to the NERC formula are:

Deleted impact due to DeratedHrs. Derations will be assessed using the Performance Index metric.

Where:

Active Turbine Hours (ACTH) is the sum of all turbine-hours that the turbines are in an active state. See [Exhibit J.1](#)

Contact Turbine Hours (CTH) is the sum of all turbine - hours that the turbines are synchronized to the system. It is the turbine - hours that the contactors are closed, and generation is connected to the grid. The term is similar to service hours used in conventional generation.

Forced Turbine Hours (FTH) is the sum of all turbine-hours that that the turbine is off-line due to forced events. FTH are all forced events where the WTG must be removed from service for repairs before the next Sunday at 23:59 (just before Sunday becomes Monday).

OMC Forced Turbine Hours (oFTH) is a subset of FTH that equals any forced turbine-hours that were due to causes deemed to be OMC.

Maintenance Turbine Hours (MTH) is the sum of all turbine-hours that the turbine is off-line due to a Maintenance Event.

OMC Maintenance Turbine Hours (oMTH) is a subset of MTH that equals any maintenance turbine-hours that were due to causes deemed to be OMC.

Planned Turbine Hours (PTH) is the sum of all turbine-hours that the turbine is off-line due to a planned event. A Planned Event is scheduled well in advance and is of predetermined duration and can occur several times a year.

OMC Planned Turbine Hours (oPTH) is a subset of PTH that equals any planned turbine-hours that were due to causes deemed to be OMC.

Equivalent Forced Derated Turbine Hours (EFDTH) is the equivalent forced turbine hours when turbine output is reduced for forced issues.

OMC Equivalent Forced Derated Turbine Hours (oEFDTH) is a subset of EFDTH that equals any turbine-hours when turbine output is reduced for forced issues deemed to be OMC.

Equivalent Maintenance Turbine Hours (EMDTH) are the equivalent maintenance turbine hours when the turbine output is reduced for maintenance turbine hours, EMDTH must meet the requirements for a maintenance outage. The turbine must be capable of running until the following week unless the outage occurs on the weekend the turbine must be capable of running through the following week.

OMC Equivalent Maintenance Derated Turbine Hours (oEMDTH) are OMC equivalent maintenance hours when turbine output is reduced for OMC maintenance issues. This is a subset of EMDTH.

Equivalent Planned Turbine Hours (EDPTH) is the equivalent planned turbine hours when turbine output is reduced for a planned issue.

OMC Equivalent Planned Derated Turbine Hours (oEPDTH) are OMC equivalent planned hours when turbine output is reduced for OMC planned issues. This is a subset of EPDTH.

Equivalent Reserve Shutdown Derated Turbine Hours (ERSDTH): are the equivalent reserve shutdown hours when turbine output is reduced for economic reasons.

Outside Management Control (OMC): are events (other than Subscriber Organization -Attributable Non-Generation events) that occur beyond the Facility boundaries or are caused by abnormal weather. OMC events can be Planned, Maintenance, Forced Outage, or Derating Events. OMC events can be due to Company dispatching the Facility resulting in a deration of the Facility's output or to Grid constraints, such as transmission/distribution maintenance or switching. OMC events do not include Subscriber Organization -Attributable Non-Generation events.

ExcludedTime: ExcludedTime is unavailability as a result of the WTG(s) and the portion of any of the foregoing being unavailable due to Force Majeure. The hours and/or equivalent hours of ExcludedTime shall be subtracted from Active Turbine Hours. This is calculated by multiplying the actual duration of the event that counts as ExcludedTime (in hours) by the number of WTG(s) in the Facility that are offline and dividing by the total number of WTG(s) in the Facility. These equivalent hour(s) are then summed.

The effect of Force Majeure is taken into account in calculating the Modified Pooled OMC Equivalent Availability Factor over the 12 calendar month LD Period as follows: When an LD Period contains a month during which the WTG(s) and the portion of any of the foregoing are unavailable due to Force Majeure, then such month shall be excluded from the LD Period and the LD Period shall be extended back in time to include the next previous month during which there was no such unavailability due to Force Majeure.

See also Section 5 (Company Rights of Dispatch) of this Contract.

Example: The following is an example of a MPXEEAF calculation and is included for illustrative purposes only:

A	B	C	D	E	F	G	H
TID	ACTH	FTH	MTH	PTH	OFTH	OMTH	OPTH
Turbine1	100.00	5.05	6.20	3.75	4.00	4.25	3.05
Turbine2	100.00	5.05	6.15	3.75	4.00	4.25	3.05
Turbine3	100.00	5.05	6.20	3.75	4.00	4.25	3.05
SUM	300.00	15.15	18.55	11.25	12.00	12.75	9.15

$$[B - (C+D+E) + (F+G+H)]/B * 100$$

MPXEEAF

96.3

2. PERFORMANCE INDEX.

$$PI_{Facility} = \sum_{i=1}^N \frac{Actual\ Generation_{WTG_i} [MWh]}{Expected\ Generation_{WTG_i} * (1 - 0.001 * (Applicable\ Contract\ Year - 1)) [MWh]}$$

Performance Index Calculation

- Performance Index will not be calculated or assessed for the first Contract Year.
- For each calendar month, Subscriber Organization shall calculate the Actual Generation at each WTG and estimate the Expected Generation at each WTG for all periods where the WTG's operational state is categorized as CTH excluding periods where the WTG's operational state is categorized as ERSDTH, oEFDTH, oMPH, oEPDTH, or Environmental Derate. See Exhibit J.2
- Subscriber Organization shall use the equation set forth above to calculate the Performance Index for the previous rolling 12 months.
- Subscriber Organization shall also provide the Company the Measured Power Curve that was used for each WTG and data from periods where Actual Generation and Expected Generation were calculated for such WTG.

See also Section 5 (Company Rights of Dispatch) of this Contract.

Example: The following is an example of a Performance Index Calculation and is included for illustrative purposes only:

A	B	C	D	E	F	G	H
ACTUAL GENERATION [MWH]							B - (C+D+E+F+G)
TID	CTH	ERSDTH	OEFDTH	OEMPTH	OEPDTH	Env. Derate	Actual Generation
Turbine1	900.00	20.00	10.00	15.00	5.00	5.00	845.00
Turbine2	1,000.00	15.00	10.00	15.00	5.00	5.00	950.00
Turbine3	1,200.00	20.00	10.00	15.00	5.00	5.00	1,145.00
Sum	3,100.00	55.00	30.00	45.00	15.00	15.00	2,940.00
EXPECTED GENERATION [MWH]							B - (C+D+E+F+G)
TID	CTH	ERSDTH	OEFDTH	OEMPTH	OEPDTH	Env. Derate	Expected Generation
Turbine1	945.00	35.00	15.00	20.00	10.00	10.00	855.00
Turbine2	1,115.00	40.00	15.00	25.00	10.00	15.00	1,010.00
Turbine3	1,300.00	35.00	18.00	21.00	10.00	10.00	1,206.00
Sum	3,360.00	110.00	48.00	66.00	30.00	35.00	3,071.00
H6/H13 * 100							
Performance Index							
95.7							

3. **CALCULATION OF DENSITY-ADJUSTED WIND SPEED.** For purposes of calculating Density-Adjusted Wind Speed for each WTG for each PI Evaluation Period, the 10-minute averaged wind speed measurement from the nacelle anemometer for such turbine shall be adjusted for the 10-minute averaged ambient air temperature and the 10-minute averaged ambient air pressure (both as measured by the field measurement devices located at approximately "hub height" on the Facility's MMTs) by calculating the Density-Adjusted Wind Speed for such turbine for each 10-minute increment as follows:

$$V_n = V_{obs} \left(\frac{\rho_{calc}}{\rho_0} \right)^{1/3}$$

where:

- V_n = Density-Adjusted Wind Speed [m/s];
 V_{obs} = Measured Wind Speed (10-minute averaged) [m/s]
 ρ_0 = 1.225 kg/m³
 ρ_{calc} = Calculated Air Density (10-minute averaged) [kg/m³]

$$= \frac{B_{obs}}{R_0 * T_{K_{obs}}}$$

where:

- B_{obs} = Measured Ambient Air Pressure (10-minute averaged) [Pa]
 R_0 = specific gas constant for dry air (287.057 J/kg*K)
 $T_{K_{obs}}$ = Measured Ambient Air Temperature (10-minute averaged) [K]

For unit conversion purposes:

$$1 \text{ Pa} = 0.01 \text{ mbar}$$

$$T_{Kelvin} = T_{Celsius} + 273.15$$

The foregoing formulae are based on the formulae found at Section 8.1 of IEC 61400-12-1.

4. DETERMINATION OF MEASURED POWER CURVE.

- During the first Contract Year, the Subscriber Organization shall collect data to create a Measured Power Curve for each WTG that will be used for the remainder of the Initial Term to calculate the Expected Generation. The Measured Power Curve for each WTG will not be updated.
- To develop the Measured Power Curve for each WTG, Subscriber Organization shall use data for such WTG during periods when such WTG is in the operational state categorized as CTH excluding periods where the WTG's operational state is categorized as ERSDTH, EFDTH, EMPH, EPDTH, oEFDTH, oMPH, oEPDTH, or Environmental Derate. See Exhibit J.3

Following the end of the first Contract Year, the Measured Power Curve for each WTG shall be calculated by Subscriber Organization using the following data from the first Contract Year: (aa) the Density-Adjusted Wind Speed (for avoidance of doubt, the only referenced air density shall be the ISO standard atmosphere for sea level air density of 1.225 kg/m^3 as set forth in Section 3 (Calculation of Density-Adjusted Wind Speed) of this Attachment J (Calculation of Certain Metrics), (bb) the 10-minute averaged Measured Wind Speed and (cc) the 10-minute averaged power output of such WTG. The data set used for calculating the Measured Power Curve shall include only Measured Wind Speed and power output measurements during the periods specified in the second bullet point above. The Measured Power Curve shall be calculated using (i) 0.5 m/s wind bins ranging from 1 m/s below the manufacturer's specified cut-in-wind speed to, at least, 1.5 times the wind speed specified by the manufacturer as associated with 85% of the rated power of the WTG and (ii) the 10-minute averaged power output for each wind speed bin. The data set used to calculate the Measured Power Curve should include a minimum of 180 hours of sampled data from periods during the preceding Contract Year, where each wind bin includes the minimum of 30 minutes of sampled data, i.e. a minimum of 3 data points. If the aforementioned required minimums of sampled data are not available, Subscriber Organization and Company may agree in writing upon a smaller data set to calculate the Measured Power Curve. Except as necessary to satisfy the foregoing requirements of this Section 4 (Determination of Measured Power Curve) of this Attachment J (Calculation of Certain Metrics), the Measured Power Curve shall be calculated in a manner consistent with Clause 8.1 and Clause 8.2 of IEC 61400-12-1. Upon Subscriber Organization's calculation of the Measured Power Curve for each WTG as provided in this Section 4 (Determination of Measured Power Curve), Subscriber Organization shall provide written notice to Company of such Measured Power Curve(s).

- 5. CALCULATION OF EXPECTED GENERATION FOR EACH WTG.** The Expected Generation for each WTG shall be based on (i) the Density-Adjusted Wind Speed for such turbine for each 10-minute increment or portion thereof during the period and (ii) the Measured Power Curve for the WTG as determined as set forth in Section 4 (Determination of Measured Power Curve) of this Attachment J (Calculation of Certain Metrics).
- 6. RESOLUTION OF DISAGREEMENTS.** Disagreements between Subscriber Organization and Company concerning the calculations to be provided under this Attachment J (Calculation of Certain Metrics) shall be resolved as set forth in Attachment E (Monthly Reporting and Dispute Resolution by Independent AF Evaluator).

---END---

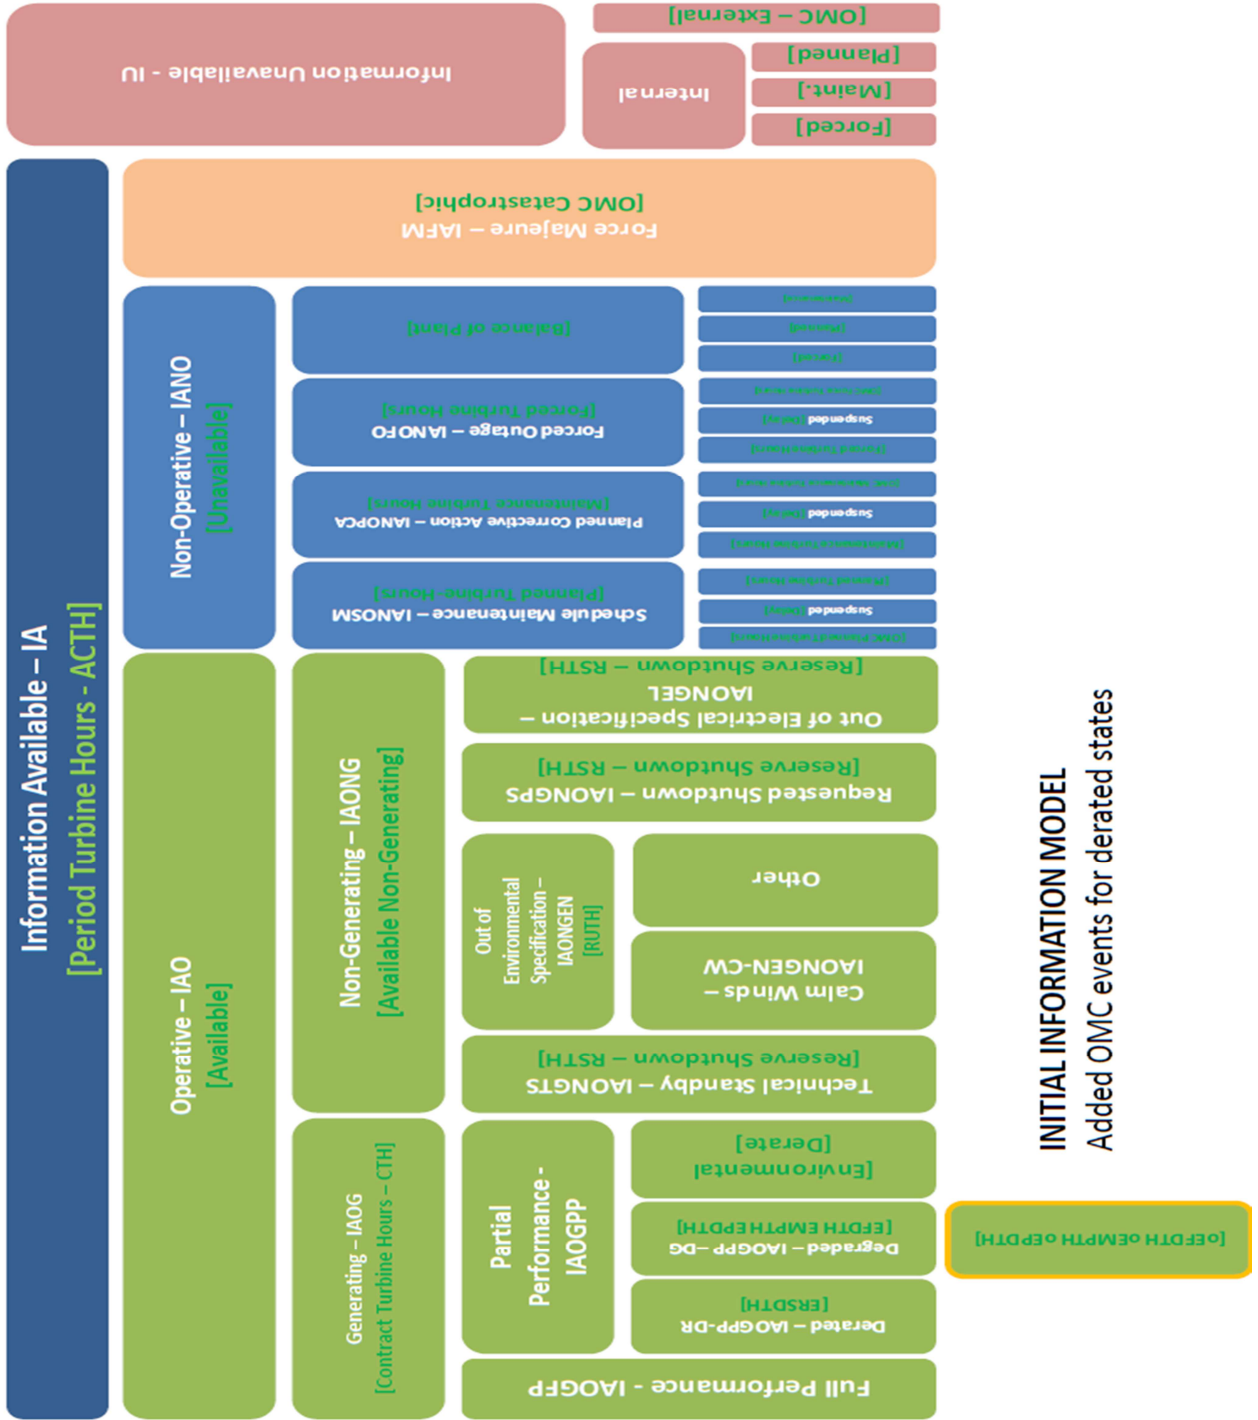
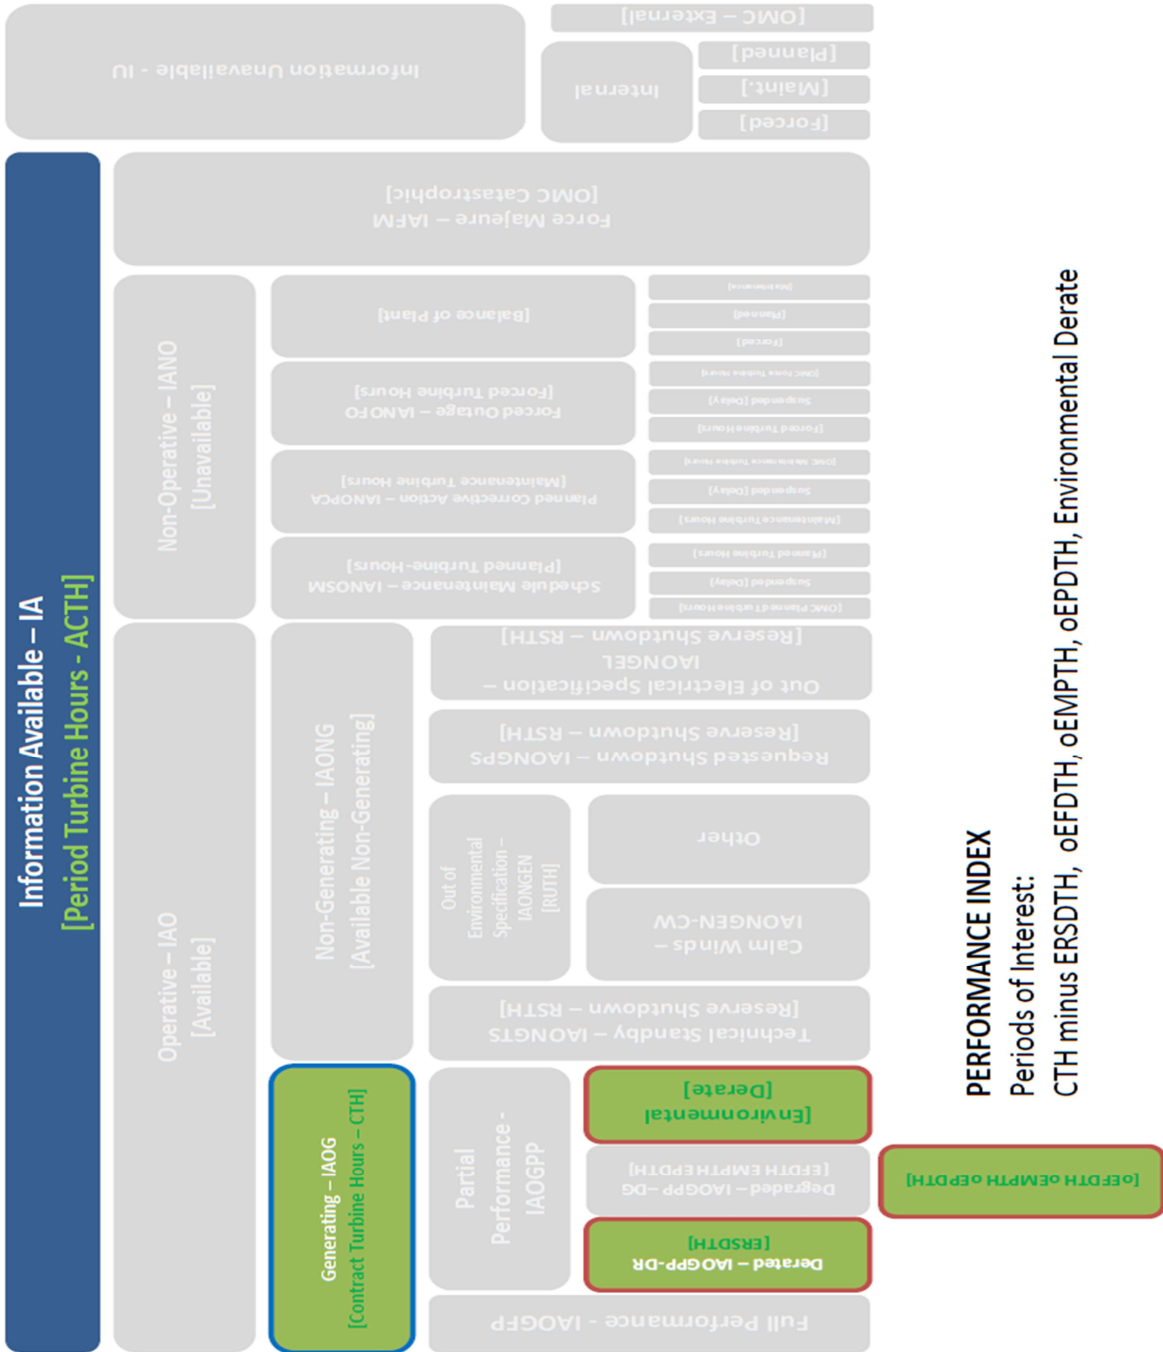


EXHIBIT J-1



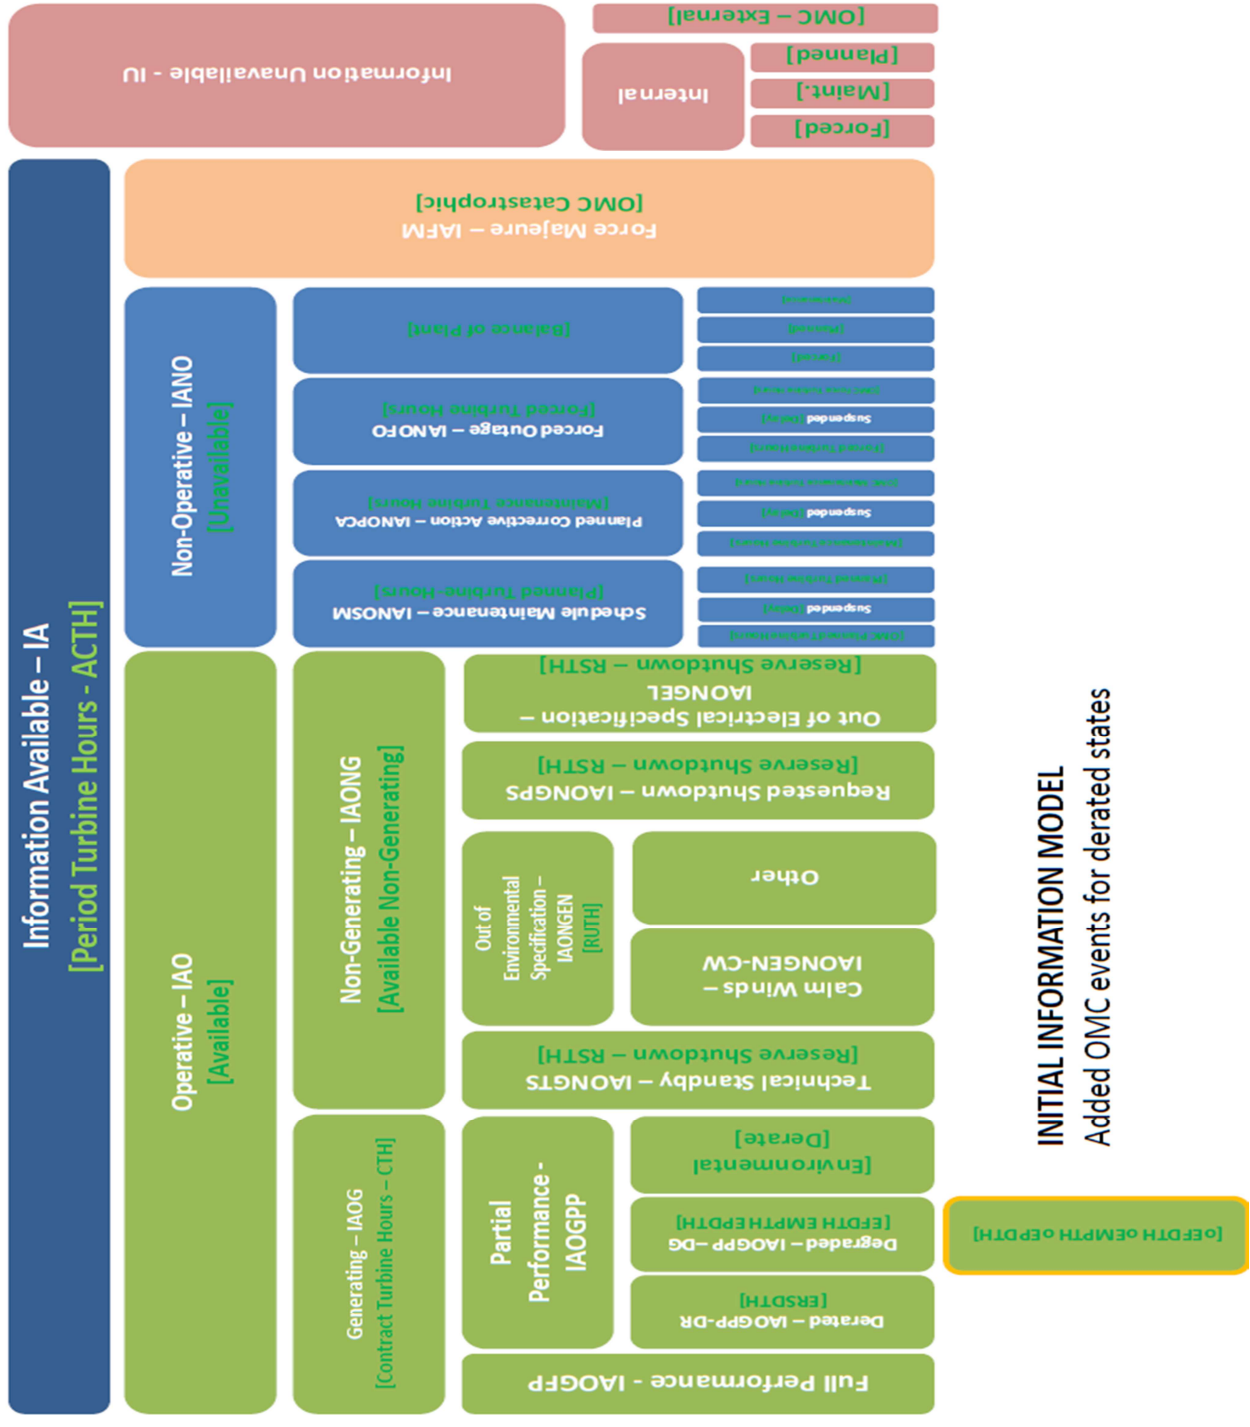
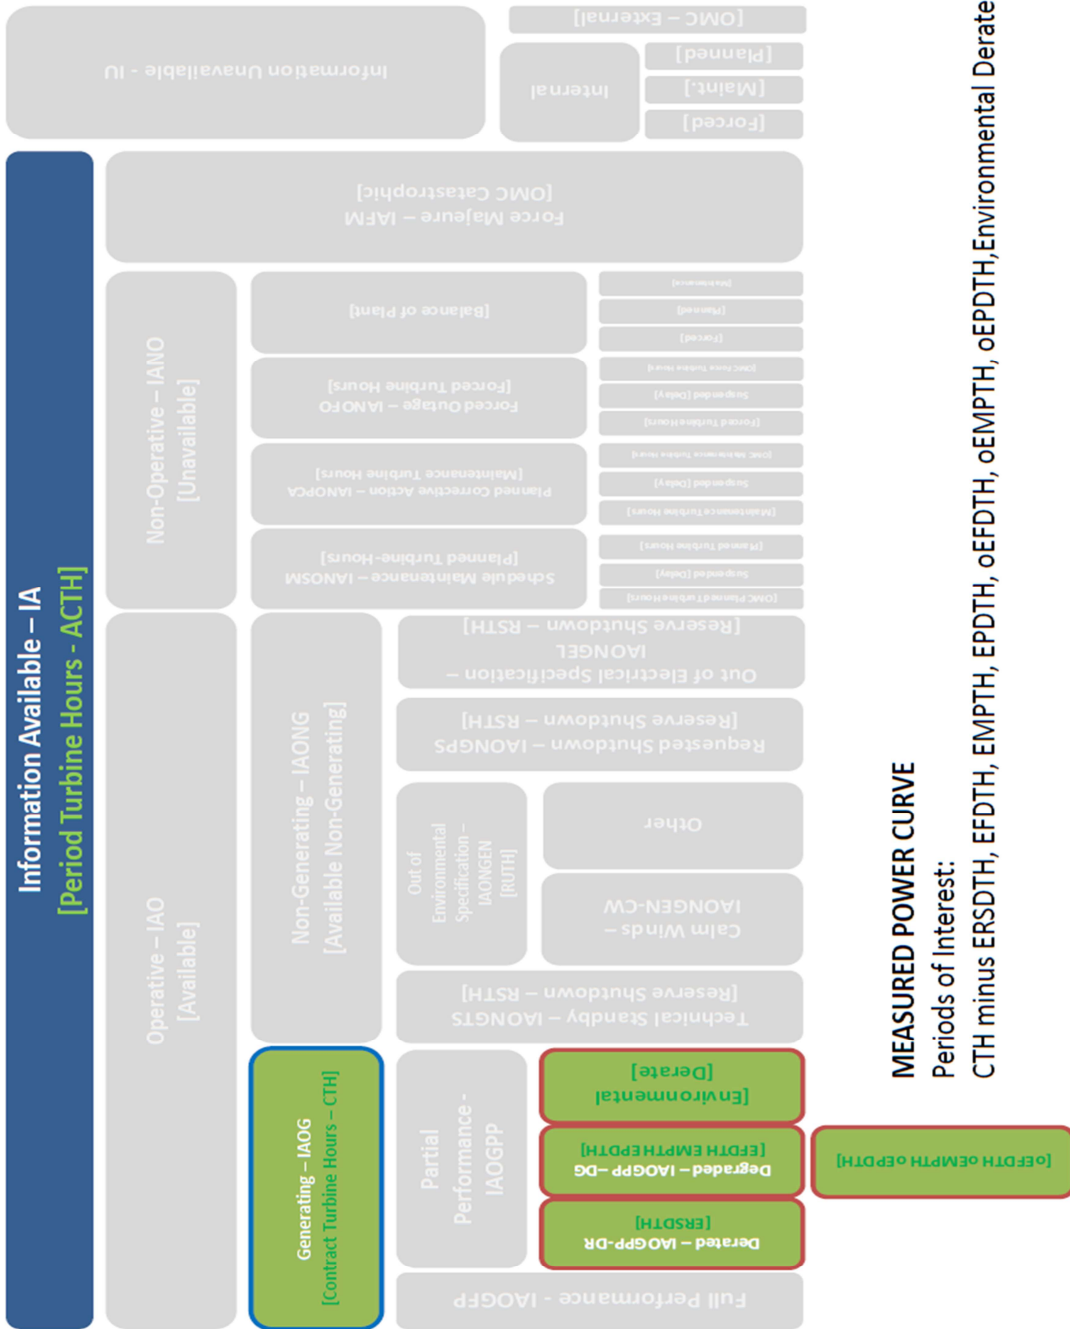


EXHIBIT J-2



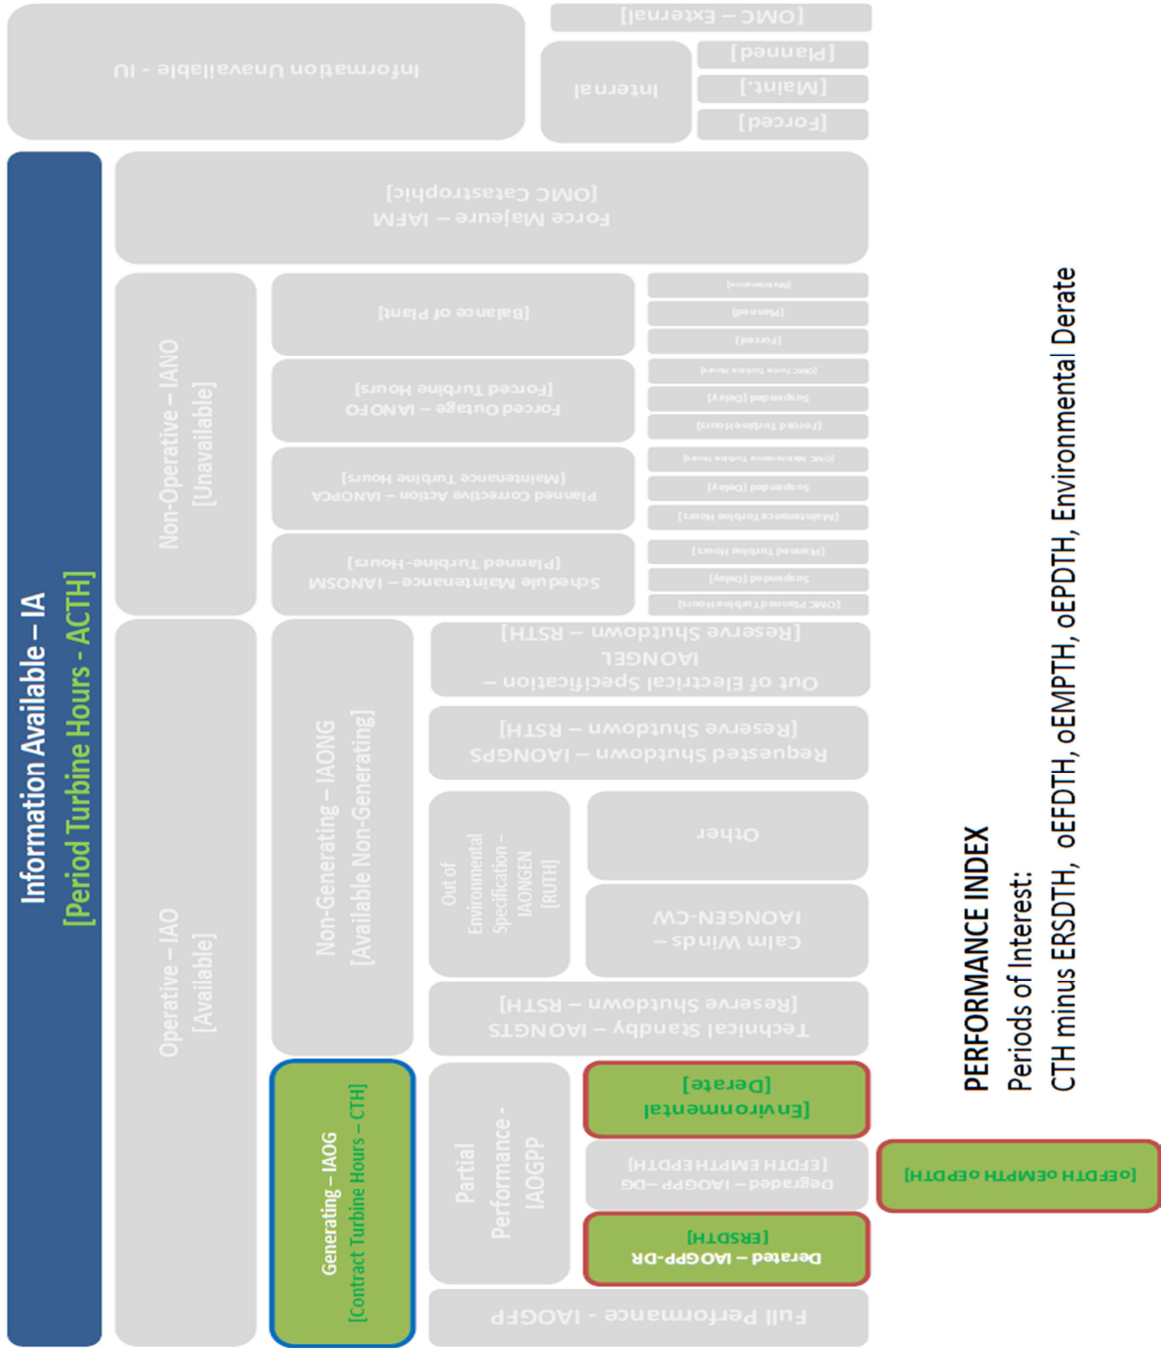


EXHIBIT J-3

